

# **EA** networks

*connecting our community*

## EA NETWORKS ASSET MANAGEMENT PLAN 2016-26



## **ASSET MANAGEMENT PLAN FOR EA NETWORKS' ELECTRICITY NETWORK**

Planning Period: 1 April 2016 to 31 March 2026  
Disclosure Year: 2016-17  
Disclosure Date: 31 March 2016  
Approved by Board: 31 March 2016

EA Networks  
Private Bag 802  
Ashburton 7740

Website: <http://www.eanetworks.co.nz>  
Telephone: (03) 3079800  
Facsimile: (03) 3079801

© Copyright: EA Networks. 2016

As of November 2012, EA Networks is the trading name of Electricity Ashburton Limited. References to EA Networks in this document denote Electricity Ashburton Limited.

The owner and custodian of this document is the Network Division of EA Networks, Ashburton. All comments, queries and suggestions should be forwarded to the Network Manager.

# CONTENTS

	Page
<b>EXECUTIVE SUMMARY</b>	<b>9</b>
1 Background and Objectives	
2 Level of Service	
3 Network Description	
4 Life Cycle Asset Management	
5 Network Development	
6 Non-Network Assets	
7 Risk Management	
8 Financial Summary	
9 Evaluation of Performance	
<b>1 BACKGROUND AND OBJECTIVES</b>	<b>21</b>
1.1 EA Networks' Evolution	
1.2 Overview of EA Networks Organisation	
1.3 Objectives of This Plan	
1.4 Stakeholders	
1.5 Scope of This Plan	
1.6 Plan Structure and Approach	
1.7 Asset Management Drivers	
1.8 Asset Management Processes and Systems	
1.9 Responsibilities	
1.10 Information Sources, Assumptions and Uncertainty	
<b>2 LEVEL OF SERVICE</b>	<b>53</b>
2.1 Introduction	
2.2 Consumer Research and Expectations	
2.3 Strategic and Corporate Goals	
2.4 Network Service Levels	
2.5 Network Security Standards	
2.6 Network Power Quality Standards	
2.7 Safety	
2.8 Environmental	
<b>3 NETWORK DESCRIPTION</b>	<b>75</b>
3.1 Service Area Characteristics	
3.2 Network Configuration	
3.3 Asset Justification	
3.4 Asset Value	
<b>4 LIFECYCLE ASSET MANAGEMENT</b>	<b>95</b>
4.1 Introduction	
4.2 Overview	
4.3 Subtransmission Assets	
4.4 Distribution Assets	
4.5 Low Voltage Line Assets	
4.6 Service Line Connection Assets	
4.7 Zone Substation Assets	
4.8 Distribution Substation Assets	
4.9 Distribution Transformer Assets	
4.10 High Voltage Switchgear Assets	
4.11 Low Voltage Switchgear Assets	
4.12 Protection System Assets	
4.13 Earthing System Assets	
4.14 SCADA, Communications and Control Assets	
4.15 Ripple Injection Plant Assets	

<b>5</b>	<b>NETWORK DEVELOPMENT</b>	<b>159</b>
5.1	Network Development Processes	
5.2	Load Forecasting	
5.3	Network Level Development	
5.4	Strategic Plans by Asset	
<b>6</b>	<b>NON-NETWORK ASSETS</b>	<b>245</b>
6.1	Non-Network Asset Description	
6.2	Non-Network Policies	
6.3	Non-Network Programmes and Projects	
<b>7</b>	<b>RISK MANAGEMENT</b>	<b>253</b>
7.1	Introduction	
7.2	Safety	
7.3	Environmental	
7.4	Risk Assessment	
7.5	Risk Mitigation Proposals	
<b>8</b>	<b>FINANCIAL PLANS</b>	<b>263</b>
8.1	Capital Expenditure	
8.2	Maintenance Expenditure	
<b>9</b>	<b>EVALUATION of PERFORMANCE</b>	<b>271</b>
9.1	Progress Against Plan	
9.2	Service Level	
9.3	Service Improvement Initiatives	
9.4	Asset Management Maturity Evaluation	
9.5	Gap Analysis	
9.6	Asset Management Improvement Initiatives	
9.7	Capability to Deliver	
<b>10</b>	<b>APPENDICES</b>	<b>297</b>
10.1	Appendix A - Definitions	
10.2	Appendix B - Asset Management Plan Cash-flow Schedule	
10.3	Appendix C - Forecast Load Growth	
10.4	Appendix D - Disclosure Cross-References	
10.5	Appendix E – Large Consumer Dialogue Questionnaire	
10.6	Appendix F – Customer Engagement Statement	
10.7	Appendix G – Disclosure Schedules	

## **Liability Disclaimer**

---

This document has been produced and disclosed in accordance with the disclosure requirements under subpart 9 of Part 4 of the Commerce Act 1986 (Electricity Information Disclosure Determination 2012).

Any information contained in this document is based on information available at the time of preparation. Numerous assumptions have been made to allow future resource requirements to be assessed. These assumptions may prove to be incorrect or inaccurate and consequently any of the future actions that are identified in this document may not occur.

People use information contained in this document at their own risk. EA Networks will not be liable to compensate any person for loss, injury or damage resulting from the use of the contents of this document.

If any person wishes to take any action on the basis of the content of this document, they should contact EA Networks for advice and confirmation of all relevant details before acting.

If you are viewing this document digitally (in pdf form) it is worth noting that there is a link to the main table of contents at the very top of every page in the centre ("To Table of Contents ▲" in grey).

# EXECUTIVE SUMMARY

<b>Table of Contents</b>	<b>Page</b>
1 Background and Objectives	9
EA Networks' Evolution	9
Objectives of this Plan	9
Asset Management Drivers	10
Processes	11
Systems	11
2 Level of Service	11
Consumer Expectations	11
Network Service Levels	12
3 Network Description	12
4 Life Cycle Asset Management	12
Overview	12
Life Cycle Plans by Asset	13
5 Network Development	13
Load Forecasting	14
Strategic (Development) Plans by Asset	14
6 Non-Network Assets	16
7 Risk Management	16
Introduction	16
Risk Assessment and Mitigation	16
8 Financial Summary	17
9 Evaluation of Performance	17
Improvements	17
Network Service Improvements	18
Capability to Deliver	18





# EXECUTIVE SUMMARY

## 1 Background and Objectives

The Asset Management Plan is a cornerstone document, which guides the work of all EA Networks personnel.

This particular plan was completed on 30 March 2016, and covers a planning period from 1 April 2016 through to 31 March 2026. The next plan is due for release by 31 March 2017.

This summary is prepared for people who may not be involved within the business of electricity distribution networks and associated services, but who understand and have an interest in efficient management.

### EA Networks' Evolution

After starting life as a privately owned generator based in Ashburton township, the Ashburton Electric Power Board was established in 1923. After that time the AEPB grew through a variety of operating voltages which included 230 volts dc, 3.3kV, 6.6kV, 11kV, and latterly, 33kV ac. During the 1970s, irrigation demand caused growth to accelerate dramatically, expanding the 33kV subtransmission network to all corners of the Ashburton District. A small hydro generator, Montalto, was also built during the early 1980s. EA Networks (as the AEPB became) has more recently introduced 22kV and 66kV as voltages on the network. A large capital works programme during the late 1990s and the early part of this century now has the majority of subtransmission lines operating at 66kV and a significant portion of the distribution network operating at 22kV.

EA Networks supply electricity line services to approximately 19,100 consumers using about 3,025km of lines in Mid-Canterbury ([see plan cover](#)) - both underground cables and overhead lines. Other pertinent statistics (As at January 2016) are shown at right. EA Networks also develop and operate an open access fibre optic network in Mid-Central Canterbury ([EA Networks Fibre](#)) and have an interest in a Mid-Canterbury piped irrigation scheme ([Barrhill Chertsey Irrigation Ltd](#)).

EA Networks Network:		
Maximum Demand	177 (Dec 2015)	MW
Annual Load Factor	45 (2015 estimate)	%
Delivered Energy	644 (2016 estimate)	GWh
Subtransmission Lines	454	km
MV Distribution Lines	2,141	km
LV Distribution Lines	430	km
Distribution Substations	6,260	
(Data as at January 2016)		

### Objectives of this Plan

This plan aims to document the approach EA Networks intends to take in managing EA Networks' electricity assets.

EA Networks has the following Asset Management Plan objective:

**To provide a systematic approach to asset management, which is intended to ensure that the condition and performance of the electricity network and associated assets are being effectively and efficiently maintained or improved to satisfy stakeholder requirements.**

This plan clearly defines the service objectives and gives a strong focus on life cycle management by presenting operations, maintenance and renewal policies and programmes by asset type. Asset management planning processes should effectively integrate best practice features. These establish the service standards and future demands to meet business, legislative and other needs, while developing optimum lifecycle asset management strategies and cash flow projections based on assessing non asset solutions, failure modes, cost/benefits and risk.

The Asset Management Plan has been fashioned so that it meets the requirements for disclosure of AMP's outlined in the Commerce Act (Electricity Information Disclosure Requirements) Notice 2004 and amendments.


The disclosure regulations stipulate that the disclosed plan must include certain mandatory sections. This plan does not necessarily follow the order or grouping that the requirements are laid out in the regulations. An attempt has been made to flow the document through logical steps rather than the arbitrary nature of the regulation. It should however be noted that every effort has been made to permit simple identification of the mandatory sections.

It is hoped that the chosen layout and style allows the widest possible audience including all stakeholders to take advantage of the information it contains. The stakeholders in the plan include:

- EA Networks shareholder/consumers
- Energy retailers
- Embedded generation owners
- Ashburton District Council
- Employees and contractors
- Transpower
- Landowners
- Financial institutions
- Regulatory agencies
- Distributed generation proponents

### Period Covered

This Asset Management Plan covers the management of EA Networks' electricity network assets for a period of 10 years from the financial year beginning on 1 April 2015 until the year ended 31 March 2025. The main focus of analysis is the first 5 years and for this period, most of the specific projects have been identified. Beyond this time, analysis tends to be more indicative based on long-term trends and it is likely that new development project requirements will arise in the latter half of the planning period that are not identified here.

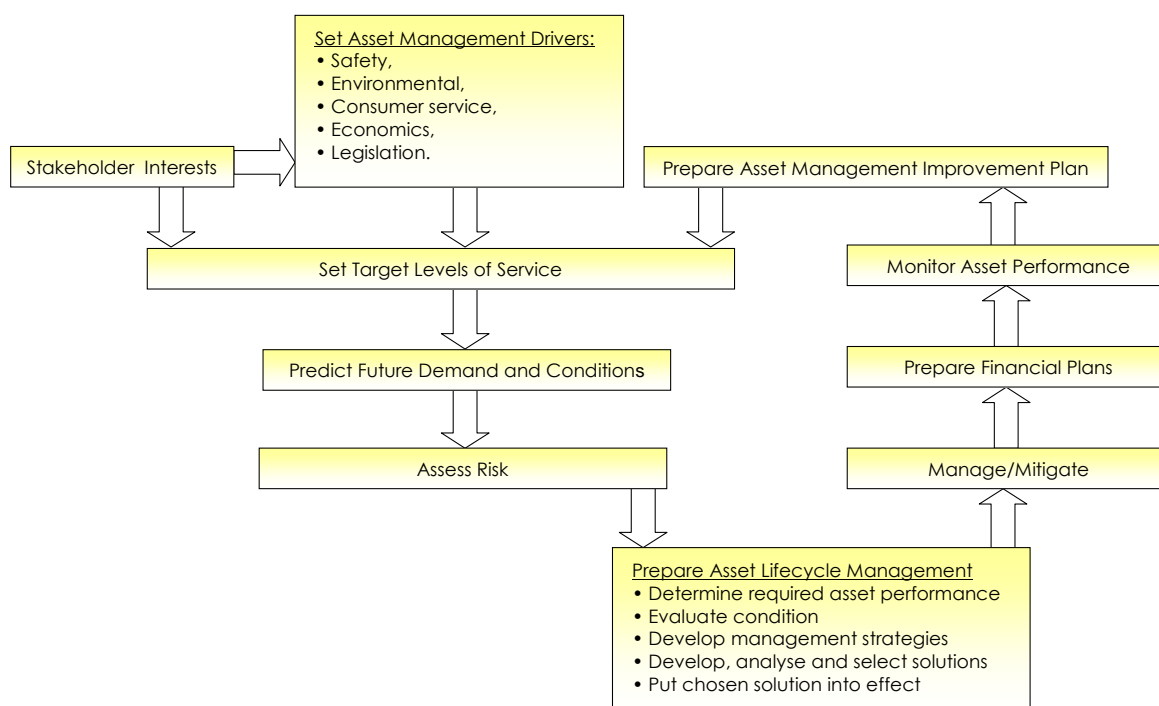

### The Planning Process

The process used to formulate the Asset Management Plan and other supporting documentation is as shown in the above diagram.

### Asset Management Drivers

Drivers for this Asset Management Plan (set in consultation with stakeholders) include:

- Safety for staff and public
- Consumer service - reliability
- Economic efficiency
- Corporate profile
- Environmental responsibility
- Legislative compliance

## **Asset Management Practices**

The management of an electricity network requires a broad range of information systems and applications to store, process and analyse the characteristics and location of electrical assets. EA Networks have a number of mature applications to facilitate some of this work. Some aspects of asset management are not so well served and improvements are planned to bring these up to an acceptable standard.

### Processes

Processes exist for most aspects of asset management in the EA Networks network division. A number of these processes require refinement to ensure optimal decision-making. One of the major processes still requiring additional documentation and formalisation is the design, inspection and testing regimes. Currently these are known and partially recorded but cannot be reproduced or easily modified. The risk management process requires a feedback that triggers reassessment of risk after network changes.

### Systems

EA Networks have a range of systems available for asset management and some are more capable than others. The main systems/applications that are in use are:

- Asset Management System
- SCADA System
- Financial/Accounting System
- Connection System
- Standards Documentation System
- GIS Asset Mapping System
- Work Management System
- Network Modelling and Analysis
- Fault Recording System
- Optimised Deprival Valuation System

## **2 Level of Service**

Service is about satisfying all stakeholders and this includes safety aspects and environmental responsibilities as well.

It is EA Networks' goal to perform above the industry median for comparable line companies and it is targeting an on-going quality improvement with a consistent price path.

### Consumer Expectations

As a co-operative company, the vast majority of consumers are in fact shareholders and they directly elect a shareholders' committee who in turn appoint the directors. Also received/scrutinised by the Shareholders' Committee is the Statement of Corporate Intent, which identifies a range of financial and reliability performance targets. In conjunction with this form of consultation, EA Networks management liaises with the Energy Retailers to determine the expectations of their customers, and quantify these in terms of desirable reliability indices. A recent telephone survey has concluded that only 3% of consumers are prepared to pay a slightly increased charge in order to ensure a more timely restoration of supply following an unexpected outage.


<b>Future Performance Targets 2017-26</b>											
Indicator	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	Default Quality Path Limit
<b>SAIDI Total (mins)</b>	191	196	203	181	187	195	194	184	171	169	151 <sup>1</sup>
<b>SAIFI Total (#/yr)</b>	1.7	1.71	1.72	1.63	1.64	1.67	1.66	1.61	1.56	1.55	1.61 <sup>1</sup>
<b>Faults/100km</b>	5	5	5	5	5	5	5	5	5	5	

<sup>1</sup> These are the Commerce Commission default quality path limits. The values are "Normalised" to remove aberrant events. The targets shown above are non-normalised and include all faults and planned outages.

## Network Service Levels

EA Networks has historically struggled to meet the majority of the service levels that it set as targets. The targets have been revised in the last 24 months. Targets were met or only slightly exceeded in recent years.

What this information infers is that EA Networks (on average) target to have fewer outages than currently. When compared to other New Zealand lines companies the targets are almost all below the average forecast performance. Irrespective of the performance relative to other companies, on average, it is intended to outperform previous performance year by year. These targets assume "severe weather events" (admittedly undefined) are excluded from the averages.

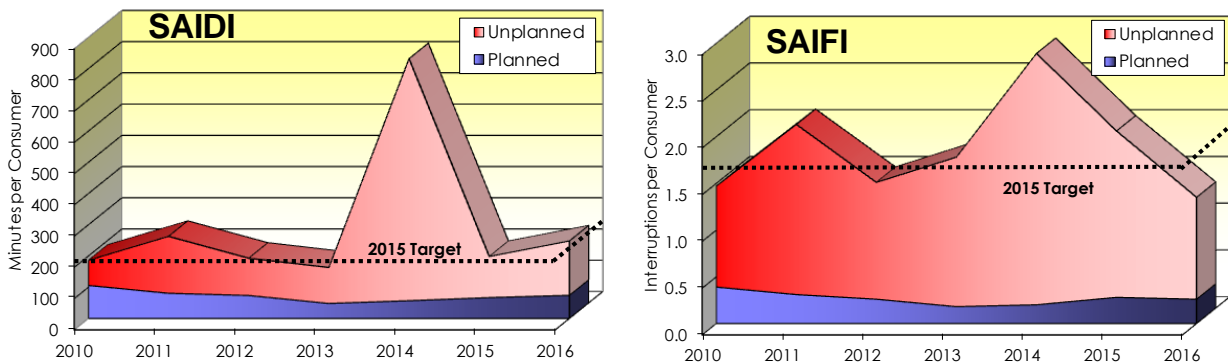

## 3 Network Description

The area EA Networks serves is largely rural land used for cropping and dairy farming. These two uses encourage a high level of irrigation in the district. The summer demand for irrigation water is in many cases served by electrically pumped systems. Irrigation load represents the largest single group of load on that EA Networks supply. Other significant loads are vegetable and meat processing facilities and a ski-field.

There is a significant amount of distributed generation on the EA Networks network. The largest is Highbank at 26 MW. Several smaller ones also contribute and they collectively provide about 20-25% of the energy needs of the district. Unfortunately, they are very seasonal and cannot be relied upon for back-up supply.

EA Networks has one geographic supply point from Transpower with two voltages (66kV and 33kV). An extensive 33kV and 66kV subtransmission network supplies 23 zone substations varying in size from 5 MVA to 40 MVA. The distribution network is a mixture of 22kV, 11kV and LV with both overhead and underground variants of each. The distribution system as a whole is about 21% underground cable by circuit length.

Distribution transformers and substations come in a variety of forms and EA Networks' modern ones are modular and flexible.

The LV network is extensive in urban areas but not so in rural areas. Underground conversion in urban areas is removing a lot of older overhead LV lines.

EA Networks have a range of secondary assets that perform critical functions in the network and range from ripple injection to protection and voice/data communications.

The 2015 closing Regulatory Asset Base (RAB) was \$226.4 Million.

## 4 Life Cycle Asset Management

When considering the priorities for maintenance of a line company network it becomes apparent that the subtransmission level lines and substations require the highest priority. These represent the backbone of supply and the long-term loss of any one of these assets would have a potentially devastating effect on service levels. Lower voltage level assets are treated with the same rigour but slightly lower priority and less intensive diagnostic testing.

### Overview

The management plans for each asset category detail how EA Networks intends to operate and manage


the assets so that they meet the required performance standards. The focus on optimising lifecycle costs shapes all of the processes involved.

Maintenance on all equipment is condition based rather than time-based. The condition is measured by inspection, testing and/or the duty a device has seen measured in operations or interrupted current.

## Life Cycle Plans by Asset


### Subtransmission Lines

This asset class is rapidly becoming younger as 66kV lines replace older 33kV lines. Little maintenance work is expected to be necessary during the planning period. Development work is likely to continue given the load growth predictions.

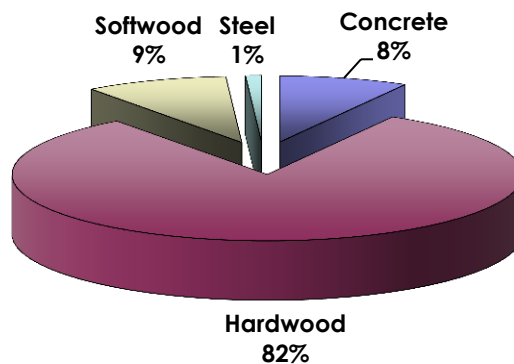

### Zone Substations

This asset category uses some of the most intensive diagnostic testing of all assets. Testing of oil, gases, mechanisms and insulation are all undertaken to ensure detailed knowledge of condition. Development of the subtransmission network will require redevelopment of several sites as well as some new sites.

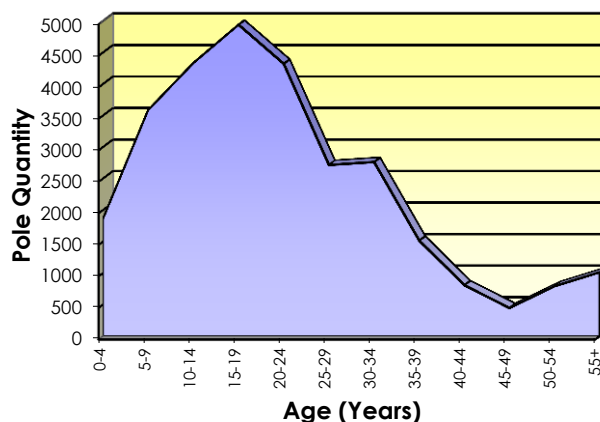

### Distribution Assets


The distribution network is predominantly in good condition with the vast majority of lines capable of withstanding moderate to strong wind and snow without damage. Condition assessment is on-going and as lines are examined they are either scheduled for maintenance or re-inspection at a later date. 22kV conversion is refurbishing portions of the network as the line is reinsulated. It allows hardware to be examined and assessed for condition. The existing conductor is typically left in-situ.

The maintenance requirements of the network are not expected to increase over the planning period despite the probable increase in line length and load.

## 5 Network Development

Dramatic load growth has occurred in the Mid-Canterbury region over the last decade. The summer maximum demand has more than trebled since 1996 and more than doubled since 2003. The 2015-16 summer peak was 177MW. The previous maximum summer peak was 168MW. Irrigation load has doubled since 2005 and now exceeds 143MW. This growth has in turn driven very significant capital development on the EA Networks network. It is important to assess the future load as accurately as possible since network investment is required before the load arrives, not after. Incorrectly assessed, the absence of load can leave expensive assets under-utilised and conversely the presence of un-forecast load can leave it un-serviced. Future demand also comes in the form of security requirements that require additional or larger assets so that the network is more fault-tolerant.

A continuation of the historic high rates of load growth are unlikely. Irrigation load growth is slowing. A combination of gravity pressurised irrigation schemes, groundwater abstraction limits being reached and potential new water storage schemes has influenced the attitudes of farmers. A cautious approach to electricity network capacity increases is warranted. An intelligence gathering exercise investigating of future on-farm irrigation demand will be undertaken to minimise the risk of new underutilised assets. The low international price for dairy products is also having a big impact.

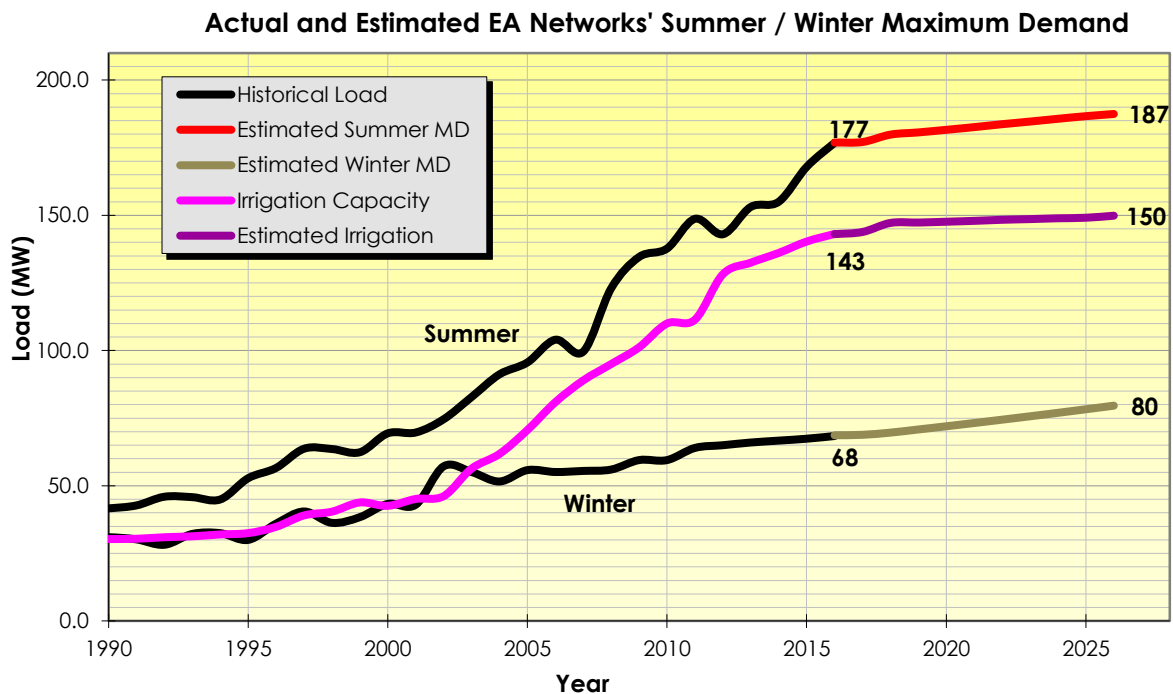

## Load Forecasting

Future load projection is a difficult task and is based on a complex multivariate environment. A careful and rigorous approach must be taken to developing future load projections based on historical trends, available information and estimates on future changes.

Forecasts of maximum demand on the subtransmission system have been derived from internal modelling work. Two forecasts have been derived. The first forecast is based on estimating the future load likely to occur on each zone substation. Separate summer and winter demands are estimated for the next ten years. The results of this estimate are shown in the diagram above.

Extrapolating a moving four-year average growth linear regression line into the future for ten years has developed the second forecast. This method of projection has the advantage of incorporating unknown future load (load that cannot be estimated because it arrives as a step increase out of the blue) since it incorporates past "surprise" load. The results of this forecast have become hopelessly optimistic (it continues to show exponential growth) and cannot take account of changes to the environmental regulations and dairy market.

The two models are divergent. The statistical projection cannot account for the likely (and now apparent) downturn in irrigation load growth caused by water extraction restrictions. On the other hand, the individual load estimation reflects that downturn but does not account for unknown future load. EA Networks are taking a cautious approach to the future summer system maximum demand. It will possibly exceed 187 MW by 2026 but at this point in time that is the presumed system maximum demand.

The additional impact of stage 2 of the proposed BCI irrigation scheme can be seen on the estimated irrigation load curve with a perceptible 3 MW step increase occurring between 2017 and 2018. This scheme will place additional demands on the subtransmission network and 66kV GXP. Projects have been included in the plan to accommodate this load.

## Strategic (Development) Plans by Asset

### Transpower Grid Exit Points

At Transpower's Ashburton substation 66kV GXP load has exceeded 150 MW on the 66kV bus and 177 MW system total. A third 220/66kV 120 MVA transformer has been installed. It is unlikely further development will be required at this GXP. Any expansion would probably be at a new geographically remote 66kV GXP site.

### Subtransmission Network

The subtransmission network will come under increased pressure if the load grows as predicted. The 33kV system will be fully converted to 66kV for capacity, security and possibly commercial reasons. By the end

of the planning period it is possible that a second, geographically separate, 66kV GXP may supply some of the 66kV subtransmission network.

### **Zone Substations**

The need to convert more of the subtransmission network to 66kV has occurred. There are several zone substations that will require conversion over the next 3 years. A few smaller 33/11kV substations have become redundant and new or rebuilt 66kV substations have supplied that load via 11kV or 22kV distribution. By the end of the planning period only one no zone substation (Mt Hutt) will be untouched by the 66kV developments.

### **Rural HV Distribution Network**

Emphasis on conversion to 22kV as the best solution to capacity and voltage problems has already paid dividends for EA Networks. This approach will be followed wherever it makes commercial and engineering sense to do so. Increasing the conductor size of 11kV lines will still be an option for specific short-term problems that are not widespread. Some key 22kV lines on state highways have been placed underground in cooperation with NZTA. This is a programme that is likely to continue. A programme to install rural ring main units continues to assist safety and reliability by using remote control.

### **Urban HV Distribution**

"Urban" distribution feeders are restricted to Ashburton, Methven, and Rakaia townships. Other townships are typically connected to a rural overhead feeder with additional network segregation using line reclosers to offer the township a more secure supply.

Urban reinforcement solutions are typically implemented by adding additional cable routes from a zone substation, although a point is reached when congestion makes this impractical. Ashburton substation was nearing this situation and the chosen solution was to introduce Northtown substation. The next phase of reinforcement is beginning with an additional, larger, "core" cable network needed in Ashburton township.

The underground conversion programme has the widespread support of the consumers/shareholders, which lends additional weight to the other less obvious advantages that accrue from this work. The additional security, capacity, flexibility, quality of supply, and low maintenance characteristics all contribute to greater consumer/shareholder satisfaction. Other stakeholders are also encouraging of this work.

### **SCADA**

A progressive expansion of the SCADA system is envisaged to include all devices at all zone substations including those without any SCADA at present. Distribution automation will also be emphasised. Communications to zone substations has improved to allow data, voice and video communication. This communications development is largely complete. The next stage is to strengthen communication to distribution devices beyond the zone substation boundary.

### **Distributed Generation**

EA Networks already has significant distributed generation connected in the form of four hydroelectric generation plants, one at Barrhill (0.5MW), one at Cleardale (1.0 MW), one at Montalto (1.6 MW) and one at Highbank (26 MW). New distributed generation of any scale is encouraged and will be connected subject to suitable commercial and technical arrangements made according to industry rules and guidelines governing these activities.

A significant number of distributed generation proponents have had informal discussions with EA Networks. During 2015-16 a 500kW hydro plant was connected to the 22kV network and commissioned. A range of other generation projects are possible and they vary from small to quite large over various fuel/energy sources. The economic environment for new generation investment is currently not particularly favourable. The possible projects are detailed in [section 5.4.12](#).

EA Networks are always reviewing the feasibility of locally connected distributed generation that would enhance the security and profitability of both the company and the community. Several preliminary studies have been undertaken and this has identified some promising options that will be detailed in the Asset Management Plan if they become a commercial proposal.

## 6 Non-Network Assets

EA Networks has recently relocated its operational base to a new purpose built premises. This site and buildings offer an integrated solution with IL4 seismic resistance and self-supporting storage infrastructure for diesel fuel, drinking water and on-site back-up power generation.

Other assets include vehicles, test equipment, LAN, radio-communications infrastructure, and various technical software systems. Some of these assets will incur significant expenditure during the planning period.

Most policies regarding non-network assets are understood but not formally documented. As opportunity permits they will be recorded. The vehicle policy is documented and has acceptable use and vehicle replacement criteria.

## 7 Risk Management

EA Networks has assessed risk from three distinct perspectives. The first is risk to people from the construction and operation of the electricity network. The second is the risk to the environment from the construction and operation of the electricity network. The third is the risk to the network from people, the environment, and condition-related failure.

### Introduction

The EA Networks network is periodically exposed to events or incidents that subject elements of the electrical network to a high risk of failure. If the location of these events coincides with a critical component of the electrical network, the result is a high risk to the integrity of the electrical network. This risk of failure can in turn lead to high risks for consumers, either as individuals or as larger collective groups.

### Risk Assessment and Mitigation

A comprehensive risk assessment has been undertaken on both individual pieces of major equipment and categories of plant with common failure modes. These assessments have been entered in to a risk register database for ease of update and prioritising. Some of the key risk factors that emerged and the proposed or actual mitigation plans are:

Risk Factor	Actual/Proposed Mitigation
Design of seismic restraints of various network equipment	Engage seismic design experts for advice and adopt that advice where prudent
Loss of 220/66kV GXP transformer leaving un-served load	Third 220/66kV transformer has been installed.
Security of Ashburton township load	Two substations now supply ensuring no on-going loss of supply. Reinforcement of 11kV network to increase transfer capacity is commencing.
Lightning exposure of major plant	Assess each item for exposure and address in most effective manner for each item.
Oil spill management	Bund major oil volumes where possible and provide training and emergency response kits accessible from all locations.
SF <sub>6</sub> gas management	Acknowledge potential harm to the environment and manage according to industry best practices.
Weather exposure of overhead lines	Network design standards, underground conversion, network renewal, emergency stocks, closed subtransmission rings.
11kV switchgear failure	Progressively replace affected model and allow only remote control until replaced.
Distribution transformer failure	A universal spare distribution transformer with cables (1 MVA, 22-11kV/415 V) exists.



Ripple plant failure

Configure plants so that loss of one plant does not prevent effective control.


Further work is required to be done on the contingency plans for low likelihood, high consequence events that have mostly been treated by contingency planning. Reassessment of risk occurs every day and the adoption of sound procedures and minimum acceptable design standards provides mitigation from the conceptual design stages of all development or enhancement work.

## 8 Financial Summary

The following tables summarise the projected expenditure over the next ten financial years on asset management of the EA Networks electricity network.

The amount of baseline capital and maintenance expenditure forecast in the plan has been revised to more accurately reflect the actual base levels that have been experienced over the last few years. Categorisation of expenditure is now more accurate and consistent than previous plans.

The costs stated here are in “constant” 2016-17 dollars (not adjusted for inflation).

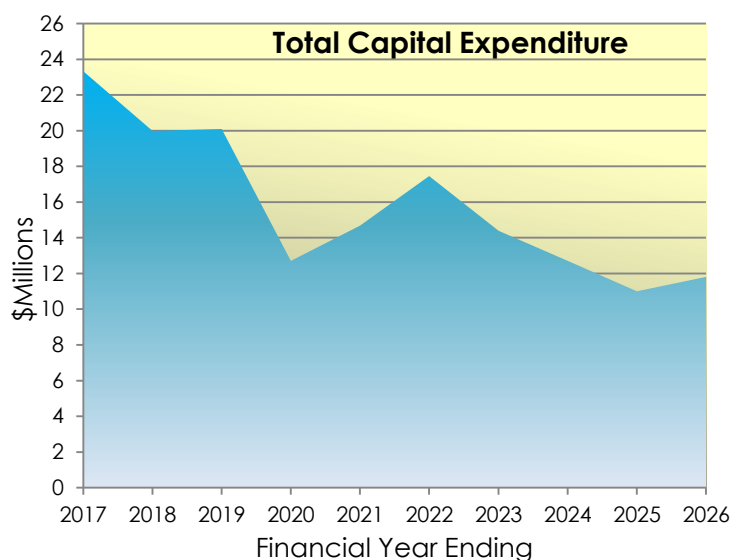

Overall Network Capital	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
<b>TOTAL (exc. Non-Network)</b>	<b>21,577</b>	<b>19,006</b>	<b>19,246</b>	<b>11,850</b>	<b>13,809</b>	<b>16,617</b>	<b>13,548</b>	<b>11,864</b>	<b>10,118</b>	<b>10,958</b>

The first 3 years of the capital forecast are dominated by a series of development projects that are driven by load growth or security requirements. After 3 years the capital expenditure drops closer to a baseline level (\$11M - \$12M) which includes on-going routine activity associated with consumer connections as well as discretionary programmes such as the urban underground conversion effort. On-going 11-22kV conversion is also included in the entire planning period.

Overall Maintenance	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
<b>TOTAL (exc. Non-Network)</b>	<b>2,877</b>	<b>2,906</b>	<b>2,943</b>	<b>2,977</b>	<b>2,928</b>	<b>2,948</b>	<b>2,977</b>	<b>3,006</b>	<b>3,035</b>	<b>3,069</b>

The operational (maintenance) expenditure is shown as flat over the entire planning period. This is unlikely to be the case as random natural events will undoubtedly cause periods where significant repairs will be required. The planned operational expenditure will be more predictable as additional actual condition data is gathered (currently condition is inferred from age). The basis for the annual operational expenditure is historical performance. Details of financial expenditure are available [here](#).

## 9 Evaluation of Performance

### Improvements

EA Networks do not claim to be leaders in any particular field of asset management. The processes, systems and applications that EA Networks use are improving all the time, but it would be overly optimistic to think that improvements could be made to use all best practice tools without consideration of the pay-back period for adopting them. Investment will be made in the areas EA Networks considers to be appropriate for a small, largely rural, electricity lines company. In some circumstances this may not compare favourably to some other companies with a different focus and drivers for asset management.


Initial targets of this improvement will be SCADA, risk management, spatial information system upgrade, and detailed system security evaluation.

## Network Service Improvements

A range of service improvement initiatives have been identified and either implemented or plan to be implemented. Areas that initiatives have targeted include:

- Subtransmission configuration
- Diagnostic inspections
- Protection upgrades
- Tree control
- Rural distribution switchgear
- New equipment specifications
- Substation configurations
- Underground conversion
- Continuing SCADA development
- Harmonic mitigation

The main factors influencing the performance of the EA Networks network during 2014-15 and 2015-16 were a significant snow event during June 2015 (causing overhead line damage) and the extent of planned outages. The only practical and affordable method to complete the scale of essential planned work is by having interruptions. These outages were required to permanently repair or maintain assets after fault repairs, attend to regular condition based maintenance work, or development work associated with load or security requirements. Planned work such as 11-22kV network conversion, new work, rebuilds, and maintenance combined contributed 68 minutes (30%) of the total SAIDI so far in 2015-16. In comparison, the unplanned SAIDI is 159 minutes (70%). Defective equipment, lightning and foreign interference (inc. wildlife) has contributed a significant proportion. Most other interruptions were the result of trees or unknown causes. Given the amount of planned work undertaken, the overall performance of EAL is quite satisfactory for this financial year and is comparable with some of the forecast targets. SCADA system expansion is continuing. It is expected that a more complete and expanded SCADA system will significantly improve fault restoration times (and to a lesser degree planned restoration times) in the future.

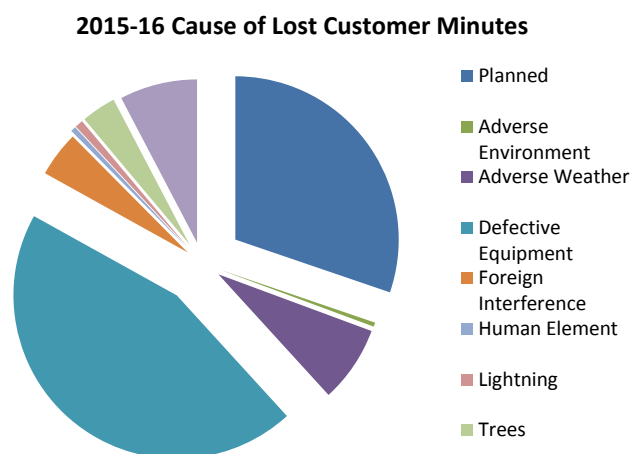

EA Networks plans to improve its performance so that it more closely matches its targets within peer companies particularly with regard the duration of outages.

Fault performance of the network was satisfactory in 2015-16. There is still room for improvement. Unfortunately, the snow event did have an impact on performance, particularly SAIDI. Removing the Snow event would give a very acceptable performance. Other than that, it appears to have been more distribution voltage faults affecting moderate numbers of consumers. Once the planned interruptions decrease, performance index totals will improve. The unplanned interruptions should also decrease in frequency and duration with asset improvements that are planned in the future.

## Capability to Deliver

History has shown that the EA Networks business structure has provided a robust and resilient platform to implement the strategies outlined in the annual Asset Management Plan through times of unprecedented asset development and load growth.

In recent years, EA Networks has grown and additional roles/skills have been employed to provide added rigour to a number of internal processes.

In future, it is planned to use the decrease in development workload to refine systems and processes that do not currently form part of a documented procedure.

# BACKGROUND and OBJECTIVES

<b>Table of Contents</b>	<b>Page</b>
1.1 EA Networks' Evolution	21
1.2 Overview of EA Networks Organisation	24
1.3 Objectives of This Plan	26
1.4 Stakeholders	26
1.5 Scope of This Plan	29
1.6 Plan Structure and Approach	29
1.7 Asset Management Drivers	32
1.7.1 Safety	32
1.7.2 Consumer Service	33
1.7.3 Economic Efficiency	34
1.7.4 Environmental Responsibility	35
1.7.5 Corporate Profile	35
1.7.6 Legislative Compliance	35
1.8 Asset Management Processes and Systems	36
1.9 Responsibilities	42
1.10 Information Sources, Assumptions and Uncertainty	43
1.10.1 Information Sources	43
1.10.2 Significant Assumptions	44
1.10.3 Future Changes to the Distribution Business	46
1.10.4 Factors Affecting Information Uncertainty	46
1.10.5 Assumptions Surrounding Sources of Uncertainty	47
1.10.6 Price Inflation Assumptions	49



## BACKGROUND AND OBJECTIVES

### 1.1 EA Networks' Evolution

In 1908 a private company, Craddock & Co, began supplying electricity to Ashburton township consumers at 220 volts d.c. The source of this supply was a 30 kW generator driven by a steam traction engine. 3.3kV a.c. was soon introduced and this was the distribution voltage of choice until around 1923.

In 1923, the Ashburton Electric Power Board came into existence and it took over the operation of the generators and began implementing one of the options for connecting to the national grid. The new Public Works Department Ashburton substation (the present Ashburton zone substation is on the same site) began supplying electricity to the Ashburton urban area in 1924. The AEPB initially had both 6.6kV and 11kV supplies from Ashburton substation (having retired the 3.3kV and d.c. supplies fairly quickly). This system evolved gradually over the next twenty years until second and third 11kV points of supply from the national grid were established near Methven and Springfield Road. During this time (1932) Mr Kemp (the founding engineer at A.E.P.B.) devised an electric tractor. The photo at right shows the mobile substation used to supply the tractor. Six tractors were built and they each did over 4,000 hours of cultivation during an eight-year period.



During the post-war years the Power Board became the Power and Gas Board - supplying coal gas to a large percentage of Ashburton township. Gas production ceased in 1973 as it had become uneconomic.

As the load continued to increase, it became apparent in the early 1960s that a true subtransmission network would be required. Planning began and once 33kV had been settled upon as the correct subtransmission voltage, the first 33/11kV substations were commissioned in 1967. These substations were supplied from three 5 MVA step-up transformers (11/33kV) located at the Ashburton substation.

The final portion of 6.6kV distribution was converted to 11kV in 1971. The popularity of pumped irrigation began to increase and general electricity use continued to rise. As a result of the increased irrigation load and other industrial loads such as snowmaking, animal processing plants and vegetable processing, the number of 33/11kV substations increased. By the early 1980s the three step-up transformers were overloaded and relief came in the form of a 33kV point of supply at Ashburton and another at Cairnbrae (5km south-east of Methven). This arrangement allowed the creation of a 33kV ring network that allowed individual 33kV line faults to be tolerated without extended loss of supply.


A small (1.6 MW) hydro power station was constructed by the AEPB during the 1980s at Montalto. This induction generator continues to operate but is now owned by an electricity retailer.

During the late 1980s and early 1990s Transpower proposed decommissioning the 110kV circuits between Timaru and Hororata. This required shifting one of the points of supply from the Ashburton township site to a site about 7km south-east of Ashburton. Once the two parties agreed on commercial arrangements, the new 220/33kV substation was built and EA Networks took 33kV supply from it in 1992.

Around 1995, what was the Ashburton Electric Power Board was transformed into the co-operatively owned company EA Networks. Options for this transition, from a quasi-governmental entity with undefined ownership to a limited liability company, were comprehensively researched and what was considered the

fairest and most stable ownership option was instituted.

The subtransmission and point of supply rearrangement assisted in extending the life of portions of the 33kV ring network, but the huge increases in irrigation load were beginning to tax the rural 33kV network beyond its capacity. The same problem was facing the 11kV distribution network in places, so a bold decision was made to begin converting portions of the 33kV network to 66kV and some of the 11kV network to 22kV. The change to 66kV introduced an opportunity to provide a 66kV connection to the Highbank Power Station that had historically been connected to the Transpower network. This option was duly negotiated and a more extensive 66kV conversion undertaken to connect Highbank. The subtransmission development also enabled the Cairnbrae 66/33kV point of supply to be relinquished and there is now only one physical location for EA Networks' connection to the national grid.

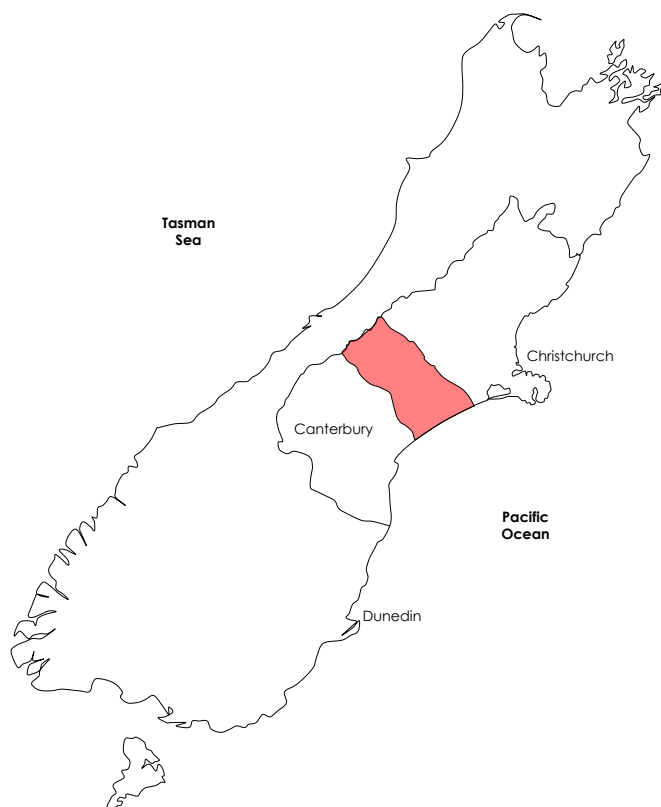

Transpower's Ashburton substation (actually 7km from Ashburton) supplies 33kV directly into the EA Networks subtransmission network. The 66kV supply from Transpower Ashburton connects to an EA Networks substation called Elgin immediately adjacent to it. Elgin then connects to the EA Networks 66kV subtransmission network. Simultaneous with the subtransmission conversion was the conversion from 11kV to 22kV of some distribution lines. This was also very successful and offers much improved voltage regulation, thereby increasing power quality to those rural consumers supplied via 22kV. 22kV conversion has continued to progress in many rural 11kV areas where additional capacity is needed.

The area EA Networks directly services is approximately 3,500km<sup>2</sup>. The extents of the area are the Rangitata River in the south, the Rakaia River in the north and the foothills of the Southern Alps in the west. Three distribution lines run up river gorges in to the foothills but these form a very small portion of the entire network.

The network comprises of some 29,089 poles, 2,369km of high voltage overhead lines, 225.7km of high voltage underground cable, 22 zone substations and switchyards, 6,260 distribution substations, one control room and a communications network.

There are four hydro generating stations embedded in the network. The newest generator is a 0.5MW unit near Barrhill, Cleardale is a 1MW station, Montalto is a 1.6MW station and Highbank is a 26MW station. The Barrhill unit is owned by Barrhill Chertsey irrigation, Cleardale is owned by Mainpower, while Montalto and Highbank are owned by Trustpower.

EA Networks' distribution lines have a variety of different capacities, dependent upon local demands and geographical considerations. Operating voltages include 66kV (66,000 volts), 33kV, 22kV, 11kV and 400V.

The rural distribution network configuration is predominantly long radial overhead feeders with some interconnection to adjacent feeders and substations. This arrangement is largely driven by economics and is the method of supplying rural consumers that offers best value at acceptable levels of reliability. Typically, the capacity of a rural feeder is limited by voltage drop and not the thermal rating of the conductors.

The urban 11kV distribution network is based upon a similar principle to the rural arrangement except the network is largely underground cable, the interconnections are more frequent, and the overall feeder lengths are significantly shorter. The capacity of urban feeders is thermally constrained by the maximum current rating of the underground cable.

EA Networks also operate and develop an open access fibre optic network in Mid-Central Canterbury and has an interest in a Mid-Canterbury piped irrigation scheme ([Barrhill Chertsey Irrigation Ltd](#)).

## Summary of Network Assets

(As at February 2016). Circuit voltage is rated voltage (operating voltage quantity in brackets).

### Network Inputs and Outputs:

Connections	19,156	
Maximum Load Demand	177	MW
Delivered Energy	644	GWh (2015-16 estimate)
Annual Load Factor	45	% (2015-16 estimate)
Annual Loss Ratio	7.7	% (2015-16 estimate)

### Network Components:

Overhead Lines (circuit km)	350 (285)	66kV Subtransmission
	98 (105)	33kV Subtransmission
	1,483 (1,206)	22kV Distribution
	439 (773)	11kV Distribution
	98	400 V Distribution
	32	Street Lighting
	Poles	29,089
Underground Cables (km)	2.1 (1.5)	66kV Subtransmission
	4.5 (5.1)	33kV Subtransmission
	113.0 (62)	22kV Distribution
	106 (157.1)	11kV Distribution
	318.7	400 V Distribution
	245	Street Lighting
	Zone Substations	15
Distribution Substations	7	33/11kV
	4,740	Pole Mounted
	1,520	Ground Mounted

The future of the EA Networks network will focus on a 66kV subtransmission network, a largely 22kV overhead line rural distribution network, and an 11kV urban underground cable distribution network in Ashburton and Methven townships. It is likely that an additional layer of larger 11kV underground cable distribution will be added in Ashburton as the existing urban feeders approach security or rating limits.


## 1.2 Overview of EA Networks Organisation

EA Networks operates as a stand-alone co-operatively owned lines business - EA Networks. This business incorporates an asset management function (the Network Division) and a contracting function (the Contracting Division). EA Networks owns, operates and maintains the infrastructure assets. The Network Division plans and controls the asset management function.

EA Networks offers network line services as its core activity. Ancillary to this function is the contracting wing, which offers services to the Network Division, other line owners and the general public. Other business activities include a fibre optic data network and partial ownership (via a joint venture company) of a piped and pressurised irrigation water delivery network.

There are 30,069,100 shares issued in EA Networks. The Ashburton District Council holds 28,750,000 of these shares in a non-rebate/non-voting form. The consumer/shareholders hold 1,302,669 rebate shares at 100 shares per consumer (some consumers have more than one connection). There are 16,431 unallocated rebate shares available for new consumers as they connect to the network. Existing consumer/shareholders who add additional connections are not entitled to additional shares.

The Asset Management Group of the Network Division holds the technical knowledge and is responsible for technical decisions concerning the asset. The Asset Management Group remains associated with the Contracting function within one corporate body. The company is in charge of EA Networks assets and personnel - hence the requirements of equipment and personnel safety remain within one corporate body. The company structure is shown below.

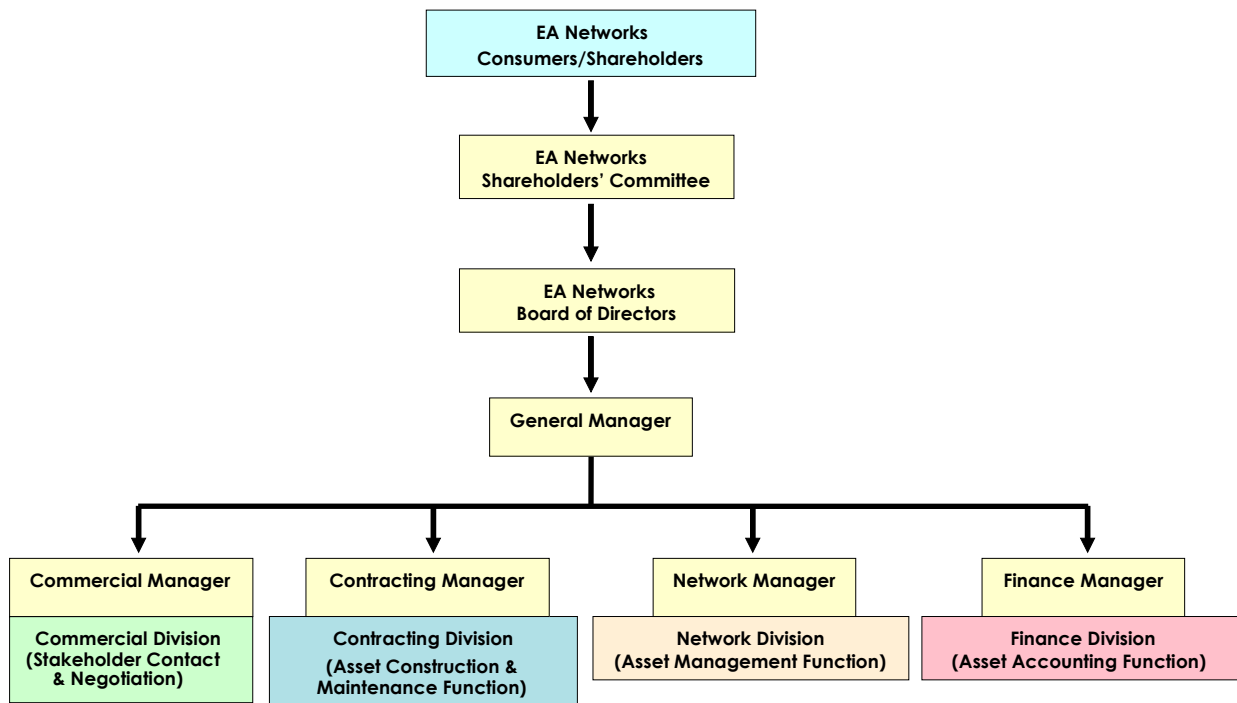

The key functions and responsibilities of the groups are:

### Consumers/Shareholders

The end users of electricity supplied over the EA Networks network. All new consumers are initially a shareholder in the cooperative company. Almost every new consumer chooses to retain the shareholding and only a handful of existing consumers are not shareholders. Each shareholder (consumer) has one vote to elect a shareholder committee, irrespective of the size/scale of their electrical connection(s) or contribution to the company's income or profit. The shareholders have the responsibility to consider their choice of committee member carefully to ensure they faithfully represent their views both in appointing directors and influencing the performance of the company as a whole. Ultimately, shareholder dissatisfaction with either the Shareholders' Committee or the Board will firstly result in changes to the Shareholders' Committee by the ballot and then a different emphasis in the Board members appointed by the Committee.



**Shareholders' Committee**

Representatives of all shareholders. Represent the interests of the shareholders/consumers (to be a shareholder one must be a consumer). Appointment of Directors, intense scrutiny of Statement of Corporate Intent (including performance targets) and monitoring and reporting of performance of the company and directors to the shareholders. The Shareholders' Committee also provide the principal means to resolve conflicts between asset management practices and large stakeholder interests. Three of the seven members of the Shareholders' Committee are appointed by the Ashburton District Council, the remainder are elected by a one vote per shareholder ballot.

**Board of Directors**

Review and approval of the Annual Budget and the Asset Management Plan as official company documents that accurately reflect the state and desired direction of EA Networks for the short and medium term.

**General Manager**

Provision of company secretariat and attaining of revenue streams and a key contact point with electricity retailing companies wishing to use the EA Networks network for the distribution of electricity. Provides corporate policies that influence asset management philosophies. Monthly reporting of significant Asset Management Plan project progress and annual summary presentation of progress and plans for asset management to the Shareholder Committee and Board. The Safety and Quality Manager reports directly to the General Manager. The General Manager has 105 staff under him.

**Network Manager (Asset Management Function)**

Managing the network including Subtransmission, Distribution, Services, LV Reticulation, Zone Substations, Distribution Substations, SCADA/Communications, Protection and Distribution Transformers to maximise system availability. Develop maintenance strategies, set and manage priorities, set and manage standards, issue works orders to ensure target reliability is achieved at minimum cost. The Network Manager has 28 staff.

The Network Division completes the vast majority of designs. Only when the scope of a project exceeds the capabilities of the internal staff in resource availability or expert knowledge is an external designer engaged.

**Contracting Manager (Asset Construction and Maintenance Function)**

Carry out the plans and works orders of the Network Manager satisfying the appropriate statutes, regulations, standards and industry guidelines. Additionally, the contracting function offers suggestions for innovative work techniques to increase safety, security and reliability while minimising capital and on-going maintenance costs. The Contracting Manager has approximately 60 staff.

The maintenance of the network is primarily carried out by the EA Networks Contracting Division as the preferred contractor. They are contracted to undertake the servicing and testing, along with fault callout and fault repair work. Most line replacement, enhancement or development projects are also handled by the Contracting Division but when the scope of a particular project exceeds the capabilities of the Contracting Division, either sub-contractors will be sourced or the Network Division will offer the complete construction project for competitive proposals from other contracting companies.

**Commercial Manager (Stakeholder Contact and Negotiation)**

Provides the interface between EA Networks and the external stakeholders – particularly major consumers. Facilitates discussions on changes to capacity and security with major consumers often assisted by technical personnel from the Network Division. The Commercial Manager has 5 staff.

**Finance Manager (Asset Accounting Function)**

Financial accounting of network assets and management. Ensures compliance with relevant legislation governing financial activities of EA Networks including financial disclosures. The Finance Manager has 6 staff.

## 1.3 Objectives of This Plan

This plan aims to document the intended approach EA Networks take in managing EA Networks' electricity assets. As a regulatory requirement, an Asset Management Plan must be published annually (with few exceptions). With this document, every effort has been made to comply with the requirements for disclosure of AMP's outlined in the most recently determined information disclosure requirements for Electricity Lines Companies set by the Commerce Commission under the Commerce Act 1986. To assist readers who have an interest in the regulatory aspect of this plan, [Appendix D](#) offers cross-reference to the mandatory disclosure items of the Electricity Distribution Information Disclosure Determination 2012.

This plan clearly defines the service objectives and gives a strong focus on life cycle management by presenting operations, maintenance and renewal policies and programmes by asset type. Asset management planning processes should effectively integrate best practice features. These establish the service standards and future demands to meet business, legislative and other needs, while developing optimum lifecycle asset management strategies and cash flow projections based on assessing non asset solutions, failure modes, cost/benefits and risk.

Asset Management Plans must address growth. The EA Networks network has seen dramatic load growth over the last decade. This was predominantly caused by various types of rural irrigation. It would appear that this growth is likely to continue for a few more years, but at a reduced rate, as farmers attempt to provide guarantees against drought, convert to dairy farming, as well as giving themselves more flexible cropping options, while ECAN promotes sustainable use of water. It should be noted that ECAN may not retain the same control of water management in Canterbury in the future. The Government are currently considering what actions to take to resolve a number of pressing issues relating to water management in Canterbury. It is likely that a significantly different approach to governance will be taken in coming years.

EA Networks has the following Asset Management Plan objective:

***To provide a systematic approach to asset management, which is intended to ensure that the condition and performance of the electricity network and associated assets are being effectively and efficiently maintained or improved to satisfy stakeholder requirements.***

## 1.4 Stakeholders

Stakeholders are defined as those parties with interests in EA Networks' asset management from a financial or operational point of view. The principal stakeholders are:

### Shareholders

EA Networks' shareholders (who, since EA Networks is a co-operative company, are all consumers) wish to ensure, as owners of the assets, that their financial capital is protected in the long term, by ensuring that the operating capability of the network is maintained and that the system is maintained efficiently so that they earn a sufficient return on their investment

The interests of shareholders are actively sought by the Shareholders' Committee. As elected committee members (or Ashburton District Council appointed members as is the case for three of the seven), they are all members of the local community and they individually and collectively seek feedback from shareholders and shareholder/consumer groups.

The shareholders also have a direct interest in how EA Networks provides customer service and how it meets its obligations to other parties (as described below).

The shareholders elect a Shareholders' Committee and this group not only appoints the Board of Directors but also provides a consultative role for the Board and management. The Shareholders' Committee review the Statement of Corporate Intent, the Annual Report, the Asset Management Plan and other relevant company disclosures and statements. This process provides shareholder feedback and provides the principal means of managing conflicts between most stakeholder interests and asset management practices. The shareholders are also able to address any specific issues at the Annual General Meeting but more commonly they would use the Shareholder's Committee as the conduit to resolve any issues of principle. [Section 2.2](#) details the representative voice that the Shareholders' Committee provides between

all shareholder/consumers and how this influences the asset management philosophy of EA Networks. Other stakeholders are typically consulted on an issue by issue basis as and when required.

### **Consumers**

These are EA Networks' directly connected end-use consumers (more than 99% are shareholders).

The Shareholders' Committee actually serve as a de facto "Consumers' Committee" as all shareholders must be current consumers on the EA Networks network. They seek and balance the interests of the shareholders from a prudent financial management perspective as well as considering the level of network performance that is required to maintain a high level of satisfaction from the consumer/customer base.

EA Networks management also encourage individual consumers and representatives of groups of consumers to engage in constructive dialogue to further refine the focus of EA Networks in satisfying their needs and interests. A biennial consumer survey of 400 consumers takes place and they are asked more than 30 questions ranging from preparedness to pay for additional reliability, ownership of on-property lines and satisfaction with advice and dialogue with EA Networks personnel. The survey is also provided to the Shareholders' Committee for their consideration. A selection of the larger consumers are interviewed as part of the survey to gauge their interests and concerns. These concerns can be addressed with individualised solutions in most circumstances and it generally comes down to presenting the price/quality trade-off options clearly and in a timely manner so that they can evaluate them objectively.

Generally, the consumers wish to receive a safe, adequate and suitably reliable network service and to be assured of being able to receive this over the long term, at minimum cost.

### **Customers (Retailers and Generators)**

The retailers and generators (most of them are both and are colloquially called 'gentailers') active on EA Networks' network are few in number (less than ten) and are always prepared to share their opinion of EA Networks' business focus and methodologies. Regular meetings are held with representatives of some gentailers while others (typically those with few customers on the EA Networks network) do not appear to seek regular engagement. At least one of the retailers has provided EA Networks with benchmark performance indicators comparing the various lines companies they deal with.

The EA Networks 'Use of System Agreement' provides the major vehicle for translating gentailers interests into the performance required of the EA Networks network. Equally, it provides a path to communicate the requirements EA Networks place on a gentailer to use the electricity network. There is a review process available for the 'Use of System Agreement' and any significant changes in either party's interests can trigger that review process.

Among other things, the gentailers want stable business practices, robust network performance and justifiable charges for use of the EA Networks network. Other issues of interest include timely responses to information requests and, where needed, follow-up actions.

### **Others**

Other parties with a potential interest in EA Networks' asset management include:

- **Transpower** who have an interest in the existing and future utilisation of their assets. Management have regular meetings with Transpower representatives on various issues. Transpower have plans to encourage closer engagement with their customers such as EA Networks. This will entail much more direct discussion between peers in each organisation. Commercial negotiations tend to arrive at the most satisfactory resolution of any issues.
- **Other lines companies** in the region with whom common problems and solutions can be shared. This engagement takes place as a matter of course, and there are many examples of a unified approach to identifying, researching and resolving issues of common interest. These can be in the form of common equipment specifications, design standards or even principles of application of similar policies.
- **Employees and contractors** who design and build the system and have an interest in the future work that is available and the safety of the assets. Every time a contractor is engaged they are fully briefed on EA Networks' safety requirements and although the level of work contracted out is

less than many other lines companies any request for information is answered promptly and candidly.

- **The public** on whose land the network may be built. EA Networks are fortunate not to have significant quantities of assets on private property. Whenever private land must be entered, permission is sought well in advance unless it is an emergency when all efforts are made to contact the owner and minimise the impact of any required work.
- **Tree owners** who have a requirement to keep their trees clear of power lines. A full time employee actively manages the required dialogue with tree owners in an attempt to minimise the conflict between trees and power lines. This process is typically amiable and very few dialogues become formal exchanges of letters. The tree owner typically has an interest in minimising the impact of tree control work on their tree and subsequently preventing any fiscal or reliability implications of the tree interfering with the line.
- **Financial institutions** who may be called upon to fund aspects of asset development or maintenance. The financial institutions that EA Networks both borrow money from and deposit money with have an interest in ensuring that EA Networks continues to be a viable and profitable business that can service any debt as contracted. These financial institutions always advertise their interests at an early stage and ensure they continue to be well known.
- **Local Electrical Contractors** who are required to comply with EA Networks' connection standards. These standards control a range of performance measures including, but not limited to: safety; the impact the connection has on the reliability of other consumers; the impact the connection's load has on the power quality of other consumers and on the EA Networks network; and the timing/advance notice needed to provide the connection.
- **Interest groups** such as Federated Farmers and Grey Power. These groups are really consumer groups from whom EA Networks actively seek opinions on issues that will impact their members. Obviously, these two groups are not the only consumer groups with whom EA Networks seek to engage and the vested interests of each group are balanced by presenting the Board and Shareholder Committee with both the interest group's opinions as well as the technical and fiscal implications for EA Networks should they choose to heed any or all of these opinions.
- **Distributed generation (DG) proponents.** These individuals and organisations are encouraged to communicate their interests to EA Networks at the earliest opportunity. As with all lines companies, EA Networks has a published policy and guidelines for the connection of DG to the network. The nature of potential DG connections is that they can be completely unknown to EA Networks and because of commercial sensitivity do not wish to engage in dialogue until the last stages of any development. This obviously makes it difficult to determine their interests in advance. EA Networks believe the DG policy in place satisfies the vast majority of DG proponent's interests.
- **Ashburton District Council** as a major shareholder and the body that controls access to the road corridor. Many of the interests of a local body are enshrined in legislation and are therefore very transparent to EA Networks. Unique local interests that are specific to either district development or planning are typically dealt with in management to management dialogue and, on occasion, formal consultation for issues such as District Plan reviews and amendments. There are issues in the political domain that are discussed at Board, Shareholder Committee and District Councillor level. Asset management personnel are generally aware of the outcomes of these discussions rather than the content. While a significant shareholder, the Ashburton District Council has no greater power as a shareholder than any other shareholder.
- **Regulatory agencies** with which EA Networks comes into contact. The governmental agencies that EA Networks are required to deal with tend to make their interests quite clear by inviting comments on discussion papers or draft regulations that indicate the intent of any future regulation or legislation. Any interaction is typically very formal and open so that all interested third parties can gauge for themselves the validity of the opinions expressed by the regulatory body and EA Networks.

## 1.5 Scope of This Plan

This Asset Management Plan covers the management of EA Networks' electricity network assets for a period of 10 years from the financial year beginning on 1 April 2016 until the year ended 31 March 2026. The main focus of analysis is the first 5 years and, for this period, most of the specific projects have been identified. Beyond this time, analysis tends to be more indicative based on long-term trends. It is likely that new development project requirements will arise in the latter half of the planning period that are not identified here. Hopefully, most new projects would only affect the timing of development funds by displacing a project which has goals that can be mostly solved by the new project.

To provide a framework for asset management within the planning period, it is necessary to determine the longer-term direction in which the system should be developed. For example, it would not be prudent to invest heavily in enhancing a system at a particular voltage if, beyond the planning horizon but well within the life of those assets, it was likely that they would be overlaid by a new higher voltage system. A case in point is the augmentation of supply to the area bordering the foothills of the Southern Alps where currently 11kV is the distribution voltage but 22kV is the voltage of choice for new lines/equipment. Further, strategic development planning must be responsive to a range of scenarios that might occur.

The regulated timing of Asset Management Plan disclosure coincides with the beginning of a new financial year. A consequence of this is that the data used for comparison with other Electricity Lines Companies is as of the date of the previous disclosure - exactly one year ago. The 'disclosed' full year data used in this plan is as of 31 March 2015. Where newer data is available it is used for forecasting/trending (such as power quality, load projections, asset quantities, asset ages, etc) or internal comparisons so that there is as little 'planning lag' incorporated as possible.

## 1.6 Plan Structure and Approach

This plan uses a consistent set of defined activities and asset types to categorise work programmes and their associated expenditure. Budgeting and financial reporting within EA Networks allows actual programme achievement and expenditure outcomes to be compared with the plan. Consistent use of this framework will facilitate comparisons over time.

It should be noted that the activity and asset definitions are independent of accounting classifications of expenditure (i.e. between maintenance and capital expenditure). Therefore trends over time should not be altered by any changes in the application of accounting policies regarding the accounting treatment of expenditure. However it should be noted that, under the current application of accounting policies, all activities could be classified as either entirely revenue expenditure or entirely capital expenditure.


Similarly, the activity and asset type definitions are also independent of EA Networks' organisational structure and responsibilities, although closely aligned with the present structure. In the long run, adherence to the definitions will ensure that the plan remains meaningful in spite of any changes in organisational structure or responsibilities.

The asset and activity planning categories are defined in [Appendix A](#). Asset Types and Activity categories, known as the Job Costing Tree Structure, are included. It should be noted that not all asset types and activity combinations are used. In addition, maintenance activities generally can be planned at the detailed asset level (e.g. servicing of transformers, of circuit-breakers etc), whereas development projects or programmes, which typically involve a combination of different asset types (e.g. lines, transformers, circuit-breakers, protection, communications and network management) are kept intact rather than attempting to allocate the expenditure against the component asset types. While no historical breakdown exists, the revised disclosure requirements will mean that this break down will occur in the future. Since the same workforce often does different tasks it is often a relatively arbitrary breakdown between asset classes. For example, in the process of laying cable for an underground conversion, the same staff lay two cables. Backfill and reseat applies to both cables along with additional works associated with installing pillar boxes and substations. It is not practical or cost efficient to expect field staff to split labour and common materials across asset classes.

One further definition distinction is made throughout this plan: between projects and programmes. The word "**programme**" is used to define a generic activity with a generic justification, but which may apply at a number of different sites. Replacement of defective insulators or fitting vibration dampers to lines are

therefore classed as such programmes. On the other hand "**projects**" are site (or asset) specific; for example adding a second circuit to a particular line, or upgrading a particular transformer bank.

The process used to formulate the Asset Management Plan and other supporting documentation is as shown in the following diagram.

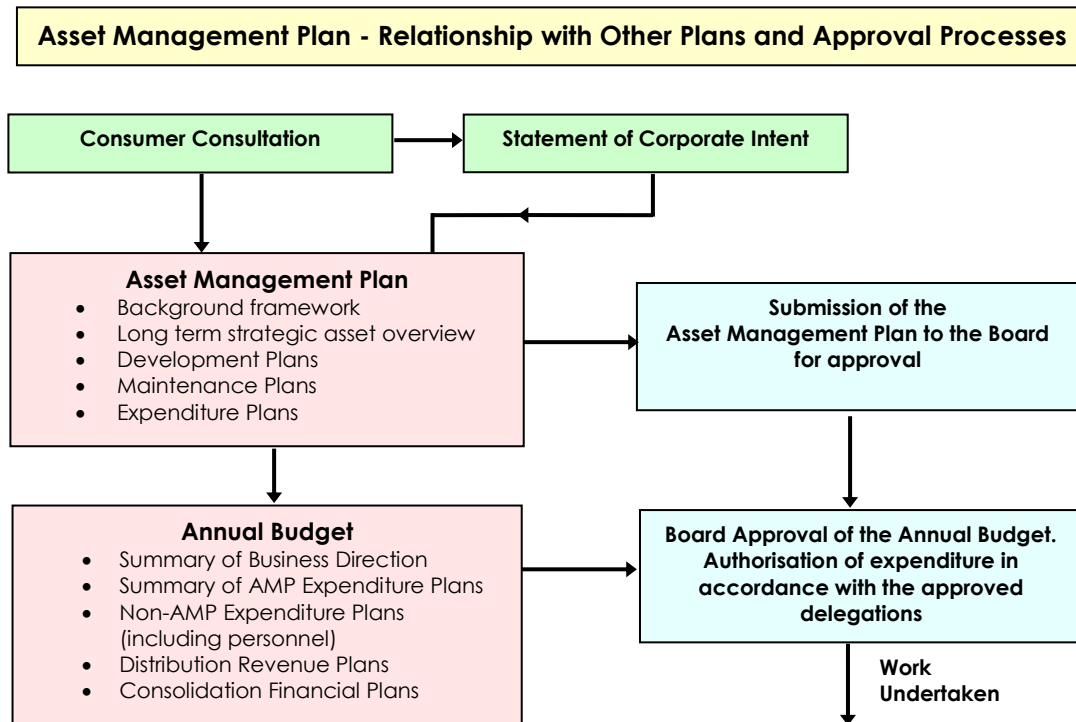

The plan interacts with other EA Networks working plans. Of particular importance are:

- The Statement of Corporate Intent, which is required by law and sets out the business intentions of EA Networks, and
- Annual budgets, which set out the specific resources required for asset management activities. Those parts of the annual estimates relating to the asset management of the electricity network are closely based on the annual Asset Management Plans.

Authorisation of expenditure results from approval of the annual estimates by the Board of Directors and from specific approvals. The Asset Management Plan does not represent an authorisation by EA Networks to commit expenditure, nor does it represent a commitment on the part of EA Networks to proceed with any specific projects or programmes.


## Governance

Any significant addition or alteration to the asset management philosophy of EA Networks is always thoroughly developed at management level using engineering focus groups before being tested for acceptability with the Board. If necessary, the Board will seek further clarification of the implications of any change and this may include workshops with management to permit less formal open exchanges of information and opinions in both directions. Once an understanding has been reached, the approach will be adopted and documented in Board motions or policy documents and this plan. Alternatively, it can be rejected and either another option is developed or the status quo remains.

An example of this process is the policy to enforce all new connections to the network to be placed underground. This has significant implications for both EA Networks and the consumer. Once the proposal was instigated, management developed a draft policy that encompassed the philosophical background and rationale along with the necessary technical requirements. The fiscal implications were also assessed and together they were submitted to the Board for consideration. After consideration of the pros and cons of the proposal, the Board adopted it as policy and it now influences significant areas of the asset

management philosophy at the distribution level.

The Board are provided with the schedule included as [Appendix B](#) of this plan (which individually identifies all significant projects) at the time of annual budget submission. This ensures that the Board can assess the complete evolution of any multi-stage project that they may be committing to in the budget they are considering. This was certainly the case when the initial conversion from 33kV subtransmission to 66kV subtransmission was proposed as it committed the Board to more than a decade of expenditure with dozens of future projects worth tens of millions of dollars. This conversion process is nearing its end after more than 15 years. A similar consideration was made with the commitment to embrace 22kV as the preferred rural distribution voltage.

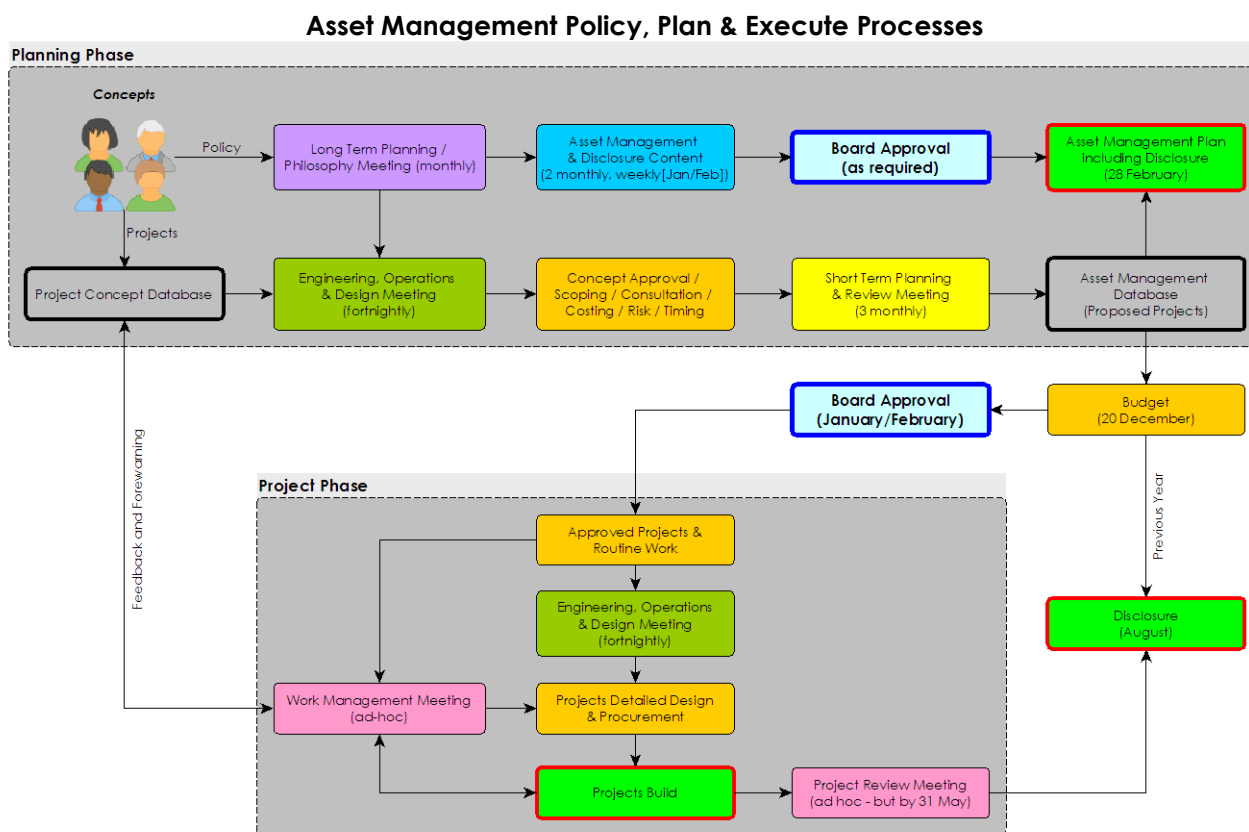

Large projects or programmes that are not part of a previously considered concept draw particular attention from the Board and the individual justification required is significantly more comprehensive than a project that fits into a pre-approved concept.

The Board take an active interest in the outcomes of all asset management decisions. This encompasses not only the direct financial cost of the projects and programmes triggered by the decision, but also the success at achieving the asset performance targets that were submitted as justification for the project or programme. An example of this interest was in the last few years a proposal was presented to rebuild two rural overhead 11kV lines (which had reached the end of their useful lives) as underground cable. Both lines bordered State Highways. The positive decision was undoubtedly influenced by the previous decision to enforce new connections to be underground as well as a commitment to reliability, road/public safety and general aesthetic values of the Ashburton District. The Board made it clear that it would be a pilot project to examine the feasibility of more widespread use of underground cable in the rural area. The projects were studied and further underground conversion projects have been completed. 2015-16 has seen more of these state highway conversions completed.

Moderate to minor asset management decisions are left in the hands of management. These decisions tend to be influenced more by technical knowledge than overarching fiscal or policy matters. As an example, these items include the preparation of methodologies to set internal performance criteria, the inclusion of new techniques and products (within approved budgets) that enhance the performance of the network, and any decision that has a low fiscal and/or reliability impact on the consumers and customers served by EA Networks.

EA Networks' management has responsibility for the day-to-day management of the company and its assets and for carrying out company policies. They are therefore the "owners" of the Plan - responsible for its creation and for using it as a tool for improving the efficiency and effectiveness of the management of EA Networks' assets.

## 1.7 Asset Management Drivers

The factors that drive asset management activities and their relationship to EA Networks' performance are derived from the external performance required of EA Networks by its consumers, staff (including contractors), shareholders and the public.

EA Networks' 2015 Statement of Corporate Intent identifies the following objective:

***"To operate a sustainable business providing an electricity distribution network and related activities that delivers electricity in a safe, efficient, reliable and environmentally responsible manner to all classes of consumer in the Ashburton District, subscribing at all times to the wider social, environmental and economic values of the community.***

***EA Networks will consider involvement in broader focussed infrastructure projects that demonstrate benefit to existing shareholders and the wider community.***

***We will continue to follow the co-operative business model to provide services at a quality that reflects consumer demand and share the benefits, including efficiency gains, with consumers through having the lowest sustainable cost to consumers."***

This statement encompasses all of the drivers that have been determined for this plan which are as follows.

### 1.7.1 Safety

Safety is determined by a combination of asset design, asset location, maintaining the assets in a safe condition and the use of safe operating and work practices.

The Electricity Act 1992 (Reprinted 1 January 2014), section 61A sets out requirements for companies such as EA Networks to provide a public safety management system (PSMS).

The PSMS requires all practicable steps to be taken to prevent the electricity supply network from presenting a significant risk of:

- Serious harm to any member of the public
- Significant damage to property owned by someone other than the electricity generator or distributor.

The Electricity Safety Regulations 2010 (reprinted 1 August 2014), Regulations 47 to 56 set out the application detail of the PSMS and that it shall comply with either NZS 7901 or Regulations 49 and 50. The regulations required that the PSMS was in place and audited by 1 April 2012. EA Networks fulfilled this requirement.

The Electricity Safety Regulations 2010, the Health and Safety in Employment Act 1992 and the Health and Safety in Employment Regulations 1995 contain additional legal drivers for EA Networks' safety related asset management. These standards require EA Networks to operate as a reasonable and prudent operator.


The Electricity Regulations 2010 have a realigned focus and are less prescriptive than previous versions. The emphasis is now on risk analysis for safe outcomes of design and operation rather than general technical requirements and considerations for new lines and substations are couched in language that reflects that.

The Regulations also require existing assets to be maintained in good order and repair to assure high immunity from danger.

The Building Act 1991 puts in place a building maintenance regime that is aimed at ensuring the existence of essential safeguards for the users of buildings; specifically that buildings are safe, sanitary and offer adequate means of escape from fire.



The Health and Safety in Employment Act 1992 and the Electricity Act 1992 (Electricity Amendment Act 1993 and Electricity Reform Act 1998) now dictate the legislative framework with a performance based regime which puts the onus on EA Networks as the employer and as a principal to take control for ensuring the safety of workers and others in the work place.

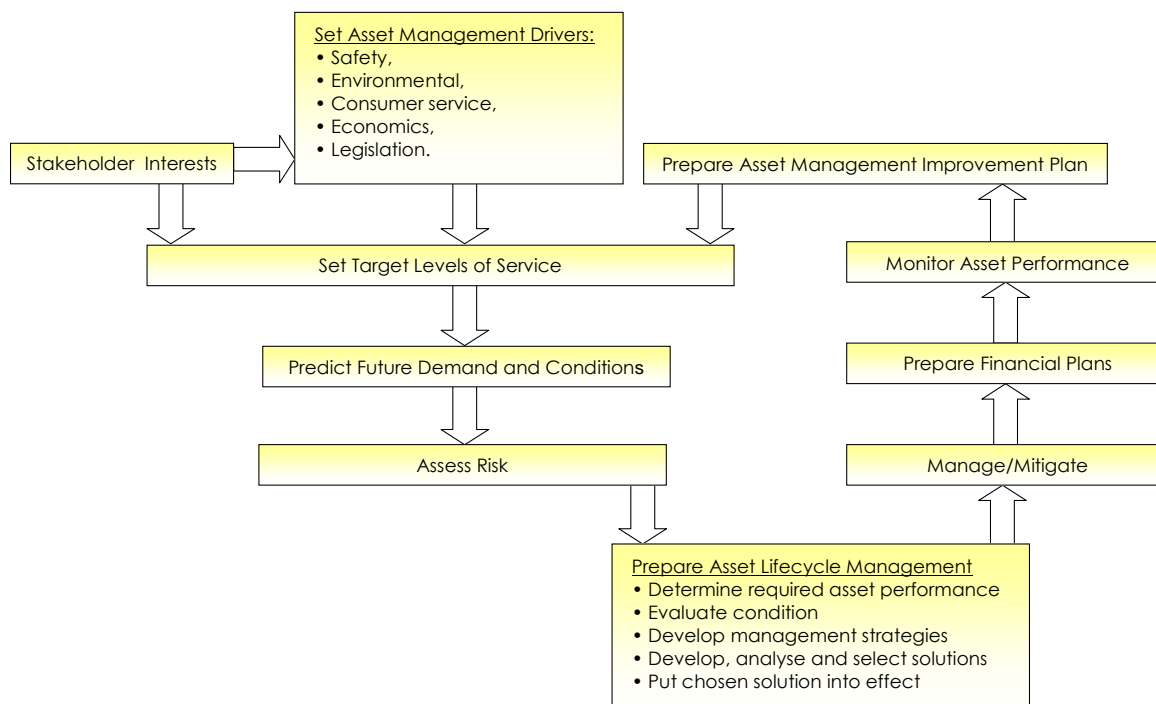

The Health and Safety in Employment Act's main objective is to provide for the prevention of harm to employees, contractors and subcontractors, who in EA Networks' case will be working on EA Networks equipment. EA Networks has the responsibility for putting in place preventive measures. The way in which EA Networks does it is discretionary, but the outcome is not.

During 2016, the Health and Safety at Work Act 2015 will come into force (4 April, 2016). The legislation has been enacted but the regulations that empower it have yet to be adopted. Once the regulations are enabled, the new act will be the principal means of providing oversight of health and safety in the workplace.

## 1.7.2 Consumer Service

EA Networks' consumer service objective is to manage the network reliably, efficiently and economically to meet the needs of its consumers.

### Capacity (i.e. Adequacy of Service)

EA Networks' policy is to provide sufficient capacity to meet current and future consumer's requirements, subject to satisfactory arrangements to cover the additional costs associated with any capacity additions required.

For asset management planning purposes, projected demands, security and capacity criteria are analysed assuming the additions and modifications to the network which have been projected in the plan take place.

Large step changes in load cannot be accurately forecasted, as these are often associated with large industrial projects whose promoters are notoriously loath to make firm commitments until the latest possible point in time. Nevertheless, EA Networks keeps up regular dialogue with these ventures whenever possible so that it can take potential changes into account when carrying out its regular planning activities.

## Reliability (i.e. Continuity of Service)

Reliability is a function of:

- Asset design, the most important mechanism being built-in equipment redundancy (referred to as the security level) so that, for example, failure of any one component does not lead to a supply outage.<sup>1</sup>
- Asset condition where this affects the likelihood of failure of a component.
- Efficient operation and maintenance practices (i.e. minimising the effects of planned equipment outages).

Within the network, EA Networks' policy is to focus expenditure on areas that give reliability improvements where the greatest benefits can be achieved for its consumers in the most economical manner. Generally this involves focusing attention on distribution automation to reduce restoration times. This includes the installation of:

- Modern reclosers for automatic fault isolation; and
- Remote controlled disconnectors, gas switches and ring main units for fault indication and sectionalising.

## Transient Effects

Where problems are identified in relation to short-term voltage variations, EA Networks works with individual consumers to identify the best economic and engineering solution.

## Voltage Profile

The present terms and conditions of supply specify voltage levels and tolerances at points of supply.

EA Networks generally adopts the policy that the supply bus voltage will not vary from the nominal voltage by more than +3/-4% for supplies at 11kV or 22kV. The maximum voltage variation at a consumer's LV connection point is  $\pm 6\%$ . Specific values are agreed with individual consumers where required.

## Power Quality

With the rapid development of modern irrigation systems incorporating variable speed drives, EA Networks has experienced a rapid increase in harmonic levels on its network. This was accentuated in some areas where load growth occurred on relatively weak parts of the network with lower than current design fault levels. EA Networks has put in place a standard for connecting new loads which requires the limitation of harmonic current generation to acceptable international standard levels. EA Networks have implemented a subsidy scheme to encourage existing variable speed drive users to mitigate the harmonic distortion they create on the distribution network. A generous 50% subsidy of the cost of a suitable filter is available for the first year and this subsidy reduces to 25% over the following years in conjunction with the introduction of a differential (more costly) tariff for non-compliant installations. This scheme gives incentives which fairly and economically encourage consumers to correct existing loads to acceptable levels. It is envisaged that after this "grace" period, where consumers are incentivised to comply, EA Networks will require disconnection if the installation remains non-compliant after 1 October 2018.

### 1.7.3 Economic Efficiency

Economic efficiency is an important driver for maintenance and development work. A large proportion of repair work, refurbishment, and asset replacement work is undertaken only after economic analysis to determine the most cost-effective solution. This frequently involves the choice between a development option and continued maintenance.

<sup>1</sup> This is referred to as an **n-1** security level. Security in which failure of a single component causes a supply outage is referred to as "**n level**" security, while design which allows for any 2 components to fail without causing a supply outage is referred to as **n-2**.

## 1.7.4 Environmental Responsibility

EA Networks' policy is to act in an environmentally responsible manner and as required under legislation.

The Resource Management Act 1991 is a major legal driver for EA Networks, now supplemented by the Hazardous Substances and New Organisms Act 1996. The provisions relating to the discharge of contaminants into the environment, the duty to avoid unreasonable noise and the duty to avoid, remedy or mitigate any adverse effect on the environment are of particular relevance to EA Networks.

## 1.7.5 Corporate Profile

Many of EA Networks' network line assets, distribution substations and some zone substations are in high public profile areas and the design/condition of these assets reflects on the public perception of EA Networks as a responsible manager of local assets. Similarly, the condition of assets is readily observable by consumers who have a strong vested interest in their reliability. Owing to its co-operative structure, many customers have a sense of ownership of EA Networks and its assets.

Maintenance programmes recognise the need to preserve visual appearance in conjunction with economic and efficient management. For example, a review of the land around substations has shown that appearances are largely reasonable and only a few can be improved and maintenance costs reduced by appropriate landscaping and/or revising the land usage.

EA Networks' policy is to develop and maintain assets in a way that reflects well on the organisation, and to adopt a socially responsible attitude towards community impacts. While this is not a major driver of asset management work, it is a consideration in all work.

## 1.7.6 Legislative Compliance

Although implicit in the philosophy of the company, the accomplishment of legislative compliance can be greatly assisted by documenting its interaction with the management of the assets of an electricity lines business. Achieving compliance with legal obligations under the following legislation (and all other legislation – the list is not exhaustive) is a driver for our asset management activities:

- Building Act 2004
- Civil Defence Emergency Management Act 2002
- Commerce Act 1986
- Companies Act 1993
- Consumer Guarantees Act 1993
- Electricity Act 1992 & amendments 1993, 1997, 2000, 2001(1), 2001(2)
- Electricity Industry Act 2010
- Electricity (Safety) Regulations 2010
- Electricity Reform Act 1998
- Electricity (Hazards from trees) Regulations 2003
- Employment Relations Act 2000
- Fair Trading Act 1986
- Financial Reporting Act 1993
- Fire Safety and Evacuation of Buildings Regulations 1997
- Fire Service Act 1975
- Hazardous Substances and New Organisms Act 1996
- Health & Safety in Employment Act 1992 & amendments 1993, 1998, 2002
- Health & Safety in Employment Regulations 1997

- Holidays Act 2003
- Human Rights Act 1993
- Injury Prevention, Rehabilitation and Compensation Act 2001
- Local Government Act 2002
- Minimum Wage Act 1983
- NZ Electrical Codes of Practice
- Parental Leave and Employment Protection Act 1987
- Privacy Act 1993
- Resource Management Act 1991
- Sale of Goods Act 1908
- Smoke Free Environments Act 1990
- Taxation Legislation
- Wages Protection Act 1983

## 1.8 Asset Management Processes and Systems

The electricity distribution system is comprised of assets with long lives. The management of these assets (comprising maintenance of existing assets and development of new assets) is EA Networks' primary focus in providing an effective and efficient distribution service to its consumers. Further, because distribution is only one part of an integrated electricity system, consultation and co-ordination of plans is an essential ingredient for the effective functioning of that system.

This plan is an annually produced plan covering the next 10 years and documents likely or intended asset management requirements. The plan provides a focus for on-going analysis within EA Networks aimed at continuously improving the management of the distribution system and it provides a vehicle for communicating Asset Management Plans with consumers.

In many cases, particularly where asset development is involved, the work will be driven directly by consumer requirements and associated financial commitments. This plan is based on EA Networks' present understanding of its consumers' requirements. It is part of the process of communication with consumers and EA Networks will be responsive to consumer input, with regard both to actual expenditure commitment and to long term future planning.

### Asset Management Processes Appraisal

Process	Current Business practice	Desired Business Practice
Level of service	<ul style="list-style-type: none"> <li>• Most performance standards in place.</li> <li>• Consultation undertaken in association with specific developments and enhancements requested by consumers.</li> <li>• Shareholder/consumer input via Board and Shareholders' Committee.</li> </ul>	<ul style="list-style-type: none"> <li>• Complete range of performance measures.</li> <li>• Additional logic for service level review process implemented.</li> <li>• Regular consumer feedback &amp; consultation.</li> <li>• Greater understanding of consumer preferences.</li> </ul>
Knowledge of Assets	<ul style="list-style-type: none"> <li>• New as-builts are entered into GIS for location and quantity after construction.</li> <li>• Some extra data capture for validation of RAB database occurs.</li> <li>• Attribute and condition information collection process from maintenance activities not comprehensive.</li> </ul>	<ul style="list-style-type: none"> <li>• Process for collection of maintenance data.</li> <li>• Proposed work documented in a way that permits as-built GIS records to be created without re-entry of data.</li> </ul>
Condition Assessment	<ul style="list-style-type: none"> <li>• Minimal condition feedback requirement from contractors.</li> <li>• Routine maintenance inspection.</li> <li>• Testing of specific sites undertaken where performance is suspected to be outside targeted level of service.</li> </ul>	<ul style="list-style-type: none"> <li>• Enhance programme for condition assessment of critical assets.</li> </ul>
Risk Management	<ul style="list-style-type: none"> <li>• Fundamental Risk Analysis is concluded but not refreshed regularly.</li> </ul>	<ul style="list-style-type: none"> <li>• Establish review process to monitor risk - closing the loop.</li> </ul>

	<ul style="list-style-type: none"> <li>• Critical assets monitored, failure modes and effects understood and used for contingency planning and asset management prioritisation.</li> </ul>	<ul style="list-style-type: none"> <li>• Complete risk management contingency plans.</li> </ul>
Accounting/ Economics	<ul style="list-style-type: none"> <li>• Financial systems record costs against maintenance activities.</li> <li>• Maintenance expenditure not allocated against individual assets.</li> <li>• Valuation based on ODV principles.</li> </ul>	<ul style="list-style-type: none"> <li>• Forecast renewals used to measure the drop in service potential.</li> <li>• Robust process for tracking and reviewing projects and asset groupings.</li> </ul>
Operations	<ul style="list-style-type: none"> <li>• Substantial documentation of operational processes.</li> <li>• On-going training of operators.</li> </ul>	<ul style="list-style-type: none"> <li>• On-going training/updating programme.</li> </ul>
Maintenance	<ul style="list-style-type: none"> <li>• No formal contractual relationship with in-house service providers.</li> <li>• Unit rates used for internal work.</li> </ul>	<ul style="list-style-type: none"> <li>• Develop target pricing for all maintenance work with contractors.</li> <li>• Process for on-going review of maintenance needs and delivery.</li> </ul>
Performance Monitoring	<ul style="list-style-type: none"> <li>• System faults recorded by controllers.</li> <li>• Power quality monitoring at individual installations at consumer request or complaint.</li> <li>• Load loss monitoring at Grid entry points.</li> <li>• SCADA evolving beyond zone substations.</li> </ul>	<ul style="list-style-type: none"> <li>• Feeder metering via telemetry for few remaining unmetered zone substation feeders.</li> <li>• Greater range of performance standards for service delivery contracts.</li> <li>• Process for monitoring compliance of contractors with performance standards established.</li> </ul>
Optimised Life Cycle Strategy	<ul style="list-style-type: none"> <li>• Replacement of assets based on assessment by experienced staff.</li> <li>• No formal risk management strategies.</li> <li>• Statistical failure modes not well understood.</li> </ul>	<ul style="list-style-type: none"> <li>• Develop rolling 10-year renewal programme with budgets based on predicting failure for critical assets, replacement on failure of non-critical assets.</li> <li>• Life cycle and risk costs considered in optimisation process.</li> </ul>
Project Management	<ul style="list-style-type: none"> <li>• Contract management process in place.</li> <li>• Project management procedures reasonably well documented.</li> </ul>	<ul style="list-style-type: none"> <li>• Document project management procedures to optimise lifecycle costs established.</li> </ul>
Asset Utilisation	<ul style="list-style-type: none"> <li>• Capacity of network assessed by load flow monitoring and computer modelling.</li> </ul>	<ul style="list-style-type: none"> <li>• Introduce real-time load flow analysis (state estimation).</li> </ul>
QA / Continuous Improvement	<ul style="list-style-type: none"> <li>• Some inspection of work undertaken but no formal process for quality assurance of decision-making; management procedure and data.</li> </ul>	<ul style="list-style-type: none"> <li>• System of quality checks on all key asset management activities in place.</li> </ul>

The plan is also intended to demonstrate responsible stewardship of assets by EA Networks to its consumers and shareholders. The plan shows the maintenance and replacement requirements which are intended to maintain the operating capability of the system over the long term. Each year an audit is carried out which reviews EA Networks' achievement with respect to this plan.

This section broadly outlines EA Networks Network Division's current and desired asset management practices and specific improvement initiatives prior to discussing proposed asset management improvements ([section 9.6](#)).

To identify and prioritise the asset management practices and needs of the Network Division, asset management improvement tasks are discussed under broad headings of **Processes, Information Systems** and **Data**.

**Processes (above)** are the business processes, analysis and evaluation techniques needed for life cycle asset management.

**Information Systems** are the information support systems used to store and manipulate the data.

**Data** is required for effective decision making (i.e. for manipulation using information systems).

The following tables broadly describe the current EA Networks asset management practices and possible future (desired) business practices it is intended to ultimately develop. The Asset Management Improvement Plan ([section 9.6](#)) discusses improvement priorities, timetables and resources for the next 3 years.

## Asset Management Information Systems Appraisal

System	Current Business Practice	Desired Business Practice
Asset Registers	<ul style="list-style-type: none"> <li>• Current database is linked/part of GIS but integration is weak.</li> <li>• Asset database system established and working.</li> </ul>	<ul style="list-style-type: none"> <li>• Close integration of Asset database and GIS database as there are strong relationships between financial, GIS, asset management and disclosure.</li> </ul>
Financial System	<ul style="list-style-type: none"> <li>• Financial system adds financial transactions to assets.</li> <li>• Depreciation based on age of asset.</li> </ul>	<ul style="list-style-type: none"> <li>• Open financial system recording asset transactions and integrated well with other systems.</li> <li>• Maintenance costs allocated against individual assets in Asset Management System.</li> </ul>
Maintenance Management	<ul style="list-style-type: none"> <li>• Maintenance history of network equipment assets is being recorded.</li> <li>• Service Maintenance Management system in place.</li> </ul>	<ul style="list-style-type: none"> <li>• Critical and non-critical assets identified.</li> <li>• Service Maintenance Management system used for cyclic maintenance programmes.</li> </ul>
Condition Monitoring	<ul style="list-style-type: none"> <li>• Some basic condition monitoring systems for asset types.</li> <li>• SCADA system fully functional, reporting being developed.</li> <li>• Condition data is loaded in to Assets database.</li> </ul>	<ul style="list-style-type: none"> <li>• Condition monitoring systems extended for key assets.</li> <li>• Predictive modelling capability available for critical assets.</li> <li>• SCADA system fully functional and data integrated with other systems.</li> </ul>
Consumer Enquiries	<ul style="list-style-type: none"> <li>• Limited records of consumer enquiries.</li> <li>• No computerised consumer service system.</li> </ul>	<ul style="list-style-type: none"> <li>• Electronic record of consumer enquiries.</li> <li>• Asset links to consumer enquiries.</li> </ul>
Risk Management	<ul style="list-style-type: none"> <li>• No risk component in the Asset Management System capability.</li> <li>• Stand-alone risk assessments.</li> </ul>	<ul style="list-style-type: none"> <li>• Failure modes, and probabilities and risk cost available from Asset Management System.</li> </ul>
Optimised Renewal Strategy	<ul style="list-style-type: none"> <li>• Renewal on systematic basis.</li> <li>• Life cycle costs taken into account in assessing renewal options.</li> </ul>	<ul style="list-style-type: none"> <li>• Renewal strategy in place.</li> </ul>
Forward Works Programme	<ul style="list-style-type: none"> <li>• 10-year forward maintenance and renewal forward programmes based on historical/condition data.</li> <li>• Development needs based on known future demands and IRR.</li> </ul>	<ul style="list-style-type: none"> <li>• Optimised future costs based on various scenarios.</li> </ul>
Integration of Systems	<ul style="list-style-type: none"> <li>• Limited integration of consumer database, Service Maintenance Management System or Asset Management System.</li> </ul>	<ul style="list-style-type: none"> <li>• Full interoperability between all systems to allow additional knowledge extraction from existing data.</li> </ul>
Plans and records	<ul style="list-style-type: none"> <li>• Overhead records all entered into GIS.</li> <li>• Underground records scanned and being vectorised gradually</li> </ul>	<ul style="list-style-type: none"> <li>• Fully digital record system allowing on-line access and linkages to other databases and systems.</li> </ul>
Operations and Maintenance Manuals	<ul style="list-style-type: none"> <li>• Some dependence on worker knowledge.</li> <li>• Operations well documented for access to network by others.</li> <li>• Maintenance manuals for limited number of zone substations.</li> </ul>	<ul style="list-style-type: none"> <li>• Basic manuals available for all significant assets.</li> </ul>
Levels of Service	<ul style="list-style-type: none"> <li>• Reported continuously by "Faults" system but entered manually.</li> <li>• No non-electrical performance measures logged in real-time.</li> </ul>	<ul style="list-style-type: none"> <li>• More complete performance analysis from real-time "Faults" system.</li> <li>• Automated entry into "Faults" system.</li> </ul>
Failure Management Plans	<ul style="list-style-type: none"> <li>• Procedures for operational activities documented.</li> </ul>	<ul style="list-style-type: none"> <li>• Complete procedures for systems failure documented.</li> </ul>
Asset Management Plans	<ul style="list-style-type: none"> <li>• Documented Asset Management Plan process but not sufficiently widely read.</li> </ul>	<ul style="list-style-type: none"> <li>• Mature Asset Management Plan used for forward planning and stakeholder consultation.</li> </ul>
Geographical Information System	<ul style="list-style-type: none"> <li>• All major assets have been captured into the GIS.</li> <li>• Present GIS is no longer supported.</li> <li>• Deployment of new GIS system has commenced.</li> </ul>	<ul style="list-style-type: none"> <li>• Open, standards based GIS system fully supported and with a future upgrade path.</li> </ul>

## Asset Management Data Appraisal

Data	Current Business Practice	Desired Business Practice
Asset Classification	<ul style="list-style-type: none"> <li>• Network asset hierarchy established.</li> <li>• Asset categories identified for asset cost records.</li> </ul>	<ul style="list-style-type: none"> <li>• Coherent multiple-use categorisation established to satisfy Disclosure, Valuation, AMP, Tax, and other uses.</li> </ul>
Asset Identification	<ul style="list-style-type: none"> <li>• Unique ID numbers allocated in Asset database and/or GIS system for all major network assets.</li> </ul>	<ul style="list-style-type: none"> <li>• Comprehensive asset register.</li> </ul>
Asset Textual/ Spatial Data	<ul style="list-style-type: none"> <li>• Quality and completeness satisfactory.</li> </ul>	<ul style="list-style-type: none"> <li>• Appropriate spatial/textual data available on GIS/plans.</li> </ul>
Maintenance Tasks	<ul style="list-style-type: none"> <li>• Check sheets for Zone Substations and other major assets.</li> </ul>	<ul style="list-style-type: none"> <li>• Documented maintenance tasks for network.</li> <li>• Documented maintenance programmes for Zone Substations.</li> </ul>
Historical Condition & Maintenance Data	<ul style="list-style-type: none"> <li>• Limited history available for some assets, but "Assets" system now storing all available data.</li> </ul>	<ul style="list-style-type: none"> <li>• Full maintenance data history in Asset Management System used for maintenance scheduling.</li> </ul>
Future Prediction Data	<ul style="list-style-type: none"> <li>• Predicted future growth data limited.</li> <li>• Simulated future load flows from computer model based on theoretical growth.</li> </ul>	<ul style="list-style-type: none"> <li>• Simulated future load flows from computer model based on growth predictions.</li> <li>• More authoritative future load growth data.</li> </ul>
Life Cycle Costs	<ul style="list-style-type: none"> <li>• Life cycle costs not collected.</li> </ul>	<ul style="list-style-type: none"> <li>• Life cycle cost data used for renewal decision-making.</li> </ul>

### Network Operational Support

EA Networks uses the internal contracting division as its preferred maintenance contractor for all network associated inspection, servicing and testing, faults response, fault repair, maintenance, replacement and network enhancement. Some development and maintenance work is put out to external tender where internal capacity or expertise is insufficient or alternatively the contracting division may arrange sub-contractors to assist.

### Information Systems Development

The network division has developed the "Assets" system, which is used to record and manage a range of assets. It was anticipated that this system would form the core data repository for current and historical data. A recent decision has been made to migrate the asset information into an asset register module of the financial system. The new financial system shows much more promise as a partner for asset management than the previous legacy system. These advances should help track expenditure by activity, asset type and other categories.

The capture of asset information has been carefully considered and EA Networks are content that the level of detail and accuracy presently stored is close to optimal. Additional information could be gathered, but the cost/benefit ratio for doing so is not particularly favourable.

The current "Assets" system records information about a range of equipment including transformers, substations, switchgear (HV and LV), ICP's, miscellaneous assets such as battery chargers and relays etc. Ancillary to "Assets" is a "Faults" system that records interruptions, a "Competency" register that records an individual's competency for tasks that need to be performed on the network. The range of data managed is expanding on a regular basis.

The GIS system installed at EA Networks is called Power-View. This system is very "open" and all its data is accessible by other applications (including Assets). EA Networks have captured all of the primary asset information via this system from work-plans and maps. The data is being used for RAB and asset management. In conjunction with "Assets", Power-View keeps information on types of equipment installed at a site. "Assets" records details of assets and tracks maintenance history of transformers and other associated equipment. The Power-View and Assets databases are continually expanding to accommodate new sources of information. EA Networks can geographically locate any uniquely identifiable asset via Power-View and Assets can provide all available data on that asset.

The Power-View GIS system has gone "end-of-life". That is, the product is no longer being developed and it is anticipated that it will become less compatible as underlying operating systems move on. EA Networks have selected and purchased a replacement product, initially implementing it to capture the fibre optic network. Electric network configuration, modelling and conversion will take place by April 2016.

The GIS system provides users information which is drawn from data stored in many different systems. Information from external agencies, "Assets", GIS, GPS units, and other open data sources can be drawn together for a spatial view of data that can reveal previously hidden relationships. It is hoped to integrate the "Faults" system to the new GIS so that spatial analysis can be performed on fault statistics.

The linking together of GIS, asset management and the financial system will enable data concerning networks assets to be accessed in a multitude of ways and from multiple applications, resulting in better decision making processes.

EA Networks have a range of in-service systems available for asset management and some are more capable than others. The main systems/applications that are in use are:

### Network Information Systems Description

System/Application	Capabilities
Asset Management System	Designed and built by EA Networks. It offers a closely customised solution for storing and analysing detailed asset information. The system lacks integration with other key decision software, GIS and financial software. A decision has been made to replace the in-house designed assets management system with an off the shelf asset management system which integrates with GIS and the financial system.
GIS Asset Mapping System	Power-View has proven to be a very effective GIS capture and storage application. It is now end-of-life and its replacement is being implemented. Open data storage enables access by many other GIS tools for detailed analysis. Data linking and exchange with other systems is very simple.  Data is complete, consistent and spatially fit for purpose. More complete and higher performance electrical connectivity analysis tools would vastly increase the value and use of the data.
SCADA System	Fully operational. Expansion continues. The SCADA system is capable and will undoubtedly boost network performance over time. Extended development time has hurt EA Networks' historical performance.  Archival data capture, storage and analysis still requires enhancement.
Work Management System	System is part of enterprise resource planning system which includes the financial system. Replacement asset management system will integrate work management system.  Data is captured for all projects and will permit reporting in multifaceted ways. Consistent categorisation of work for disclosure is still challenging at times.



Financial/Accounting System	<p>System is in place and detailed reporting will permit useful insights. The use of an industry standard database engine will lead to better integration/availability of data.</p> <p>Until GIS, asset management and financials are integrated, analysis is challenging and maximum benefit cannot be achieved.</p>
Network Modelling and Analysis	<p>DlgSILENT and ETAP Powerstation software are easy to use and provide for day-to-day analysis of network fault levels and power load flows. Future prospects for real-time analysis exists and integration by linking with SCADA and GIS for interruption planning and fault restoration is possible.</p> <p>Network models are prepared as required. The overhead of maintaining a complete model in an accurate state cannot be justified. Future GIS may allow direct linkage and provide a useable model without additional data entry.</p>
Connection System	<p>All connections are recorded and linked via unique identifier to the Assets system and GIS. History of connection changes and occupation are available as is the interruption history, which is integrated with the faults system.</p> <p>Data is complete and as accurate as required. Access is readily available and widely used.</p>
Fault Recording System	<p>All interruptions, both planned and unplanned, are recorded in this system and a full history is available that permits anytime calculation of performance indices and any other parameter of interest.</p> <p>Data is reasonably complete. Additional benefit would derive from data capture of fault location to the nearest pole or faulted asset.</p>
Standards Documentation System	<p>There is a minimal intranet based system for storing documentary standards. A more robust and substantial system is being implemented to provide a framework for storing and accessing documentation as it is developed.</p> <p>A system is being installed that will allow storage and access to a wide range of documentation. As it develops, the desire to commit more information to standards will grow.</p>
Public Safety Management System	<p>As required by legislation, a safety management system has been implemented. The supporting processes and systems for the PSMS will help underpin other necessary systems that have historically lacked robust structure.</p>

### Specification, Procedures and Manuals

EA Networks has spent considerable effort in preparing a set of drawings which provides information to staff and contractors on EA Networks standard overhead line and underground cabling construction techniques. Further work is still required to extend these publications into documented design standards. Documentation for levels of competency, Network Releases and access to sites is now complete but additional work is still required to provide a completely integrated approach.

Procedures have also been completed which are deemed to be mandatory for contractors who wish to carry out work for EA Networks or on EA Networks' network.

EA Networks licensed a set of procedures and standards from PowerCo which assisted in initially

developing the significant quantity of documentation required to support asset management and a Public Safety Management System (PSMS). This initiative helped overcome the historic difficulties EA Networks have experienced with high load growth causing rapid network development which prevented adequate resource being available to develop documentation. EA Networks have transitioned away from the PowerCo documents and dedicated staff are developing standards that better suit EA Networks.

## 1.9 Responsibilities

Within the network division of EA Networks, staff are allocated distinct responsibilities for asset management functions. The Network Manager oversees the process and takes direct responsibility for the asset decisions which are made. The size of EA Networks requires multiple responsibilities by all staff and this helps to provide perspective on many tasks and assets that would otherwise quickly become foreign.

The modest scale of EA Networks means that planning/analysis/asset management/design/procurement/standards are all managed by a small core team of personnel. There are no 'departments' that separately handle these functions and consequently there is no distinct structural separation.

The entire network group work in close proximity in an open plan environment. This working arrangement encourages the free flow of information and ideas between members of the group and encourages the dissemination of information. A fortnightly "Engineering Meeting" is an open forum for discussing all aspects of asset management, work processes, ideas and the general dissemination of information. The communication paths established and the relatively small number of people involved in the asset management process alleviates the need for some of the formal documentation that would be required in a larger organisation.

The key staff have the following responsibilities specific to asset management, although these are also shared to some extent:

### **Network Manager:**

- Electricity network information systems - development and maintenance
- Network valuations - preparation and maintenance
- Overall responsibility for asset management and asset performance

### **Operations Manager:**

- Network operations – day to day network control and performance
- Vegetation control management
- Network performance – capture, analysis and disclosure of faults statistics and consequently offering engineering recommendations for improvement or investigation of equipment
- SCADA development, maintenance, operation, enhancement and expansion
- Graduate engineer management

### **Planning Engineer:**

- Network planning – preparation, analysis and documentation of medium-long term and medium-large scale network development
- Electrical protection – design, specification and procurement of major equipment
- As-built records – capture, documentation and recording of records as they are returned
- Zone substation – conceptual design, detailed design, major equipment specification and procurement
- Engineering analysis – incidental load-flow and fault analysis (shared responsibility)
- Preparation of Asset Management Plan
- Geographic Information Systems – development and maintenance
- New technology – investigation and analysis

**Project Manager (Overhead and Underground):**

- Scheduling and management of underground cable projects
- Scheduling and management of overhead line projects
- Network stores management
- 11kV to 22kV conversion design and management

**Projects Manager:**

- Overhead lines – detailed design and maintenance
- Distribution equipment – procurement and specification
- New connection interface – network design and specification

**Engineering Safety Advisor:**

- Personnel competency – documentation of individual competencies
- Safety and Training – management of the safety and training regimes run by EA Networks
- Public Safety Management System (PSMS) – coordination of implementation

**Senior Network Engineer:**

- Performance monitoring and analysis of network
- Reporting and analysis of network and planning options using engineering software (load-flow and fault analysis)
- Power quality investigation and analysis
- Preparation of documented standards for areas of responsibility
- Electrical protection – settings, maintenance planning and test plans on various equipment

**Substation Manager:**

- Zone and distribution substations – maintenance planning
- Distribution transformers – specification and procurement
- Substation construction – project management

**Underground Manager:**

- Underground cables – detailed planning, design and maintenance
- Subdivision development electrical reticulation negotiations and design
- Land interests and requirements – negotiation, procurement and maintenance

## **1.10 Information Sources, Assumptions and Uncertainty**

As a forward looking planning document, this publication relies on a considerable pool of information sources, assumptions, opinions and known facts. Other than facts, all of these considerations have a degree of uncertainty associated with them which needs to be at least described and where ever possible quantified.

### **1.10.1 Information Sources**

It is impractical to list every source of information used to prepare this document. The items listed below represent the principal foundations upon which this plan is built. They are:

- EA Networks' 2015 Statement of Corporate Intent.
- EA Networks' 2015-16 Business Plan and Budget.

- EA Networks' Use of System Agreement.
- EA Networks' New Connections and Extensions Policy (22 March 2013).
- EA Networks' 2015 Shareholders Committee Report.
- EA Networks' October 2015 Consumer Engagement Survey Report.
- EA Networks' large user consumer interviews.
- EA Networks' Asset database.
- EA Networks' Consumer Connections database.
- EA Networks' equipment loading records.
- Retailer's generation and energy consumption data.
- Retailer's reports on EA Networks performance.
- Transpower's and EA Networks' GXP energy data.
- Transpower's disclosed development documents.
- Ashburton District Council's District Plan.
- Ashburton District Council population projections.
- Environment Canterbury's strategy and policy documents as they relate to home heating and water availability for irrigation. Resource consent data (water) is also supplied from this source.
- EA Networks' internal discussions regarding commercial and technical options for managing security, reliability, increased load and the value of these considerations.
- External discussions with existing and prospective consumers regarding new electrical load and/or security requirements.
- Correspondence with shareholders (consumers) regarding issues that can be addressed within the scope of asset management techniques.
- Documents by The Treasury such as "Half Year Economic and Fiscal Update 2015".

### 1.10.2 Significant Assumptions

It is important for stakeholders that the manner and the basis upon which the Asset Management Plan is intended to operate is clearly understood. For the purposes of clarity, and in order to avoid any confusion, the following underlying assumptions need to be taken into account by the stakeholders in dealing with the Asset Management Plan:

- As a Lines Business, EA Networks will continue to be a going concern under the regulatory regime in place now or in the future.
- Asset Management, System Control and Corporate Services functions will be provided internally and be based in Ashburton.
- EA Networks will have access to skilled and experienced staff.
- The Lines Business will continue to operate an internal Contracting Division.
- The Lines Business must satisfy the twin constraints of providing a risk-adjusted normal profit for its shareholders sufficient to retain investment, while performing within the regulatory limits set by government regulations.
- The prevailing regulatory and legislative requirements mandated by central and local government remain unchanged for the duration of the planning period. This ensures that the environment which influences reliability targets, as well as governing industry codes of practice, health and safety, design and environmental standards is stable.
- The predictions and estimates of load growth are timely, and of reasonable and prudent scale. This ensures that the level of investment to cope with additional load is not unreasonably small or

large and occurs in advance of the additional demand occurring.

- The availability of ground water for irrigation will not increase above that presently consented in ECAN 'red-zoned' aquifers.
- There are no significant unidentified errors or omissions in the internal records and databases (they contain suitably accurate information).
- The focus, policies and key business strategies of EA Networks remain consistent for the duration of the planning period.
- The value of future projects and programmes is not affected by the value of the New Zealand Dollar or the cost of constituent raw materials (particularly copper, aluminium, steel and oil) by more than the official rate of CPI. In reality these costs will change. The impact of these changes will be reflected within 12 months when a subsequent plan is issued with updated cost projections.
- Wage rate movements are not significantly greater than the prevailing CPI. Skill shortages and wage/availability pressures around the Christchurch rebuild could be an issue.
- The availability of sufficient capacity (as described by projected load growth in this plan) from both the existing Ashburton GXP and any new Transpower Grid Exit Point will not be unreasonably constrained by 220kV operational limits. This applies under steady state and fault conditions.
- The Transpower charging methodology of regional coincident maximum demand remains and the peak occurs during winter. Consequently, load management of summer peaking consumers (such as irrigation pumps) has not been a necessary commercial consideration.
- The consistent pattern of responses exhibited by consumers surveyed annually by EA Networks continues in future surveys. This will ensure satisfaction, expectations and willingness to fund improved reliability remain within narrow bounds and do not fundamentally change the current asset management strategies.
- The EA Networks network is not exposed to extraordinary natural disasters during the planning period. In particular, events such as a major earthquake caused by a rupture of the Alpine Fault, further Canterbury earthquakes, a massive flood of record proportions, a snowstorm of record proportions, or a windstorm with sustained speeds exceeding 140 km/h (900 Pa). Any of these events is outside the reasonable design parameters for the electricity network to survive without significant damage.
- The impact of electric cars on peak demand is not significant during the planning period. The moderate initial uptake of electric cars due to high cost is likely to dampen the initial impact on the network. It is also inevitable that they will be subject to some form of load control. The option to source stored energy from electric cars into the network has not been considered as viable during the planning period.
- A review of any of the District Plans covering the EA Networks network does not materially affect the ability of EA Networks to manage the network assets using the strategies outlined in this plan.
- Any distributed generation that is commissioned during the planning period is of sufficiently small scale as to not materially affect the demand estimates or permit the postponement or cancellation of any planned projects or programmes.
- The climate during the planning period is within the normal range of precipitation, temperature, wind speed and humidity. Significant changes in any of these parameters could not only affect the assets but also the characteristics of electricity demand placed on those assets.
- The changing retail cost of electricity does not materially affect the rate or pattern of consumption exhibited by consumers or groups of consumers representing significant demand on the EA Networks network.
- The international price of agricultural commodities remains similar to current values. This is particularly relevant to dairy products and irrigated crops. A major drop in price could see less irrigation demand and a major increase in price could see a dramatic increase in irrigation demand.
- No significant agricultural event, such as an outbreak of foot and mouth disease occurs, which could materially affect the value of agricultural production in Mid-Canterbury.

- The performance characteristics of technologies and equipment types new to the EA Networks network are as represented to EA Networks during the approval process. History has shown that on rare occasions vendors have misrepresented the products they sell (generally unknowingly). EA Networks have an expectation that any such technology or equipment performs as specified.

### 1.10.3 Future Changes to the Distribution Business

Any change in the scale, scope, structure or focus of EA Networks as an electricity lines company could considerably affect the validity of many information sources and assumptions used to prepare this plan.

There is no intention to change the ownership or structure of the electricity lines company that is EA Networks. As such, all of the prospective information and assumptions used here are consistent with the current scale, scope and structure of EA Networks.

For completeness, it should be noted that EA Networks are currently involved in two other utility projects:

- A fibre optic communications network. Initially for EA Networks' use as inter-substation communication, but also built with the intent of provision of broadband services to other users.
- A piped and gravity pressurised water distribution network for irrigation from the Rangitata Diversion Race.

The primary focus of EA Networks for the foreseeable future remains the electricity lines function.

### 1.10.4 Factors Affecting Information Uncertainty

The information sources that have been used in this plan are all subject to a greater or lesser degree of uncertainty. A high level of uncertainty in a parameter is not necessarily problematic unless the plan exhibits a high degree of sensitivity to that particular parameter. What follows is a description of the information sources that do have a moderate to high degree of sensitivity on the plan's projections and outcomes. Should the uncertainty prove to be significant, it could materially affect any comparison of predictions with future actual outcomes. The factors are as follows:

- The load growth is significantly greater or less than predicted in the plan.
- Water availability for irrigation significantly increases from either ground or storage sources.
- No significant agricultural event, such as an outbreak of foot and mouth disease occurs, which could materially affect the value of agricultural production in Mid-Canterbury.
- The regulatory environment changes, requiring EA Networks to achieve different service standards or different design or security standards. This could also affect the availability of funds for asset management.
- The regional coincident maximum demand occurs in summer. This could drive further investment in piped irrigation schemes as the increased cost of Transpower summer peaks discourages electricity usage.
- Consumer expectations change and/or they are prepared to pay a different amount for a significantly different level of reliability.
- A significant natural disaster occurs.
- Significant amounts of distributed generation are commissioned.
- Large and unforeseen loads require connection to the network.
- The uptake of electric cars is much faster and widespread than anticipated.
- The District Plans covering the EA Networks network introduce significant new restrictions or requirements on new or existing network.
- International markets for agricultural commodities boom or collapse causing changes in irrigation or processing industry demand.

- Advances in condition assessment and research in network planning generate additional development and maintenance requirements that are significantly different from current strategies.
- A major item of equipment may fail without warning requiring significant repair or replacement expenditure.
- The ownership of EA Networks may change with new owners requiring different service, design or security standards to meet business objectives not embodied in this plan.

### 1.10.5 Assumptions Surrounding Sources of Uncertainty

It is possible to subjectively quantify uncertainty and in some cases even objectively quantify uncertainty. Even if the actual degree of uncertainty is open to debate, the effect of the uncertainty can often be evaluated in a much more rigorous manner that establishes the sensitivity of the assumption to uncertainty and ultimately its impact on any information based on the assumption. What follows is a generalised description of the effects of uncertainty on the assumptions of [section 1.10.2](#).

Source of Uncertainty	Potential Effect of Uncertainty	Potential Impact of the Uncertainty
Load Growth	A general acceleration or deceleration in load growth would (as has happened in previous plans) advance or retard the enhancement and development project(s) that had been earmarked to accommodate it.	Low
Irrigation Water	If significant additional irrigation water sources were made available, the projected demand could increase well above the level expected during the planning period. The rate of increase could also be dramatic as the allocation is likely to be prioritised by the sequence of application. Significant additional network reinforcement (capital expenditure) would be necessary to support the extra load.	Medium – High (estimated 10-25% increase in capital expenditure depending on water quantity and location).
	Alternatively, a significant move from deep well pumped irrigation to gravity fed/surface water could result in significant load reductions. Retention of the deep well water consent and electrical connection could cause very large peaks in drought years – hidden/unused in average years.	Medium
Regulatory Environment	While the majority of network lines companies remain natural monopolies, it is highly likely that the level of regulation will persist at current levels or increase. Regulatory compliance costs are therefore likely to increase. The Regulator is best placed to quantify the likely impact.	Low
Regional Demand	If the regional demand peak period changes to summer, pressure would come on to control that peak. Presently the irrigation consumers have indicated they prefer to pay the peak penalty than accept load control. If peak charges increase, irrigators may accept control capping peak load. This would defer some scheduled capital expenditure.	Medium to High

Consumer Expectations	If the annual consumer survey reveals a change in service quality expectations and/or a preparedness to fund this change, the altered service levels would result in variations in capital expenditure.	Low
Natural Disaster	Widespread equipment damage (potentially irreparable) would require significant funding for repairs and replacements not allowed for in cost projections.	Low – Medium – High severity dependent
Distributed Generation	Widespread small scale distributed generation could cause localised issues that would need resolution as well as network wide issues. Depending upon generation availability it could defer some development costs. Small quantities of medium-large (0.5 – 5.0MW) individual distributed generators can generally be accommodated without major service level or network development cost implications.	Low
Large Loads	Large new loads (typically industrial) will change the load growth estimates by step amounts. Beyond the GXP, additional investment required to service a new load is typically borne by the new load. This funding can be in the form of a long-term contract requiring EA Networks to initially find the capital. This would change the capital cash-flow projected in the plan.	Low
Electric Vehicles	Rapid and widespread uptake of electric vehicles could require significant network development in dense urban areas. This would be new capital expenditure not allowed for in the plan.	Low – Medium (estimated 15-20% increase in capital expenditure)
District Plans	A dramatic change in the District plan rules or land zoning would typically only impact on new network (existing use rights would protect existing network). A tightened set of controls would increase new network capital cost.	Low
Commodity Prices	A significant rise or fall in agricultural commodity prices would raise or lower existing and new irrigation demand. This would in turn advance or defer planned network capital projects and programmes.	Low – Medium
Planning & Monitoring	The development and maintenance requirements differ from those currently projected, particularly for years 6-10 of the planning period and generally involving the 22kV, 11kV and LV networks.	Low
Equipment Failure	Widespread or major equipment failure and subsequent repairs or replacement are not factored into current projections. Largest individual item does not exceed 1% of network value.	Low
Ownership	An altered ownership structure or new owners outright could alter the business objectives of the company and therefore the drivers of this plan. This could result in significant changes to service levels and expenditure.	Low – Medium

Weather affects the fault expenditure through the level of storm damage experienced. As it is very difficult to predict weather patterns over a 12-month period, the budget for fault expenditure can only be an estimate based on historical averages and general knowledge of the asset condition.



The sensitivity of the network to storm damage has greatly reduced over the last 10 years as major subtransmission and distribution feeders have been progressively upgraded with better quality materials. A continuing distribution automation programme is reducing the amount of time and effort required for fault location and repair. Recent events with earthquakes in Canterbury show the unpredictability of major events and the extent of damage that can occur in a significant earthquake.

EA Networks is regulated using a default price-quality path under Part 4A of the Commerce Act 1986 that applies to 17 electricity distribution business in NZ. The price-quality path reset for a five year period from 1 April 2015 has the following components:

- The maximum prices/revenues that are allowed at the start of the regulatory period.
- The annual rate at which maximum allowed prices can increase – expressed in the form of CPI-X
- The minimum service quality standards (SAIDI&SAIFI) that must be met.

Penalties may incur for breaches of the price-quality path.

If prices are forced downward, costs will have to be reduced accordingly through reduced maintenance expenditure. The most likely area for attention would be that of Inspection, Servicing and Testing, as this has little immediate effect on system performance and can be deferred for short periods to smooth out expenditure.

GDP in the Mid-Canterbury area has a direct effect on EA Networks' revenue stream through increased demand from large consumers. It also has an indirect effect as secondary and tertiary level consumers in the commercial and domestic area expand. As for price control, any reduction in revenue must be reflected in cost savings or deferred maintenance if profitability is to be maintained.

Several major projects have been mooted for Mid-Canterbury over recent years involving irrigation, agricultural processing and industrial processing. Any large additional loads could require major system reinforcement with associated increased expenditure on development and enhancement projects. This activity would also highlight the potential shortage of skilled labour which could either delay or price-escalate projects. This expenditure will have to be at least partially funded by the end user, either as a capital contribution or through a longer term contractual arrangement. Maintenance expenditure will not be directly affected except insofar as competition for resources may slightly reduce the level of non-critical work carried out.

### 1.10.6 Price Inflation Assumptions

The majority of costs quoted in this plan are in 'constant price' 2016 calendar year New Zealand dollars (2016-17 financial year). There are some disclosures associated with the plan that require 'nominal dollar' values. In order to convert forecasts made in 'constant price' dollars to 'nominal dollar' values a set of assumptions must be made about future economic conditions. The obvious factors that would influence future costs include:

- The consumer price index (CPI)
- NZD/Foreign currency exchanges rates
- New Zealand labour rates
- International commodity prices (aluminium, copper, steel, oil, plastic etc)
- Export/import tariffs and taxes

Although all of these factors are valid, there are very few authoritative forecasts freely available for periods exceeding a few months to a year. The CPI actually includes most of the other factors to some degree. Consequently, EA Networks have decided that the only price inflator that will be factored into the 'nominal dollar' multiplier is the CPI forecast issued by the New Zealand Government Treasury at:

<http://www.treasury.govt.nz/budget/forecasts/hyefu2015>

This "Half Year Economic and Fiscal Update 2015" published in December 2015 includes a CPI forecast to 2020 and EA Networks will use the 2020 value of CPI for the following 6 years, extending the forecast to 2026. The values are as follows:

<b>Financial Year</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Treasury Forecast (%)</b>	2.1	1.9	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2
<b>Cumulative Price Inflation</b>	1.021	1.040	1.062	1.086	1.110	1.134	1.159	1.184	1.210	1.237

# LEVEL OF SERVICE

<b>Table of Contents</b>	<b>Page</b>
2.1 Introduction	53
2.2 Consumer Research and Expectations	53
2.3 Strategic and Corporate Goals	56
2.4 Network Service Levels	56
2.4.1 Target Level of Service	57
2.4.2 Forecast Level of Service	61
2.4.3 Significant Recent Events	62
2.5 Network Security Standards	63
2.5.1 Introduction	63
2.5.2 General	63
2.5.3 Transpower Grid Exit Points	64
2.5.4 Main Subtransmission Ring Systems	64
2.5.5 Radial Subtransmission	64
2.5.6 Zone Substations	65
2.5.7 22kV and 11kV Distribution System	65
2.5.8 Low Voltage System	65
2.5.9 Protection	66
2.5.10 Reliability by Design	67
2.6 Network Power Quality Standards	67
2.6.1 Steady State Voltage	68
2.6.2 Transient Voltage Disturbances	68
2.6.3 Harmonic Voltage and Current Distortion	68
2.7 Safety	69
2.8 Environmental	70



## 2 LEVEL OF SERVICE

### 2.1 Introduction

EA Networks is required by statute to take all reasonable precautions to secure continuity of service. A certain level of outages is inevitable and they occur in all utilities. As a predominantly rural electricity supplier with several townships it is not always reasonable to compare EA Networks directly with a predominantly urban supplier. It is EA Networks' goal to ensure that it continues to perform above the industry average for comparable line companies and it is targeting an on-going quality improvement with a consistent price path.

Service is about satisfying all stakeholders and this includes safety aspects and environmental responsibilities as well.

This section outlines stakeholder expectations, current, past and desired network performance, and goes on to detail service improvement solutions that are either proposed or have already been implemented.

### 2.2 Consumer Research and Expectations

In order to set reasonable security standard targets that are compatible with end user expectations, appropriate research must be carried out.

The needs of electricity users have changed greatly over the last decade or so with the rapid introduction of technology into the domestic market. Appliances from DVD players and personal computers to security and fire alarm systems are now commonplace in most homes and have greatly increased the sensitivity of householders to power outages and minor interruptions.

The degree to which modern society has come to be reliant on a secure supply of electricity was clearly demonstrated during outages in the Auckland area in recent years. While EA Networks' area cannot boast a similar level or density of critical business users, this perception is merely a matter of degree. The small gift shop owner in Ashburton, running on small margins and high overheads, is just as reliant on electricity to power cash registers and EFTPOS terminals as the largest multinational company is for power to its multi-storey tower office block. There is of course an argument that they both should have some degree of backup for critical systems (a UPS for the cash register, EFTPOS terminal and phone system would be sensible in the case of the small retailer).

EA Networks' 2015 Statement of Corporate Intent Objective (see [section 1.7](#)) details the governance philosophy of the business. This approach has been crafted by embracing the feedback received from the community of consumers that the company serves.

Words used in the Statement of Corporate Intent such as "efficient", "reliable" and "sustainable" are relative terms that are subject to personal perceptions. In turn, these perceptions must be viewed from the consumer's perspective, which must be actively sought.

A consumer engagement telephone survey had been undertaken annually since 2006. The most recent survey was in September/October 2015. The year-by-year consistency of results has resulted in a decision to conduct biennial surveys, 2014 was therefore omitted. These surveys were initially commissioned in response to Commerce Commission requirements along with a desire to gauge consumer responses to a number of issues. The results of the 2015 survey had a margin of error of  $\pm 4.9\%$  at the 95% confidence level. The 400 randomly selected consumers were split 70% urban (Sept 2013 : 72%), 30% rural (28%). The main results were as follows:

- 93% (88%) of the total sample accepted the idea of three planned outages a year.
- 77% (75%) of the sample accepted the possibility that planned outages could last an average of 5 hours.
- 71% (89%) of respondents who had experienced unexpected outages indicated supply had been restored within an acceptable timeframe.
- 36% (33%) of the total sample believed that up to 3 hours was an acceptable timeframe for supply

restoration.

- 3% (6%) of the total sample indicated that they would accept paying a slightly increased charge in order to ensure the timely restoration of supply following an unexpected outage.

A summary of the results of some of the survey questions is shown below.

Question	2006	2007	2008	2009	2010	2011	2012	2013	2015	0% ----- 50% ----- 100%
Acceptance of three planned outages per year.	88	90	95	89	93	90	83	88	93	
Acceptance regarding planned outages lasting on average five hours each.	65	73	76	66	72	71	72	75	77	
Advice received during the previous six months about a planned electricity outage.	5	14	11	11	10	7	9	7	14	
Satisfaction with amount of information and period of notice.	100	100	95	98	90	100	94	100	94	
Customers experiencing an unexpected interruption to their electricity supply during the previous six months.	21	36	44	43	25	18	35	63	23	
Time taken to restore electricity supply. < 2hrs	56	56	56	55	69	65	50	44	41	
<4 hrs	84	84	77	87	82	83	68	54	54	
Electricity supply restored within an acceptable timeframe.	83	85	88	89	91	86	75	89	71	
Accept slightly increased charge in order to ensure timely restoration of electricity supply following an unexpected outage	1	6	9	4	8	6	5	6	3	
Acceptance of 0-3 hours overall timeframe for supply restoration following an unexpected interruption	60	60	42	44	53	40	38	33	36	

Other opinions have also been sought relating to EA Networks' role in the community, on-property asset ownership and satisfaction in dealings with EA Networks. It is relevant that between the first two surveys a major snow storm had caused lengthy and widespread power outages that had affected virtually every EA Networks consumer. Somewhat surprisingly, the survey results showed little change in the opinion of the participants towards outages and restoration times.

### Managing Conflicting Stakeholder Interests


As a co-operative company, the vast majority of consumers are in fact shareholders (more than 99%) and they directly elect a Shareholders' Committee who in turn appoint the directors. When shareholder viewpoints are required, the Shareholders' Committee provides the effective voice for consumers/shareholders. Regular consultation occurs between the Board and the Shareholders' Committee where any issues that concern either party are discussed. Examples of the type of discussion that occur are:

- the cost implications of various network performance improvements (price/quality trade-off)
- the conflict of the differing scale of urban versus rural reliability/cost/capacity/aesthetic impact
- the balancing of asset management practices with potentially conflicting shareholder interests
- the path of proposed network development and the consumer price implications
- major projects that are proposed and the impact they will have on EA Networks and consumers
- the Statement of Corporate Intent and the associated Trend Statement which documents targeted financial and reliability performance indices into the future (the Shareholders' Committee receive/scrutinise the Statement of Corporate Intent)

The Shareholders' Committee provide a commentary on the performance of EA Networks for inclusion in the EA Networks Annual Report each year. In short, it appears to endorse the general direction of the company's performance. The company have taken this endorsement as concluding an appropriate method of reconciling stakeholder/shareholder interests and asset management practices.

Perhaps the most potential for tension tends to exist between owners and customers. The co-operative by its nature self-manages this to an extent, given that EA Networks' owners are also EA Networks' customers (generally). As such, if one group is favoured over the other, ultimately the same person benefits. The balance is between consumer service levels and shareholder financial return. Between the Shareholders Committee and the Board of Directors, the interests of these two groups are considered and managed appropriately.

When an obvious conflict between significant stakeholders' interests arises, the technical and political elements are separated. The technical options are conceptualised and approximate costs prepared along with the pros and cons for each option. These are presented to the Board for consideration alongside the political ramifications of the technical options that exist to address the conflict. Once in the realm of socio-political evaluation, the process of reconciling the technical and political aspects is left to the Board and Shareholder Committee to reach a consensus. The decision is then passed back to management for implementation.

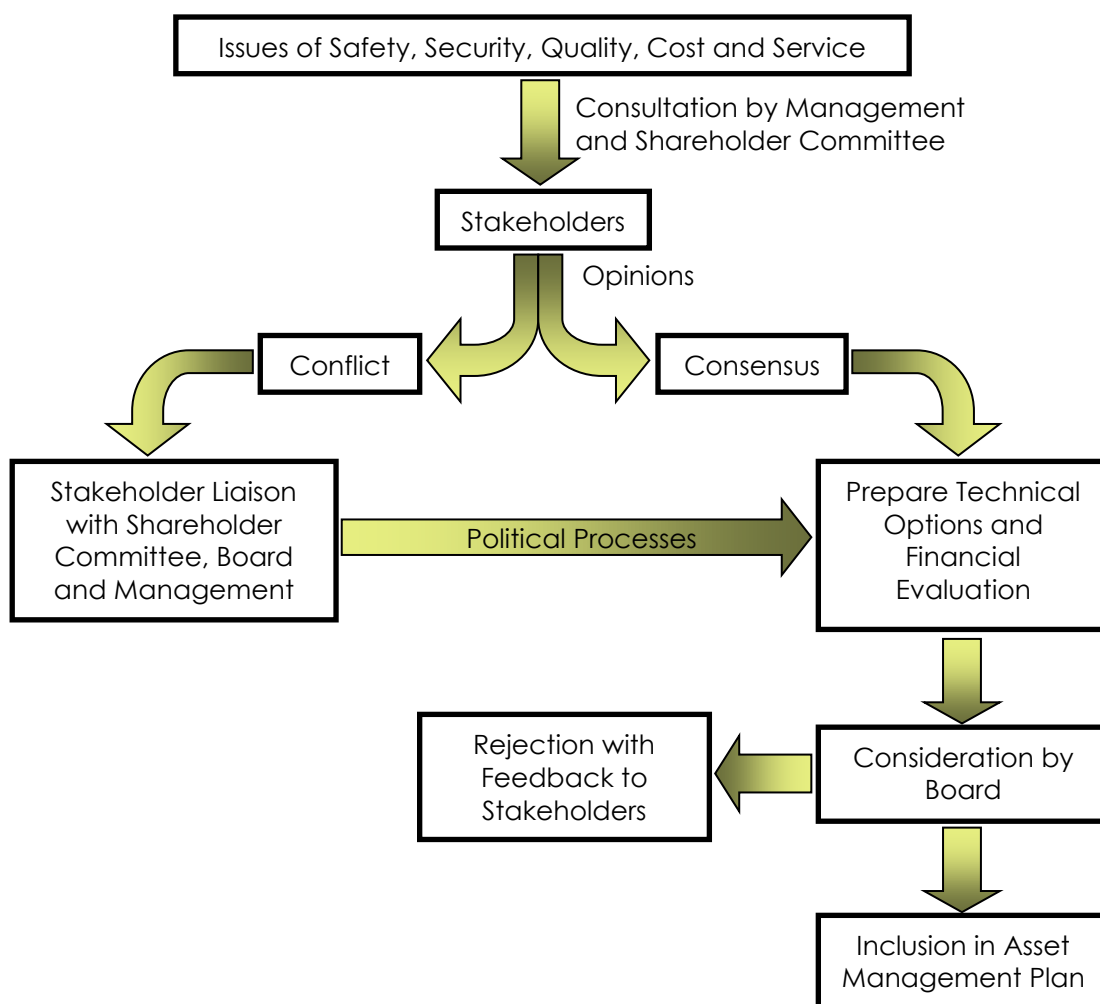

In conjunction with the abovementioned forms of consultation, EA Networks management liaises with the Energy Retailers to determine the expectations of their customers, and quantify these in terms of desirable reliability indices as well as other relevant system or process improvements.

The EA Networks control centre accepts calls from consumers (but does not actively encourage them) and this inadvertently forms another useful avenue for consumer research. Although the consumer is generally contacting EA Networks to report a power outage, the consumer's attitude is almost always courteous and understanding. There are relatively few instances of angry callers and where appropriate the caller's concerns are documented and passed on to the relevant staff member. Field staff also pass on any constructive comments from consumers to the relevant staff members.

Large users of electricity are contacted on a regular basis to ascertain their satisfaction with current service levels. The Commercial Division of EA Networks undertake this consultation. When service issues are raised, a range of alternative solutions are prepared to encourage the consumer to consider the service/cost trade-off. Typically, this has resulted in relatively minor changes to the status quo. A questionnaire that is used to prompt discussion in these dialogues is shown in [Appendix F](#). This process has resulted in three consumers requesting some options for a higher security supply. Discussions with these consumers are on-going and several options are being provided for their consideration.

EA Networks have described in some detail in the "Disclosure of compliance with quality threshold 6(1)c" the forms of consumer consultation that occur - published as part of the 2005 threshold disclosure process and available publicly on the EA Networks website ([www.eanetworks.co.nz](http://www.eanetworks.co.nz)). Relevant excerpts from this document are included in [Appendix E](#) – Customer Engagement Statement.

## 2.3 Strategic and Corporate Goals

EA Networks is committed to an open and neutral policy of operation. Its prime responsibilities are to manage the distribution system reliably, efficiently and economically and also to meet its users' needs in providing quality electricity supply services. EA Networks operates to meet those needs effectively and efficiently, recognising its position as Mid-Canterbury's dominant provider of electricity distribution services. Minimisation of operational costs is sought through the introduction of distribution automation as appropriate and the strict management of all projects to set standards of safety, performance, budget and timing.

The present condition (and by implication reliability) of any distribution line is largely a factor of its age and the environmental aggression of the locations it traverses. Historically, maintenance has been reactive rather than proactive.

The construction of lines in the distant past was often driven by not only consumer demands but also political influences (the Power Board was an elected body). This has contributed to the seemingly erratic nature of some line ages. One aim of the Asset Management Plan is to normalise the age profile of the system as much as possible by maintaining the average age of the network at approximately half of the weighted service life of the assets. At the same time, the condition of all lines will be carefully monitored to make sure that the integrity and reliability of the network is not unduly compromised.

Network performance, as measured by SAIFI and other performance indices are key parameters in determining whether sufficient maintenance expenditure is being provided to sustain a satisfactory level of network reliability.

The underground conversion programme is primarily driven by the condition of urban overhead lines and the need to either convert them to underground cable or rebuild them overhead. It must be noted however that additional considerations were involved in the Board decision to allocate these funds. One of the significant influences was (and still is) the desire to provide fairness in the degree of investment provided in rural versus urban areas. The many millions of dollars spent in developing the rural network to accommodate irrigation demand are being counterbalanced by the allocation of additional discretionary funds for urban development for additional reliability, security and environmental appeal. The outcome of this strategy continues to be satisfied consumers/stakeholders in both the rural and urban areas.

## 2.4 Network Service Levels

The overall level of system reliability can be measured in many ways that are combinations of the number of interruptions, the length of interruptions, the frequency of interruptions, the number of consumers affected by the interruptions, the total number of consumers, and the total length of lines. These parameters are used to disclose a range of performance measures which are used for comparison with other, similar, companies.

The following published parameters are used to measure EA Networks' performance in comparison to other Power Companies (see [Appendix A](#) for explicit definitions):



**Consumer Service Levels:**

$$\text{SAIDI} = \frac{\text{Sum of (number of interrupted consumers x interruption duration)}}{\text{Total number of connected consumers}}$$

System Average Interruption Duration Index

$$\text{SAIFI} = \frac{\text{Sum of (number of interrupted consumers)}}{\text{Total number of connected consumers}}$$

System Average Interruption Frequency Index

$$\text{CAIDI} = \frac{\text{Sum of (number of interrupted consumers x interruption duration)}}{\text{Sum of (number of interrupted consumers)}}$$

Customer Average Interruption Duration Index

$$\text{Total Interruptions} = \text{Sum of (number of interruptions)}$$

The above indices reflect a measure of continuity of supply and supply restoration time to individual consumers. While SAIDI largely depends on restoration time, SAIFI is a measure of outages - which depend on the planning, design and condition of assets. While it is possible to control these indices to an extent, it is not always feasible or possible to do so. As examples, extreme weather conditions and vehicle vs. pole collisions can significantly influence these parameters.

**Asset/Financial Performance Levels:**

$$\text{Faults per 100km} = \frac{100 \times \text{Sum of faults at a particular voltage and line type}}{\text{Sum of (length of particular voltage and line type) in km}}$$

$$\text{Fault Restoration} = \text{Maximum time taken to restore power to the Electricity Ashburton network after an unplanned interruption.}$$

Electricity (Information Disclosure) Regulations are designed to ensure that Network Line Companies provide an appropriate level of reliability and security of supply to their consumers.

**2.4.1 Target Level of Service**

While ultimately it is consumers' requirements and financial commitments that drive work, possibly altering system reliability, the Asset Management Plan is based upon maintaining a set of predetermined targets.



It should be noted that the statistics used to measure performance against these targets could vary significantly from year to year due to the random occurrence of a single major outage, seriously weighting the overall statistic. Further analysis by EA Networks will seek to identify trends in underlying system reliability so that appropriate management responses can be taken.

<b>2015 Reliability Forecast : Target</b>			
Index	Unplanned	Planned	Total
<b>SAIDI (min)</b>	120	88	208
<b>SAIFI (p.a.)</b>	1.44	0.32	1.76
<b>CAIDI (min)</b>	83	275	118
<b>Faults/100km</b>			5


The targets are set by:

- examining the historical performance of EA Networks,
- aligning planned outage performance with the level of work planned on the overhead network,

- evaluating historical performance when compared with all lines companies and separately with similar lines companies then defining a position close to the desired performance relative to the other companies,
- taking account of consumer feedback from surveys and shareholder/consumer representatives,

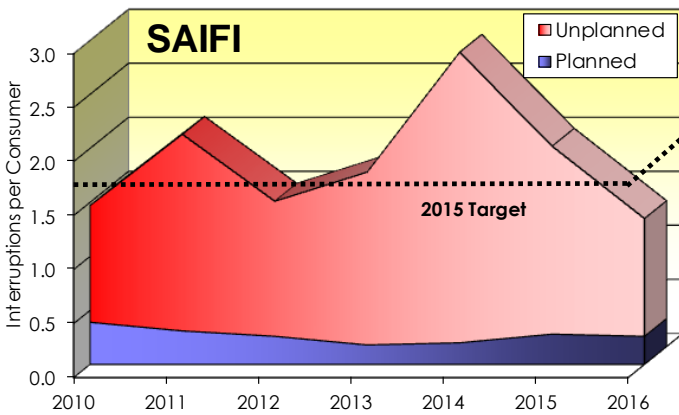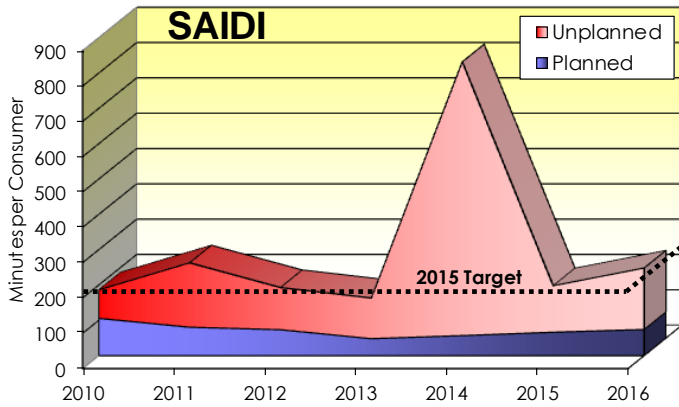

### Faults per 100km by Operating Voltage

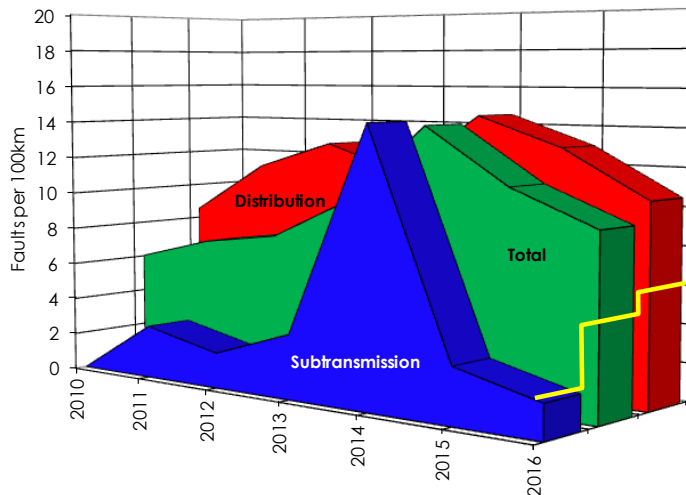

- ensuring the target dictated by industry comparisons is both desirable and ultimately achievable.

- recognising the improvements made to the network infrastructure and the positive impact that will have on system performance

EA Networks justify setting targets in this manner because it not only ensures that consumer/shareholder preferences are accommodated but any movement in performance by the industry as a whole will cause a shift in emphasis for EA Networks. Performing above or below the normal bounds of the group of peer companies highlights areas where as a minimum an explanation is required and, in the worst case, significant alteration to asset management or operational methodology is necessary.

History has shown that the performance targets quantified are ambitious and consequently they are not shown as a downward trend during the planning period. Once the targets are being consistently achieved, they will be reviewed to ensure they continue to match stakeholder expectations. This review may result in changed targets which will be published in applicable documents. This review is likely to establish a more rigorous methodology to quantitatively set and review future targets.

While significant amounts of capital are being spent on development, most of this is justified by the need to provide capacity for a rapidly growing rural load. It does not necessarily follow that dramatically higher levels of reliability will occur. In fact, at times through the 11kV to 22kV conversion process, security is temporarily lowered as previous tie points have to remain as an open point as a consequence of the voltage difference. In the long term, security will definitely increase for most consumers and EA Networks are confident this will have a positive effect on reliability (all new assets are designed to meet security standards while a range of existing ones do not meet them). There has however been no effort made to mathematically quantify the likely increase in reliability in this plan. Future plans may attempt to provide analysis of this data thereby influencing targets.

The unplanned SAIDI & SAIFI targets have been based on the average of the years ending 2008 to 2015 excluding 2009 & 2014 which both had wind storms. The planned SAIDI and SAIFI have been calculated using long-term averages with a variable component based upon the amount of overhead line work

planned in that year. These values form the two components of the overall SAIDI and SAIFI targets. This approach ensures that achievable targets are set while still challenging the asset manager to make the best planned and unplanned historical performances coincide as often as possible.

The targets are reviewed annually by management, the Board and the Shareholders' Committee to ensure that they are relevant and reflect consumer feedback accurately. These targets assume "severe weather events" (admittedly undefined) are excluded from the averages.

The Power-View Geographic Information System that EA Networks use has the ability to "trace" the network to determine which connections are without power for any open/close combination of switches and fuses. The results of these analyses are fed into the Assets system that records each outage against individual connections. This system can then be interrogated to establish performance over any time scale at each connection. The Intergraph GIS system will be able to do this and much more once it is fully implemented.

EA Networks have additional detailed targets. The following tables provide some of these.

<b>Faults per 100km : Target</b>					
Year	66kV Lines	33kV Lines	22kV Lines	11kV Lines	All Lines
<b>2016-17</b>	2	3	6	6	5
<b>2018 – 2021</b>	2	3	6	6	5
<b>2022 – 2026</b>	< 2	< 3	< 6	< 6	< 5

<b>Number of Interruptions : Target</b>			
Year	Unplanned	Planned	Total
<b>2016-17</b>	150	300	450
<b>2018 – 2021</b>	150	300	450
<b>2022 – 2026</b>	< 150	< 300	< 450

## Network Performance Target Comparisons

The performance achieved by the EA Networks network is not presently class-leading when compared to similar network line companies. Although EA Networks will improve its performance, the medium term target for the critical indices is to be better than the median performance of all New Zealand power companies and in the top third amongst its predominantly rural peers.

The following table compares EA Networks' 2017 performance targets with the industry forecasts as a whole and then peer companies. The most recent forecasts readily available are those for 2015-19 years so those have been used. The "Industry Average" is the average value for all disclosing distribution lines companies. The "rural average" is the average value for those companies that have less than 10 consumers per kilometre of network and have less than 18% of their network underground (EA Networks' network is 17% underground). The predominantly rural group of 14 peer companies supply 15% of the total consumers in New Zealand using 33% of the total lines in New Zealand that have 21% of the total distribution network value. The percentage of average is an indication of EA Networks target level (lower is better ~ better than average is less than 100%).

Comparing EA Networks 2017 targets with the industry forecasts (disclosed in March 2014) it can be seen that EA Networks' reliability targets are similar to the average forecast, particularly the rural peers. If the targets can be achieved regularly it will reflect in a newly revised target the following year. This will probably reflect in a lowering of the average score percentage when compared to the industry. This will provide useful feedback to the stakeholders allowing them to consider how much reliability is sufficient or even what the added cost of reliability well above the industry norm may be and whether they wish to pay that cost in the future.

### Comparison of Target Performance Indices: 2016 & 2017

		EA Networks 2017 Target	2015-19 Industry Average Forecast	<b>% of Average</b>	2015-19 Rural Peers Average Forecast	<b>% of Average</b>
<b><u>SAIDI</u></b>	<b>Total (mins)</b>	208 88 Planned 120 Unplanned	160	<b>130%</b>	199	<b>105%</b>
<b><u>SAIFI</u></b>	<b>Total (interruptions)</b>	1.76 0.32 Planned 1.44 Unplanned	1.70	<b>104%</b>	2.57	<b>68%</b>
<b><u>Faults/100km</u></b>	<b>Total</b>	5.0	3.36*	<b>149%</b>	-	-

\* The data to calculate this forecast was not available. The actual 2014 performance has been used instead. This actual value includes all voltages underground cables and overhead lines. It is not representative of a rural network.

There continues to be significant amounts of planned development and maintenance work. Planned SAIDI and SAIFI is one of the few areas that EA Networks has direct control over. If stakeholders indicate that the duration or frequency of planned outages are above tolerable levels, then EA Networks could use less efficient but lower outage duration approaches to doing planned work. These approaches could include:

- employing additional contractors or staff to get much more done during any given outage or shortening the outage,
- using live line working techniques to do some work that is currently done de-energised,
- more widespread use of generators to supply load that would otherwise be interrupted,
- building new lines on routes not occupied by the existing lines (for example the other side of the road),
- converting more of its rural network to underground.

Although these approaches are possible, there would have to be a demonstrable advantage to employing them. As yet, that advantage is not sufficient to actively pursue most of these approaches.

It must be remembered that the industry-wide average values above, include all of the urban network data which are not considered to be typical of EA Networks' peer companies. Another aspect of EA Networks' network is that one Transpower substation serves the entire EA Networks area. This is uncommon for the size of network load EA Networks carry and one of the consequences is that EA Networks takes the 'risk of fault' on the additional length of subtransmission lines and also energy losses that are borne by Transpower in most other line company networks.

Historically, EA Networks has undertaken a lot of planned development work and this is reflected in traditionally high planned CAIDI and SAIDI values. This has begun to change as 66kV line development work decreases although 11kV to 22kV conversion work still has an impact.

EA Networks averaged 4.0 planned interruptions per 100km of lines in 2014 compared to an average of 5.8 for the industry (0.69 x the industry average). 2014 planned outage rates per 1,000 connections were 6.69 compared to the industry average of 4.25 (1.57 x the industry average). It is anticipated that this planned outage rate will vary in proportion to the level of overhead line development work and this is largely dictated by on-going load growth.

Internal reporting and targeting of performance indices are more detailed than those discussed here. EA Networks management report performance against these to the Board each month and they take an active interest in not only the nature of the targets but also how they are influenced by a variety of factors.

There are other financial and technical indices published as part of the disclosure process but these can be very misleading without a great deal of technical analysis using background information about each company's load types, locations, profiles and seasonality. In the future more detailed cross-company

comparisons may be attempted if significant asset management benefit is seen by using these indices.

EA Networks is constantly endeavouring to improve its service performance. As part of this effort, EA Networks has started to implement an analytical approach to identify various network trends. A number of initiatives have been planned for the upcoming years. For example, a review of the outage management database is underway in order to align historical and current performances. Feeder performance comparisons will be included as part of a regular reliability analysis.

As part of its on-going commitment to improve system performance, the Company will (in 2016-17) pilot a distribution automation system on part of its rural network. If this is successful and delivers the desired results, then consideration will be given to extending this system across the entire rural network.

## 2.4.2 Forecast Level of Service

The targets set in the previous section indicate the level of service that EA Networks would expect to deliver in a year when the impact of external influences is at a minimum and planned work is at a normal level. Meeting our target level of service would be considered a good, although not extraordinary, year.

A normal year will have external influences impact on the level of service EA Networks delivers and it is 50% probable that the target will be exceeded.

Future Performance Target/Forecast : 2017-26											
Indicator	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	Default Quality Path Limit
<b>SAIDI Planned</b> (mins)	71.2	77.3	85.1	64.2	72.1	82.3	83.5	75.4	64.4	64.5	-
<b>SAIFI Planned</b> (#/yr)	0.26	0.28	0.31	0.23	0.26	0.30	0.30	0.27	0.23	0.23	-
<b>SAIDI Unplanned</b> (mins)	119.9	118.7	117.5	116.3	115.2	112.9	110.6	108.4	106.2	104.1	-
<b>SAIFI Unplanned</b> (#/yr)	1.44	1.43	1.41	1.40	1.38	1.37	1.36	1.34	1.33	1.32	-
<b>SAIDI Total</b> (mins)	191	196	203	181	187	195	194	184	171	169	<b>151<sup>1</sup></b>
<b>SAIFI Total</b> (#/yr)	1.70	1.71	1.72	1.63	1.64	1.67	1.66	1.61	1.56	1.55	<b>1.61<sup>1</sup></b>
<b>Faults/100km</b>	5	5	5	5	5	5	5	5	5	5	-

<sup>1</sup> These are the Commerce Commission default quality path limits. These limits are "normalised" and remove aberrant fault events and a proportion of the planned outages. The targets are non-normalised and include all planned events.

In order to provide a realistic expectation of future performance, a set of forecast performance indices have been calculated based upon historical fault performance and future network expenditure (see table above).

The unplanned SAIDI and SAIFI reflect the average actual performance over the last four years. The planned SAIDI and SAIFI are the most recent actual performance (2015-16) scaled by the forecast network expenditure on overhead lines for each year of the planning period – essentially a planned minutes/frequency per million dollars spent.

Over recent years EA Networks has had a program of installing additional remote controllable switching points within the Network. In the past year considerable effort has occurred enabling the remote control of these devices. While some devices are installed specifically to improve network switchability most are installed as part of other works most commonly line requiring rebuilds (either overhead or by underground cable). As a result of this approach devices tend to be scattered around the network rather than concentrated in specific areas. While each device helps to improve reliability large improvements are not seen until the population reaches a critical mass or a particular area is completed. We are anticipating a general improvement in reliability due to the increase in switching points however the population is still not large enough to see wholesale improvements.

It has already been noted that a lot of the 'Quality of Supply' expenditure in this plan will increase security of supply for relatively rare but very consequential events. If none of these events have occurred in recent years or occur in the disclosure year, then the future impact on the level of service of this expenditure may not be particularly measurable/visible. Having said that, it is expected that the increases in security will

have considerable advantages to the consumer in service level improvements, but those improvements are difficult to directly quantify.

For many years EA Networks has experienced load growth well above the national average load growth. This has resulted in rapid expansion of the network's load serving capability. In meeting this huge load growth, it has often not been possible to fully complete the finer details of the job. For example, fuses are updated to gas switches or reclosers and this new equipment has remote control capabilities. Unfortunately, time and the pressure of other load growth requirements meant that effort could not be devoted to completing the remote control aspect. As load growth tails off, time and resource will become available to complete these projects with high reliability and safety values.

Similarly, load growth has bought about the requirement to convert parts of the network from 11kV to 22kV operation. Again, time and resource constraints mean that only the practical minimum is converted to meet the increased load at that time. This has resulted in what was once a fully-meshed network having open points introduced as a consequence of the different voltages. With the reduced new connection growth currently being experienced, EA Networks are now in a position where resources can be allocated to go back and rectify the reduced security introduced by the former load growth requirements. As this work is not directly caused by load growth, it is classified as a reliability improvement. In reality, it is only returning security to previous levels.

In a similar vein, EA Networks has a policy of converting urban overhead lines to underground when they fall due for replacement (the Urban Underground Conversion Programme). This work is classified as Asset Replacement, however, at times it is appropriate to go further than the absolute minimum, e.g. convert a further section of line so the underground area become contiguous or extend it further to remove the risk from a significant tree plantation. These extensions are classified as reliability improvement when often they are Asset Replacements done in advance of the actual need.

There are many types of faults that are almost impossible to prevent without disproportionate cost – particularly in rural areas. Trees falling through overhead lines is one; as the tree regulations do not permit obligatory tree control beyond a set radius of the line. A tall tree can fall from across the road (well outside the trim radius) and cause considerable damage to any overhead line. The only way to avoid this risk is to build outside the road corridor (easements and associated cost and access difficulties) or underground conversion of the line (cost). EA Networks are currently talking to tree owners where an overhead line is within the fall distance of their tree. We are encouraging these tree owners to consider the ramifications if their tree damages EA Networks' line and encouraging them to take appropriate action.

### 2.4.3 Significant Recent Events

It is considered worthwhile to document any recent events that have had a significant impact on network performance and asset management strategies. The following events are ones that have caused sufficient impact as to cause network performance to exceed targeted values.

#### June 2015 Snow Event

In June 2015 a significant snow event took place that caused many small scale outages. This had a significant SAIDI impact for the month (11 minutes compared to about 5 minutes for an average month). The network has proven to be much more resilient in these moderate events than was the case in the past.

#### Use of System Agreement

EA Networks have a "Use of System Agreement" with energy retailers that outlines a number of connection service standards that EA Networks must meet or payments become due to the affected consumers. To date these payments have been very low (nil for the year to date February 2016). This tends to provide support for the current Asset Management Plan strategies. On the rare occasions EA Networks have not met a connection service standard, some retailers have chosen not to pass the payment on to the affected consumer.

Other service guarantees to consumers include:

- Not to accidentally disconnect supply to a consumer.
- To provide written notice 7 business days in advance of planned maintenance interruptions and no more than two in any 12 month period (unless by agreement).

- To advise requirements for new connections within 5 business days and connect on agreed day provided all requirements are met.
- To disconnect or reconnect at an agreed time, or within 8 business hours for urban addresses and 12 business hours for rural addresses from request - subject to safety approvals.
- To provide a written response or estimate for new or additional supplies within 5 working days.

Failing to meet these targets requires payment of the previously mentioned \$30 (single phase consumer) or \$100 (three phase consumer). So far during 2015-16 there have been no payments made for failing to meet these standards.

## 2.5 Network Security Standards

### 2.5.1 Introduction

Electrical supply security can be generally defined as the ability of a portion of the electrical network to resist loss of supply to consumers. EA Networks have adopted a security standard that is comparable to the "Security of Supply in NZ Electricity Networks - 2013" prepared by Electrical Engineers Association of New Zealand Inc. which is in turn comparable to the P.2/5 requirement set in the United Kingdom. It is EA Networks' assessment that the comprehensive standards that have been adopted meet, and in some circumstances exceed, the above mentioned standards.

As previously discussed, security is normally defined in terms of "n-a" where "n" is the number of possible supplies for a particular consumer or group of consumers, and "a" is the number of these supplies whose loss can be tolerated while still keeping full capacity available. If "n" is one, then the loss of one supply ( $a=1$ ) means no supply. If n is two, the loss of one supply ( $a=1$ ) will mean at least 50% of the total capacity is still available, and if the load is less than 50% of the total supply capacity it can be said to have n-1 security. If the load is more than 50% of the total supply capacity, then only a portion of the load has n-1 security. For example, Ashburton zone substation has a nominal total supply capacity of 40MVA (two x 10/20 MVA transformers), allowing for loss of one transformer means this substation has a "firm capacity" of 20MVA. For all practical purposes this substation is considered a 20MVA substation, so following the loss of any one item (transformer, incoming line etc) to be at n-1, then a "full" 20MVA of load can be supplied. Where additional switched capacity is available, the firm capacity can be considered as the overload capacity of the smallest transformer or line (if there is more than one) for the duration of switching excess load to other substations. This overload capacity can easily be 20% for typical switching times.

Very secure loads can be configured to have n-2 security, which means two supplies can fail and the supply capacity can still be greater than the load. EA Networks have no consumers with any assurance of n-2 security. The more secure a system is, the more reliable it tends to be.

Another term that requires definition is the "firm" capacity available to a consumer. The firm capacity is the total supply capacity with the largest of any possible supplies out of service. Firm capacity can be either "no-break" or "break". No-break would infer that two supplies are operating in parallel and no loss of supply is experienced when one supply fails. Break firm capacity is when the supply fails and the alternative one has to be switched into service to restore the supply. For the purposes of this plan, no-break firm capacity is generally only used in reference to parallel zone substation transformers and firm capacity without a qualifier will be the alternative supply capacity available after switching.

Environmental security has two aspects - (1) the effect of the environment on the electricity network and (2) the effect of the electricity network on the environment. Both are considered under the environmental security standards.

### 2.5.2 General

When the EA Networks network is maintained or upgraded the electrical configuration of the network can change. This rearrangement could lead to individual connections or groups of connections having a different level of security. An example of this is with the continuing conversion of the distribution network from 11kV to 22kV. This work was initially triggered by increasing loads. As parts of the network have been converted, the lack of 11 to 22 kV conversion on the boundaries of the converted area lead to a temporary reduction in security until further parts of the network are converted.

The security level of any one connection will not permanently decrease over time. The only exception to

this is at dedicated, high voltage, single user connection points, where security can be varied by agreement. For the purposes of this guideline, the term "permanent" means any period greater than 24 months.

The term critical load describes load that would be severely disadvantaged by an outage of more than about 90 minutes. Examples of critical load would include diabetics, hospitals, milking machines on dairy farms, retirement homes, lighting at night, refrigerated food storage etc. Non-critical load would include all air-conditioning, pumped irrigation, some types of industrial load (where they have discretion), commercial heating, and all water heating etc. For the purposes of this standard, critical load will be taken as 50% of the peak through/busbar load unless more authoritative information is available.

A significant proportion of the EA Networks network meets the adopted security standards. Proposals to improve the remaining portions are included in [Section 5 - Network Development](#). The dynamic nature of the subtransmission and distribution network in recent years (caused by significant development) has made thorough analysis of the areas that do not meet the security standards difficult. Engineering staff have been diverted to load-driven development rather than assessment tasks. All development will ultimately improve security levels. Additional effort will be required to identify non-compliant portions of the network and these results will appear in future plans as they are completed.

### 2.5.3 Transpower Grid Exit Points

The main on-going requirement for GXP (Grid Exit Points) will be that the firm transformer, or alternative feed capacity, will match or exceed the any-time GXP maximum demand. This criterion will mean that the failure of any single item of Transpower plant will not lead to on-going loss of supply under any conditions. Depending upon the Transpower failure, restoration of all load by switching within the EA Networks will occur within 90 minutes.

### 2.5.4 Main Subtransmission Ring Systems

Sufficient redundancy shall be designed into the subtransmission system to ensure no on-going loss of supply should certain credible contingency events arise. The following criteria define these contingencies:

- All load must be restored within 90 minutes of any one section of a circuit becoming unavailable.
- For a single point failure affecting 2 circuits, critical load must be restored within 90 minutes and all load within the designated Connection Service Standard target time limit.
- No single point failure will affect more than two circuits.

Subtransmission system design shall allow for maintenance, including major component replacement e.g. transformers, circuit-breakers, poles and conductors to be carried out at appropriate times, without the above criteria being violated to any significant degree or for any significant length of time.

The precise level of redundancy built in to specific parts of the subtransmission system depends on the likelihood of contingency events occurring and the costs of reinforcement. Each situation shall be treated on its merits and subject to rigorous financial analysis.

### 2.5.5 Radial Subtransmission

The radial subtransmission system comprises those parts of the network that act as spur supply systems for specific sites or connections. Currently these spurs include:

- Methven 33kV Substation, Montalto Power Station, Montalto (Temp) Substation, and Mt Somers Substation
- Highbank Power Station (by agreement)
- Dorie Substation
- Mt Hutt Substation
- Northtown Zone Substation (has two 66kV circuits but at this point in time, one of the circuits does not provide meaningful in-feed capacity during summer).

By definition, these components have a single circuit supply (some in common with adjacent substations) and any failure will result in the need for a back-up supply via the 11kV and/or 22kV distribution system. The



restoration of all load, after any one failure, must occur within the designated Connection Service Standard target time limit (unless agreed otherwise with the connected consumer).

### 2.5.6 Zone Substations

The zone substation's function is to provide transformation from the subtransmission voltage to the distribution voltage. In performing this function, it is a critical element in the path from point of supply to connection. If it fails, the consequences are seen over a wide area and there are relatively few parallel paths to provide back-up supply. In order to minimise the risk at these substations, the following criteria have been developed:

- The capacity of any subtransmission or distribution busbar within a zone substation will not limit the operation of the network for credible network configurations.
- With the exception of bus coupling devices, all zone substation switchgear can be worked on with only one other circuit element (i.e. electrically adjacent transformer, line etc) out of service.
- All zone substations normally supplying less than 2,000 connections shall permit restoration of critical load within 90 minutes and the balance within 48 hours under all credible n-1 contingencies.
- All zone substations normally supplying greater than 2,000 connections shall have a no-break supply for all load under all credible n-1 contingencies.
- Zone substations dedicated to an individual connection will have a security level negotiated with the electricity user using that connection.
- All zone substations must be able to deliver nominal secondary voltage for n-1 scenarios whilst delivering supply.
- The distribution voltage substation bus must be able to be used as a "through/linking" bus when the transformation is out of service.

The zone substation security standard has recently been revised. The electrical load served by a transformer has been removed from the standard and a 2,000 consumer threshold introduced for a full no-break n-1 supply. In lieu of a second transformer at many of the high seasonal load, low consumer count, rural substations, a second spare 66/22kV transformer has been purchased (CRW) that can be relocated at any time to replace a failed unit. This unit also provides cover for a second failure while a faulty unit is either replaced or repaired. These types of repairs can take up to 12 months and a new transformer will typically require 9-12 months for delivery from order placement.

### 2.5.7 22kV and 11kV Distribution System

The overhead line distribution system is typically less reliable than the subtransmission system. There is significantly more length of distribution line, it is lower to the ground, and there are significant numbers of privately owned distribution lines connected to the same system (which are outside EA Networks' direct control for maintenance and tree control purposes). Rural underground cables offer a higher level of reliability, but they are still subject to reliability issues arising from being supplied via overhead lines or overhead lines being supplied from the cables. The urban underground reticulation has a much higher reliability than the rural overhead lines. The urban network is also heavily interconnected which typically allows faster restoration times.

EA Networks' policy of requiring all new connections to the network to be by way of underground cable is helping to improve the reliability of the rural distribution system. Many consumers who now see the reliability and safety gains of having their on-property lines underground are voluntarily converting existing overhead lines to underground cable.

The only performance requirement for the distribution system is that the restoration of all load, after any one failure, must occur within the designated Connection Service Standard target time limit.

### 2.5.8 Low Voltage System

The only performance requirement for the low voltage system is that the restoration of all load, after any one failure, must occur within the designated Connection Service Standard target time limit.

## 2.5.9 Protection

The systems that detect and isolate either faulty equipment or external interference with electrical equipment have a large influence on the outcome of any incident. The systems that detect and isolate electrical plant when undesirable electrical situations arise is generically known as "Protection". Protection systems generally measures AC currents and voltages in order to determine when an undesirable situation has arisen.

As a policy, new or rebuilt nodes on the subtransmission network will have protection systems that are in line with modern standard practice.

Protection systems for the EA Networks network will be designed to:

- detect faults between phases or between phases and earth,
- allow plant to carry rated maximum load without disconnection;
- disconnect faulty plant from the system with minimum damage;
- disconnect faults quickly enough to avoid system instability,
- minimise the likelihood of personal injury or property damage;
- minimise supply interruptions;
- detect abnormal operating conditions which could result in plant damage;
- disconnect only the plant item affected;
- prevent damage due to through faults;
- operate with a level of reliability that can be economically justified;
- operate with a level of sensitivity that will not result in tripping of circuit-breakers at normal load levels.

### **Abnormal Conditions**

For zone substation transformers the protection will be set to detect conditions that may lead to significant overheating and possible failure of equipment. Overload protection will be provided for subtransmission circuits only where potential system configuration could lead to sustained overload conditions.

### **Selectivity**

The protection will be set so that when all protective relays and circuit-breakers are functioning as designed, the protection system will clear only the faulted equipment from the system.

If a circuit-breaker fails to operate correctly, it is desirable that the remaining equipment operates selectively.

### **Fault Clearance Time**

Clearance times will be:

- limited so that damage at the point of fault is reduced to that economically justified by the increasing protection expenditure
- such that the short time rating of equipment is not exceeded
- short enough to ensure that system stability is maintained for all foreseeable fault conditions, where the fault is cleared by the main protection. It is desirable that this time is also short enough even when the fault is cleared by backup protection

### **Risk to People**

The protection system will always comply with the Electrical Supply Regulations. Particular attention will be paid to providing fast and reliable protection in urban areas.

### **Protection Reliability**

Protection systems will be designed to have a high degree of reliability because of the extreme consequences of failure to operate.

### **Protection Security**

Protection systems will be designed with a form of backup protection should the primary protection fail for some reason. This backup protection will be in line with industry standards.

## **2.5.10 Reliability by Design**

To ensure some emphasis is placed on minimising the extent of any one outage, the target maximum number of connections on any one continuous section of network (no isolation within the section) has been defined. This provides guidelines limiting the number of consumers who have an extended outage while a fault is repaired (reducing SAIDI). In addition, the maximum number of consumers on a distribution feeder limits the impact of a feeder circuit breaker tripping on a fault (reducing SAIFI).

These design parameters ensure that the network can be restored as quickly as possible after a fault with as few consumers left without supply as possible. It also provides a degree of determinism about how many consumers should be affected by any on-going outage for the duration of a repair. This determinism does assume that the network is capable of providing adequate back-feed capacity at every location on every feeder at all times of the year. This is not currently possible. Provided the repair does not exceed the Connection Service Standard target time limit, the performance standards have still been met.

The table below identifies the current guidelines for design.

<b>Target Number of Consumers per Electrical Asset</b>				
	<b>Design</b>		<b>Maximum</b>	
	<b>Urban</b>	<b>Rural</b>	<b>Urban</b>	<b>Rural</b>
<b>Radial Subtransmission</b>	1,500	1,500	2,000	2,000
<b>Zone Substation</b>	1,000	1,000	2,000*	2,000*
<b>Distribution Feeder</b>	200	200	250	250
<b>Distribution Segment</b>	45	45	50	50
<b>Distribution Substation</b>	45	5	60	5
<b>LV Feeder</b>	20	4	25	4
<b>LV Segment</b>	10	3	15	3

**Design** - Maximum number of consumers connected to asset when asset is designed.

**Maximum** - Maximum number of consumers connected to asset during steady state operation. Once exceeded, redesign/reconfiguration required to reduce to design level.

\* For single transformer zone substations. Once zone substation consumer count exceeds the maximum limit a second transformer is required.

## **2.6 Network Power Quality Standards**

The principal aspects of quality are voltage variation and control, and the voltage waveform. Ideally, it is EA Networks' intention to supply a pure sinusoidal voltage to all consumers and for consumers to take a pure sinusoidal current from the network.

EA Networks is judged by the quality of electricity delivered to consumers. There are some aspects of power quality that are outside the control of EA Networks. It is not the responsibility of EA Networks to "condition" the supply voltage waveform it receives from generators either directly or via Transpower. Transpower are contracted to supply an appropriate level of power quality performance at the GXP's.

The network is designed to remain within the normal tolerance voltage ranges for the forecast loading conditions considered. For the various credible contingency situations identified and studied for security purposes, the voltage should not go beyond the voltage range prescribed by the regulations.

## 2.6.1 Steady State Voltage

Programmes and projects are typically justified on the basis of the following benefits from improved voltage level or controls:

- the ability to meet any legal or contractual requirements with respect to voltage standards
- specific consumer requirements which the consumer is willing to pay for
- improvements in subtransmission circuit capacity and the consequential deferment of capital expenditure

Most consumers are connected to the system at LV (230 or 400 volts) and EA Networks undertakes to control this within a range of  $\pm 6\%$  as per legal requirements.

For 11kV and higher voltage consumers, the design voltage range is from 96% to 103% of rated voltage.

Voltage Complaints per Annum			
	2013-14	2014-15	2015-16
<b>Complaints Received</b>	25	23	18
<b>Valid Complaints</b>	16	7	8
<b>Complaints Resolved</b>	25	23	17

## 2.6.2 Transient Voltage Disturbances

EA Networks design to limit transient voltage disturbances in accordance with the AS/NZS 61000.3.5 (LV) and 61000.3.7 (MV) standards. Motor starting is controlled according to The Electric Supply Engineers' Institute of New Zealand Inc. "Committee Report on Motor Starting Currents for AC Motors - February 1982".


## 2.6.3 Harmonic Voltage and Current Distortion

Harmonics are non-sinusoidal currents or voltages produced by nonlinear loads. Nonlinear loads such as Variable Speed Drives (VSD), switch mode power supplies (SMPS), electronic ballasts for fluorescent lamps, and welders inject harmonic currents into the power distribution network. These harmonic currents couple with the system impedances creating voltage distortion at various points on the network. As a result, equipment such as computers, digital clocks, transformers, motors, cables, capacitors, and electronic controls connected to the same point, can suddenly malfunction or even fail completely - beyond economic repair.

As harmonics are produced by the end users, it is important that these harmonics are controlled at the end user connection. This is considered to be a good practice as by controlling the emission levels of individual sources of harmonics, the flow of harmonics into the network is restricted at the point of common coupling (PCC) with other consumers. This will, in turn, limit widespread effects of harmonics in the entire network.

EA Networks endeavours to ensure that the quality of voltage in the network is always maintained at an acceptable level at all times. In recent times, EA Networks has observed network voltage problems that are associated with harmonics. EA Networks have decided that it is time to act and take all the necessary measures to minimize the widespread effects of harmonic pollution. The end result will enable EA Networks to provide better voltage quality to all consumers.


EA Networks have implemented measures to control harmonic currents (and therefore voltages) in the network. The network standard that has been prepared requires all new rural loads to meet current distortion limits (typically 8% maximum). It is expected that the design practices and

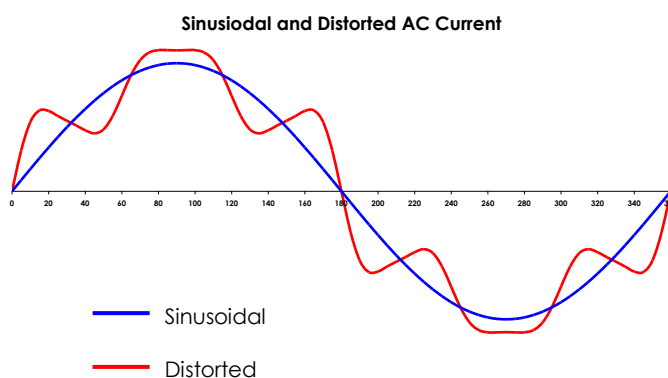

equipment purchases for the network will continue to meet the requirements of EA Networks' harmonic standard for limiting harmonic voltages at consumer connection points.

There are 1,500 irrigation connections to the network and they constitute most of the summer peak load. About one quarter of these loads are unfiltered active harmonic producing loads. This assessment is based upon a full survey completed during 2013-14. EA Networks has realised that it is not easy to track the exact number of variable speed drives because the consumer's equipment can change over time and any new equipment's characteristics are not necessarily provided or available to EA Networks. The number of variable speed drives has been increasing steadily over the past few years and this may grow in the future. The per substation irrigation load shown in [Section 3.2.3](#) provides an illustration of the presumed scale of distorting irrigation loads on each substation.

A scheme to subsidise the mitigation of harmonic distorting equipment has been introduced (as of April 2014). Under this scheme the cost of a filter or other form of mitigation is heavily subsidised for the first year of the scheme's operation and this rolls back to no subsidy over the next two years. Owing to the economic downturn in the rural area a differential tariff that was to operate from April 2016 has been delayed. Discretion will be exercised with the loads that have not been corrected by October 2018. Originally, these distorting loads were to be disconnected for non-compliance. It appears that the zone substation power quality monitoring devices have shown a worthwhile reduction in peak harmonic distortion during the 2015-16 summer (see chart below). This programme will continue until all rural pump loads comply.

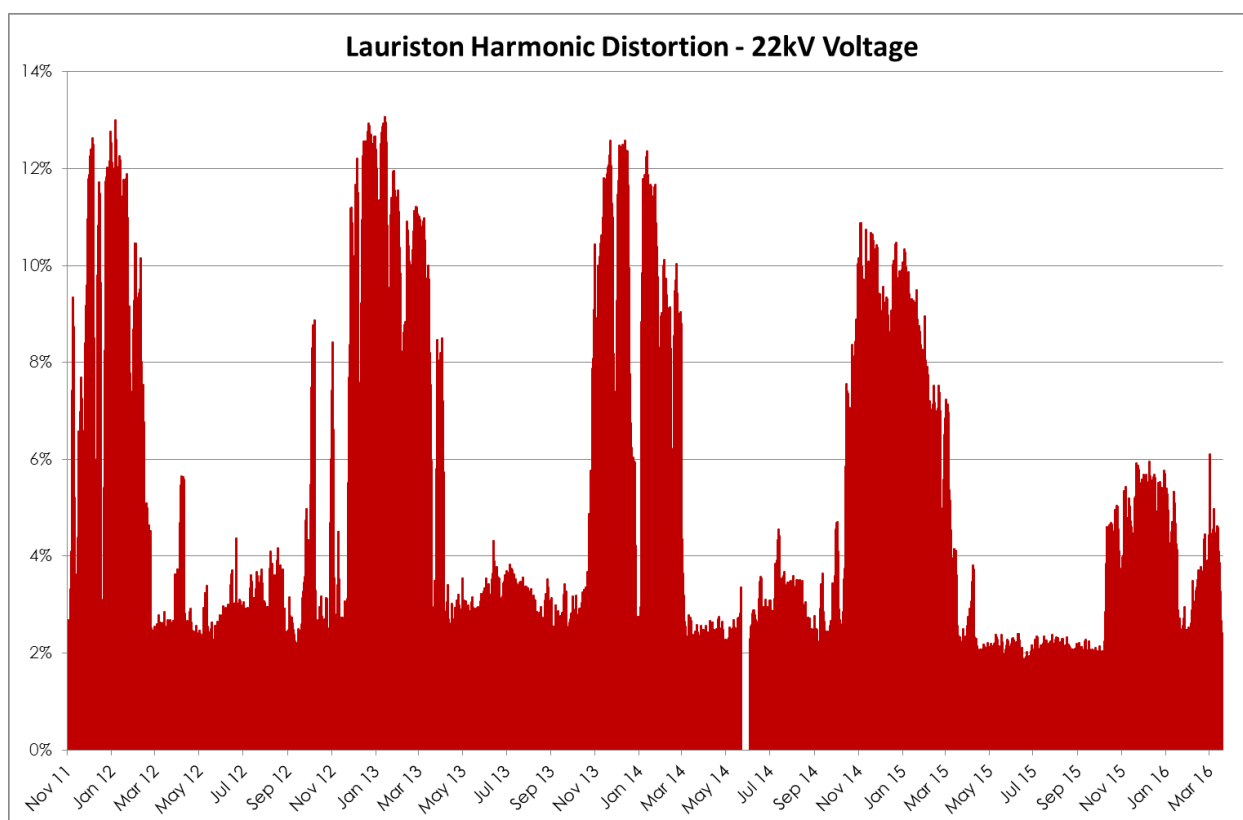

## 2.7 Safety

Electricity is potentially dangerous. All participants in the electricity industry have an obligation to ensure staff, contractors and the public are well informed of potential hazards and how to avoid them. Industry participants also have an obligation to minimise the exposure of all people to hazards by designing to an appropriate level for the environment in which the electrical equipment is installed.

In general terms, the safety standards are determined by relevant legislation and industry best practice on any particular issue.

The commitment to education and training of all staff is a core obligation of EA Networks' approach to

safety. EA Networks are committed to having appropriately competent persons working on and operating the network. All work is carried out in accordance with nationally accepted regulations, guides, codes and rules. Records of worker competency levels are held on file with regular refresher training undertaken to maintain current competence. EA Networks work closely with the industry training organisation (ESITO) to promote worker competency standards.

The general public are kept informed of safety issues by regular radio and newspaper advertising of the hazards of all electrical equipment - particularly overhead lines. Safety presentations are regularly made to emergency services personnel to ensure safe behaviour of all people in emergency situations. Extensive warning labelling of EA Networks equipment is undertaken where public access to kiosks, poles or other safety perimeters is possible. All accidental line contacts are recorded and informative letters sent out to those involved with the event.

EA Networks are aware of increasing safety issues with privately owned lines. Aging overhead lines are creating potential hazards by contacting trees, sagging lower than legal heights and component failure. A free condition assessment is offered to owners of HV service lines and this highlights any problems to them in writing. If our recommendations are ignored, a more assertive stance is taken that entails providing a written warning and, if this is disregarded, a copy of the letter is forwarded to the Energy Safety Service.

EA Networks have a Public Safety Management System (PSMS) in place that covers all aspects of asset management including:

- management of risk, hazards and change,
- equipment specification,
- procurement,
- network design,
- network construction,
- network operation,
- public awareness.

## 2.8 Environmental

EA Networks is committed to being environmentally responsible and strives to minimise the effects of its activities and actions on the environment.

A range of environmental phenomena have an influence on the security of the electricity network. The following environmental factors are considered significant in electricity network performance and impact:

### Seismic

EA Networks has taken expert advice on seismic design and a design standard has been prepared for structural design of foundations, supports, structures and buildings. The level of seismic resistance incorporated into the standard is at least 50% higher than the general building requirement.

The standard is currently being reviewed as a consequence of the Canterbury earthquakes. A revised standard based upon NZS1170 Part 5 methodologies and updated risk factors will be the result. Typical seismic horizontal load coefficients in use are 1.0 - 1.1g.

### Pollution

Where harsh environmental conditions exist, such as saline pollution in coastal locations, appropriate provision is made in specifications for anti-corrosion protection of surfaces, and for insulation performance.

### Acoustic

EA Networks currently requires certain equipment to meet international standards on noise levels, and in locations adjacent to urban areas will require plant to be installed to meet defined criteria at the site boundaries.

### Climate

The summer peak of EA Networks' network demand requires careful consideration of the specifications of major transformers and the sag and clearance design of network overhead lines.

### Oil Containment

It is policy to provide oil containment facilities at substations with oil filled equipment or storage facilities containing 1,500 litres or more of insulating oil. The standard design incorporates a bund wall around transformers with manually controlled storm-water drainage to a field drain or to the surface (where there is no risk of the discharge entering waterways). At some sites a polymer cartridge has now been installed that allows clean water to flow through but forms an impermeable barrier once hydrocarbon contaminated water comes in contact with it.

Oil spill kits are maintained at certain strategically placed zone substations and any discharge from the bund is controlled by strict guidelines stipulating no contamination.

If oil is spilled, all of the contaminated earth is collected and disposed of at authorised disposal facilities.

### Statutory Obligations

The electricity network has an influence on the environment. In order to control this influence, certain statutes apply to EA Networks in its operation and maintenance of the distribution network.

These include the Resource Management Act. Section 9 of RMA relates to Restrictions on use of land -

*"(1) No person may use any land in a manner that contravenes a rule in a district plan or proposed district plan unless the activity is*

- a) Expressly allowed by a resource consent granted by the territorial authority responsible for the plan; or*
- b) An existing use allowed by section 10 (certain existing uses protected)."*

EA Networks' Network currently crosses land governed by two different Territorial Authorities, each with their own District Plan and each slightly different in the rules governing the construction of new distribution lines.

EA Networks' protection of existing works is covered by Section 22 of the Electricity Act 1992 and the rights of entry in respect of these works are covered in Section 23 of the Act. Prior to commencement of any construction or maintenance of works, EA Networks must give notice to other utility owners and the appropriate Territorial Authority of its intention to commence construction or maintenance on its works.

EA Networks' Distribution Network generally runs along the roadside throughout the Mid-Canterbury plains area. Mid-Canterbury is predominantly a farming area and the only cost-effective means of supplying these farms with electricity is via overhead power lines. In the future, for specific applications, EA Networks may be required to use alternative methods of construction to minimise the effects on the environment. An example of this was the supply to Mt Hutt ski-field. The impact on the environment would have been too great had an overhead line been constructed. An underground cable was installed in that case. District Plan rules require consultation with the Council when installing lines in areas of high scenic value and EA Networks consults and works with the District Councils when working in these areas. This consultation may be required for tree trimming, agreement on line routes or just general distribution line upgrades.

Other sections of the Resource Management Act also help shape EA Networks' approach to network design and construction. As an example, the urban underground conversion programme is a way EA Networks chooses to improve the urban environment with no assistance from external funding sources.

As a major user of SF6 gas, EA Networks is a participant in a monitoring regime to ensure annual loss of gas is kept below 2%. To date there has been no loss detected that is outside the measuring tolerances. EA Networks have also registered with the New Zealand Emission Trading Scheme as a major user of SF6.





# NETWORK DESCRIPTION

<b>Table of Contents</b>		<b>Page</b>
3.1	Service Area Characteristics	75
3.2	Network Configuration	78
3.2.1	GXP and Generation	78
3.2.2	Subtransmission	82
3.2.3	Zone Substations	83
3.2.4	Distribution System	85
3.2.5	Secondary Assets	88
3.3	Asset Justification	89
3.4	Asset Value	90



## 3 NETWORK DESCRIPTION

### 3.1 Service Area Characteristics

The Mid-Canterbury area (see AMP cover) has a number of activities that in some way contribute to the demand on the EA Networks electrical network or influence the design or operation of the network.



The activity that Mid-Canterbury is most known for is farming. The 'patchwork quilt' effect when flying over the district illustrates the various crop types that are growing, each crop having a distinctive shade of colour. The variety of colours are reducing as more and more farms are converted to grow grass to feed dairy cows. The productivity of Mid-Canterbury dairy herds is amongst the highest in New Zealand. In order to grow enough grass to ensure an economic level of milk production it is essential to irrigate the grass. This irrigation demand influences the design, capacity and maximum demand of the EA Networks electricity network. Irrigation occurs throughout the Plains area of Mid-Canterbury. Currently EA Networks have about 1,500 irrigation connections. The dairy sheds associated with these farms also place a significant demand on the network. Farmers are very keen to have high electrical reliability to these dairy sheds as a couple of missed milking cycles can cause the cows to 'dry off' and this can have a catastrophic impact on the farmer's income.

Another feature of the district is the meat and vegetable processing facilities. There are two meat-works supplied by EA Networks as well as a vegetable processing factory. These facilities either have dedicated electricity substations or a dedicated supply from a substation. The key issues these consumers have are capacity and reliability.

Mt Hutt ski-field is also located in the district and it has electric tows and snow-making facilities. The location of the field means that the electricity supply is both electrically and environmentally challenging. The supply to the ski-field requires dedicated power lines from Methven to a substation above the Rakaia Gorge. From the substation, a pair of underground cables wend their way up a steep slope across the main ridgeline and descend into the My Hutt basin. This route was the only one that was acceptable to the Department of Conservation and overhead lines were not acceptable from an environmental perspective or from a viewpoint of serviceability. In winter, the route can be covered by several metres of snow and winds on the ridges regularly exceed 160 km/h. This is no place for an overhead line.

The main settlement in the District is Ashburton township and it holds about 17,000 people. Smaller towns of




Methven (1,400 people) and Rakaia (1,100 people) are also significant in terms of electricity consumer count. The district has a total population of about 30,000 people.

In the early 20th century, the Government decided to build an irrigation canal that takes water from the Rangitata River and transports it across the Canterbury Plains as far as the Rakaia River. This canal is called the Rangitata Diversion Race (RDR). During summer the RDR is used as an irrigation water canal and several downstream irrigation schemes are supplied from it. These schemes distribute water onto farms using various sizes of irrigation races. In recent times, some of these races have been

converted to piped schemes which eliminates evaporative and ground losses as well as providing gravity pressurised water to the farm gate. To reduce the risk during dry periods many farmers on open race schemes have constructed large storage ponds on their farms. The farmer may then take their full allocation of water at any time it is available and any water not required at that moment is stored for later use. The farmer can pump the water from the pond at any rate they choose.

One of the uses for the RDR is power generation. There are two hydro generators on the RDR, one at Montalto and another at Highbank. The Montalto one generates all year round while Highbank can only generate if most irrigation schemes are not taking water.

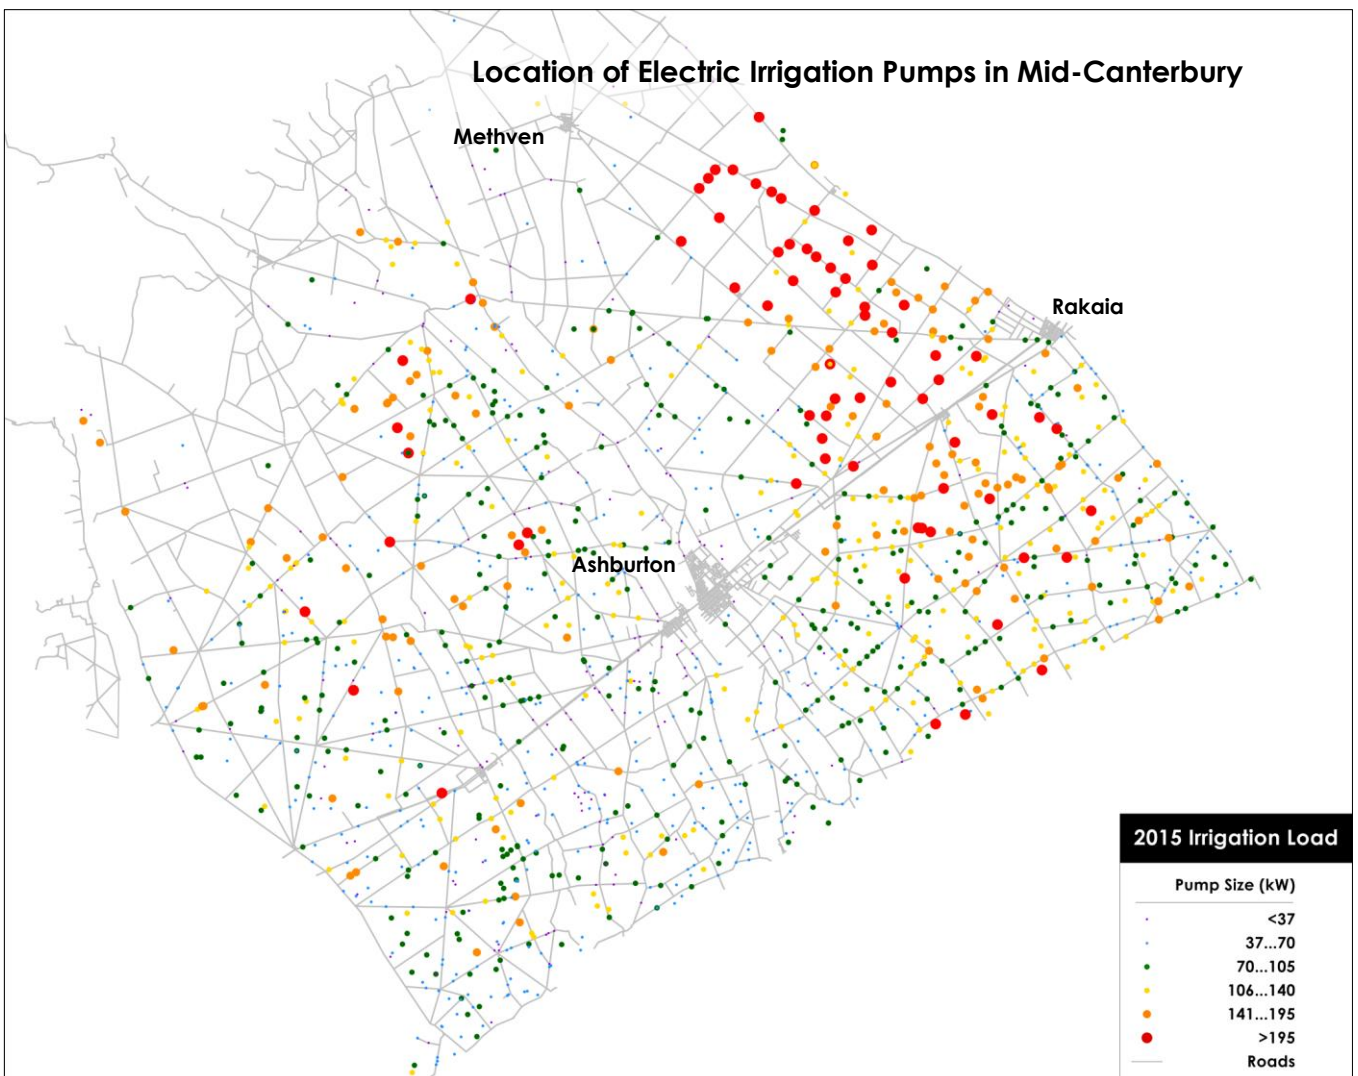

There are a couple of other small hydro generators in the district at Cleardale (Rakaia Gorge) and on an irrigation canal at Ealing.

The electrical demand needed to irrigate a hectare of land at a rate of 0.6 litres/second/hectare (the generally accepted rate) varies depending on the source of water and irrigator type. A modern centre pivot irrigator supplied with water from a surface pond will require about 0.55 kW/hectare. So, a 900m radius centre pivot will require a pump of approximately 140 kW to drive it. If the water comes from a deep well, the pump must also overcome the additional gravity head of the well. If the same 900m centre pivot is supplied with water from a 120m deep well then another 0.71 kW/hectare must be added. This would mean the installation would need a 320 kW electric pump to drive it. This type of load places considerable demand on a rural electricity network. The average size of EA Networks' irrigation connections is 85 kW.

The Highbank Hydro Power Station has recently been equipped with an array of six 1.5 MW pumps that allow it to take water from the Rakaia River and pump it up the power station penstock (a height of about 100m) into the RDR. The water is then available for irrigators to use. This scheme is generally referred to as the BCI scheme ([www.bciwater.co.nz](http://www.bciwater.co.nz)). During January 2015 this load was coincident with the summer peak demand for the first time (a dry year caused low diversity of irrigation demand). There is an agreement in place that should a 66kV subtransmission circuit be unavailable because of a fault, the supply to these pumps would not be available (i.e. the Highbank pump load is interruptible). This was a condition negotiated before the load was initially supplied.


The following table depicts the major loads supplied by EA Networks.

Significant Load	2012 Energy (MWh)	Peak Load (kW)
<b>Meatworks #1</b>	39,000	8,000
<b>Meatworks #2</b>	13,600	3,400
<b>Vegetable Processor</b>	21,400	4,400
<b>Plastic Goods Mfr</b>	4,100	1,300
<b>Ski-field</b>	1,900	2,100
<b>BCI Irrigation Scheme</b>	650	8,400
<b>Distributed Irrigation</b>	220,000+ (Typical Year)	140,000
<b>Other Load</b>	250,000+ (Typical Year)	65,000
<b>TOTAL</b>	550,000+ (Typical Year)	177,000

More than 50% of the energy transported by EA Networks is delivered to 8% of the connected consumers. The peak demand (which occurs in summer) is almost entirely determined by the amount of rainfall, which in turn influences the amount of irrigation that takes place. The winter peak demand is approximately 40% of the summer peak and is largely determined by the harshness of the winter and low temperatures driving residential heating. The winter load is concentrated in the townships particularly Ashburton and the urban underground network is designed with this in mind. Mt Hutt ski-field is also peaking its electricity usage in winter and the early part of winter can see the snow-making systems working at full capacity, particularly overnight when it is colder.

The diagrams in [section 3.2.3](#) show the seasonal variation in load between rural/urban zone substations as well as the seasonal load/generation balance.

**Irrigation Connections in 10kW Bands**

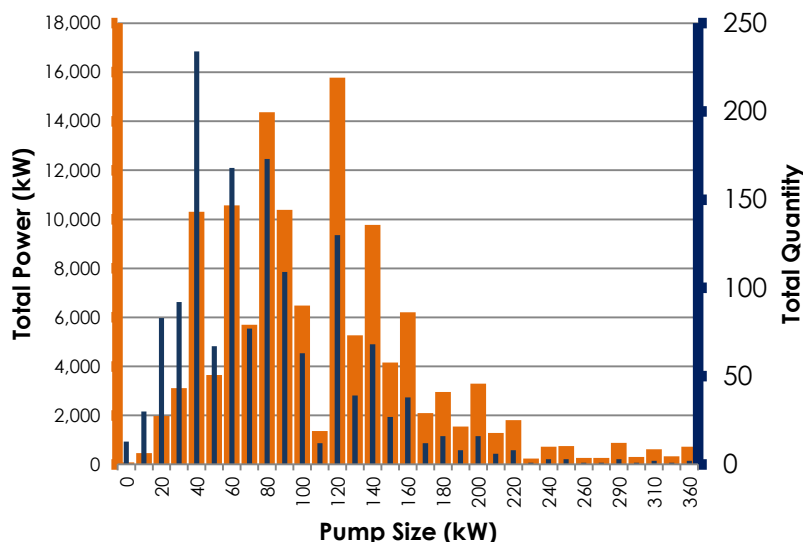

### 3.2 Network Configuration


This section describes the general arrangement of each major section of the EA Networks electricity network.

#### 3.2.1 GXP and Generation


EA Networks take supply from the national grid company (Transpower) at a site approximately 7km south-east of Ashburton township. The Transpower Ashburton Substation (known as Ashburton220 or ASB since EA Networks also have an Ashburton substation) supplies EA Networks with two subtransmission voltages, 33kV and 66kV (also known as a Grid Exit Points – GXP). The following diagram illustrates the configuration of the Transpower ASB substation and the two GXPs within it.

The orange lines represent 220kV (the national grid transmission voltage). The blue lines are 66kV and the green lines are 33kV. The capacity of each transformer is shown above and the peak load of the 33kV GXP is currently below the rating of one transformer. The 66kV GXP has a peak load below the rating of one transformer.


Connections by GXP Voltage

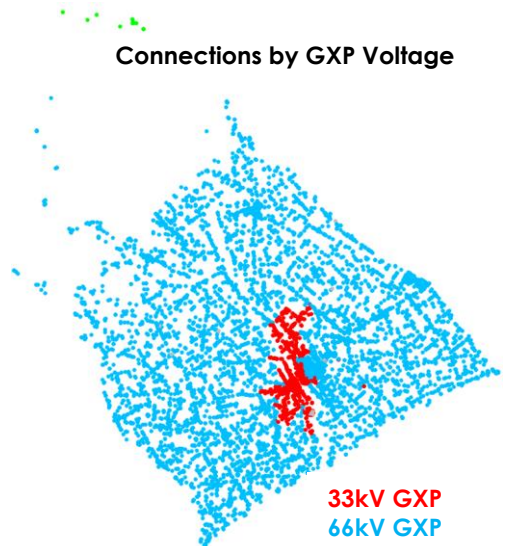


EA Networks Grid Exit Point Configuration

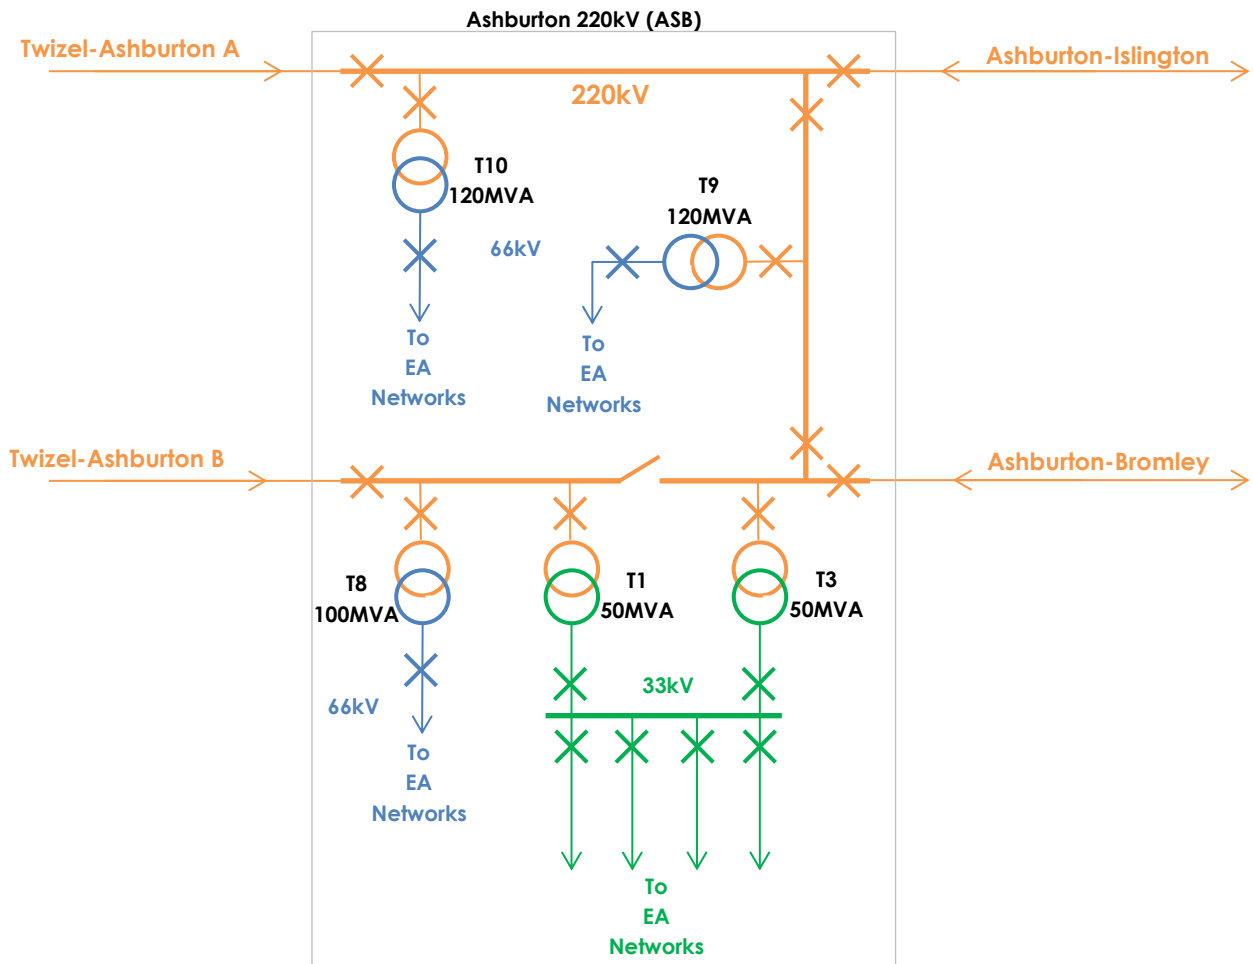


**Ashburton 33kV Net Load 2015-16 (146 GWh YTD)**

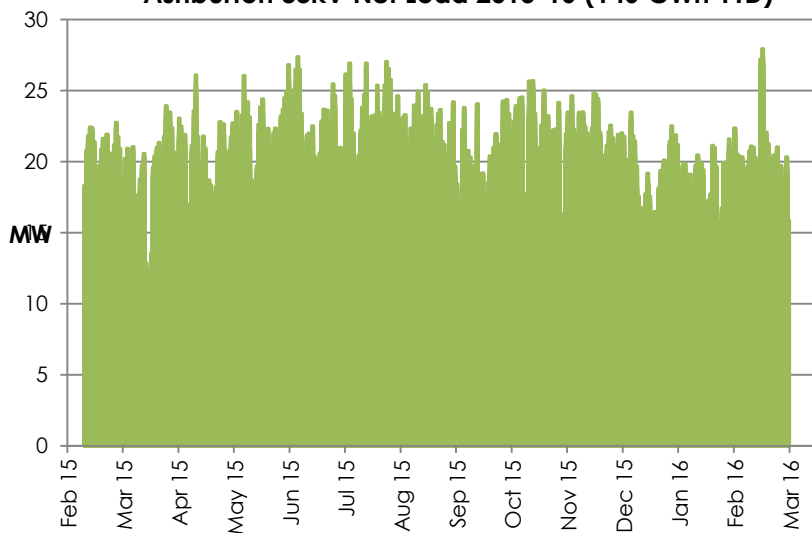

**Ashburton 66kV Net Load 2015-16 (450 GWh YTD)**

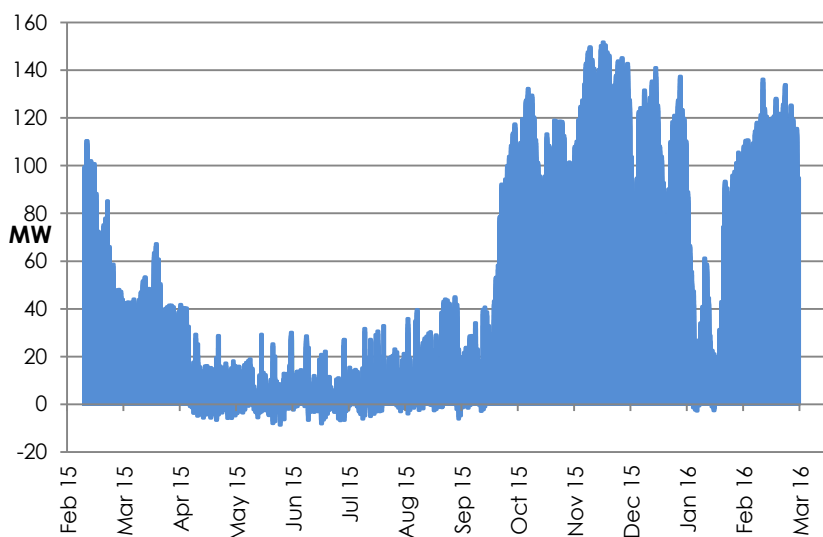



**System Total Load 2015-16 (690 GWh YTD)**

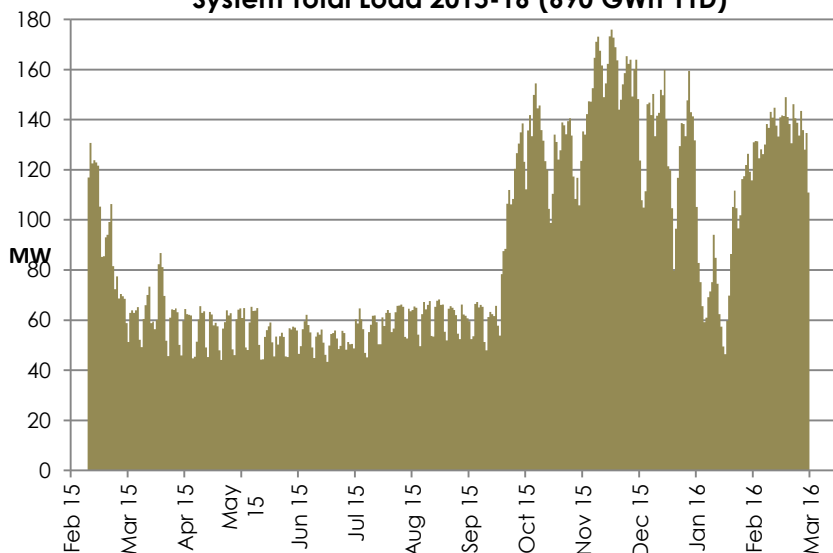


T8 (the smallest of the three 220/66kV transformers) and one other of T9 or T10. T9 was commissioned during 2013. This configuration ensures 66kV loads up to 220 MVA are secure.

The 33kV GXP supplies approximately one third of EA Networks' consumers (6,300) and has the lowest peak load of the two GXPs. The load charts below illustrate the residential/commercial nature of the load on the 33kV GXP. The seasonal variation is present and is of the order of 20-30% higher in winter than in summer. The weekly load variation can be clearly seen with significant dips at the weekends. The daily load variation is very marked during morning and evening meal times with both heating and cooking loads being heavily used. It is at these times that water heating load control is used to ensure both the Transpower grid and EA Networks assets are not unnecessarily high capacity for a load that can be shifted a few hours without consumer impact. Note that in May there was a step decrease in 33kV GXP load when Northtown zone substation was converted run at 66kV. The corresponding load increase on the 66kV GXP is seen as a decrease in net export caused by embedded generation.

The 66kV GXP is very different in its load profile. This GXP supplies about 12,400 consumers including about one third of Ashburton township. Many are similar residential (albeit rural) connections to that on the 33kV GXP. It is however the relatively small number of irrigation and generation connections that shape the seasonal and peak 66kV GXP loads. Irrigators do not tend to have a daily or weekly load variation. Once the water is required, the irrigator is left to run for possibly weeks on end. The irrigation is predominantly used in the summer although a farmer's growing season can extend into April in some years. Equally, a dry winter can cause early irrigation demand to occur in August or September as happened in 2014. A wet spell during December has reduced that demand briefly. Note that the negative MW areas of the graph below the '0' line represent a net export of power into Transpower from the GXP. The load on the 66kV GXP varies from +140 MW in summer to -15MW in winter.

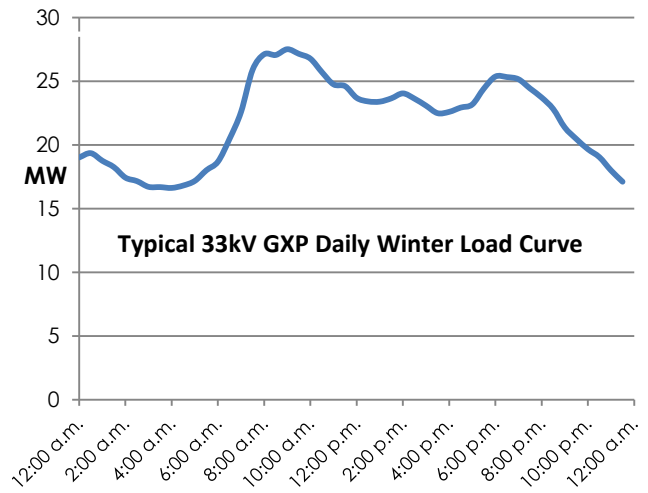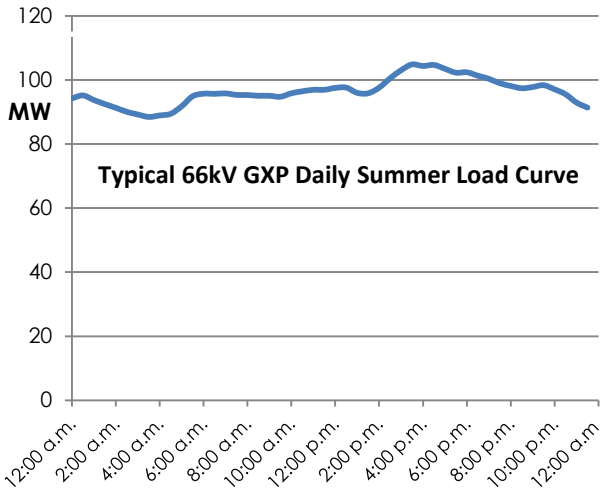

The Highbank Hydro Power Station is rated at about 28MW output. It has a single turbine with a head of 104m. The RDR race has a flow of 31 m<sup>3</sup>/s at peak times when no water is being used for other purposes. There is no ability to store water in the RDR and Highbank is considered a 'run of the river' station. The output diagram for 2014-15 can be seen below and when irrigation demand begins in September and October the water supply becomes less consistent and daily peak generation output can vary significantly.

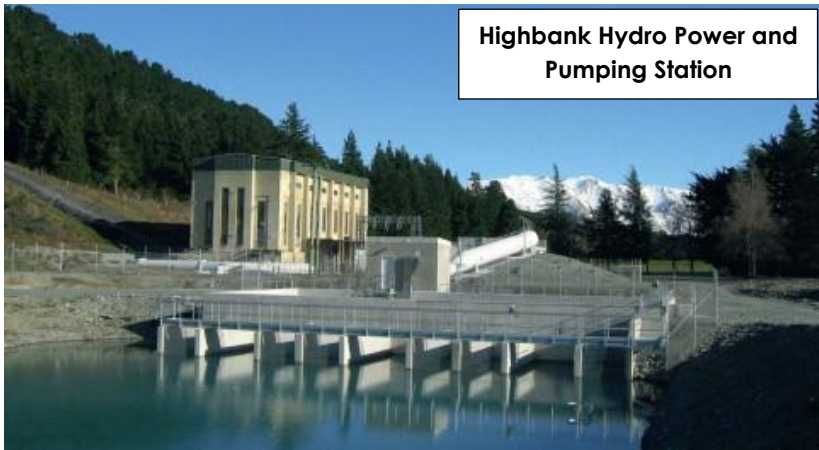


Being a single turbine station with no water storage facilities EA Networks cannot rely on Highbank operating at any particular point in time. As such, EA Networks do not factor in Highbank output during supply security studies.

Highbank also has relatively new pumps located at it to allow Rakaia River water to be pumped up into the RDR. These pumps have been used significantly during 2015-16 and appear on the Highbank load graph as load of about 5-8MW. So, the Highbank


66kV connection varies from -28MW during winter (generation) to +8MW during summer (pump load).

**Highbank Load & Generation 2015-16 (8 GWh Load / 90 GWh Gen YTD)**

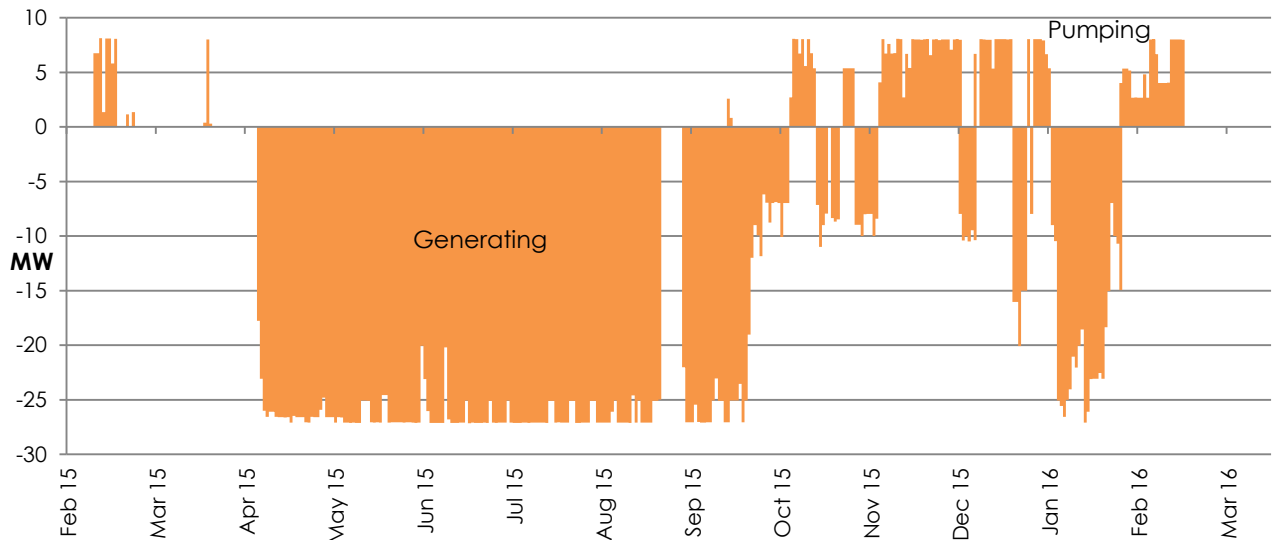



There are three other embedded generators of note connected to the EA Networks network.

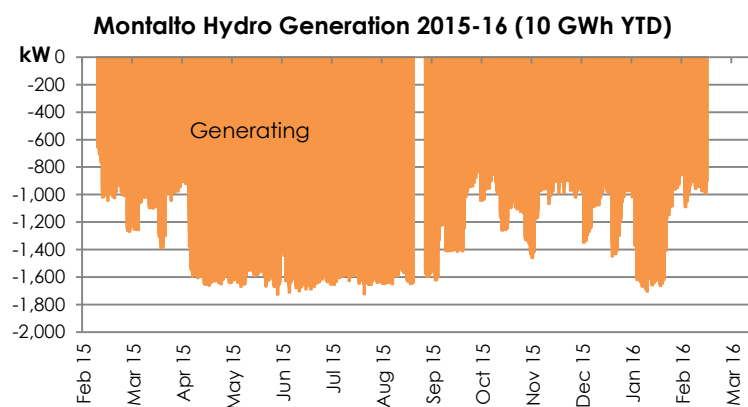

Montalto is also located on the RDR but its location offers year round output. Connected at 33kV, the generator is an induction machine which means it cannot provide any system support or provide emergency output during network faults. Winter output is around 1.6MW while summer output is about 1.1MW.

Cleardale is a 1MW generator in a valley adjacent to the Rakaia River gorge. A high head low flow machine, it generally has year round output. The 11kV connection is relatively remote and its output is largely absorbed in the Methven area after being transformed up to 33kV. The machine cannot provide emergency output. The additional expense to provide this ability was examined at the time of installation but could not be justified for the small variable output and local fault frequency/consequences.

In 2016, an additional hydro generator has been connected to the EA Networks 22kV system near Barrhill. The unit is owned by BCI Irrigation and rated at 520kW output. This output is absorbed into a 22kV feeder from Lauriston zone substation. The output of the generator is determined by BCI's irrigation customer demand for water. The intake for the generator is some 6.7km upstream of the generator site and a large diameter plastic pipe delivers the water to the generator with a 32m static head. Just above the generator site is a bifurcation of the delivery pipe and gravity pressurised irrigation water is diverted as required for delivery onto the Canterbury Plains. Flow into the irrigation system is controlled by the main valve on the generator. The machine has not been running long enough to obtain meaningful output data, but future plans will document its operational characteristics.

The very small hydro turbine at Ealing Pastures is located on an irrigation race and is normally used as a mechanical drive to a pump. When there is excess mechanical power a 200kW induction generator provides electrical power for on-farm needs and any excess is then exported onto the EA Networks system at 22kV. The generator has virtually no impact on the network other than to reduce the farm's demand during the irrigation season.


Distributed Generator	Typical Energy (MWh YTD)	Capacity (kW)
Highbank	102,545	28,000
Montalto	9,978	1,650
Cleardale	3,341	1,000
Barrhill	2,700*	520
Ealing Pastures	19	200

\* An estimate based upon one month of operation


The geographic location of the main generators as well as Transpower's ASB substation are shown in the diagram in [section 3.2.2](#).

### 3.2.2 Subtransmission

EA Networks use two voltages for subtransmission; 33kV and 66kV. The 33kV network is limited to two distinct zones.

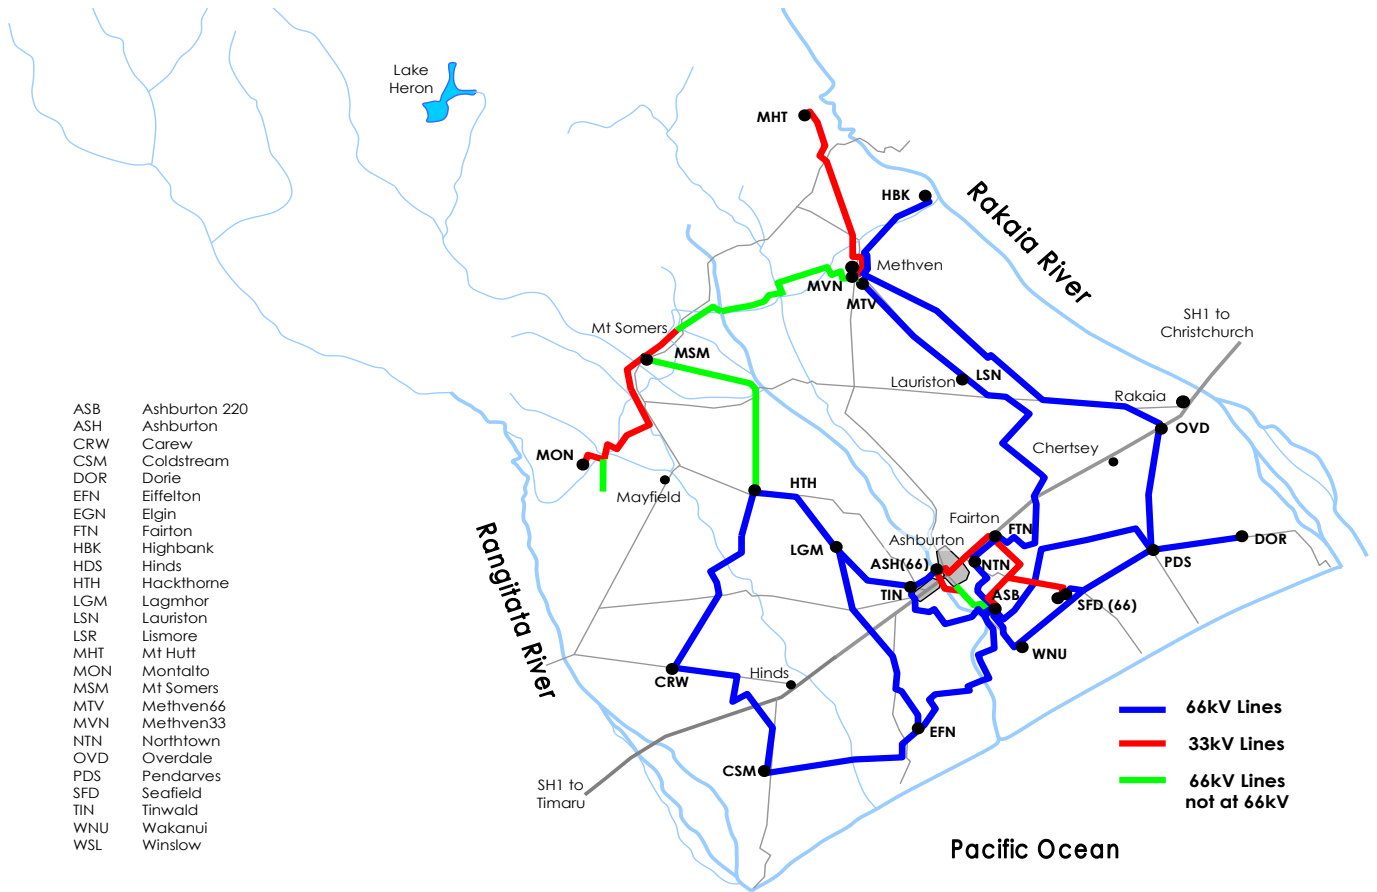

2015 Electricity Ashburton Subtransmission Network

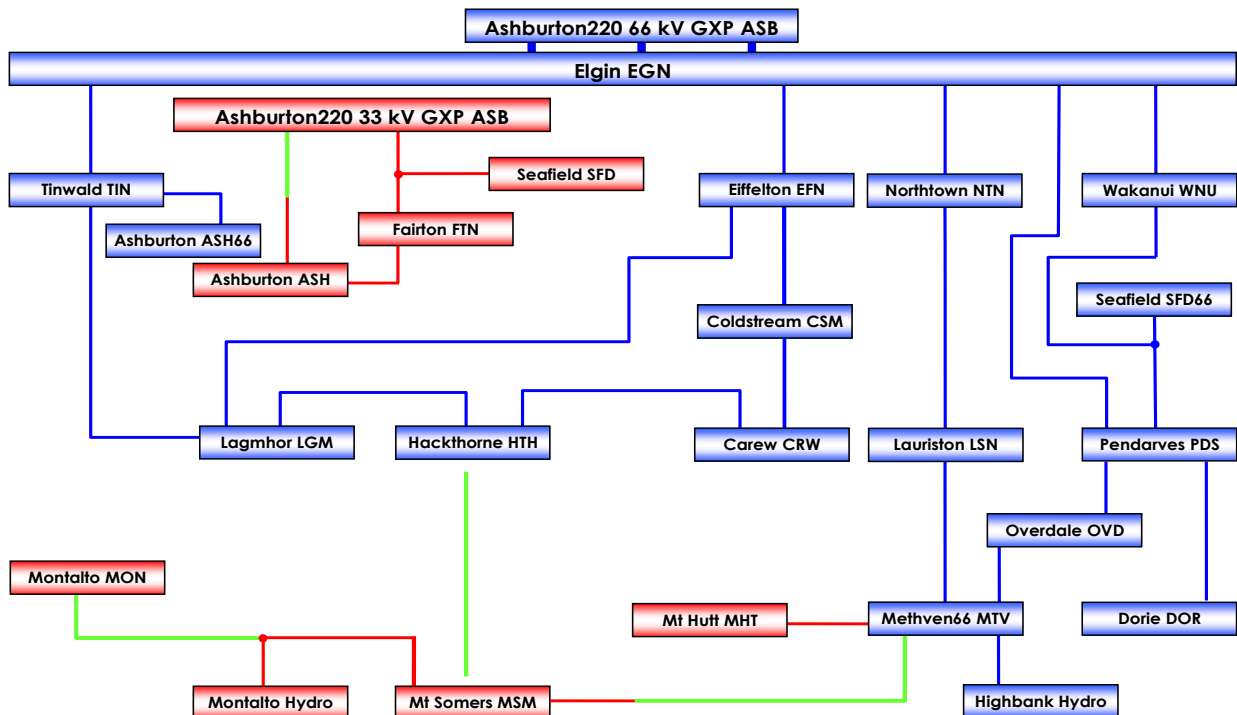

The most heavily loaded 33kV network, which is directly connected to the 33kV GXP, supplies Ashburton, Fairton and, optionally, the ANZCO meat works (SFD). During 2013-14 the ANZCO load was switched to the 66kV network, as was a portion of the Ashburton load when Northtown substation was converted to 66kV. The Ashburton-Fairton supply consists of a 33kV ring that is normally operated closed. This means that in most circumstances a single line fault will not cause an interruption in supply.

The second section of 33kV network is two radial 33kV lines supplied from the Methven 66/33kV substation. One is dedicated to the Mt Hutt 33/11 kV substation which supplies the Mt Hutt ski field as well as the Cleardale generator. The other 33kV line supplies Methven 33/11kV substation, Mt Somers substation, Montalto substation and Montalto Hydro Power station. Both of these lines are radial, so a fault anywhere along their length will typically mean loss of supply will occur. There is a line circuit-breaker at Mt Somers which prevents faults beyond there from causing an outage at Methven or Mt Somers 33kV substations.

The 66kV subtransmission network is the core of the rural supply system for EA Networks. The configuration of the 66kV network consists of two closed rings.


The northern network supplies a number of 66/22 kV substations as well as Methven 66/33kV & 66/11 kV substation. There is a three terminal 66kV line in this section of the network that supplies the new Seafeld66 (SFD) zone substation. In the middle of summer, this portion of the network supplies more than 80 MVA of load.

The southern 66kV ring is also operated closed and has an internal 66kV line joining two substations. This line offers additional security for faults in the first section of the ring leading away from the 66kV GXP. A fault in any 66kV line in the southern ring should not result in any outage for consumers. A 66kV line has been built towards EA Networks' Ashburton 33/11kV substation (ASH) in preparation for its conversion to 66kV. The first stage of this conversion has occurred and has increased the security of Ashburton township considerably.

### 3.2.3 Zone Substations



Zone substation loads and security are detailed numerically in [section 4.7](#) as well as [Appendix C](#). The load/generation centres shift between the summer/winter seasons. This shift requires the network to support high urban loads and high rural generation during winter, while during summer the rural load increases dramatically and generation disappears. These two distinct load/generation configurations are not particularly conducive to efficient network utilisation since energy is not being generated close to the available load. Another factor with electric irrigation is the need to keep fault levels relatively high so that motor starting (an intrinsically poor power factor situation through predominantly reactive overhead lines) is less disturbing to other consumers. Modern "soft" starters and variable speed drives have helped this aspect but drives in particular introduce other potentially disturbing characteristics.

A typical 66/22kV zone substation will have two 66kV lines supplying it. Line differential and distance protection is installed on each line terminal circuit-breaker. The tubular aluminium 66kV bus is supported by steel stand and has high impedance bus zone protection installed. An ONAN/ODAF 10/20 MVA 66/22kV transformer with a +5/-15% tap-changer is installed with an

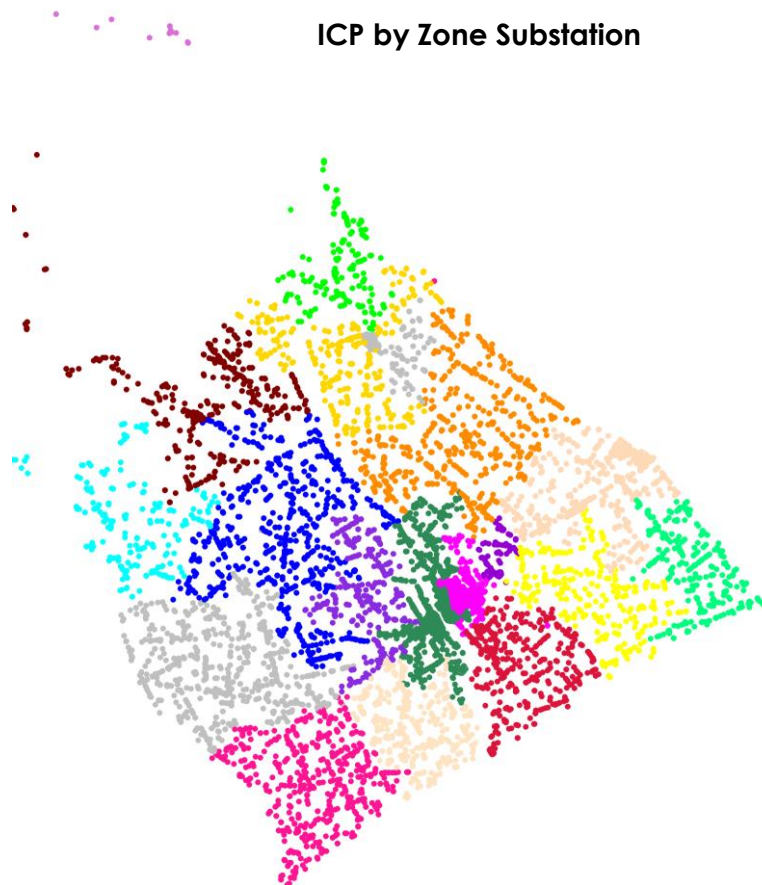

### Summer Zone Substation Loads


### Winter Zone Substation Loads

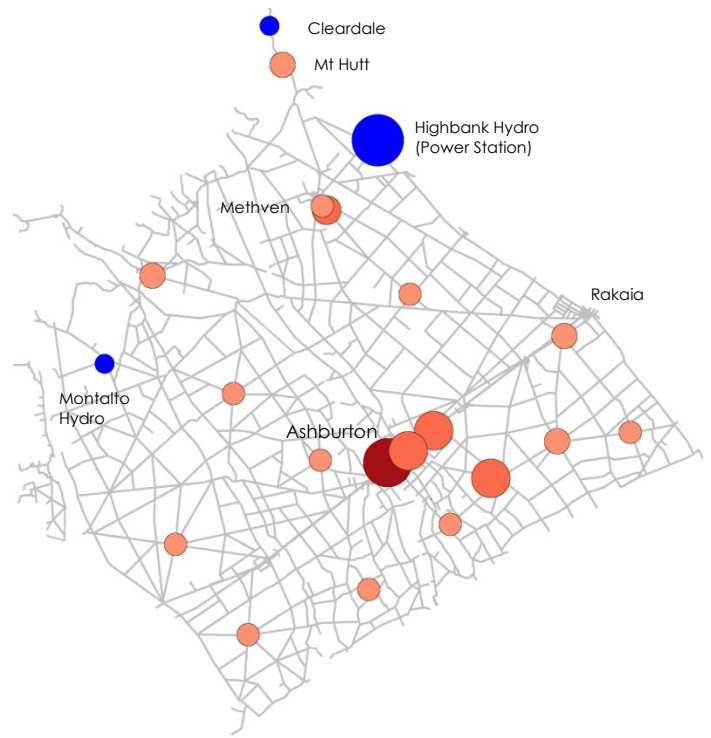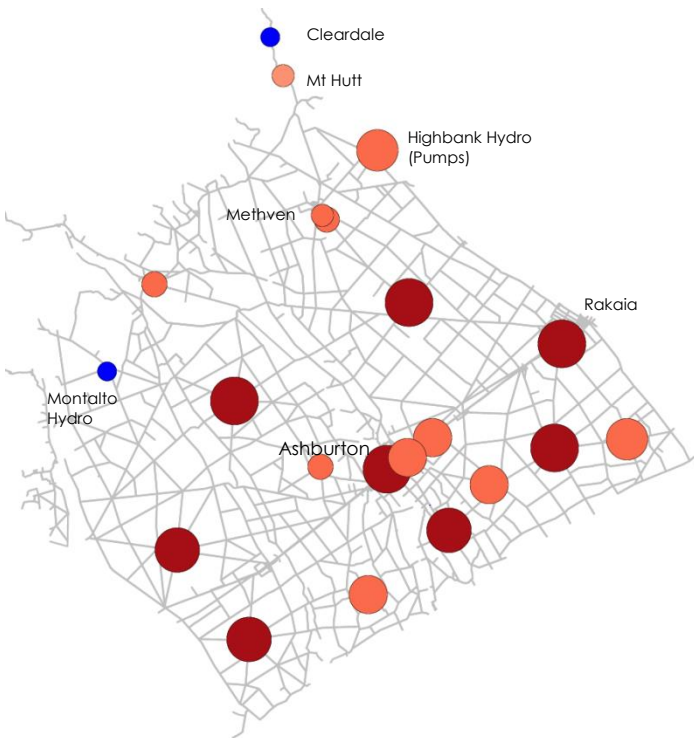

accompanying 22kV 40Ω NER. A numeric transformer differential relay protects the transformer. An indoor 22kV 5 way switchboard (one incomer and four feeders) is installed with numeric protection relays. The 22kV feeders leave the substation in 250 amp rated underground cables that are terminated outside the substation on suitable poles. Large urban substations will have multiple 66kV bus-sections, bus-section circuit-breakers, multiple 66/11kV transformers, multiple 11kV switchboards with at least one bus section circuit-breaker in each board.


The preceding load maps represent existing zone substation maximum demands themed by colour and circle diameter. The larger and redder the circle, the larger the load is. The blue circles represent

### ICP Count by GXP and Substation

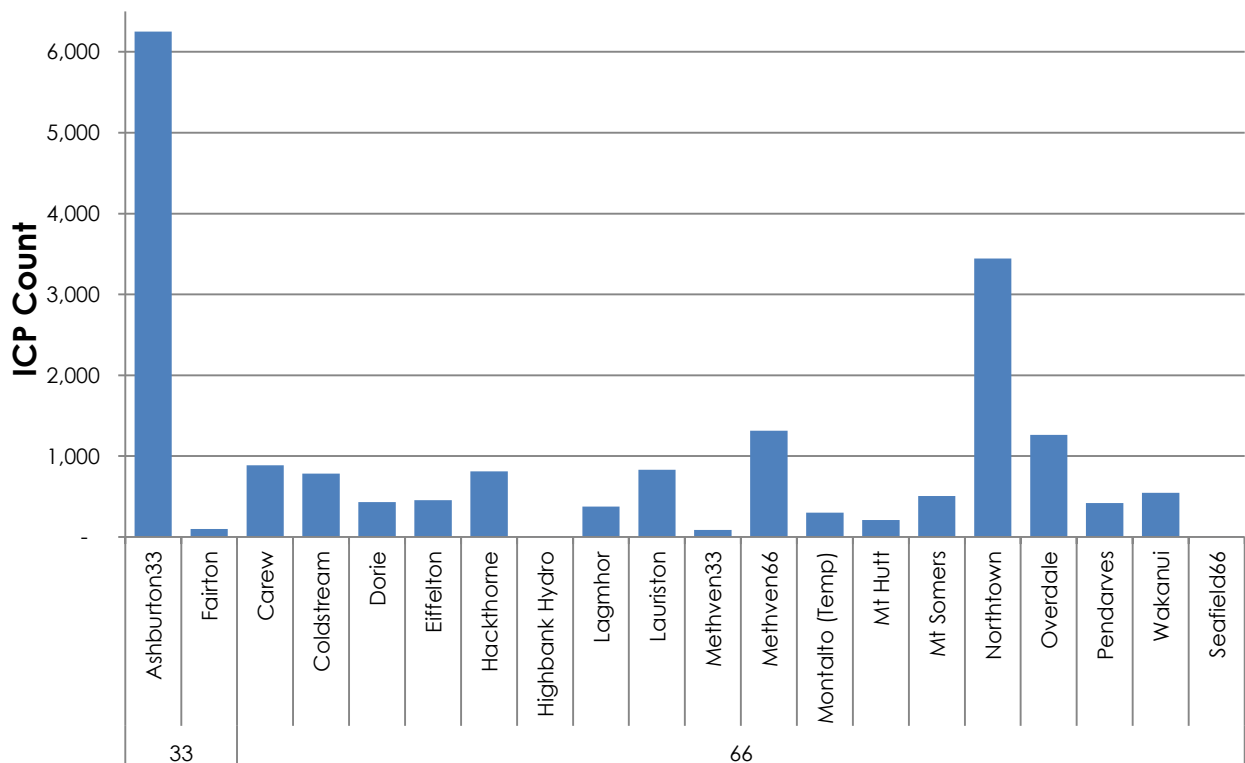

embedded generators. Highbank at 28 MW is by far the largest of the three and currently only runs during winter due to irrigation demands on its water supply (Rangitata Diversion Race) during summer.

### Irrigation Load by GXP & Substation

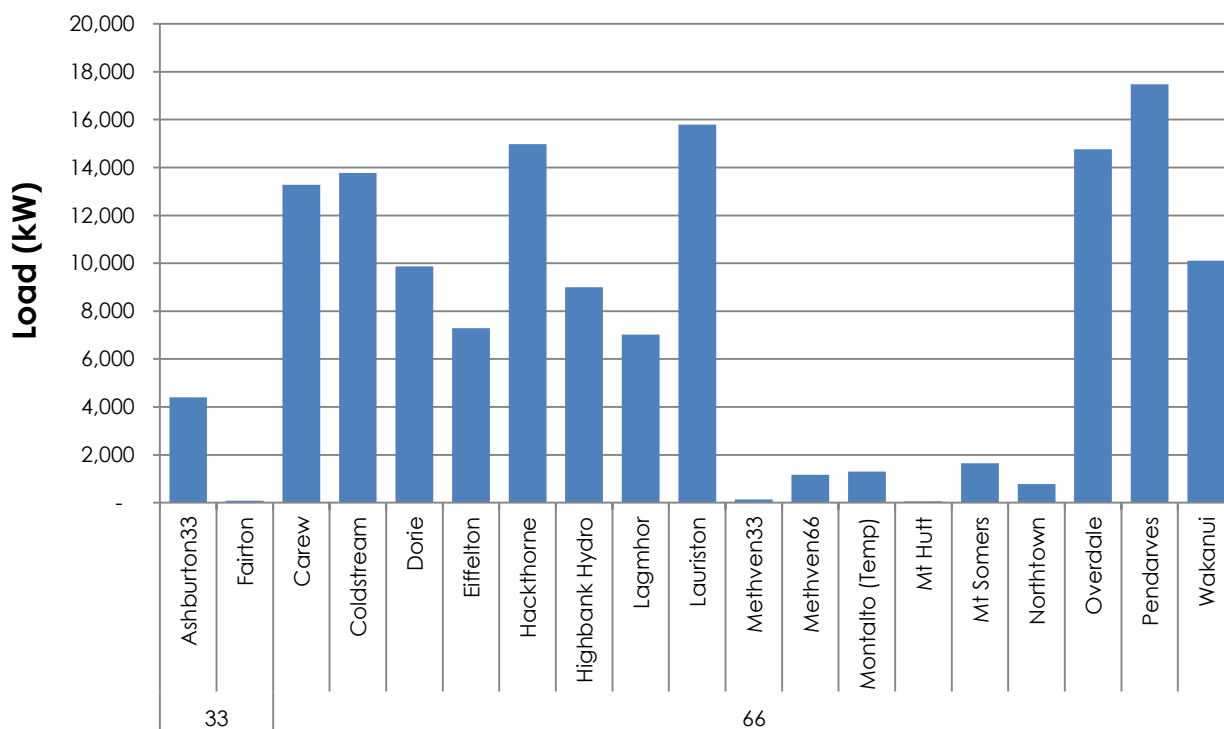

The three charts above show the irrigation load by zone substation as well as the connection count per substation. Examination clearly shows the large disparity between the two measures. 50% of the connections that EA Networks supply are on two substations (Ashburton and Northtown). The irrigation load that these two substations serve is about 3.3% of the total.

A more detailed description of the assets at each zone substation is included in [section 4.7](#).

## 3.2.4 Distribution System

The distribution system is the most obvious and visible part of the electricity network. It is on the side of many roads and when it is overhead the poles and wires are immediately evident. It is also the most numerous, asset intensive and fault prone portion of the electricity network.

### Medium Voltage

EA Networks operates two medium voltage distribution voltages.

The 11kV network is the system which has been used since around 1960 in Mid-Canterbury. It has served EA Networks well and it will remain as the dominant voltage for distribution in Ashburton and Methven townships. The extensive 11kV underground cable network in both townships means that it is not economically viable (or currently technically necessary) to convert it to 22kV.

The 22kV network voltage has been in use since about 1997. Each year since then, some portion of the heavily loaded 11kV network has been converted to 22kV. 22kV has become EA Networks' rural distribution voltage of choice. The dramatic increases in irrigation load during the early part of this century could not have been accommodated on the pre-existing 11kV network or even a heavily upgraded 11kV network.

It is fortunate that the small rural townships had not been heavily converted from overhead lines to underground cables. This has allowed townships such as Hinds, Rakaia and Chertsey to be supplied directly from the surrounding 22kV distribution network. Other townships such as Mayfield and Mt Somers

are now being converted to underground distribution and all of these cables are capable of 22kV operation (Mayfield is now operating at 22kV).

A typical rural 22kV feeder will have about 175 connections on it. The feeder will leave a zone substation indoor circuit-breaker in a short length of underground cable and connect to the overhead line on a nearby pole. The main feeder line will then radiate away from the substation for an average of about 10-15km before it encounters the end of an adjacent feeder (typically fed from another zone substation). At intermediate points along the feeder there may be spur lines protected by reclosers or sectionalisers. These devices prevent the main feeder circuit-breaker from tripping for faults on these spur lines thereby keeping supply on to most consumers during such faults. There will typically be several points along the feeder where it can interconnect with adjacent feeders. These normally open switches are either disconnectors, SF6 gas switches, or ring main units. Remote control of these switches can speed restoration significantly. Fault indicators will be located at some junctions where more than one line branches off the main feeder line. These indicators will show if a fault current has passed it recently. If an indicator is triggered, the fault is beyond that point. Ring main units are being used at points in the rural network where there are many lines that require switching (at least three, normally four). 22kV feeders can have peak loads up to 7MVA although typically they are around 4MVA. The length of a rural feeder is constrained by voltage drop along its length. It is very rare that a thermal limit is reached as conductors must be sized for voltage drop and this typically results in larger conductors than would otherwise be thermally required to supply the load.

A typical urban 11kV feeder is completely underground and has about 450 connections on it. At every distribution substation on the feeder a ring main unit will be installed that allows isolation of the cables connected to it, as well as the transformer supplied from it. This allows ready isolation of a faulted item, speeding restoration as well as permitting planned outages of assets without supply interruption. Fault indicators are used at regular intervals along a feeder to permit prompt identification of a faulty cable or transformer (which will normally cause a feeder circuit-breaker tripping). The opportunity for interconnection with other feeders is far greater in an urban area simply because of proximity/density. It would not be uncommon to have four or five points that permit at least partial back-feeding of an urban 11kV feeder. The 'reach' of an urban 11kV feeder is normally constrained by thermal considerations. The rating of a buried cable is thermally limited and prudent sizing is required to ensure adequate capacity for future demand without over-specification. An underground feeder may radiate up to 4km long (cable route) and typically has a peak load of around 3MVA. This limit ensures a 4.5MVA capacity feeder can provide back-feed support to adjacent feeders in case of a fault.

The degree of underground cable usage is very dependent on the voltage. The urban 11kV areas adopt intensive use of underground cable. Methven township is completely underground at both 11kV and LV levels. The only poles in Methven are street lighting poles (supplied from underground cables). Ashburton township is approximately 87% underground cable at 11kV and at LV is 83% underground. Overall, the 11kV network is 16.9% underground and the LV network is 77% underground.


At 22kV, the penetration of underground cable is much less. Only 4.9% of the 22kV network is underground.

The distribution network (22kV, 11kV and LV) is 20.6% underground by circuit length.

## Distribution Substation

A distribution substation is a facility in the network that accommodates equipment that switches and transforms MV (medium voltage - 22kV and 11kV) to LV (low voltage - 230-400 volts). There are a range of styles of distribution substations.

A pole-mounted substation is a relatively simple assembly of assets. The key component is the transformer which is hung from a short crossarm using galvanised steel brackets that are supplied with the transformer. These brackets are secured to the crossarm for both seismic security and restraint should a vehicle contact the pole. The transformer has a set of MV drop-out fuses mounted above it (generally on a separate crossarm) that provide the transformer with fault protection as well as the ability to isolate the transformer should it be required for

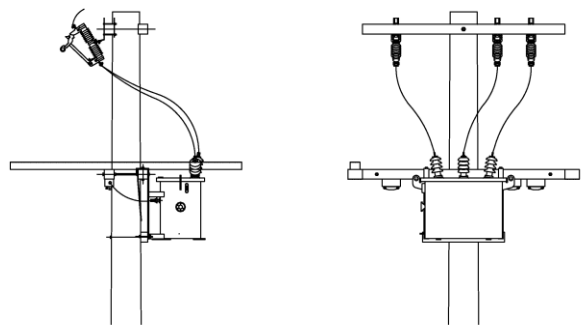

maintenance or replacement. A set of LV fuses are installed on the transformer hanger arm which ensure any fault in the connected LV network does not cause the MV fuses to operate and also provides some overload protection to the transformer.

Several types of ground-mounted distribution substations are in use. The simplest ones consist of an off-the-shelf 'microsub' or 'minisub'. These are a ground-mounted transformer with two cabinets directly attached to the body of the transformer. One cabinet has the MV bushing wells in it and can have one or two cables per phase connected (two cables allows a connection to another transformer). The second cabinet houses the LV bushings and can accommodate several LV cables and a number of LV fuse-disconnectors. This style of substation is used when small (<150 kVA) supplies are needed and there is no need for multiple high capacity LV circuits. They are commonly used on rural properties for houses, sheds, small dairy sheds, etc particularly when they are fed from a nearby overhead line. Some of the larger microsubs have two MV bushing wells per phase (bridged internally) that allow two cables to be connected. This permits simple disconnection of one set of screened elbow terminations to occur when the need arises. The microsub and minisub both use precast concrete foundations.

The next level of sophistication comes with a pad-mounted transformer and either one or two separate small steel kiosks. This arrangement provides the ability to house a MV ring main unit in one kiosk and a multi-way LV switchboard in the other kiosk. These substations can be large (up to 1,000kVA) and are used in commercial/industrial applications where an exposed transformer is less conspicuous. The concrete foundations for these units are also precast to one of two standard designs (depending on transformer rating). These substations can be integrated into an interconnected urban/industrial/commercial LV network.



The final variant of the distribution substation is a large single kiosk design (above; 11kV left and 22kV right). The kiosk is either steel (22kV) or fibreglass (11kV) and houses a transformer (up to 500kVA), a MV ring main unit (up to 5 x 11kV or 3 x 22kV circuits), a LV switchboard (up to 7 x 630 amp rated circuits plus 3 x 60 amp streetlighting circuits), and any ancillary equipment such as ripple relays and maximum demand indicators. These substations are the standard style used for residential areas and integrate fully into the MV and LV networks.

An urban distribution substation can supply up to 100 residential connections on multiple LV feeders.

## Low Voltage

The low voltage distribution network is largely located in the urban areas. Rural LV is typically short overhead lines or underground cables from a pole mounted distribution substation to the property boundary (EA Networks ownership typically ends at the boundary).

The urban LV network is either older overhead lines located in the smaller townships or predominantly underground located in the larger townships. Overhead LV is smaller in capacity and has virtually no interconnection (via switches) with adjacent overhead LV network fed from other distribution substations. The reason for the low level of interconnection is twofold: the small capacity means it is typically incapable

of providing adequate back-feeds and the pole-mounted distribution substations are typically much smaller and cannot provide the capacity for back-feeding. The urban underground LV network is much higher capacity and has a great deal of interconnectivity. This allows the shifting of segments of the LV network from feeder to feeder and substation to substation during either planned or fault work. The switching of these segments (between substations) takes place at distribution boxes housing compact LV switchgear (see image at right). The style of switchgear in use allows live (dis)connection of cables, installation of new ways, and even interconnection of two adjacent cables without using the bus. This very flexible system provides opportunities to accommodate unusual operating conditions. The distribution boxes are standardised designs that use a common backplane/bus that permits addition/removal of plug-in switching devices as required.



### 3.2.5 Secondary Assets

There are a range of EA Networks assets that are ancillary to the structural or high current/voltage functionality of electricity distribution. These include the following:

#### Protection Relays

The protection relay assets at EA Networks vary from relatively few old electromechanical devices through to many modern microprocessor based units. The standard approach is to use a limited range of standardised devices so that existing designs can be reused and staff do not have to retain familiarity with too many different devices. Although this may not be the cheapest initial cost it provides the most economical lifetime cost. At subtransmission voltages every protection scheme incorporates a local device that will provide back-up in the event of failure or non-detection of a fault. This ensures that the minimum amount of equipment is removed from service during fault conditions. At distribution voltages the zone substation transformer protection provides back-up to the feeder protection. Beyond the feeder circuit-breakers exist a range of reclosers and sectionalisers that do not have local back-up but rely on the feeder protection relay to detect the fault if they do not. This leads to larger loss of supply but the fault is still cleared safely.

[Section 4.12](#) provides some additional information about the protection relays at EA Networks.

#### Ripple Injection Systems

EA Networks operate a 283 Hz decabit ripple injection system. The injection plant is all solid state. There are three injection plants, two of which are actively used. The 33kV plant at Ashburton 33kV substation (ASH) provides signal injection for Ashburton, Fairton and Seafield substations. This represents about 33% of the connections on the network and a significant proportion of the controlled water heating load. The second 33kV plant at Transpower's Ashburton220 substation (ASB) provides signal for the 66kV network using a 33/66kV step-up transformer in the adjacent Elgin substation. The signal level from the ASB plant is lower than ideal and has come under additional pressure since a third 220/66 kV transformer was commissioned at ASB in late 2013. In the event of a problem with the ASH plant the ASB plant can provide signal by switching it from the step-up transformer to the ASB 33kV bus. The small third injection plant at Methven 33kV substation (MVN) can provide some cover in the event of a problem with the ASB plant but it does not provide complete coverage. There are two projects in the plan to address this issue.

#### SCADA Systems

The SCADA system is available at the majority of EA Networks' zone substation sites. The newer sites with numeric protection relays have all been integrated onto the SCADA system. Some of the older/smaller sites have not been connected or are not fully monitored/controlled. [Section 4.14](#) provides additional information about the SCADA system.

#### Telecommunication Systems

EA Networks own a fibre-optic data network (as a separate commercial function) and extensive use is made of it for electricity network telecommunications. A digital mobile radio (DMR) network has been



implemented as the primary voice communication system for EA Networks. DMR offers digital audio clarity and the ability to transparently transport small data packets such as GPS location, device control signals or SMS messages. Another advantage of DMR is the ability to integrate multiple base stations to provide better coverage. The 5 base stations are interconnected using TCP/IP over the fibre network.

Other uses of the large reliable bandwidth that fibre offers include the SCADA system and video monitoring of zone substation buildings and yards. This allows not only intruder detection but also an additional layer of safety as the control centre can monitor staff while they are on site and response to any incidents can be immediate.

A more comprehensive description of the telecommunications network is available in [section 4.14](#).

### 3.3 Asset Justification

In order to justify the existence of the present EA Networks owned electricity network assets one could look at it from first principles and prove by calculation that the class and size of each asset category is the minimum needed to support the loads that exist on the network. Alternatively, one could assume that only variations from the Australasian norm would need to be justified – the evolution of the Australasian electricity networks have occurred progressively over the last 50 years and most networks have ended up with a similar style and scale of investment. The following table documents what EA Networks anticipate the electricity industry considers to be the "average" network:

Network Feature	Characteristics
Connection(s) to National Grid:	One or more supply points operating at one or more voltages at or between 11kV, 33kV, 66kV and 110kV. Typical respective capacities: 10-60 MW (11kV urban supply), 20-100 MW (33kV general supply), 50-250 MW (66kV general supply), and 150-500 MW (110kV general supply). Capacity is comparable with the peak load of the supplied network.
Subtransmission Network:	33kV, 66kV or 110kV network with typical respective capacities of 25 MW, 55 MW and 95 MW per overhead circuit. Maximum voltage drop not exceeding 10% during n-1 security events. Typically overhead lines in rural and light urban settings. Normally underground cables in high density urban settings.
HV Distribution Network:	6.6kV, 11kV, 22kV and rarely 33kV network. Capacity determined by thermal rating for short feeders and voltage drop in long feeders. Rural network and older urban network are usually overhead lines. Newer urban network is usually underground cables. Typically rated at between 200 and 400 amps. Voltage drop should not exceed about 5% under normal peak loading.
LV Distribution Network:	230/400 volt network. Rural network and older urban network typically overhead lines. Newer urban network typically underground cables.
Embedded Generation:	If it exists, it is typically up to several MW at discrete locations around a network. Can be connected to either HV distribution or subtransmission networks.

EA Networks' network can be briefly described as follows:

EA Networks Network Feature	Characteristics
Connection to National Grid:	One supply point operating at 33kV and 66kV. 33kV capacity 2 x 50 MVA and 66kV capacity 2 x 120 MVA + 1 x 100 MVA. 33kV peak


load approx. 24 MW, 66kV peak load approx. 160 MW. EA Networks have fewer supply points than most similar companies.

Subtransmission Network:	Extensive 33kV and 66kV network with capacities of 25 MW and 55 MW per overhead circuit (500 amps). Some portions of the 33kV network are radial and have no alternative 33kV supply. All significant subtransmission is overhead except for one run of 33kV cable in the Ashburton urban area. Prior to conversion to 66kV, parts of the 33kV network were operating at 30kV (-10%) during peak loads with all circuits in service.
HV Distribution Network:	11kV and 22kV network. Urban network is mixed overhead and underground 11kV. Per circuit capacity of 200 to 400 amps. Rural network is both 11kV and 22kV overhead lines. Portions of 11kV network approaching 5% voltage drop during peak loading. Prior to conversion to 22kV much of the 11kV network exceeded 5% voltage drop at peak loading.
LV Distribution Network:	230/400 volt network. Rural network and older urban network overhead lines of modest capacity. Newer urban network is underground cables of significant capacity.
Embedded Generation:	Four significant embedded generators: 0.5 MW, 1.0 MW, 1.6 MW and 26 MW. The 0.5 MW and 1.0 MW units are connected to the distribution network. Both larger units are connected to the subtransmission network. The 26 MW unit required dual 66kV circuits from Methven to Elgin to provide security and limit voltage rise.

The reader is directed to [section 1.1](#) for the evolution of the present network and it is hoped that along with this section it provides adequate justification for the network in use today.

### 3.4 Asset Value

EA Networks are required by regulation to periodically disclose the value of its assets. This value derived from this process is called the Regulatory Asset Base (RAB).

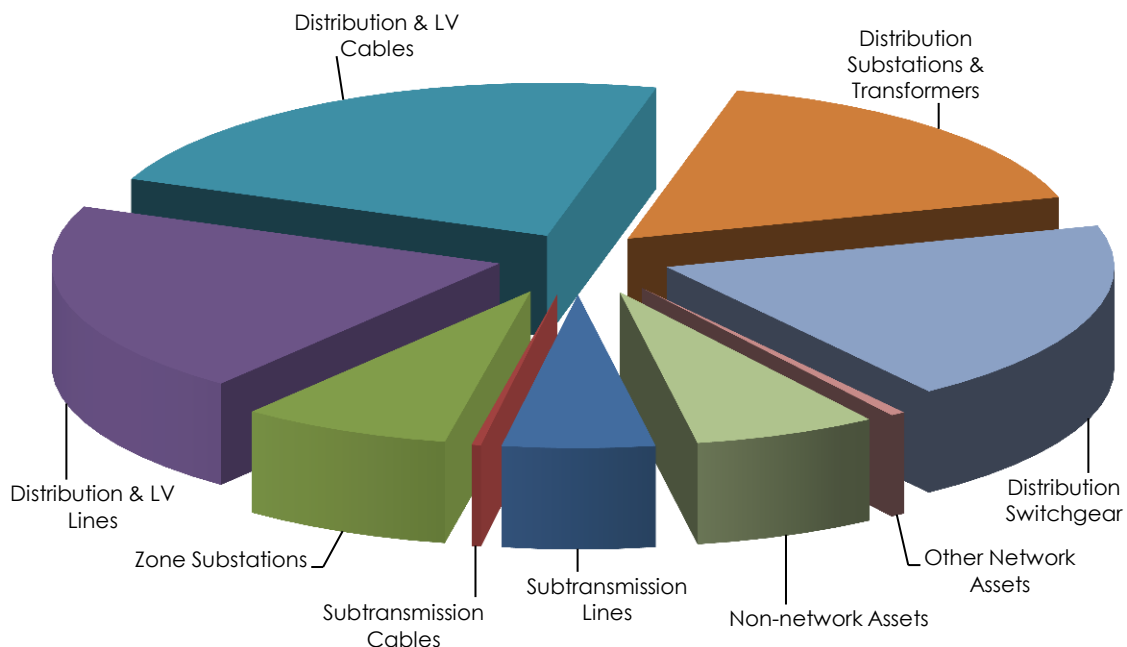

In order to provide indicative values for the assets covered by this asset management plan the most recent RAB components are detailed below. The table (below) and chart (above) describe the proportion and value of assets in each category.

The values stated in the table and displayed in the chart are extracted from the 2015 RAB disclosure of asset value as at 31 March 2015. The RAB categories are not completely aligned to the categories used in this plan but do provide an indicative distribution of the value in each category.

<b>Summary of EA Networks Regulatory Asset Base (2015)</b>		
<b>Asset Category</b>	<b>RAB Value (\$M)</b>	<b>Percent of Total</b>
Subtransmission Lines	12.5	5.5%
Subtransmission Cables	0.8	0.3%
Zone Substations	17.2	7.6%
Distribution & LV Lines	46.2	20.4%
Distribution & LV Cables	51.7	22.9%
Distribution Substations & Transformers	37.8	16.7%
Distribution Switchgear	44.0	19.4%
Other Network Assets	1.2	0.5%
Non-network Assets	15.0	6.6%
<b>TOTAL</b>	<b>\$ 226M</b>	<b>100%</b>

The 2015 closing Regulatory Asset Base (RAB) was \$226.35 Million.

Additional information concerning the make-up of EA Networks RAB can be downloaded from:

<http://www.eanetworks.co.nz/Disclosures/Regulatory.asp>.



# LIFECYCLE ASSET MANAGEMENT

<b>Table of Contents</b>	<b>Page</b>
4.1 Introduction	95
4.2 Overview	97
4.2.1 Maintenance	97
4.2.2 Replacement	97
4.2.3 Enhancement	98
4.2.4 Development	98
4.2.5 Asset Renewal Processes	98
4.2.6 Line Maintenance - General Observations	100
4.2.7 Present Planning Priorities	101
4.3 Subtransmission Assets	102
4.3.1 66kV Subtransmission Lines	102
4.3.2 33kV Subtransmission Lines	104
4.4 Distribution Assets	108
4.4.1 11kV and 22kV Overhead Distribution Lines	108
4.4.2 11kV and 22kV Underground Distribution Cables	113
4.5 Low Voltage Line Assets	115
4.5.1 400 V Overhead Distribution Lines	115
4.5.2 Description	115
4.5.3 400 V Underground Distribution Cables	118
4.6 Service Line Connection Assets	120
4.7 Zone Substation Assets	122
4.8 Distribution Substation Assets	130
4.9 Distribution Transformer Assets	132
4.10 High Voltage Switchgear Assets	136
4.11 Low Voltage Switchgear Assets	144
4.12 Protection System Assets	145
4.13 Earthing System Assets	148
4.14 SCADA, Communications and Control Assets	151
4.15 Ripple Injection Plant Assets	154



## 4 LIFECYCLE ASSET MANAGEMENT

### 4.1 Introduction

This section is where the detailed asset-specific management issues are discussed. It describes each asset by category and details quantities, condition, performance, maintenance and the operational standards of each in turn.

The management plans for each asset category detail how EA Networks intends to operate and manage the assets so that they meet the required performance standards. The focus on optimising lifecycle costs shapes all of the processes involved.

EA Networks owns electricity reticulation assets that are used to provide distribution and connection services to electricity retailers and generators. These assets generally comprise equipment that is common to all New Zealand electricity lines businesses and, wherever possible, industry standard assets have been employed. In particular, the Asset Management Plan covers the electrical reticulation assets and associated systems owned by EA Networks.

For the purposes of managing the assets that EA Networks own, logical groupings of assets are required. These groups may have members that are geographically distant or installed in a different application but they are most effectively managed as a single population. These groupings comprise the following:


- *Subtransmission Line Assets* - Electric lines and cables, including associated easements and access ways operating at voltages of 33kV and 66kV;
- *Overhead HV Distribution Line Assets* - Electric overhead lines, including associated easements and access ways operating at a voltage of 11kV or 22kV;
- *Underground Cable HV Distribution Assets* - Electric underground cables, including associated easements and access ways operating at a voltage of 11kV or 22kV;
- *Overhead Low Voltage Line Assets* – 400V electric overhead lines, including associated easements and access ways;
- *Underground Cable Low Voltage Assets* – 400V electric underground cables, including associated easements and access ways;
- *Service Lines* – Connection assets at any voltage owned by EA Networks for the purpose of supplying a single consumer (not including the line on the consumer's premises but including any portion of the service line in, on, or above the legal roadway);
- *Zone Substations* – High voltage substations connected to the subtransmission network. This includes plant and equipment within the substations such as power transformers, foundations, oil interception equipment and incidental equipment such as DC batteries and chargers together with station land and buildings. Other items such as switchgear, structures and buswork, earthing, SCADA and protection, are covered by other definitions;
- *Distribution Substations* – Substations connected to the distribution network. This includes plant and equipment within the substations such as foundations, platforms and Maximum Demand Indicators, together with land and kiosk covers, but excludes transformers, MV and LV switchgear and earthing;
- *Distribution Transformers* – Standard transformers used in distribution substations ranging from 5kVA to 1000kVA and generally having a primary voltage of 11kV or 22kV. Also includes MV regulators or autotransformers up to 5,000kVA.
- *High Voltage Switchgear* – Circuit-breakers, reclosers, sectionalisers, disconnectors, ring-main units, expulsion drop-out fuses, structures and buswork used in the distribution and subtransmission systems;
- *LV Switchgear* – Load-break switches, fuse switches, fuses, support frames, busbars and capacitors used in the LV line and cable systems.
- *Protection Systems* – *Fault protection* includes all protection relays, associated panels, metering devices, current transformers, voltage transformers and control cabling.
  - *Over-voltage protection* includes surge arrestors and spark-gap devices.
- *Earthing Systems* – All earthing systems that are owned by EA Networks and connected to EA Networks

equipment.

- *SCADA, Communications and Control Equipment* – SCADA, Communications Equipment and associated facilities installed at any location. This includes Control Room equipment, Remote Terminal Units, radio repeaters and dedicated fibre optic systems installed, owned and maintained by EA Networks;
- *Ripple Control* – Ripple Injection Equipment.

The size and complexity of EA Networks' fixed asset base is considerable when compared to other businesses such as retail chains and serves as a major differentiator for this company and other utility organisations. Below is a diagram illustrating some of the different asset categories and typical ownership involved in the electricity supply industry.

Asset Owner	Voltage(s)	Equipment
Generator/ Retailer	11kV or similar	Generator (Wind, Hydro, Gas, etc)
Generator/ Transpower	11kV and 220kV	Generator Transformer
Transpower	220kV (Transmission)	Transmission Overhead Line(s)
Transpower	220kV and 66-33kV	GXP Substation Transformer(s)
EA Networks	66-33kV (Subtransmission)	Subtransmission Overhead Line(s)
EA Networks	66/22-11kV or 33/11kV	Zone Substation Transformer(s)
EA Networks	22-11kV	Zone Substation Feeder Circuit-Breaker and Protection Relay
EA Networks	22-11kV (Distribution)	Distribution Overhead Line or Underground Cable
EA Networks	22-11kV and 400 V (LV)	Distribution Substation Transformer
EA Networks	LV (Low Voltage)	LV Distribution Overhead Line or Underground Cable
EA Networks	LV	Consumer Connection Point (Pillar Box or Pole Fuse)
Private	LV	Consumer Service Line

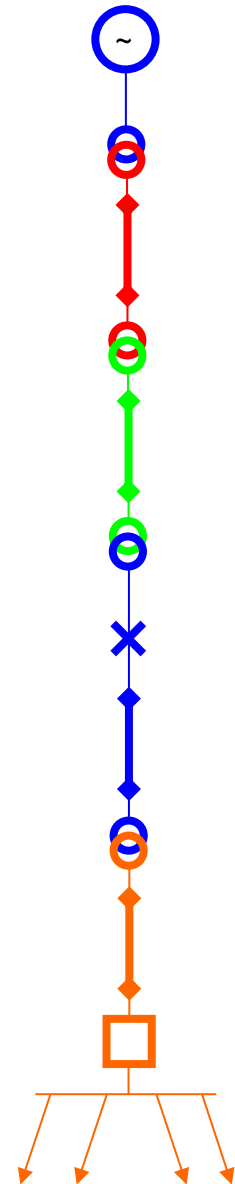

Variations on this ownership structure exist, particularly in industrial or rural situations where the consumer is likely to own 22-11kV lines on private property which are dedicated to servicing their property.



## 4.2 Overview

This section outlines the lifecycle management plan required to maintain, enhance and develop the operating capability of the system. The programmes are outlined by asset type and, within this, according to area and then by maintenance activity.

- Maintenance
  - servicing, inspections and testing
  - fault repairs
  - planned repairs and refurbishment (including replacement at the component level)
  - planned replacement programmes (at the asset level)
- Enhancement
- Development

[Section 8.1 - Appendix A](#) has a more complete series of activity definitions.

For the purposes of lifecycle management, the Enhancement and Development categories can be seen as the asset creation/acquisition phase of the cycle. The Replacement category will introduce new equipment of similar function at a similar location and have a similar purpose as the existing asset.

Each category of asset has a "Standards" subsection that details the documentation available for each activity undertaken on that category. This is one area that still requires some work to complete. Many categories do not have documentation to cover post-commissioning activities such as inspection and maintenance. The actual work is done to an acceptable standard, but the methodology is not yet formally recorded.

Asset disposal is typically done only at the end of an asset's useful life. The majority of these assets are equipment that is only suitable for scrap and it is normally disposed of in an appropriate manner as part of the activity replacing it. Any asset that becomes surplus and is not at the end of its service life will have a specific disposal plan. As at the time of writing there are relatively few assets that have been identified that will require disposal in this manner and only those asset categories will contain a Disposal activity.

### 4.2.1 Maintenance

Maintenance work is largely based on the condition of the assets.

The scope of work planned under each maintenance activity is quantified wherever possible to assist in reviewing EA Networks' achievement in future years. The estimated maintenance expenditure is projected in this section and where relevant, the consequences of the proposed maintenance programmes are noted. It should be noted that analysis of maintenance strategies and programmes is an on-going process and the most cost-effective means of maintaining the network is constantly under review. In some instances (e.g. pole replacement) further investigation and analysis is required to determine a suitable strategy.

The maintenance requirements are influenced by development projects, many of which, if they proceed, will lead to dismantling and decommissioning of assets that would otherwise require significant repairs and/or replacement. The maintenance programmes described in this section cover the anticipated situation where all of the planned development projects proceed.

The base-line planned maintenance expenditure projections assume, for consistency within this plan, that development projects take place as projected in [Section 5 – Network Development](#). It will be necessary to monitor closely the likelihood of each project proceeding and additional remedial work will need to be programmed if certain projects do not proceed or are significantly delayed.

### 4.2.2 Replacement

When an asset reaches the end of its useful life and economic maintenance options have been exhausted, the only remaining options are scrapping the asset without replacing it, or replacing it with a modern equivalent asset. Under most circumstances assets will be replaced with an asset that exhibits the best price/performance ratio. Each individual case will be examined for the economic efficiency of the

options.

Replacement work does not increase the asset's design capacity but restores, replaces or renews an existing asset to its original capacity.

### 4.2.3 Enhancement

This activity outlines work that is planned to enhance the system. By this, it means that this increases the capacity of the asset to:

- supply increased load
- enhance voltage regulation
- improve security and reliability

It includes projects (at specific sites) and programmes of related work covering a number of sites. Project numbers (e.g. [10023]) are used to identify individual projects or programmes. [Appendix B](#) has a complete list of these, including costs and categorisation.

Specific enhancement projects are detailed in [Section 5 – Network Development](#).

### 4.2.4 Development

Specific development projects and programmes are described in [Section 5 – Network Development](#), which outlines the projects currently anticipated over the planning period. The nature of each project is briefly described along with the reason why it appears to be required. The justifications for including each of the projects in the plan are categorised as follows:

- safety-related issues
- specific consumer requests (and commitment to incur project-related charges)
- anticipated demand growth
- to meet security planning guidelines
- economics (i.e. where the project produces overall cost savings)

The projects described in this document represent an indicative plan based on the best information currently available. There is currently no commitment by EA Networks to undertake all or any of the specific projects listed, nor should consumer commitment be inferred from the inclusion of any project in this plan, except where they are described as being already committed. Further, it should be noted that more detailed investigations will undoubtedly lead to changes in the scope of projects that do proceed. There may be considerable scope for integrated subtransmission/distribution system planning to achieve the required results by somewhat different means.

Because of the need for consumer consultation and, in many cases, agreement, as well as uncertainty in the fickle prediction of future load growth, it is likely that some projects in the first half of the planning period will not proceed or will proceed later than indicated in this plan. Secondly, because investigations tend to be more focused on the short-to-medium term, it is likely that additional required projects will arise, particularly towards the end of the planning period.

### 4.2.5 Asset Renewal Processes

The general renewal strategy is to rehabilitate or replace assets when justified by:

- *Safety*

The asset represents an unacceptably elevated risk to the safety of people or property.

- *Asset performance*

Renewal of an asset is where it fails to meet the required level of service. The monitoring of asset reliability, capacity and efficiency during planned maintenance inspections and operational activity identifies non-performing assets. Indicators of non-performing assets include:

- Structural life
- Repeated failure
- Ineffective and/or uneconomic operation

- *Economics*

Renewals are programmed with the objective of achieving:

- The lowest life cycle cost for the asset (uneconomic to continue repairing), or
- An affordable medium term cash flow, or
- Savings by co-ordinating renewal works with other planned works

- *Risk*

The risk of failure and associated environmental, public health, financial or social impact justifies proactive action (e.g. impact and extent of supply discontinuation, probable extent of property damage, health risk etc)

<b>Selection Criteria for Asset Renewal</b>	
<b>Priority</b>	<b>Renewal Criteria</b>
<b>1 (High)</b>	<ul style="list-style-type: none"> <li>• Safety concerns</li> <li>• Asset failure has occurred.</li> <li>• Asset failure of critical system component is imminent.</li> <li>• Regular maintenance required.</li> <li>• Complaints</li> </ul>
<b>2</b>	<ul style="list-style-type: none"> <li>• Failure of non-critical asset is imminent and renewal is the most efficient life cycle cost alternative.</li> <li>• Maintenance requiring more than six visits per year.</li> </ul>
<b>3</b>	<ul style="list-style-type: none"> <li>• Reticulation maintenance involving two to three visits annually.</li> <li>• Difficult to repair, due to fragile nature of material, obsolescence.</li> </ul>
<b>4</b>	<ul style="list-style-type: none"> <li>• Existing assets have low level of flexibility and efficiency compared with replacement alternative.</li> </ul>
<b>5 (Low)</b>	<ul style="list-style-type: none"> <li>• Existing asset materials or types are such that known problems will develop in time</li> </ul>


Planned and reactive replacement works can be prioritised in accordance with the priority ranking shown in the above table.

The process of asset renewal is generally triggered and managed according to the flow-chart shown below. The Assets database is used to examine candidates for inspection based on a combination of age, material of construction, make or type of equipment, and any previous inspections. Other triggers for inspection include information from the Faults database and ad-hoc reports from either field staff or the public describing a potential condition-related problem.

The inspection is scheduled and completed using the appropriate personnel (internal for routine inspections, external specialists for some unique or critical equipment). The results of the inspection are passed to engineering staff for evaluation. Consideration is given to all stakeholders interests when evaluating possible replacement equipment. If the inspection reveals an acceptable level of remaining life in the equipment the inspection details are recorded against the equipment in the Assets database and scheduled for reinspection at a future date. If the economic test is passed other considerations are introduced to ensure opportunities for security or capacity improvements at little or no extra cost are not lost. The best value option is ultimately selected were the "value" is not only financial but, on occasion, also relates to less tangible stakeholder interests. The project budget is prepared and submitted to the Board for approval. If approved, the project is scheduled for construction and detailed design occurs, ultimately

leading to the issue of workplans to the chosen contractor (by default internal). A project manager from the Asset Management function of EA Networks is appointed to monitor all aspects of the project and ensure a successful outcome. Project timing, budget monitoring, spot auditing, compliance with the specification, and adherence to normal contractor standards (safety and contractual) are the common areas attended to by the project manager.

## Condition Monitoring Process and Responses

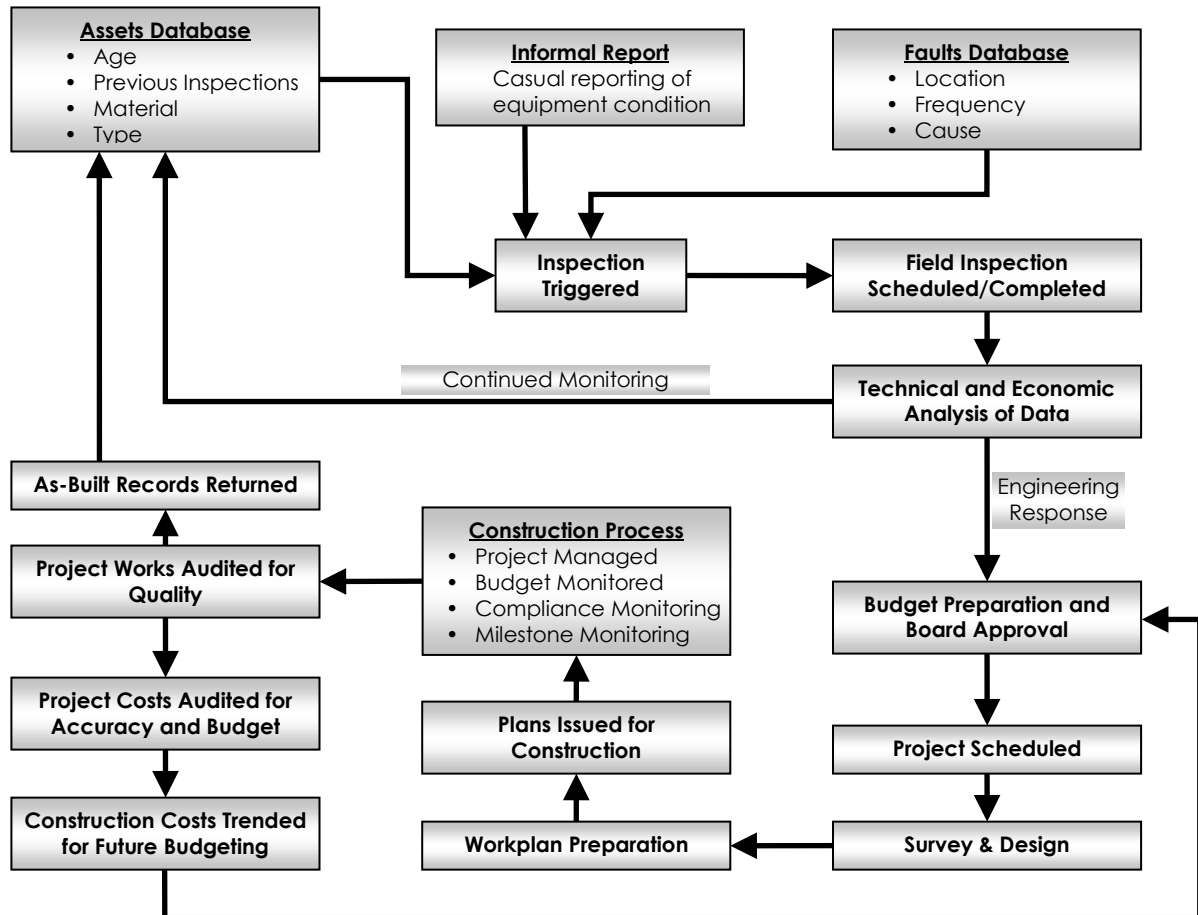

Once notified as complete, the works are audited by the appropriate inspection staff to ensure quality and completeness are acceptable. The as-built records are returned to the GIS and Assets systems so that the dismantled plant is removed and the new plant is added. The completed project is then financially analysed to ensure accuracy and the cost compared to budget and any discrepancies investigated. The actual costs are used to refine the budgeting process for future project costing.

### 4.2.6 Line Maintenance - General Observations

#### Line Repairs and Refurbishment

All line repairs are carried out to the requirements laid down in EA Networks' line maintenance standards. These are based on international practice combined with local knowledge and New Zealand legislative requirements.

#### Major Refurbishment

A number of HV overhead lines will require refurbishment or replacement during the planning interval. These are not all explicitly identified, but pooled and allocated a value based on the known distribution pole age profiles and historical trends. The subtransmission lines that are approaching the end of their mechanical life are identified by line section and a Project number.

### Wood Poles and Crossarms

Approximately 2,800 hardwood poles are over 40 years old (another 1,100 are 35-40 years old). It is currently projected that approximately 500 poles per year would need either changing or replacing with underground cable over the next 5 years in order to cope with defects. However this number will gradually decrease as lengths of very old wood pole lines are dismantled and eventually the annual pole change should reduce to nearer 300 each year.

### Conductors and Accessories

As a policy, all replacement Aluminium Conductor Steel Reinforced (ACSR) is being purchased with a greased core wire. Some aluminium wrap splices have failed and investigations are being undertaken to discover the mechanism of failure. Once the cause is found remedial action will take place to minimise the risk or recurrence. Some single strand conductor types are considered deficient and have been targeted for replacement.

### Insulators and Insulator Fittings

Neoprene wrap-lock ties were used for a period but have proven troublesome by loosening the grip from wire to insulator when exposed to normal wind vibration. Replacement of these ties is occurring as a moderate priority. EA Networks' current standard practice is to bind the conductor to the insulator with wire of the same metal as the conductor.

### Diagnostic Techniques

The purchase of an infrared thermographic video camera allows EA Networks personnel to regularly inspect overhead lines for failing or overloaded connections or equipment. This is a very good preventative measure that has already saved a number of fault outages (albeit that a planned outage took its place). A second camera high resolution camera has now been purchased to allow a faster 'drive-by' scan of equipment.

## **4.2.7 Present Planning Priorities**

Load growth caused by increased consumer demand and consumer expectations of reliability, security and power quality, as well as the regulatory and statutory environment set by central, regional and district government all guide the planning priorities of EA Networks.

In recent years, the principal focus has been on providing capacity for the dramatic pumped irrigation load growth in rural areas. In conjunction with this stimulus there were other security and capacity issues that required resolution. As a result of these combined pressures, 66kV has been implemented as a subtransmission voltage. Fifteen zone substations have been built and now operate at 66kV. Six more zone substations remain to be either converted to 66kV or built from scratch. The vast majority of the subtransmission network by length is now insulated at 66kV. All zone substations that are planned to be built at 66kV or converted from 33kV will be completed during the next ten years.

The development focus is also on the Ashburton urban area and the capacity and security requirements of the township. At Ashburton substation the original switchboard was replaced as it was more than 55 years old, maintenance intensive, and at risk from a seismic event. An additional zone substation has been constructed to provide additional capacity and supply security to Ashburton township consumers. Northtown, as the substation is known, has been commissioned for approximately five years and has proven to be very beneficial. Northtown was recently converted to 66 kV operation.

At the HV distribution level, conversion from 11kV operation to 22kV operation has been the chosen option for many of the areas facing the need for reinforcement associated with additional pumped irrigation load. This form of reinforcement has proven to be very successful and is likely to continue as the preferred option where significant rural HV distribution reinforcement is required.

EA Networks continue to monitor and assess the condition of all network equipment and, where necessary, this equipment is replaced or maintained depending upon the risk it presents and the whole life economics of repair versus replacement. The risk each piece of equipment represents is assessed according to the methodology outlined in [Section 7 - Risk Management](#).

### *June 2006 Snow Storm Review*

In the aftermath of the damaging snow storm of June 2006 a number of reviews were done to assess the adequacy of the existing network and of the suitability of the current line design standards. The review of

the existing network identified a number of component types that appeared to be inadequate to meet current security standards. A full report was prepared and submitted to the Board for assessment. The major items that have been identified as needing attention are:

- Long spans (>100m) of small conductors such as squirrel (lower priority)
- One, two or three strand conductors such as #8 galvanised steel (number 8 fencing wire), 3/10 copper (relatively high priority)
- Older, low strand count, copper conductors (of any span length) that appear to have become more brittle over time (relatively high priority)
- 1940s vintage steel poles (so called Bates' poles) which do not have adequate strength reserves (higher priority)
- Understrength mechanical fittings (particularly near the historically lightly snow loaded coast) which cannot withstand the weight of conductor when loaded with snow. (lower priority)

The Canterbury-wide review of the existing line design standards showed that they were very close to the suggested level. The line design standards remain largely unchanged but the specification of equipment used to build lines has been raised to ensure all components are rated and applied to meet these design standards. The main change has been the use of Flounder conductor in place of Squirrel conductor for new and rebuilt lines.

#### *September 2010 and February 2011 Earthquakes*

The earthquakes of 2010-11 were a tragedy for Christchurch and provided a severe test for all utilities serving the affected population. The severity of the shaking felt in Ashburton was significantly less than that felt in Christchurch during both major events. During the September earthquake, the peak recorded ground acceleration anywhere in the Ashburton District was less than 0.2g. This compares with acceleration of more than 0.3g in most of Christchurch and more than 0.7g in rural areas closer to the Greendale fault. The February earthquake was further from Ashburton than the September one and Ashburton District ground acceleration was less than 0.1g. The Christchurch urban area experienced ground acceleration between 0.5g to 0.9g with one recorder peaking at more than 2.0g.

The experience of the earthquake has refocused EA Networks. Preparedness is essential to prevent catastrophic equipment failure. EA Networks will be keen to learn anything that Christchurch-based lines company Orion are prepared to share about risk preparedness and recovery. EA Networks are well aware of the many natural and man-made risks that are faced by an electricity utility but have not progressed risk and recovery planning into formal documentation that could be called upon in an emergency.

The seismic design standards that EA Networks use are considered and robust. This should ensure that modern equipment is largely serviceable after a significant seismic event. The main area of concern is likely to be the significant quantity of older equipment that was installed prior to the adoption of current standards.

Future plans will address the additional planning required for rare but significant events and the impact they have on an electricity utility.

## **4.3 Subtransmission Assets**

### **4.3.1 66kV Subtransmission Lines**

#### Description

EA Networks now own significantly more 66kV insulated overhead line than 33kV overhead line (350km vs 98km). The 66kV network (see [Section 3.2.2](#) for a map of the layout) is in two distinct rings. The northern section is an interconnected ring directly supplying Northtown (NTN), Wakanui (WNU), Pendarves (PDS), Dorie (DOR), Overdale (OVD), Lauriston (LSN) and Methven66 (MTV) zone substations. Highbank (HBK) power station is connected on a 66kV spur line beyond Methven66. To the south of Ashburton, a southern 66kV ring supplies Ashburton66 (ASH), Eiffelton (EFN), Coldstream (CSM), Carew (CRW), Hackthorne (HTH) and Lagmhor (LGM) zone substations.

Two types of construction have been used to build 66kV overhead lines. The first type is brand new Jaguar, Lemon or Dog ACSR line constructed with treated hardwood poles and polymer insulators. The second type is reinsulation of pre-existing 33kV lines on hardwood poles. Steel extensions are used to provide adequate clearance to the under-built 22kV circuit on these reinsulated lines.

The capacity of the conductors in use is:

- Jaguar (low snow loading areas) or Lemon (heavy snow loading areas) which both have a conservative 'still air' thermal rating of approximately 400 amps (summer) and 500 amps (winter),
- Dog has a conservative 'still air' thermal rating of about 250 amps (summer) and 300 amps (winter).

All 66kV insulators are manufactured using polymer materials (synthetic rubber) with a clamp top rather than the traditional porcelain and binder. This allows construction of new lines without crossarms (see adjacent photo).

There are some short sections of 66kV underground cable that have been used to provide egress from sites at Pendarves and Elgin (adjacent to ASB). The 66kV subtransmission cables located at the Pendarves substation are copper conductor / XLPE insulation / HDPE sheathed cables and they were installed in 1999 and 2001. Other short sections of 66kV cable have been installed from Elgin substation to the overhead lines which supply Coldstream and Northtown substations. At the request (and partial funding) of a land owner a 300m section of 66kV cable has been installed across private property allowing the removal of a section of 33kV overhead line. These cables have a thermal rating to match the connected 66kV overhead line and are expected to have a lifetime in excess of 50 years.



## Condition

### Poles

The condition of the 66kV subtransmission assets largely reflects their age and the quality of materials used in construction. The vast majority of the poles are less than 15 years old and the cluster of older poles represent the lines that were converted from 33kV. All of the poles have a life expectancy of at least 40 years from new.

### Insulators

The 66kV insulation has no known issues.

### Fittings


Fitting of vibration dampers as standard to all 66kV circuits and to the underbuilt HV distribution circuit (where larger conductor sizes are used) has reduced aeolian vibration effects to an acceptable level. Wedge connectors are universally used for conductor junctions and have proven to be very reliable.

There are no known issues with the condition of any of the 66kV lines currently in service although the older ex-33kV poles will be considered for replacement within the planning period.

## Standards

Documentation of standards presently used for testing, inspection and maintenance of the 66kV

**66kV Sub-Transmission Pole Age Profile**

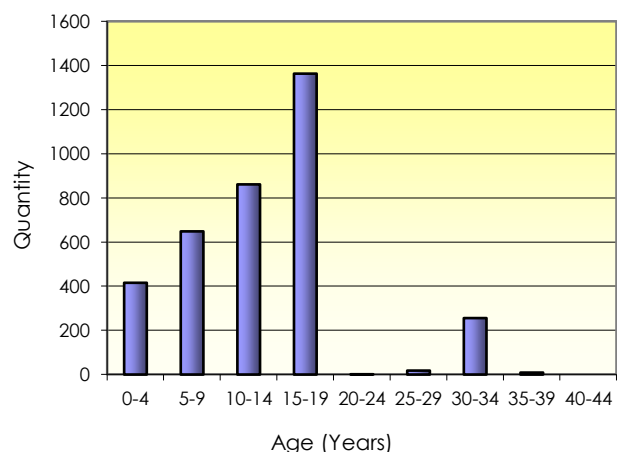

subtransmission network is still being developed. Construction standards are fully documented and all new work is audited for compliance.

## Maintenance

### Inspections, Servicing and Testing

The condition of the 66kV subtransmission network is monitored using the following techniques:

- corona camera survey (insulators and cable terminations)
- complete visual inspection every 5 years (roadside location assists in reporting of any uncharacteristic behaviour)
- periodic infra-red scanning (typically every two years)
- analysis of fault information
- tree control inspections annually.

### Fault Repairs

There have been very few faults on the 66kV subtransmission network. The only issues that have arisen are one occurrence of a loose bolt holding a 66kV insulator causing a pole fire (necessitating pole replacement) and several instances of insulator failure on the under-built circuit causing pole fires. The majority of 66kV faults have been caused by vehicles, wildlife or trees.

### Planned Repairs and Refurbishment

Other than routine tree cutting there is only one remedial project planned. No other repairs or refurbishment is scheduled.

### Retrofitting of 66kV Vibration Dampers

During the early periods of 66kV line construction it was not obvious that 100m+ length spans would cause aeolian vibration of conductors. A significant programme revisited early 66kV circuits and fitted vibration dampers to the conductors. The dampers prevent the vibrations from damaging the insulators and other pole fittings, extending the life of the line considerably. This programme is nearing completion and there is no additional damper installation retrofitting planned.

## Replacement

There are plans to replace the ex-33kV poles during the planning period [00570], [00571] & [00572].

## Enhancement

See [section 5.4.2](#) – Network Development for details.

## Development

See [section 5.4.2](#) - Network Development for details.

## 4.3.2 33kV Subtransmission Lines

### Description

EA Networks have a 33kV subtransmission network comprising of a main inner ring supplied from a single Transpower GXP - Ashburton (ASB) (see [Section 3.2.2](#) for a map of the layout). Radial 33kV lines supply four zone substations (MVN, MSM, MON, MHT) from Methven 66kV zone substation where a 66/33kV transformer is located. This arrangement has evolved as 66kV subtransmission has been introduced and 33kV line length will continue to shrink as more load is taken on to the 66kV network. The total route length of the 33kV network is 98km.



The evolution of the 33kV network was initially focussed on NZED's (Transpower) urban Ashburton substation (ASH) as the 15 MVA 33kV supply point. This was later upgraded to a 30 MVA 110/33kV supply point. Once the 110kV network was removed, the 33kV supply point was shifted to its present location in Wakanui Road (ASB). From this point onwards the 33kV network had to support the pre-existing load plus the addition of urban Ashburton load (about 20 MW at the time).

The load on the 33kV network has been significantly reduced in recent years by widespread conversion to 66kV but portions remain that will cause constraints within the next few years. There is a point in the very near future when most of the 33kV network will be converted to 66kV to prevent voltage constraints, conductor thermal limitations and security concerns.

The 33kV lines take a variety of standard construction forms. The early lines are on hardwood poles with porcelain insulators and many of these still standing today. During the 1970s and 1980s concrete poles came into vogue for 33kV construction and a number of lines use either prestressed or mass reinforced (spun) concrete poles. Pin insulators are exclusively porcelain, but the strain insulators are a mixture of porcelain and polymer materials. Conductor types are exclusively ACSR and AAC. The most common sizes are Jaguar, Mata, Waxwing and Dog.

The capacity of the conductors in use is:


- Jaguar (snow loading areas) or Mata (low snow loading areas) which both have a 'still air' thermal rating of approximately 400 amps (summer) and 500 amps (winter),
- Waxwing has a 'still air' thermal rating of about 300 amps (summer) and 350 amps (winter),
- Dog has a 'still air' thermal rating of about 250 amps (summer) and 300 amps (winter).

EA Networks have approximately 4.6km of 33kV underground cable in various locations around the district. All 33kV cables are XLPE insulated with heat-shrink terminations and joints.

The most significant 33kV cable length (3km) is installed between Ashburton township zone substation in Dobson Street (ASH) and the northern end of Ashburton urban area. This cable is single core 185 mm<sup>2</sup> aluminium conductor with XLPE insulation, aluminium wire screen and PVC oversheath (conservatively rated at 295 amps). This particular cable was installed when the 33kV supply point was at ASH and its design could not take in to account the later reversal of significant power flow from Transpower's Ashburton site (ASB) to ASH. Operational restrictions are required to prevent overloading this cable. It is probable that within 5 years, as a consequence of 66kV conversion, this cable will be derated to 11kV and used in the urban distribution network.

Larger 33kV cables are installed at ASB and ASH as a way to connect from substation busbars to overhead lines. The cable used here is single core 400 mm<sup>2</sup> aluminium conductor XLPE insulated, copper wire screened with an HDPE/LDPE oversheath (rated at 500 amps). These cables are sized to match the line ratings and are up to 200 metres long.

There are a variety of other short 33kV cable lengths installed (typically 185 mm<sup>2</sup> aluminium) that overcome height restrictions under Transpower lines and glide-slopes at airstrips.

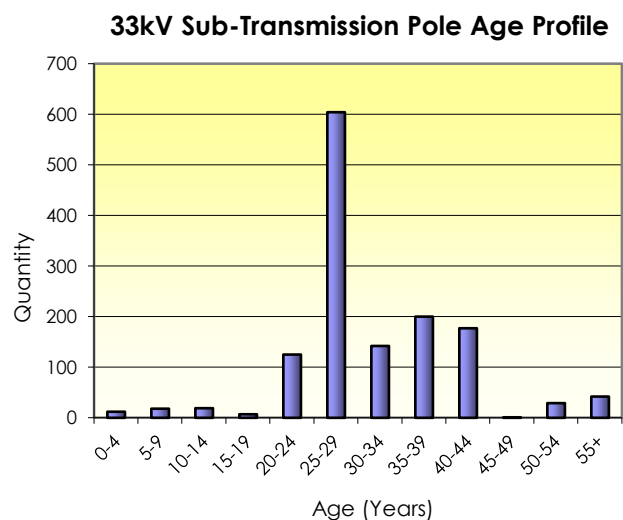

## Condition

### Poles

The age profile of the 33kV subtransmission poles shows that the only new poles that have been installed since 66kV subtransmission became the preferred voltage, are to either replace defective ones or those damaged in car crashes.

With the decommissioning of Lismore zone substation, a portion of the 33kV line from Lismore – Montalto to Mt Somers Substation has been made redundant. It was constructed in 1972 and is considered to be in a fair condition and may be partly reused at 22kV. The piled poles which form part of this line in the Hinds River, failed during a rainstorm event during 2002. The failed hardwood piles have been replaced with a much more substantial form of steel foundation. It is planned to rebuild much of this circuit at 66kV to supply the proposed Montalto substation (project [00513] ) after which the remaining line will be redundant (200 poles). This will remove a significant number of older 33kV poles from the network (approx. 450 total).

The line from Mt Somers to Methven was in a similar state. It was constructed in 1980 and is currently being replaced. This line is oriented across the infamous north-west wind and encounters several snowfalls most winters. Project [10697] will see the line rebuilt and converted to 66kV. In the process, complete renewal of all the components will remove even more old 33kV poles from the network (approx. 450). The need to complete some small seasonally dependent work has delayed completion until 2016-17.

As of February 2016, the 33kV system involved approximately 300 concrete poles and 1,100 hardwood poles. Of these, it is estimated 250 hardwood poles (21% of total) will need replacing within 5 years. Approximately another 700 are estimated to need replacement closer to the end of the planning period (subject to further evaluation).

If the EA Networks network evolves as described in this plan, the 33kV network will be entirely superseded with a new 66kV network by the end of the planning period. This obviously solves all of the 33kV line conditions issues identified above. Many 33kV poles have underbuilt distribution lines on them and they will continue in service beyond the end of the planning period. These poles will be managed as distribution poles once they operate at 22kV or 11kV only.

### Fittings

There is a mixture of old technology (porcelain) and new technology (polymeric) insulation used on the 33kV subtransmission system. Due to the low pollution environment in Mid-Canterbury and the replacement of failed first generation polymeric (cycloaliphatic) insulation some years ago, it is not envisaged there will be a need for a widespread insulation replacement programme before retirement or conversion to a lower voltage.

During 1999, radio interference problems occurred on a section of 33kV over 11kV line built in the early 1990s. The problem was identified as deterioration of the neoprene cushion within pre-formed insulator wrap lock ties used to attach aluminium conductors to insulators. Apart from the possibility of interference as the cushion deteriorates further, there is a possibility of the conductor parting company with the insulator as it loosens. EA Networks have installed approximately 7,000 of this type of tie on the system to date, but discontinued their use approximately ten years ago. It can be expected that during the planning period there is a high likelihood of the ties deteriorating further requiring their progressive replacement. This work will be covered by progressive 66kV conversion. Should the 66kV conversion not progress as planned any 33kV lines requiring attention will be resolved separately.

The Methven to Mt Somers 33kV line uses two piece 44kV rated porcelain pin insulators. In recent years there has been an increase in the number of insulators failing in the junction between the two sections of the insulator. These failures cause outages. The line is currently in Stage 3 (of 3) of replacement which will be complete within a year. It has been decided that additional ultrasonic inspection will be the remedial action until the replacement occurs.

Termination or connector practices have varied over the years ranging from PG (parallel groove) connectors, line taps and over the last seven or eight years a policy of using only wedge connector clamping has been implemented. The existing PG clamps are prone to overheating and/or corrosion and subsequent failure. The line tap arrangement was subject to failure during through-fault conditions. While the PG connectors and line taps still exist in the EA Networks system, it is not intended to undertake a mass replacement programme. However, the PG clamps will be monitored on a regular basis by thermographic methods and individual clamps replaced as and when necessary.

## Underground Cables

The 33kV single core cables laid from the Ashburton zone substation out to Racecourse Road are some 3km in route length and have an Aluminium/ XLPE insulated PVC sheath with an aluminium screen. This cable was installed in 1986 and has been the subject of several failures due to water between the aluminium screen and the sheath entering joints. It is suspected that the water problem occurred both during the manufacturing process and prior to installation (poorly fitting end caps). Further analysis revealed a problem that required attention. The issue that was identified was that of excessive circulating currents in the cable screens. The cable has now been mid-point earthed and cable screen voltage limiting devices installed at each end of the cable. This work permits the full cable rating to be sustained without excessive heating.

Partial discharge tests, wire screen continuity/impedance tests and insulation tests would suggest that the cable itself is unlikely to fail catastrophically within its useful lifetime of operation at 33kV. Within the planning period it is proposed that the cable will be derated to 11kV operation - once Northtown and Ashburton substations are both operating at 66kV. This cable will then be incorporated into the core 11kV network as two or more circuits between 11kV network centres and zone substations.

## Standards

Documentation of standards presently used for testing, inspection and maintenance of the 33kV subtransmission network are unlikely to be developed. It is unlikely this work will proceed to conclusion with the conversion to 66kV or retirement of 33kV lines well within the planning period. Construction standards are fully documented and all new work is audited for compliance.

## Maintenance

### Inspections, Servicing and Testing

The condition of the 33kV subtransmission network is monitored using the following techniques:

- corona camera survey (insulators and cable terminations)
- complete visual inspection every 5 years (roadside location assists in reporting of any uncharacteristic behaviour)
- periodic infra-red scanning (typically every two years)
- analysis of fault information

As with the entire 33kV network, inspection and patrols are important to reduce fault incidents. The 33kV network has a higher impact on reported statistics than lower voltage lines and this encourages more preventative action and research. The majority of the 33kV network is on public road reserve (as are most EA Networks lines) and this fact tends to encourage both staff and the public to report components that are causing concern. The Lines Inspector will examine the 33kV network at least once during the planning period.

### Fault Repairs

The history of faults on the 33kV network would suggest that one or two a year would occur on average. This rate could increase slightly up until the date the oldest lines have been either replaced or refurbished.

It is very difficult to predict the number of faults from year to year due to climatic conditions. An estimate for fault work is provided based on historical fault data for the entire 33kV network.

The 33kV lines have had a variety of faults affecting them over recent years. The most concerning was a spate of 33kV porcelain insulator failures where the binder groove would crack off the top of the insulator allowing the conductor to drop and cause either an earth fault or a pole fire. Analysis of the failed insulators did not suggest any particular cause and the corona surveys have not revealed any additional problems. The usual problems of trees, wildlife and car crashes account for the remainder of the problems.

The per km cost of faults on the 33kV network is slowly rising, but in absolute terms the total cost is decreasing as new 66kV lines replace the older 33kV ones.

## Planned Repairs and Refurbishment

Other than regular tree cutting, there are no scheduled plans for repairs or refurbishment of portions of the 33kV network.

## Replacement

Should the need arise, any replacement of 33kV lines will be with 66kV lines in a location compatible with future requirements. This will make the work enhancement rather than replacement.

## Enhancement

See [section 5.4.2](#) - Network Development for details.

## Development

See [section 5.4.2](#) - Network Development for details.

## 4.4 Distribution Assets

Electric lines and cables, including associated easements and access ways operating at a voltage of 11kV and 22kV make up the bulk of EA Networks' infrastructure assets, in terms of both value and number. The extent of the distribution network is such that it covers virtually all of the plains in Mid-Canterbury and three long spur lines reach 35km in to the foothills of the Southern Alps via the Rangitata, Ashburton and Rakaia Gorges.

### 4.4.1 11kV and 22kV Overhead Distribution Lines

#### Description

EA Networks have extensive 11kV and 22kV distribution networks. Until the early 1990s, EA Networks only used 11kV as a distribution voltage. The rapid increase in irrigation load caused steady state 11kV voltage to drop to intolerably low levels. The security of the distribution network also fell, since back-feeding was not an option, as it would have resulted in an unacceptably low voltage. A rigorous investigation of the various solutions led to the adoption of 22kV as the preferred solution to the raft of capacity and security problems.

The 22kV network is proving to be an excellent distribution voltage. As an example, most people in the industry are familiar with conductor sizes by code names. Swan or Squirrel ACSR conductor run at 22kV has a lower percentage volt drop for a given kW load than Dog ACSR run at 11kV. Ferret conductor at 22kV has 21% less voltage drop than Jaguar ACSR at 11kV. These capabilities ideally suit a rural voltage-constrained network. The two-fold increase in thermal capacity (absolute power rating) of all conductors is merely a useful by-product of the conversion work.

11-22kV construction types are many and varied with lines that cover various materials, ages and designs. Pole types include hardwood, treated hardwood, treated softwood, prestressed concrete, mass reinforced concrete and steel (expanded I-beam). All of these different poles have their strengths and weaknesses. Crossarms are either hardwood or steel.

Major insulation hardware has always been, and continues to be, porcelain pin insulators because of competitive pricing and a respectable track record. Strain insulators of choice have changed from being porcelain to universal adoption of polymer strain insulators at 11kV and 22kV.

Current standard construction employs hardwood poles and crossarms in a conventional style with porcelain pin insulators and polymer strain insulators.

The table above details the route length of the overhead distribution assets owned by EA Networks by

Capacity Class	11kV Circuit Length (km)	22kV Circuit Length (km)
Light	284	631
Medium	155	824
Heavy	0	28
<b>TOTAL</b>	439	1,483

'ODV' capacity class. It should be noted that a significant quantity of the lines categorised as 22kV will be insulated at 22kV but operating at 11kV.

The HV overhead distribution lines that radiate from rural zone substations are what most people see running along the rural roadsides. EA Networks own a total of 1,922km of 11kV and 22kV overhead lines that are predominantly located on the roadside. Some of the poles that carry these lines also carry subtransmission or LV lines. The highest voltage the pole was constructed to carry provides the asset category that is responsible for the structure's asset management.

Other line owners supplied by EA Networks own about 512km (523km in previous plan) of HV overhead line which is all on private property.

As of the date of this plan, the data available for management of pole hardware is incomplete. The total number and age of poles is known from work-plan information however the hardware fitted to these poles has not been captured. The relatively low incidence of ancillary component failure on poles and the ability to repair failures quickly means that there is a low return on gathering and maintaining this data. At this point in time, data on components other than poles will be gathered if and when personnel visit the host pole. It should be noted that replacement of any existing pole will result in brand new pole hardware being fitted.

Distribution Components	Type	Quantity
<b>Distribution Structures (not overbuilt)</b>		
	Wood	
	- Hardwood	16,754
	- Softwood	2,287
	Concrete	2,006
	Steel Poles	121
	<b>TOTAL</b>	<b>21,168</b>
<b>Distribution Pole Supports</b>		
	Guy Wires	
	- Aerial	221
	- Single Down	2,364
	- Double Down	1,003
	In-Ground Pole Blocks	4,844
	Prop Poles	9
<b>Conductor</b>		
	Conductor Length (km)	
	- 11kV	1,234
	(Span length x No of wires)	
	- 22kV (inc. 22kV at 11kV)	4,392
	<b>TOTAL (km)</b>	<b>5,626</b>

The next stage in data capture will be capturing the structure type and this will permit the use of standard bill of material schedules to determine total quantities of cross arms, insulators braces and even nuts, bolts and screws. This will also tie into costing, budgeting, asset valuation, stores management, asset management and financial reporting.


## Condition

The present condition of any distribution line is largely a factor of its age, the quality and type of materials used and the climatic conditions the lines are exposed to in various areas. EA Networks' location is largely free from corrosive airborne contaminants such as salt. The major life accelerating factors are sun (attacks insulation and protective coverings), wind (vibration and cyclic stress) and pole resilience to fungal or insect attack. At this stage, relatively few young poles have been individually inspected. The older poles

have been inspected and those in need of attention replaced. The age profile would suggest that the bulk of the backlog maintenance has been attended to.

#### Hardwood Poles

There are approximately 16,754 hardwood poles (79% of total distribution poles) in the overhead distribution network. The distribution lines are 22kV or 11kV single circuit and double circuit construction with an age ranging from new to around 50 years old. A number of the older lines have been replaced over recent years, but this has still left a small but significant percentage of poles in excess of 45 years old. Several of these lines are scheduled for replacement over the next two years. Over the years, three styles of hardwood poles have been used in the EA Networks system. These styles are - natural round (first generation pole), desapped hardwoods and more recently CCA treated hardwood poles. The average age of the hardwood distribution poles is 20.6 years.

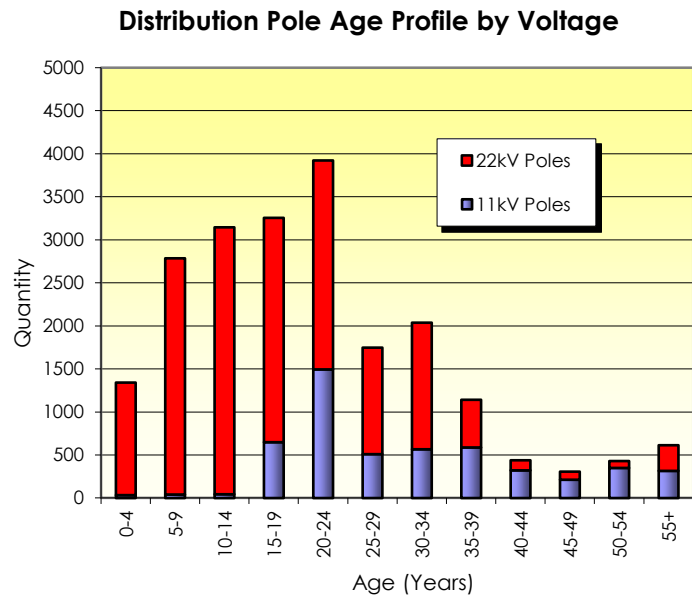

#### Concrete Pole Lines

Concrete poles make up approximately 8% of the total distribution poles used in EA Networks' system.

There are 2 two types of concrete poles used

- Pre-Stressed concrete poles - these various pre-stressed type of concrete poles were first installed around the late '60s and therefore not expected to need to replacement during the planning period. An early type of pre-stressed pole (called Burnett) was deemed defective and dangerous and these have all been replaced with other manufacturer's pre-stressed concrete poles, softwoods and hardwood poles.
- Mass-reinforced concrete poles - these are in excellent condition and are likely to last well beyond 40 years.

The average age of the concrete distribution poles is 25.2 years.

#### Treated Softwood Pole Lines

Construction of treated softwood pole lines began in the early 1990s for economic reasons, and continued through until 1997, when the cost differential between hardwood and treated softwood poles became less and the quality of the softwood poles received deteriorated. These poles make up approximately 9% of the total system poles.

The green (damp) nature of the poles when first installed has seen the pole tops in many cases setting with a twist as the timber dried out causing the conductor to become unevenly sagged. This in turn leads to the possibility of conductor clash during turbulent wind flows. Large cracks have also appeared during the drying process in some poles that may pose a problem if the poles continue to split especially around any bolt holes. The splits also allow moisture in to the untreated pole interior.

Due to the varying diameters of the poles they can be susceptible to birds resting between the centre insulator and pole causing a current to earth and the resulting burning-out of the top portion of the pole.

It is not envisaged a wide-spread remedial maintenance programme be set in place during the planning period. Repair work will be expected in some cases, but this will occur as and when problems develop. Each specific case will be examined at that time to determine if it is symptomatic of a wider problem. The expected life of these poles is greater than 30 years.

The use of these poles may be reconsidered, as a refined treatment process now produces a higher quality

pole. The technical/economic balance will determine future softwood pole usage.

These lines are typically wired in ACSR conductor.

The average age of the softwood distribution poles is 21.2 years.

#### "Bates" Steel Pole Lines

These poles were installed in the mid-1940s and account for approximately 0.5% of the system total (1.2% in previous plan). These poles are rapidly approaching the end of their life with a reasonable number of poles requiring replacement within 5 years.

The rapid deterioration through rusting has seen a programme introduced to replace the majority of these poles within the planning period. The June 2006 snow storm reinforced this opinion as a number of steel poles failed during this severe weather event.

The main 11kV line between Ashburton and Overdale had 52 "Bates" Steel poles which needed replacement (out of approximately 196 "Bates" Steel poles in this line). A 22kV conversion exercise in 2003 provided the opportunity to replace the substandard poles and the remaining steel poles were considered suitable for up to 10 more years of service. Some of this was as a consequence of the failures experienced during the snow storms of recent years and others were simply the poor condition of the poles. As of 2015, 134 "Bates" Steel poles remained in this line. In late 2015, 100 of these poles were removed as a project to convert the state highway to underground proceeded (leaving 142 in service network-wide).

The average age of the steel distribution poles is 47.8 years.

#### Conductors and Conductor Accessories

A variety of conductor types have been used over the years ranging from galvanised steel, Aluminium Conductor Steel Reinforced (ACSR), All Aluminium Conductor (AAC), copper weld (copper coated steel), #8 copper (solid high strength copper) and stranded copper.

Most of the ACSR and all AAC installed are in a good condition and there is no intended replacement programme for any of these conductors. After the recent snow storms it was decided that the small relatively low strength 'Squirrel' conductor would not be used for new or rebuilt lines. In its place a much stronger smooth body conductor 'Flounder' will be used.

Galvanised steel, #8 copper and copper weld conductors make up approximately 1.0% of the total distribution conductor length. In particular the galvanised steel conductors are beginning to rust (in some cases quite significantly), while the copper weld conductor is becoming brittle and is prone to breaking. It is anticipated that the majority of these conductors will require replacement during the planning period and there has already been significant progress along this path – a reduction of about 10 km since the last plan was published. This leaves approximately 59 km of these conductors in service at 11kV or 22kV. Some of this conductor length is the first span (which crosses the road corridor) of an on-property extension owned by others.

Line splices have started to cause an increase in faults. It appears the application of these splices has not been according to the manufacturer's instructions. Remedial action will be taken once a survey of suspect splices has been completed using thermography.

Wire termination and connector practices have been amended as per the current practice for subtransmission lines (see [section 4.3.2 - Fittings](#)).

#### Insulators and Insulator Fittings

A majority of the insulation used on the distribution system is porcelain and generally considered in reasonable condition. Given the relatively low pollution environment it is not envisaged that any major replacement programme will need to be implemented in the near future.

Wrap-lock ties were also used at 11kV and the situation described in [section 4.3.2 - Fittings](#) also applies to a proportion of 11kV lines.

The June 2006 snow storm identified that in some cases mechanical fittings were inadequate and they failed prematurely, dropping conductors onto the ground. The application and use of these types of fittings has been reconsidered and provided they are applied correctly they are adequate.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of the HV overhead distribution network is still being developed. Construction standards are fully documented and all new work is audited for compliance.

## Maintenance

HV distribution assets comprise the majority of EA Networks' asset base by distance, value and most other measures. Consequently, the asset type also accounts for the greatest share of maintenance and enhancement expenditure.

The value of distribution lines included in projects that are triggered by subtransmission development is beginning to reduce. These lines are incidentally reconstructed on the route of new 66kV subtransmission lines (or existing 33kV lines being converted to 66kV). The cost of these rebuilt distribution lines has been estimated and allocated so that a true indication of increasing asset value can be obtained.

Any line in the 22kV network is at worst a refurbished line and at best a brand new one. This situation has arisen from the 11kV to 22kV conversion programme. Lines are generally reinsulated without full replacement work being necessary, however, if any faulty components are discovered they are replaced. This process effectively extends the planned maintenance-free period on 22kV lines for at least ten years from the date of conversion.

### Inspections, Servicing and Testing

The rural 22-11kV network is the area that consumes most of the Lines Inspector's time. The majority of the inspection budget is spent assessing poles and hardware on these lines. A gradual accumulation of information on lines is being achieved with inspections targeting the oldest lines first. Future plans may allocate the inspection time more systematically.

The refurbished nature of the 22kV network has relegated it down the priority list for patrols and inspections. It is anticipated that the data gathered during the conversion work so far will be used to assess the refurbished lines, looking for inspection candidates towards the end of the planning period.

### Fault Repairs

This section of the network absorbs the biggest portion of the fault budget every year. The usual culprits are wind, wildlife, cars, trees, snow, irrigators (large rotating steel booms), occasionally aircraft (top dressing), vandalism, equipment failure, consumer earth faults intruding into the distribution network causing protection to trip a feeder, and completely unknown causes. The projected costs are based on historical values adjusted for major replacement, refurbishment and development projects.

A surprising statistic has come from the fault data gathered since 22kV conversion was started. There appears to be an irreducible lower level of faults that exist for all open wire distribution lines. Asset management staff were hoping to see the number of faults fall to low levels in the 22kV areas, but this was not the case. The fault level certainly dropped, with aged equipment failure virtually eliminated (faulty or damaged new components accounted for most equipment failures). It would appear that provided there are people, birds, exotic marsupials, and trees (including blue gum trees with bark streamers), faults will occur. Dramatic reductions in this base level of faults will require alternative construction techniques.

The fault repairs on the HV distribution network have been estimated from the pool of fault maintenance done in previous years.

### Planned Repairs and Refurbishment

The various repairs and refurbishments have not been identified individually. The present rate of maintenance is likely to reduce over the planning period as the average pole age decreases.

#### **Single Strand Galvanised Steel Conductor (on-going)**

The single strand galvanised steel conductor (predominantly #8 galvanised steel fencing wire) historically used in the 11kV network is considered deficient. It has corroded and during wind and snow events is prone to failure which will drop a conductor onto the ground in many cases. A conscious decision has been made to eliminate this conductor from the distribution network. It will be replaced with the minimum



modern equivalent conductor in order for the structure/line to survive until the pole is at the end of its useful life. A maintenance programme has been started to give effect to this strategy.

## Replacement

The rural HV distribution network is decreasing in average age. A considerable effort has been made in recent years to catch up on backlog maintenance that was postponed during times of major enhancement and development. This has reduced the level of annual maintenance required to a more routine amount. Routine amounts would be 2.0 to 2.5% (40 to 50 year average lives) of the total pole population per year needing replacement. With a distribution pole population of approximately 21,000 this represents approximately 500 poles per annum. This of course assumes a flat age curve and this is not the case. The present rate of replacement would be about half this number (250 per annum).

### Bates Steel Poles (on-going)

The Bates steel poles, which have given long service, are reaching the end of their mechanical life. As part of the pool of overhead HV distribution line replacement funds allowed in the planning period, these poles will be progressively replaced. Approximately 100 of these poles have been replaced/removed since the last plan was published - leaving 142 in service. The rural underground conversion programme will remove more of these poles in the future.

## Enhancement

See [section 5.4.4](#) - Network Development for details.

## Development

See [section 5.4.4](#) - Network Development for details.

## 4.4.2 11kV and 22kV Underground Distribution Cables

### Description

Underground cable is becoming a significant asset for EA Networks. It is being used to service any new urban development as well as replacing urban overhead plant when it requires rebuilding. The Methven urban area is completely underground. The decision to proceed with undergrounding Methven was taken after a disastrous snowstorm in the 1970s that left the majority of poles and wires lying in the streets. It took many weeks to repair the damage sufficiently to return supply to all consumers.

Voltage (kV)	Description	Current Rating (amps)	Capacity (MVA)
11	3 core 95 mm <sup>2</sup> XLPE aluminium (urban distribution)	200	3.8
11	3 core 150mm <sup>2</sup> XLPE aluminium (distribution feeder core)	255	4.9
11	3 core 300mm <sup>2</sup> XLPE aluminium ("Core"distribution)	400	7.6
22	3 core 35mm <sup>2</sup> XLPE aluminium (rural consumer connection)	120	4.6
22	3 core 95mm <sup>2</sup> XLPE aluminium (general distribution)	200	7.6
22	3 core 120mm <sup>2</sup> XLPE aluminium (distribution feeder core)	240	9.1

Urban Ashburton is being progressively converted to underground cable as the condition of the existing overhead lines deteriorate, demanding replacement. When prioritisation is required because of limited resources, the HV distribution voltage lines are chosen before the LV reticulation as they have a higher public safety risk and a more dramatic impact on reliability.

It is not only urban areas that benefit from underground cable installation. Where necessary, short sections of rural distribution lines have been placed underground to avoid conflict with Transpower transmission lines, airstrips and to get around problematic obstacles. Distribution feeder entry and exit from zone

substations is also normally achieved with short lengths of underground cable. More extensive rural underground distribution is being undertaken with approximately 27km of end-of-life overhead line being replaced with underground cable. With the assistance of NZTA, currently only state highways are being targeted for rural underground conversion. An assessment of the actual costs and operational experience will determine if rural underground becomes more commonplace.

It should be noted that EA Networks has a policy that all new connections to the EA Networks network must be made using underground cable (up to and including 22kV).

The distribution voltage cables used by EA Networks are almost entirely XLPE insulated. The cables in common use at EA Networks are shown in the table above.

Since about 1995, the cable specification changed from a copper tape screen with PVC over-sheath to a copper wire screen with HDPE over-sheath.

EA Networks presently have about 106km of 11kV cable installed (an increase of 1km from the last plan) and 113km of 22kV cable (an increase of 20km from the last plan).


### Condition

EA Networks have a mixture of old and new technology cables throughout the system and these are generally in reasonable condition and trouble free. As with most power companies, failures are typically associated with joint and termination problems or mechanical damage. The spike in cable 25-34 years old is a consequence of 14km of 11kV cable being installed onto Mt Hutt ski-field in the late 1980s.

#### Cable Accessories

Any remaining older style cable terminations are of concern from a reliability point of view. EA Networks is targeting these for replacement during the planning period.

Historically, a series of joint failures occurred in an 11kV cable in William Street, Ashburton. A thorough investigation was less conclusive than was hoped. It is suspected that a crimp connector failed and caused a heavy current fault. This fault may have weakened similar crimped connectors in other joints in the same cable. Additional care is now being taken during application of crimp connectors and where possible existing and new joints are being engineered out of the cable system. Where possible, new distribution cable installations use shear-bolt connectors, which appear to be more tolerant of cyclical heating.

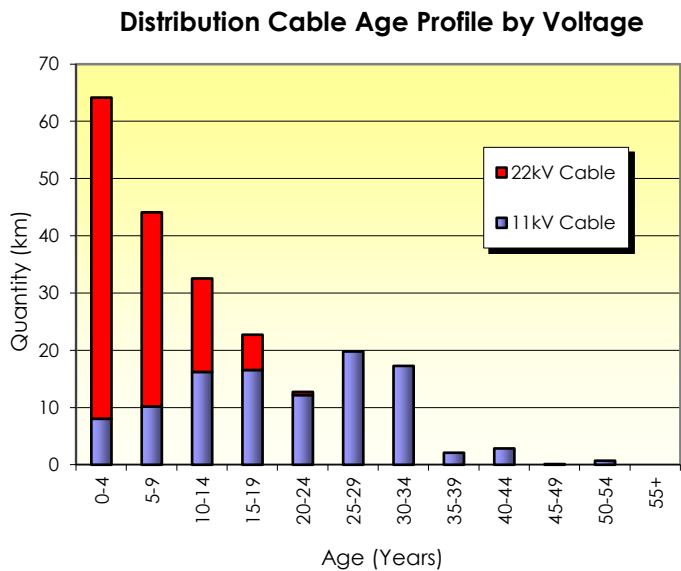

### Standards

Documentation of the standards presently used for testing, inspection and maintenance of the HV underground distribution network is still being developed. Construction standards are fully documented and all new work is audited for compliance.

### Maintenance

The maintenance requirement of underground cable is virtually nil and the urban Ashburton 11kV network is being placed underground on the basis of condition, solving the problem for the foreseeable future. The other township areas that have some 22-11kV overhead distribution, namely Rakaia and Hinds face the same destiny of being placed underground - when condition demands it. This approach provides for medium to long-term cost minimisation.

### Inspections, Servicing and Testing

There is limited inspection and testing work that can be done on any buried equipment. Periodically,

electrical tests are done on cable segments that are out of service for other reasons, but condition is predominantly ascertained by tracking fault information. Some tests using partial discharge mapping have been trialled after a series of faults occurred in quick succession. The results of the testing were not particularly compelling and it was decided widespread adoption of the technique would not offer good value.

### Fault Repairs

There is a very low frequency of faults on the HV distribution cable network. A small allowance is made for fault repairs annually.

### Planned Repairs and Refurbishment

There are no planned repairs or refurbishment scheduled.

### Replacement

There are no plans to proceed with any replacement work.

### Enhancement

See [section 5.4.5](#) and [5.4.6](#) - Network Development for details.

### Development

See [section 5.4.5](#) and [5.4.6](#) - Network Development for details.

## 4.5 Low Voltage Line Assets

These assets include 400V overhead lines and cables used to reticulate electricity to the boundary of consumer's premises where it connects to the service line.

### 4.5.1 400 V Overhead Distribution Lines

### 4.5.2 Description

EA Networks uses a conventional overhead low voltage configuration with insulated conductors and wooden crossarms. Aerial Bundled Cable (ABC) construction techniques are not employed. The total length of line in this category is approximately 98km. This quantity has reduced from the last plan through a combination of removal and refinement of ownership for spans that leave an EA Networks pole and connect to a privately owned pole. These lines are located in both urban areas and on the rural roadside. The urban lines will typically be heavier construction with larger conductor and almost always three phases. The rural lines are likely to be lighter and commonly will be only single phase. A significant proportion of the circuit length identified here is likely to be road crossings and the first span leaving the road to service a consumer's property. Despite being dedicated to each consumer, these short spans are all owned by EA Networks as they are fully or partially over the public roadway.

Copper conductor was used extensively until the mid-1970s, but was gradually replaced with PVC covered aluminium because of economic and constructability considerations. The last large-scale urban overhead reconstruction was completed in the early 1990s and used PVC covered Weke AAC conductor. Since then, there has been no significant urban LV reconstruction undertaken. The present policy of the EA Networks' Board is to convert to underground cable whenever an urban overhead distribution reconstruction becomes necessary because of the line's condition.

The smaller rural villages and townships of Fairton, Lauriston, Rakaia, Chertsey, Hakatere Huts, Rakaia Huts and Rangitata Huts and Hinds all have some LV overhead reticulation, much of which is approaching the end of its useful life. Hinds is approximately 75% underground. Mayfield and Mt Somers townships have both been converted to underground in recent years and Chertsey is almost complete. The urban underground conversion programme is scheduled to place the remaining township reticulation underground as and when necessary.

The supply to some of these settlements is via long overhead distribution lines, which is the most significant risk in the overall security to the consumer. Underground conversion has been selectively applied in these areas where it is truly advantageous to all stakeholders. An example of this is at the Rangitata Huts where



the Hutholders' Association organised the conversion of both HV and LV overhead to underground cable (photo below). This solved safety, capacity and reliability issues within the settlement and provided a much more aesthetically pleasing environment.

There is very little truly rural LV network. The majority of this is single spans leaving or crossing the road reserve.

### Service Poles

Service lines on consumer's premises are generally owned and maintained by the individual consumers - irrespective of voltage. The only ownership interest EA Networks maintains is in the span leaving EA Networks' network pole (while it is above the road reserve) and poles in the road reserve that only support one or more services. Service poles can be likened to aerial pillar boxes.

### Street Lighting

A network of street lighting pilot wires has been run to supply street lighting. These pilots are switched at distribution substations by a ripple control relay that is signalled at dusk (on) and dawn (off). This conductor is typically 16 mm<sup>2</sup> copper in overhead reticulated areas. EA Networks own 32km of overhead street lighting pilot line. The overhead pilot network is as reliable as the other LV overhead distribution and malfunctions/faults are generally caused by clashing wires or a faulty ripple control relay.

There are some cases where EA Networks have converted to underground reticulation and have made available an underground cable street lighting pilot but the street light owner has chosen not to use it or install new street lighting columns. In these circumstances the overhead street lighting pilot and supporting poles become the street light owner's responsibility.

### Condition


The age-based condition of LV overhead lines is a relatively evenly distributed profile. The distribution represents all LV poles and these are distributed in both rural and urban areas. The poles less than 15 years old are mostly located in the rural area. Then urban lines are split between much older lines that will probably be converted to underground within the next ten years and relatively new lines that were rebuilt in the 1980s and early 1990s. These newer lines will be in generally very good condition. The older lines (>40 years) are one of the principal targets of underground conversion. They will typically be smaller conductors with either no covering, or failed covering, that offers little protection against conductor clash or accidental contact. The conversion to underground will eliminate any condition related issues.

The EA Networks policy change to enforce all new network connections be underground has caused a dramatic drop in the number of LV poles under four years old. This will become even more apparent in future years.

The overhead lines constructed over the last twenty years consist mainly of PVC covered All Aluminium Conductor (AAC) or PVC covered hard drawn copper and are in generally good condition.

A number of older lines still exist using original braid covered conductor. The general condition of this conductor is very poor and is subject to conductor clashing. In some places insulated spreaders have been used to reduce this problem. It is not intended at this stage to replace these conductors in the near future, as the undergrounding programme will take care of this as condition dictates.

The recently adopted policy that all new connections to the network will be via underground cable will see a gradual reduction in the quantity of overhead LV network although its average age is likely to increase.

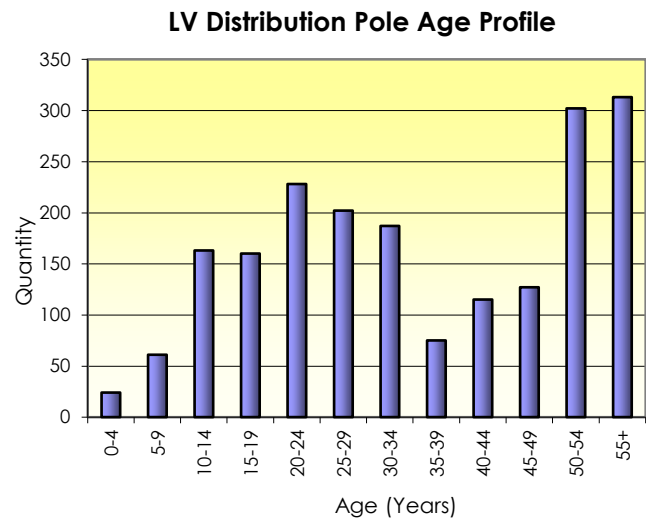

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of the LV overhead distribution network is still being developed. Construction standards are fully documented and all new work is audited for compliance.

## Maintenance

### Inspections, Servicing and Testing

Major inspections were performed during 2007 and 2013. This ascertained the condition of all urban poles including LV and service poles. This data is being used to further prioritise and schedule reinspections and the urban underground conversion effort. In rural townships this data may promote some replacement activity of overhead lines. Rural LV lines are only reinspected if the associated HV distribution line has triggered a visit.

### Fault Repairs

The frequency of LV faults on the EA Networks network is very low. This is reflected in the relatively low cost of LV faults overall.

Of the sum allowed for LV faults system-wide, Rakaia takes a slightly higher than average proportion. This is purely age related and reflects the "minor maintenance until converted to underground" approach considered as prudent by EA Networks.

### Planned Repairs and Refurbishment

No substantial repairs or refurbishment are proposed during the planning period. Most maintenance work is on an as-required basis.

## Replacement

There are no plans to replace any LV overhead network in urban areas during the planning period. Rural areas are likely to have some replacement work completed as part of HV distribution replacement or enhancement work.

Where individual poles are close to failure, in an otherwise sound line, a pole replacement will occur, generally with a pole that matches the remaining life of the rest of the line.

## Enhancement

See [section 5.4.7](#) - Network Development for details.

## Development

See [section 5.4.7](#) - Network Development for details. The Ashburton District Council's District Plan has rules that make additional pole locations in urban areas a non-compliant activity.

### 4.5.3 400 V Underground Distribution Cables

#### Description

As has been already mentioned EA Networks has a significant amount of underground cable and this is increasing as LV overhead lines require reconstruction. The Methven urban area is completely underground and approximately 73% of Ashburton consumers are supplied via a pillar box using an underground cable. This broadly reflects the degree of underground reticulation versus overhead LV circuit length in Ashburton (83%).

Various cable types were used during early underground installations. This included PVC insulated single solid aluminium core cable. The present standard types are:

Description	Current Rating (amps)	Capacity (kVA)*
3 core 16mm <sup>2</sup> XLPE copper (standard urban connection)	85	60
3 core 25mm <sup>2</sup> XLPE copper (larger urban connection)	120	85
3 core 35mm <sup>2</sup> XLPE copper (pillar box to main cable)	150	107
3 core N/S 95mm <sup>2</sup> XLPE aluminium (light duty LV distribution)	200	142
3 core N/S 185mm <sup>2</sup> XLPE aluminium (standard LV distribution)	300	213
4 core 185mm <sup>2</sup> XLPE aluminium (old standard LV distribution)	300	213
4 core 240mm <sup>2</sup> XLPE aluminium (heavy duty LV distribution)	360	256

\* It should be noted that distribution LV cable circuits are typically limited by voltage drop not thermal rating.

In many cases the ability to supply load with a LV cable is determined by voltage drop rather than thermal capacity. The total distance of LV cable presently installed and owned by EA Networks is approximately 332km. This includes all cable sizes from 16 mm<sup>2</sup> to 500 mm<sup>2</sup>.

Currently, all new urban subdivisions are reticulated underground as a requirement of the appropriate District Plan. District Plan provisions ensure that no new poles (where one does not already exist) can be located in urban areas. This means that any new urban reticulation is typically underground.

Various roadside boxes are required to complete the LV cable system. These vary in size and are categorised as follows:

- Pillar box Residential pillar box that can accommodate up to six single phase or two three phase connections,
- Link box This is typically at a junction in the LV network and provides network reconfiguration capabilities or supplies a larger three phase load,
- Distribution box This is the largest LV box and can provide up to four 400 amp three phase connections and its typically used in commercial and industrial areas.

Box Type	Quantity
Pillar Box	4,595
Link Box	507
Distribution Box	356
<b>TOTAL</b>	<b>5,458</b>

The typical configuration of urban LV underground distribution is that a cable will be run on each side of the street in individually fused feeders from a distribution substation. The cables either loop between pillar

boxes or are tapped off to pillar boxes that are used to connect the consumer's service cable via fuses. At the end of a cable run, a link box or distribution box will allow interconnection to adjacent LV cables that may be from a neighbouring substation. This arrangement allows reconfiguration to accommodate changes in load or back-feeding during cable failure or distribution transformer replacement.

### Service Cables

The cable from pillar box to house or business does not always exit directly from the pillar box across the road boundary. Often during underground conversion the most cost effective and least disruptive route is along the footpath and then across the boundary. EA Networks retain ownership of the portion within the road reserve. The underground service cable is generally very reliable in the roadside unless excavated by other utilities or contractors. There are no known problems with this portion of the LV network.

### Street Lighting

As mentioned above, a parallel network of street lighting pilot cables has been run to supply street lighting. This cable is typically 16 mm<sup>2</sup> copper neutral screened cable in underground areas. EA Networks own 245km of underground street lighting pilot cable. The pilot cable network is very reliable and malfunctions/faults are generally at the ripple control relay or caused by third party damage.


## Condition

EA Networks has a mixture of early generation PVC and modern XLPE insulated, PVC covered, low voltage cables in the low voltage network. Generally, these are all very reliable with the exception of some early single core aluminium cables that have a very thin plastic sheath and are therefore prone to mechanical damage from stones etc. These cables only form a small percentage of the total low voltage cable population - approximately 2%. It is intended to replace these cables as they begin to fail at an unacceptably high rate.

The age distribution shows the effect of more than 25 years of underground conversion and new urban subdivision. This

chart has all EA Networks owned underground cable including small in-road service cables. The underground LV cable system is generally in excellent condition. The exposed parts of the network, such as boxes, can be subject to vandalism and vehicle damage but the frequency of damage is very low and there are no known outstanding condition-related issues.

**LV Underground Cable Age Profile**

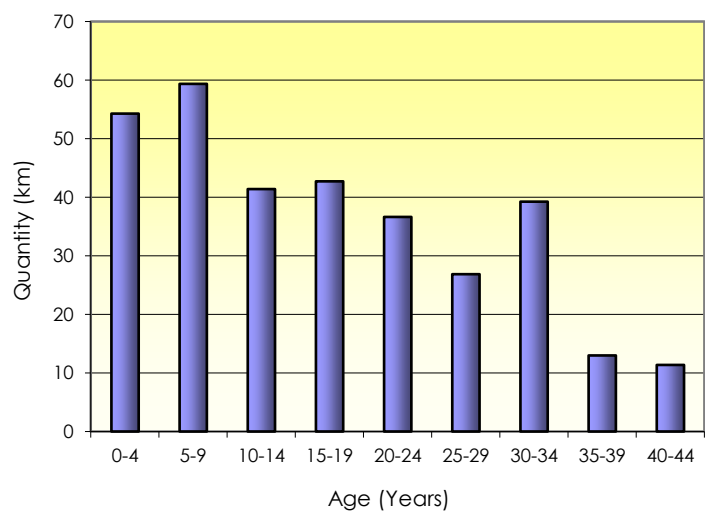

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of the LV underground distribution network is still being developed. Construction standards are fully documented and all new work is audited for compliance.

## Maintenance

### Inspections, Servicing and Testing

Inspections of LV boxes, cables up poles and cable terminations are only instigated when damage is noticed or reports of unusual appearance are received.

### Fault Repairs

Fault repairs are typically very low in frequency and in many cases are chargeable to the party causing the fault.

## Planned Repairs and Refurbishment

There is one historical problem with the LV network in urban Ashburton. The phasing of different parts of the network is not necessarily the same. That is, the "red" phase wire cannot be guaranteed to have the same absolute phase angle as another "red" phase wire in an adjacent substation area. Correct phasing is necessary when using LV ties between substations. A number of LV links are now labelled "Do Not Operate" because of the phase difference across them. This situation has arisen from the historical lack of LV interconnectivity. The overhead LV network was built in a substation-by-substation manner with no particular reference to adjacent or absolute phase angle. A survey of phase angle is complete and each Magnefix ring-main unit has been labelled with the known and true, red, yellow and blue phase conductors. This gives all personnel the information needed to correctly connect a standard Dyn11 distribution transformer as HV RYB ABC and LV ryb abc. Work is proceeding to physically correct the phasing both as a stand-alone programme (during periods of reduced workload for high priority tasks) as well as in association with other routine projects or tasks. It is likely to be several years before this is 100% complete as the areas that remain are not as simple to remedy. Currently, the programme is about 75% complete.

No other repairs are planned.

## Replacement

There are no plans to replace any significant portion of underground LV network during the planning period.

## Enhancement

See [section 5.4.7](#) - Network Development for details.

## Development

See [section 5.4.7](#) - Network Development for details.

## 4.6 Service Line Connection Assets

### Description

This asset consists of the equipment used to connect approximately 19,000 consumers to the EA Networks distribution network.

The major component of this asset is the service protective device, which may be one of the following:

- 400V re-wireable pole fuse
- 400V HRC pole fuse
- 400V HRC pillar box or distribution box fuse
- 11-22kV drop-out fuse
- 11-22kV disconnecter
- 11-22kV circuit-breaker

The service line on the premises of the consumer is owned and maintained by the consumer. There are circumstances where EA Networks will contribute towards consumer owned service lines. One example would be during underground conversion. EA Networks fund the first 20 metres of underground service line conversion onto private property. This ends up in consumer ownership but is a cost against the project and therefore against the LV network assets. Any portions of service line assets on the road reserve are considered EA Networks' asset as a private land owner has no explicit right to own equipment in the road reserve.

### Condition

The connection assets are largely in sound order with the most common condition related issue being gradual deterioration of the fuse link as fault current (interrupted by on-property equipment) passes



through the fuse. Occasionally, the fuse link carrier may deteriorate as a consequence of corrosion or thermal (overloading) damage and this is replaced as and when required.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of service line connection assets is still being developed. Construction standards are fully documented and all new work is audited for compliance.

## Maintenance

In general, EA Networks does not carry out maintenance on consumer owned service lines unless contracted to do so. These are the responsibility of the consumer to maintain and they can use any competent contractor to do so.

The situations where EA Networks do maintain service line related equipment include:

- replacement of blown service fuses due to faults
- replacement of service poles on the street where these are sub-standard
- repairs to network connection equipment
- repairs to service spans across road reserve (any asset located in the road corridor is assumed to be EA Networks' responsibility unless informed otherwise).

Financial control procedures mean that only approved work is carried out and that the consumer will be required to pay for most work on consumer-owned service lines.

## Inspections, Servicing and Testing

There are no scheduled inspections of the LV service asset category.

The Board have indicated that they believe EA Networks are in the best position to offer advice to consumers about their 11-22kV service lines. Consequently, the lines inspector visits private on-property lines to assess them and advise the owner of any remedial work that is required. Currently there is no charge for this inspection. The relatively few HV service lines connected via a circuit-breaker are subject to regular inspection and servicing as per [section 4.10](#). HV EDO fuses connecting HV service lines are examined whenever they are operated.

## Fault Repairs

Service lines are generally owned by the end consumer and as such are not maintained by EA Networks. The only maintenance item of note is the occasional replacement of a defective service fuse carrier, cartridge or base.

## Planned Repairs and Refurbishment

No repairs or refurbishments are planned.

## Replacement

The gradual replacement of re-wireable fuses with HRC types as part of LV replacement projects is expected to reduce the number of premature service fuse failures, which should be reflected in a reduced cost of fault work.

## Enhancement

There are no enhancement proposals.

## Development

There are no development proposals. It should be noted that all new connections to the EA Networks network are required to be made using underground cable (at all reticulated voltages below 33kV). This will lower the mechanical burden on the service line connections and should decrease further the impact

of failed service lines on the EA Networks network.

## 4.7 Zone Substation Assets

### Description

Zone Substations are used to transform power from subtransmission voltages of 66kV or 33kV down to EA Networks' standard distribution voltages of 11kV or 22kV.

These substations comprise buildings, switchyard structures and associated hardware, high voltage circuit-breakers, power transformers, instrument transformers, and a multitude of other associated power supply cabling and support equipment. Furthermore, the substations range in size from 5 MVA to 40 MVA and are used to feed all areas of EA Networks' network, thus playing a critical role in the overall reliability of EA Networks' network. [Section 5.4.2](#) shows the location of EA



Networks' 23 Zone Substations. ASH and ASH66 are co-located. Highbank is not shown as it is owned by Trustpower although it both injects winter generation and takes summer pump load. EGN is adjacent to the Transpower 66kV GXP and does not supply any distribution load (although this is planned in the future).

Abbreviations have been used to keep substation descriptions concise. The substations are listed below along with some vital statistics. Note that firm capacity in this context relates to the loss of a power transformer.

Each site has its own particular characteristics that tend to relate to the design and technology at the time of construction. The full details of each site are too much to describe here, but a brief overview follows. The distribution load details in each title line are pre-diversity and non-seasonal. The General category will include a lot of commercial users such as retail, accommodation, dairy sheds and warehousing while the majority is residential. The actual peak load is in the summary description that follows.

Code	Name	Transformer Count	Peak Load (MW)	Sub-transmission Line Security	Firm Capacity (MW)	Firm (Break) Capacity (MW)	ICP Count
ASH	Ashburton 33/11	2 x 10/20 MVA	25	n-1	22	28	6,250
ASH66	Ashburton 66/11	1 x 10/20 MVA	-	n	0	28	0/6,250
CRW	Carew 66/22	1 x 10/15 MVA	15	n-1	0	9	890
CSM	Coldstream 66/22	1 x 10/15 MVA	13	n-1	0	9	780
DOR	Dorie 66/22	1 x 10/15 MVA	11	n	0	9	430
EFN	Eiffelton 66/11	1 x 10/20 MVA	9	n-2	0	4	450
EGN	Elgin 66/33**	1 x 45/60 MVA	-	n-1	-	-	0
FTN	Fairton 33/11	2 x 5/10 MVA	8	n-1	10	6	100
HTH	Hackthorne 66/22	1 x 10/20 MVA	15	n-1	0	9	810
LGM	Lagmhor 66/11	1 x 10/15 MVA	7	n-2	0	6	380
LSN	Lauriston 66/22	1 x 10/20 MVA	15	n-1	0	7	780
MVN	Methven 33/11	1 x 5 MVA	2	n	0	4	90

<b>MHT</b>	Mt Hutt 33/11	1 x 5 MVA	2	n*	0	2	210
<b>MON</b>	Montalto 33/11	1 x 2.5 MVA	2	n	0	1	300
<b>MSM</b>	Mt Somers 33/11	1 x 5/10 MVA	3	n	0	3	510
<b>MTV</b>	Methven 66/11	1 x 10/15 MVA	4	n-1	0	4	1,370
<b>MTV</b>	Methven 66/33**	1 x 18/25 MVA	5	n-1	0	5	1,100
<b>NTN</b>	Northtown 33/11	2 x 10/20 MVA	9	n	20	28	3,450
<b>OVD</b>	Overdale 66/22	1 x 10/20 MVA	14	n-1	0	10	1,260
<b>PDS</b>	Pendarves 66/22	2 x 10/20 MVA	16	n-1	20	30	420
<b>SFD</b>	Seafield 33/11	1 x 5/10 MVA	-	n*	0	10	0/1
<b>SFD66</b>	Seafield 66/11	1 x 10/15 MVA	8	n*	0	10	1
<b>WNU</b>	Wakanui 66/11	1 x 10/15 MVA	13	n-1	0	10	550

n\* - these substations are dedicated to one industrial consumer each and security levels have been negotiated with that consumer. SFD is essentially hot standby for SFD66.

\*\* EGN and MTV 66/33 do not have any distribution voltages present.  
MTV 66/33 supplies MVN, MHT, MSM and MON.

**Ashburton (ASH & ASH66)** General: 24.9 MW Industrial: 4.0 MW Irrigation: 4.4 MW

This site used to be Transpower's supply point into Ashburton. The site is expansive and well fenced. The 33kV switchyard is well laid out, easily maintained and has equipment around 25 years old. Two incoming 33kV circuits support the 33kV bus. The 33/11kV transformers are about 18 years old. Stage 1 of 66kV development (ASH66) is complete with a single 66kV line and a single 66kV transformer installed. The main building dates from the late 1940s but was extended to accommodate two 11kV switchrooms. The 11kV load is served from two 11kV switchboards. 11kV Feeder protection uses electronic relays. Some SCADA functionality exists, which is limited by the older technology used at 33kV. A high capacity crane bay (25 tonne) is one of the unique facilities at Ashburton. The site currently supplies 70% of urban Ashburton and some outlying areas. The load has a winter peak consisting almost entirely of residential dwellings. Northtown zone substation offers additional switched firm capacity. Total switched firm capacity matches load.



**Carew (CRW)** General: 3.7 MW Industrial: Irrigation: 13.3 MW

A recent 66/22kV site. Two 66kV circuits from a closed ring serve this site. The 66kV numeric line protection is line differential with backup distance. The site has modern electronic transformer and 22kV feeder relays fitted and SCADA. The site is proving to be low maintenance. The load is summer peaking and irrigation based. The high general capacity is a consequence of the large number and size of dairy sheds. Firm capacity almost matches load. Site will have second 10/20 MVA transformer fitted to provide spare system transformer, more firm capacity to load and back-feed capacity to adjacent sites (CSM, HTH & LGM). See projects [10969] and [11090].

**Coldstream (CSM)** General: 3.2 MW Industrial: Irrigation: 13.8 MW

A relatively new site that operates at 66/22kV and serves an area that has seen significant growth in irrigation requirements. Two 66kV circuits from a closed ring serve this site and line distance and differential protection is fitted. Modern electronic relays are fitted and SCADA is operational. Load exceeds firm capacity. The high general capacity is a consequence of the large number and size of dairy sheds. The

dominant load is irrigation pumps which are summer peaking.

**Dorie (DOR)**                      General: 1.8 MW      Industrial:                      Irrigation: 9.9 MW

This site is compact and originally housed a 33/11kV substation. Rebuilt as a 66/22kV site around 2000 it has a concrete block building and all electrical equipment is new. A single 66kV circuit serves this site. Indoor 22kV circuit-breakers are used. 22kV feeder protection and the 66kV transformer inter-trip signalling has been updated in 2013-14. The site summer peaks with irrigation load. The high general capacity is a consequence of the large number and size of dairy sheds. SCADA system installation covers 22kV feeder protection. Firm capacity via 22kV interconnections exceeds load.

**Eiffelton (EFN)**                      General: 1.5 MW      Industrial:                      Irrigation: 7.2 MW

Eiffelton site (EFN66) supplies all of the load that was connected to the now decommissioned Eiffelton 33/11kV substation and some of the ex-Hinds 33/11kV load. It is a new site with a 66/11 kV, 10/20 MVA transformer, 22kV capable indoor switchboard, numeric 22kV feeder, transformer, 66kV bus, and 66kV line protection. SCADA control is available and the three 66kV circuits that are connected provide excellent security. Firm capacity is slightly below load due to 11kV back-feed limitations.

### Elgin (EGN)

A site that is located adjacent to the Transpower Ashburton GXP. This site houses EA Networks' main 66kV supply bus and a large (60 MVA) autotransformer to allow ripple plant signalling on the 66kV network (also previously used to provide security to the 66kV bus). Significant changes occurred during 2012-13 to make the 66kV bus more secure. The 66kV bus now has three sections with bus zone protection over each section. There are no distribution feeders currently supplied from this site. Firm capacity and load is dependent on Transpower GXP configuration. Once all 33kV load has been migrated to 66kV GXP the 60 MVA 66/33/12.7kV YNa0d1 autotransformer will be reconfigured as a YNyn0 66(33)/22kV transformer [10104]. This will allow load to be served directly off the EGN 66kV bus and provide significant back-feed capacity to Wakanui, Eiffelton, Ashburton, Northtown, Fairton, and Seafeld substations.

**Fairton (FTN)**                      General: 0.6 MW      Industrial: 5.5 MW                      Irrigation: 0.1 MW

This site was originally established to supply the nearby meat-works. The meat-works are still operating and additional industrial load has arrived in the area. The site is somewhat prone to corrosion from atmospheric pollution. The switchgear is a combination of indoor 11kV and outdoor 33kV and 11kV. Two 33kV lines have directional protection on them. The industrial load is non-seasonal but total load peaks in summer with irrigation load. The meatworks and a vegetable processing plant form a base load. Limited SCADA system. Two 5/10 MVA transformers. Firm capacity exceeds maximum load. Substations is In the process of being replaced by 66/22+11 substation (projects [10957] and [11066] ).

**Hackthorne (HTH)**                      General: 2.5 MW      Industrial:                      Irrigation: 14.9 MW

A modern site configured for 66/22kV operation. Two 66kV subtransmission circuits are connected in a closed ring. The site has modern electronic relays fitted and SCADA. Full 66kV line protection is fitted (differential & distance). The site is proving to have low maintenance requirements. The load is summer peaking and irrigation based. The high general capacity is a consequence of the large number and size of dairy sheds. Maximum load currently exceeds firm capacity. 22kV incomer cables have been replaced to obtain full 20MVA rating from transformer. Additional 22kV conversion will over time increase firm capacity, as will operation of Montalto and Mount Somers substations at 66/22kV.



**Lagmhor (LGM)**                      General: 0.5 MW      Industrial:                      Irrigation: 7.1 MW

This site was developed in 2006. 2012 saw conversion from 33/11 kV operation to 66/11kV operation. During late 2012 the site was converted to 66/22kV operation. Three 66kV subtransmission circuits are

connected which gives excellent security. A 10/20 MVA transformer is relatively lightly loaded although feeder reconfiguration has increased this and unloaded Hackthorne substation somewhat. Numeric 22kV feeder and transformer protection is installed. 66kV bus differential and full 66kV line protection is installed. Indoor 22kV vacuum circuit-breaker switchboard. Fibre-optic communication gives full SCADA facilities. Firm capacity exceeds maximum load.

**Lauriston (LSN)**                      General: 4.0 MW                      Industrial:                      Irrigation: 15.6 MW

Rebuilt in 2000 and now operating at 66/22kV. The site was established in the 1980s anticipating a surge in irrigation demand that didn't arrive until ten years later. Two full capacity 66kV circuits offer n-1 security. Load has seemingly reached a plateau with limits on new water extraction. Irrigation pumps are large in this area due to depth of wells (200m+). SCADA system is operational on most relays. Maximum load exceeds firm capacity. Summer peaking due to irrigation demand. The high general capacity is a consequence of the large number and size of dairy sheds. Recent 22kV conversion has largely secured most load. The conversion of the 66/33kV transformer at Methven to 66/22kV (project [00495]) will secure all distribution load. A 10 MVA 22/11kV transformer is currently being installed at Methven to increase switched firm capacity to both sites.

**Methven33 (MVN)**                      General: 2.5 MW                      Industrial: MW                      Irrigation: 0.2 MW

A site that was developed on the edge of Methven to offer reliable service to this tourist village. Chalet style A-frame building houses problematic 11kV switchgear and a 33kV ripple plant. Outdoor 33kV switchgear in a compact pole-mounted arrangement. SCADA system fitted but not fully functional. Currently supplies only rural overhead feeders. Marginally winter peaking as a consequence of tourist/skiing influx. Summer irrigation almost retains a flat annual load profile. Firm capacity exceeds maximum load. One 33kV circuit available. Backup via nearby Methven66 substation provides firm capacity. Scheduled for decommissioning as an 11kV supply point during 2015-16. The site will be retained as a remote storage and backup network control centre facility.

**Methven66 (MTV)**                      General: 5.0 MW                      Industrial: 0.2 MW                      Irrigation: 1.4 MW

A site that was established as part of the initial 66kV ring development and Highbank generation embedding. Three 66kV lines terminate at this site, two of which are high capacity alternatives. The third (radial) circuit serves Highbank power station. This site serves as a 66/33kV transformation to supply Methven33, Mt Hutt, Montalto Hydro, Montalto and Mt Somers substations. There is also a 66/11kV transformer, which offers Methven township n-1 levels of security on an entirely underground 11kV network. Load is winter peaking as a consequence of tourist/skiing influx and residential/commercial predominance. SCADA system is fully functional. Firm capacity of 11kV exceeds maximum load. 33kV firm capacity is zero. All 33kV switched firm capacity is via the distribution network.

**Montalto (MON)**                      General: 0.5 MW                      Industrial:                      Irrigation: 1.3 MW

This site has been in service for a few years. It is currently a temporary substation located near the Montalto hydro power station. As the BCI irrigation project proceeds (making more irrigation water available), a future project will possibly construct a brand new Montalto 66kV substation at a permanent site about 3 km away (Project [00513]). The new substation is dependent on new irrigation load occurring. If significant new load does not occur the new substation construction will be delayed.

**Mt Hutt (MHT)**                      General: 0.4 MW                      Industrial: 2.6 MW                      Generation: 0.1MW

A 1980s site with modern indoor 11kV switchgear and a compact outdoor 33kV bus arrangement for the single incoming 33kV underground feeder. Small concrete block building. No SCADA system because of difficult communication paths although this will be resolved in 2017 [11068]. Load peaks in winter associated with ski-field activities. Maximum load exceeds firm capacity. Zero irrigation. Cleardale generation is connected at 11kV. Early electronic protection is scheduled for replacement (project [10961]). Switched firm capacity is sufficient for essential services of the major consumer. Any increase in security is by negotiation.

**Mount Somers (MSM)**                      General: 1.7 MW                      Industrial: 0.7 MW                      Irrigation: 1.6 MW

A 1970s site with two 33kV circuits - one incoming, one outgoing (to Montalto substation and Montalto Hydro). Outdoor 33kV switchyard. Recently commissioned SCADA system. Maximum load matches firm capacity. A new building has been constructed and a new 22kV switchboard has been commissioned along with modern transformer and feeder protection. Fibre-optic recently connected. A 33/11kV 5/10 MVA transformer was installed in 2013. Site will be rebuilt as 66/11-22kV in future [00516] depending

upon load and security requirements. The load is balanced between extensive rural (many non-electric irrigated) farms, Mt Somers township, and a couple of lime quarries. The load is slightly summer peaking due to the irrigation but remains close to the summer peak during winter as a consequence of the residential demand. There is scope for additional irrigation load to occur on this site as more water is made available from the RDR. Firm capacity is available from Hackthorne via a 66kV line running at 22kV supplying a 5MVA 22/11 kV autotransformer.

**Northtown (NTN)**      General: 10.2MW      Industrial: 1.6MW      Irrigation: 0.8 MW

A site completed in 2006 that is now operating at 66/11kV. Two 66kV subtransmission circuits supply an outdoor 66kV switchyard (one of the circuits has limited in-feed capacity). Two 10/20 MVA 66/11kV transformers. The 11kV switchgear is configured as two switchboards, each with a bus-coupler and two incomers, in two separate rooms giving four bus sections with one incomer and four outgoing feeders on each section. Modern electronic protection relays and SCADA. This site is intended to complement Ashburton (ASH) substation providing additional capacity and security to Ashburton township and immediate surrounds. Better transformer security now that it is operating at 66kV. 2019 will see a second full capacity 66kV circuit available. Firm capacity exceeds maximum load. Load is winter peaking in line with residential demand.

**Overdale (OVD)**      General: 5.0 MW      Industrial: 0.3 MW      Irrigation: 14.8 MW

A site constructed in 2004. Two full capacity 66kV circuits offer n-1 security. The site has a 10/20 MVA transformer (upgraded in 2014), indoor 22kV vacuum circuit-breaker switchboard, modern electronic relays fitted and SCADA. The site is exhibiting low maintenance requirements. The load is summer peaking and irrigation based, although Rakaia township with its residential/commercial demand causes higher base loads than some other irrigation-serving substations. Firm capacity exceeded by maximum load. Planned work at adjacent FTN substation will further increase switched firm capacity.

**Pendarves (PDS)**      General: 1.6 MW      Industrial: 0.2 MW      Irrigation: 17.5 MW

Site constructed originally as 33/11kV in 1997. Two full capacity 66kV circuits offer n-1 security, a third offers limited back-feed ability. A fourth 66kV radial circuit feeds Dorie substation. All modern equipment with a newly replaced/enlarged building. Outdoor 66kV bus and circuit-breakers. New 22kV circuit-breakers. Irrigation load causes this site to summer peak at 10 times its winter peak. Full SCADA system functionality. Firm capacity is available to all load as the site has two 10/20 MVA transformers (one of these is considered as the system spare). Project planned to provide fire barrier between the two 66/22kV transformers [10960].

**Seafield (SFD & SFD66)**      General:      Industrial: 8.0 MW      Irrigation:

These sites are dedicated to Canterbury Meat Packers meat-works. At SFD, a single 33kV line feeds onto a bus via an outdoor circuit-breaker. Indoor 11kV switchgear feeds into a consumer-owned cable network. Concrete block building. Non-seasonal peak load. Limited SCADA system to permit switching load between SFD and SFD66. SFD66 is a new site separate to SFD and is supplied from a single "T" connected 66kV line. A single 66/11kV 10/15 MVA transformer normally supplies the industrial load. Firm capacity currently exceeds maximum load but this is not a contracted arrangement and will reduce to a 5MVA 22kV back-up once the 33kV site is decommissioned (scheduled late 2018). Long term, SFD will be a 66kV site only (when 33kV GXP relinquished).

**Wakanui (WNU)**      General: 2.5 MW      Industrial: 0.2 MW      Irrigation: 10.1 MW

66/22kV site with a summer peak load. Is unique in the EA Networks network as a split-level site. Two full capacity 66kV lines serve a single 10/15 MVA 66/22kV transformer and new 22kV indoor switchgear. The site has modern electronic relays fitted and SCADA. Firm capacity is insufficient to secure all load. Additional 22kV conversion will progressively increase firm capacity. Elgin 66/22kV reconfiguration (project [10104]) will increase switched firm capacity.

## Power Transformers

EA Networks has 27 power transformers (18 x 66kV and 9 x 33kV primary voltage) installed at its Zone Substations, (as opposed to distribution transformers, which are used in distribution substations).

All of the power transformers are three phase units fitted with on-load tap-changers. A mixture of tap-changers have been used including:

- Easun MR (Reinhausen)
- MR (Reinhausen)
- Ferranti
- ATL
- Fuller
- ABB

### Oil Containment

Oil containment facilities have been installed at major substations constructed since 1991, including Pendarves, Dorie, Hackthorne, Lauriston, Wakanui, Elgin, Methven66, Carew, Coldstream, Lagmhor, Overdale, Eiffelton66, Northtown and Ashburton Substations. These facilities have also been retrofitted at Mt Somers. EA Networks' policy is to install these facilities at all new sites where single vessels contain 1,500 litres or more of mineral oil and at existing sites where there is a risk to the environment.

### Other Equipment

Five revenue energy meters owned by EA Networks are installed at Transpower's Ashburton substation (one on each supply transformer) and these are used as "check" meters for comparison with Transpower's meters. The only other energy meters installed on the network are principally used for power quality monitoring at zone substation bus distribution voltages. EA Networks do not own or operate any power factor correction equipment at any voltage.

### Condition

The 23 zone substations that EA Networks operate range in age from brand new to almost 35 years old. The new sites are obviously in excellent order while the older, smaller sites such as Mt Somers (MSM) are beginning to reach the point where maintenance is increasing.


### Transformers

The population of zone substation power transformers are generally in very good order. A proportion of the units could be said to have entered middle age, and, like anything in middle-age, it pays to monitor certain critical parameters more closely. Dissolved Gas Analysis (DGA) has allowed EA Networks to monitor the internal condition of its power transformer population and demonstrate that, in general, there is little evidence of accelerated insulation ageing or deterioration. The age chart clearly shows the younger and larger 66kV transformers versus the older and smaller 33kV transformers.

Four smaller (2.5 MVA) 33/11kV units, manufactured by ECC in the mid-1960s, have all been detanked after a design flaw was exposed as a result of an 11kV fault. No major damage was done (an exposed tertiary inter-phase conductor had touched the tank) and some minor corrective engineering achieved an acceptable solution. While detanked, the core and winding clamps were tightened and a general internal wash (with clean oil) refurbished the units. None of these units is currently in service, and they are awaiting disposal. With the conversion to 66kV at some sites, several 33/11kV units have been taken out of service and been relocated to other sites facing increased loading. A number of other transformers are currently in storage awaiting commissioning, redeployment (possibly at 22/11kV or 33/22kV after modification) or disposal.

### Oil Containment

All oil containment bunds installed at Zone Substations are in excellent condition. Some of the bund field

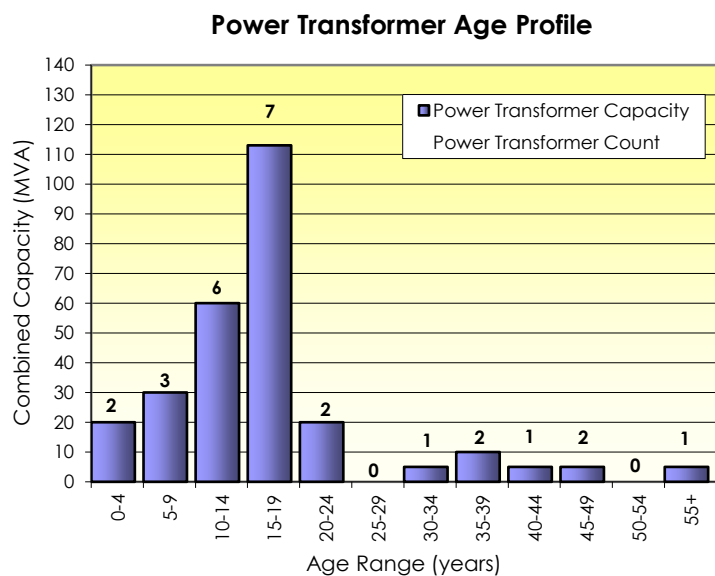

drains have become clogged with detritus from bird's nests and leaves. These will be renovated and are likely to be converted to the more modern surface drain type permitting much simpler maintenance. EA Networks have trialled polymer filter devices to allow direct drainage of storm-water from the bund without a normally closed valve. Unfortunately, they appear to be prone to clogging with dust and detritus which makes them impermeable.

### Other Station Equipment

Batteries at all stations are now monitored with portable specialist equipment and analysis of the data obtained has kept the batteries in good order. HV switchgear is considered in [section 4.10](#) and protection in [section 4.12](#).

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of zone substations is still being developed. Construction standards are fully documented and all new work is audited for compliance.

## Maintenance

All Zone substations are routinely inspected, tested and maintained regularly in accordance with EA Networks' standard requirements. Maintenance is categorised as either minor (non-invasive) or major (invasive). Visual Inspections are categorised as minor.

### Inspections, Servicing and Testing

#### Visual Inspections

All Zone substations are visually inspected monthly as a minimum, increasing to fortnightly during high load periods. Visual inspections incorporate the checking of oil levels, voltage regulation, switchgear condition, battery test and security. A detailed report is made of load and equipment operation. This information is used to assist with forward planning and maintenance.

#### Battery Banks

While the modern battery is considered virtually maintenance free, high importance is placed on the reliability of substation batteries, as many of the new protection devices are reliant on stable DC supply for correct operation. Batteries and chargers are visually examined at each monthly inspection and every three months a non-intrusive battery impedance test is carried out and recorded for comparison with previous values. Regular analysis of the trend can be used to determine battery replacement criteria.

Several sites have dual battery banks to guard against individual cell failure causing loss of protection functions. Dual battery banks are standard at new sites.

#### Infrared Camera Thermal Inspection

Inspections using a sensitive thermal infrared digital camera are carried out on most equipment on at least an annual basis.

#### Ultrasonic

Ultrasonic outdoor inspections are performed bi-annually to detect high levels of discharge.

#### Partial Discharge

Partial discharge testing is performed on indoor equipment on a bi-annual basis. This technique is used selectively where certain switchgear/bus components are known to present a risk or represent a security hazard.

#### Other Station Equipment

Other switchyard equipment such as local service transformers, surge arrestors, cables, etc is maintained as necessary when the associated circuit is taken out of service.





## Power Transformer Testing

As part of EA Networks' maintenance programmes all major power transformers have an annual minor maintenance service which encompasses a visual inspection, routine diagnostic tests and minor repair work in accordance with EA Networks standards which incorporate manufacturers' recommendations and EA Networks' experience.

In general, maintenance on the transformers consists of maintaining oil within acceptable dielectric and acidity standards, patching up corrosion, fixing oil leaks and annual diagnostic tests on the insulating oil. In addition, the units fitted with on-load tap-changers require periodic inspection of the tap-changers and the contacts are dressed or replaced as necessary. Additional remedial work required outside the scope of the maintenance standard is referred to the asset management team for further action, which is budgeted as repairs and refurbishment.

### *Oil Testing - Dissolved Gas Analysis*

For almost two decades, all Zone Substations have had annual dissolved gas analysis tests carried out and this has helped identify potential problems that need monitoring. A baseline Dissolved Gas Analysis (DGA) test was carried out on most power transformers in 1996 (the remainder in 1997). Trends revealed by this analysis give some indication of internal condition. After a period, the frequency of testing may be reduced on units showing no discouraging trends.

Costing for minor maintenance is very dependent on location and based on historical maintenance expenditure.

Costing for major maintenance, i.e. on-load tap-changers, is not only dependent on the location of the site but also the usage and types of unit and is such that some units are scheduled to be serviced every two years and others every six years.

## Fault Repairs

Equipment failures occur randomly and generally without warning and range from a simple battery failure or a faulty resistor, to a costly transformer winding failure. The cost budgeted is the cost to restore supply or the service following the failure, not the cost of any repair work after supply or service has been restored.

The projected expenditure is based on actual expenditure incurred in recent years. It is not practicable to allocate projected expenditure against each substation asset category given the range of faults which can occur.

## Planned Repairs and Refurbishment

This area of expenditure includes corrective work identified during inspections and tests while undertaking routine maintenance or following equipment failures. The magnitude of costs can vary significantly.

Planned expenditure also includes the cost of materials and spares.

## Power Transformers

Major causes of power transformer failures to date have been winding, internal connection faults and on load tap changer mechanism failure. No faults to power transformers have been caused by lightning to date, however, surge arrestors are installed at all zone substations as a precaution.

The other major internal maintenance on a power transformer is oil refurbishment, which is carried out as required based on oil acidity and moisture test results. It is not expected that this will be required on any EA Networks units within the planning period. Some older transformers do require regular maintenance for oil leaking around radiator connection fittings. This work is usually combined with other maintenance such as painting.

## Repainting

Painting is carried out on a regular basis at a period of generally between 10 to 15 years depending on site conditions. It is planned to paint approximately 0.5 site/transformer per year over the period 2017 - 2026.

## General

The general condition of the one or two smaller, older zone substation sites is beginning to deteriorate. The transformer capacity of these sites is now coming under pressure and fortuitously they will be either rebuilt

as 66kV sites or decommissioned within the planning period.

## Replacement

There are no plans to replace any of the existing power transformers during the planning period based on the age and condition of the units. The recent 66kV subtransmission expansion has introduced a significant number of new transformers that help decrease the average age of power transformers. Within the plan horizon, planned 66kV development will ensure all older transformers are retired from 33kV service and any that remain in alternative applications will have suitable replacements available.

There is a concern that some of the 33kV transformers are greater than 30 years old with an increasing potential for failure. Indications to date have shown that, apart from some sealing problems, the older transformers are well within acceptable test parameters. It is expected that some 33/11kV units will become available for reuse as the 66kV upgrade progresses with an opportunity to decrease the average age of 33kV transformers. These 33/11kV transformers may be investigated for reuse as 22/11kV transformers. The feasibility of modifying them will be examined once they are available.

Regardless of whether a pre-emptive replacement programme is undertaken, it seems likely that the oldest units will fail at an increasing rate in future, and this will force replacement. Provided sufficient diagnostic tests are undertaken to identify imminent failure and provided some suitable spare units are available, this should not lead to a noticeable decrease in consumer supply reliability and could be a cost-effective replacement strategy option.

## Enhancement

See [section 5.4.3](#) - Network Development for details.

## Development

See [section 5.4.3](#) - Network Development for details.

## Disposal

When zone substation equipment becomes surplus to requirements it is either scrapped in a commercially and environmentally appropriate way or, if it is saleable, it will be offered to other electricity network companies. Should a serviceable unit not sell it is likely to be stored for use as spares or until it is certain no third parties are interested at which point, depending upon the value of the item, consideration will be given to selling the item as scrap.

Zone substations represent some of the larger single location land holdings of a network operator and there have been occasions where some site rationalisation has occurred. It is typically impractical to offer the result of small boundary adjustments to anyone other than the adjacent land owner. Each situation is treated on its merits. Should an entire site require disposal it would be placed in the hands of a real estate company for valuation and marketing.

## 4.8 Distribution Substation Assets

### Description

Pole-mounted substations generally consist of a distribution transformer (defined elsewhere) and associated equipment including:

- 11 or 22kV Drop Out Fuses
- Surge Arrestors
- Low Voltage Fuses
- Support Crossarms

In addition to these items, larger substations rated at 100kVA or 150kVA will often have the following additional components:

- Galvanised Steel Cantilever Platform
- Maximum Demand Indicator

In some applications, transformers as large as 300kVA have been placed on a pole-mounted platform consisting of two poles with broad beams between them, upon which the transformer sits (this is no longer done for reasons of seismic security and the borderline economic advantage of pole mounting). Any new pole mounted transformers (maximum 100kVA) reside on one pole only.

New substations greater than 100kVA use pad-mounted construction, where the transformer is placed on the ground. One such site is shown above. The EA Networks Board have adopted a 'New Connections and Extensions Policy' that requires all new connections to the EA Networks network to be via underground cable at less than subtransmission voltages. In addition, the policy requires that all new on-property transformers are ground-mounted. This means that the only new pole-mounted substations are those that are established on EA Networks owned poles on the rural roadside and are less than 150kVA capacity.



Distribution Substation Type	Quantity
Ground-Mounted	1,520
Pole-Mounted	4,740
Autotransformer/Regulator	10

Generally, EA Networks provides the recoverable substation assets without a capital contribution from the consumer. This policy has caused a significant increase in the number of ground-mounted substations.

Extra assets required for ground mounted substations usually include:

- Concrete pad
- Fibreglass or steel cover
- HV and LV Feeder Cables
- HV ring main unit (when part of a cable network)
- DIN LV Fusegear
- Anti-ferroresonance capacitors (when single phase switched at a distance) or three-phase remote switching
- Land purchase or easement.

## Condition

The condition of these assets covers the whole range from being in need of replacement to brand new. The assets in need of prompt replacement are generally either smaller, very old, rural sites or urban sites built on platforms between two poles. Very few remain in urban settings and they will be replaced with a pad-mounted site. The small rural sites will be prioritised for refurbishment.

The volume of transformer replacement and upgrading caused by load growth has ensured that the majority of substation sites have been at least proven mechanically sound during the last 15-20 years.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of distribution substations is still being developed. Construction standards are fully documented and all new work is audited for compliance.

## Maintenance

## Inspections, Servicing and Testing

All distribution substations are required to be tested every five years for safety reasons in accordance with the Electricity Regulations. At the same time, the general condition of the transformer is checked and an oil sample may be taken to monitor the internal state of the unit.

## Fault Repairs

Lightning damage, pole failure or ingress of water causes most transformer faults.

Regular inspection of transformers and covers reduces the number of failures due to water ingress caused by deterioration such as rusty tanks as these are clearly obvious to the naked eye.

Pad-mounted substations have relatively few faults and usually the substation itself is not damaged (other components such as transformers or HV and LV switchgear tend to be at fault).

## Planned Repairs and Refurbishment

There are very few substations that are known to be in need of repairs or refurbishment. Those that are will be attended to under a general repair budget set aside for this and other minor repairs.

## Replacement

The urban underground conversion programme will often revisit substations that were first installed in the 1960s or earlier. These tend to be either pole-mounted on a platform (not suitable for underground conversion) or "tin box" style units that cannot accommodate the modern style of HV and LV switchboards used by EA Networks. The result is a rebuilt substation that has the same capacity but is dramatically more flexible/functional and achieves much higher levels of operator and public safety.

## Enhancement

See [sections 5.4.4](#), [5.4.5](#) and [5.4.6](#) for details.

## Development

See [sections 5.4.4](#), [5.4.5](#) and [5.4.6](#) for details.

## 4.9 Distribution Transformer Assets

### Description

Distribution transformers come in a variety of forms suited to particular applications. Many small transformers (<75kVA) are mounted on a single pole by a hanger bracket and suited to rural situations such as a farmhouse, dairy-shed or workshop. A significant proportion of these small transformers will in future be mounted on the ground in accordance with EA Networks' 'New Connections and Extensions Policy'. Modern low-maintenance specifications require galvanised steel tanks supplied as standard for all pole-mounted distribution transformers.


Larger distribution transformers take a similar form when they are designed for pole mounting (up to 100kVA), but tend not to have hangers, as the mass is too great for a single crossarm. All new transformers larger than 100kVA are now ground mounted to ensure adequate seismic security and immunity to pole condition. When the transformer is designed for ground mounting there are several options, of which EA Networks has at least one example of each. EA Networks' standard specification for transformers has facilities to fit HV and LV cable boxes and wall mounted HV bushing wells (which allow screened cable termination elbows to be connected). The lid is fitted with outdoor porcelain bushings as standard and these are removed and blanked-off when ground mounting is required. Other types of transformers in use include pre-packaged "mini-sub" which have integral equipment cubicles at each end and specialist kiosk mounting units which have the HV and LV bushings adjacent to each other on one wall of the tank.

All new ground-mounted transformers are fitted with in-tank HV fuses. These allow multiple transformers to be installed on an underground cable without the need to consider individual fault rating or fuse operation causing ferroresonance issues.

The chart at right shows the total MVA of each different standard transformer size and the number of each. The chart excludes regulators and autotransformers.

Extra-large distribution transformers are those that operate at distribution voltages on both primary and secondary. Examples of this in use at EA Networks are a 3MVA 11kV regulator and nine 5MVA 11/22kV autotransformers (several containerised). These transformers are designed, constructed and operated in a similar fashion to "large" ground-mounted distribution transformers and hence they are covered by

**Distribution Transformer Size & Count**

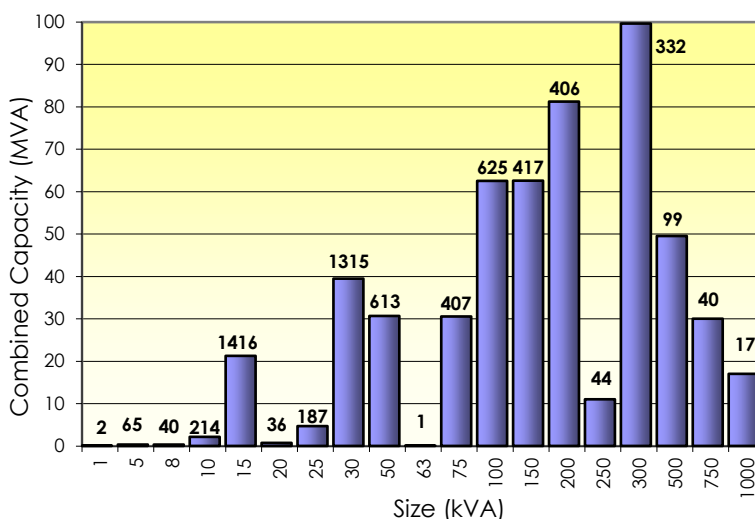

this description. Regulators are used on only one portion of the 11kV network. The location is where a long, heavily loaded line feeds the Braemar area. In 2015, the upstream 11kV line was converted to 22kV and the regulator is now awaiting recovery but still in service in combination with a 22/11kV autotransformer. 11/22kV autotransformers are used at locations where the 11kV network and 22kV network meet mid-feeder or at zone substations to provide a source of 22kV or 11kV depending on the substation bus voltage. Low impedance, bi-directional power flow (maintains neutral earth reference), portability (housed in 6 metre shipping containers with cable connections) and low losses are some of the appealing features of the autotransformers. There are 44MVA of 11/22kV autotransformers and 11kV regulators on the network, all of which are in good order.


The tanks of most distribution transformers have in recent times been supplied with bolted lids. This is of particular note with widespread use of in-tank fuses. All units have an off-load tap-changer with a boost capability of 7.5% and a buck capability of 2.5% to account for heavy voltage regulation.

All substation data including servicing records are stored in the "Assets" database system. This system includes links to the GIS, which can locate substations and electrically trace upstream to feeder circuit-breakers or downstream to consumers (ICP's) for the purposes of outage notices and fault statistics.

**Condition**

In the past three decades, and particularly in recent years, EA Networks has purchased significant quantities of distribution transformers at both 22kV and 11kV. The main driver for this either directly, or indirectly (via 22kV conversion), is the growth in load. A population of transformers with low average unit age of 20.5 years (average kVA-weighted age is 17.6 years) is a relatively low fault and maintenance asset. The average transformer size is about 86 kVA.

**Distribution Transformer Age Profile**

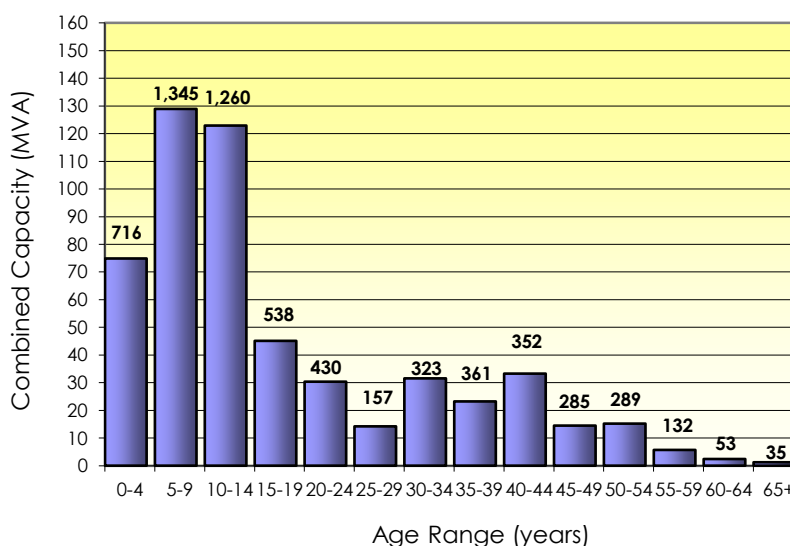

There are a number of transformers that are very old and these are normally retired when they either fault or are removed from service for other reasons. It must be said that many of the older transformers were built to last and consequently they have a longer life expectancy than the newer units.

The total population of in-service distribution transformers numbers 6,276 (6,176 previous plan) and the combined capacity is 543 MVA (523 MVA previous plan). There are several hundred transformers in storage either ready for service or ready for assessment/servicing. Many of these are related to 11kV to 22kV conversion work. These stored transformers are not included in the age profiles.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of distribution transformers is still being developed. Purchasing specifications are fully documented and all transformers are inspected for compliance.

## Maintenance

The population of distribution transformers covers a diverse range of sizes, types and ages. As such, it is important that a comprehensive management plan is put in place, as the condition of the asset is not always easily discernible on a population-wide basis.

EA Networks' policy is to extend the life of distribution transformers where this is economically feasible. In support of this policy, many distribution transformers run well below their rated values for much of the time, resulting in long lives for the cores and windings. Provided that the tanks and oil are well maintained, the overall unit may be kept in service for up to 55 years or more. In this way, the maximum return can be leveraged from these high value assets.

### Inspections, Servicing and Testing

Smaller pole-mounted distribution transformers are regularly inspected on a rolling five-year basis in conjunction with EA Networks' substation earth testing programme.

The inspection includes checks for

- tank corrosion
- paint chips
- breakdown
- oil leaks
- insulator damage
- breather condition (where fitted)
- termination faults

Where possible, the oil level is checked and recorded and if an oil sample valve is available (standard issue on all new transformers), a sample of the oil is taken and checked for dielectric breakdown.

Larger pole-mount and all pad-mount units have Maximum Demand Indicators (MDI's) which are read every 12 months. This indicates loading trends to be monitored and that allows for early intervention should a unit become overloaded.

Very large transformers in areas such as the CBD of Ashburton or industrial sites such as ANZCO have annual thermograph surveys carried out to check the tank and termination temperatures as well as to identify any other potential hotspots.

Any indications suggesting that the transformer requires attention results in prompt on-site repairs, or if this is not possible, the transformer is swapped with a spare unit from the store and sent back to the transformer workshop for refurbishment.

### Fault Repairs

The majority of distribution transformer faults are caused by lightning damage. Because of the regular inspection and servicing carried out, it is very rare for a unit to fail because of old age or deterioration.

Most faults are handled by swapping the transformer with a spare and sending the damaged unit back to the transformer workshop for inspection and repair – or scrapping if the damage is too severe.

An exception to this is bushing faults on large units where the bushing can be easily repaired or replaced

on site.

A result of 11kV to 22kV conversion is that a large number of 11kV transformers are returned into stock. Some of these units have reached the end of their useful life and they are scrapped. The remainder are either sold or refurbished for use elsewhere on the distribution network.

EA Networks have a limited stock of "emergency spares" which are used only under the circumstances of unexpected failure. A single dual voltage (22-11kV), 1,000kVA unit covers all pad-mounted situations and is equipped with 15 metre flexible HV and LV cables to permit installation adjacent to the failed unit.

## Planned Repairs and Refurbishment

Repairs can range from a minor paint touch-up on earlier painted units through to insulator repairs and bolt replacements. Refurbishment may include oil changes, rewinds and even tank replacements.

Rewinds are only attempted on relatively modern units where modular replacement windings are readily available.

Tanks are often subject to corrosion, especially in the case of older painted units. At the same time however, the internal core and windings may be in excellent condition. For this reason, tanks are often repaired or replaced if the unit is otherwise in good condition.

Each unit is assessed on its age, loss characteristics, condition, and service history in determining whether to repair or replace the unit.

Oil refurbishment is planned for up to 100 distribution transformers per year.

Generally, it is necessary to refurbish a transformer's oil initially after a 25 year period then approximately every 10 years which, with EA Networks' in-service distribution transformer population, means oil refurbishment will be required on a number of units throughout the planning period. With an estimated life of 55 years, this means each transformer will have its oil refurbished at least 3 times in its life.

It is expected that in the future, because of the high quality requirements for the insulating oil in transformers now being purchased, the initial and following periods to oil refurbishment will be less than the aforementioned 25 and 10 years.



## Replacement

Very old transformers that require extensive refurbishment or transformers that have been extensively damaged due to say a lightning strike are often replaced rather than repaired. This is a purely economic decision.

All replacement units are purchased to EA Networks' specifications, which prescribe galvanised tanks, stainless steel fixings and oil sampling valves to minimise the cost of future maintenance.

The 22kV conversion programme ensures that a steady flow of used 11kV transformers return to stock. This is in addition to those units that have failed as a result of old age or lightning damage. The transformer technician individually assesses each transformer when returned to the store and estimates the likely cost of repair and subsequent life. A spreadsheet is then used to make an appropriate economic decision to scrap or repair the unit.

This economic decision-making process is a means of prudently managing the asset and ensuring that an appropriate age profile is maintained. The Assets information system records all available information about transformer condition and history. This data will be used in future plans as a maintenance cost projection technique.

## Enhancement

Occasionally, the need arises for a pad-mounted cable box style of transformer. The EA Networks distribution transformer specification allows for conversion of a pole-mounted unit 150kVA or larger to a pad-mountable arrangement. The cost of doing so is typically \$500-\$600. This capability is used regularly but this work is done on demand rather than as a planned activity. While this is being done, in-tank HV fuses will be retrofitted.

A standard seismically designed precast concrete foundation pad is now in use for all uncovered ground mounted distribution transformers. These pads allow very accurate location of holding-down bolts cast into the pad. All transformers larger than 100kVA that are cycled through the store for reuse are modified to accommodate the standard mounting template. This process ensures that all transformers will over time adopt a rigorously designed and standardised hold-down arrangement.

In some cases the rehousing of the core and windings of smaller (<100 kVA) pole-mounted transformers in good condition into new ground-mounted tanks is viable. This is only commercially feasible because of the recent increase in price of the materials that are used in the core and windings. The value of the New Zealand dollar also impacts the economy of this approach.

Other than this capability, little enhancement work is carried out on distribution transformers, as these are essentially a standard module, with no capacity for upgrading.

## Development

EA Networks provide most distribution transformer assets as part of the network line charging mechanism. Any new development of note will require a suitable transformer. The 22kV conversion projects have liberated a reasonable quantity of 11kV transformers which are used whenever possible. Failing this, a new unit will be purchased or a second-hand unit may be sourced from other network companies.

## Disposal

As a consequence of the 11kV to 22kV conversion that EA Networks regularly undertakes, a significant quantity of older 11kV transformers become surplus to requirements. Any transformer returned to stock has an evaluation completed to determine its remaining life and value. Any units that are considered saleable are offered to other electricity network companies at a cost that reflects the remaining life and maintenance costs required to return it to service. Any transformers that are unsaleable are disposed of as scrap after removal of insulating oil.

## 4.10 High Voltage Switchgear Assets

### Description

This class of equipment includes all of the following items regardless of location:

- Disconnectors (66, 33, 22 and 11kV)
- Gas (SF<sub>6</sub>) Switches (22kV and 11kV)
- Circuit-breakers (66, 33, 22 and 11kV, indoor and outdoor)
- Voltage Transformers (66, 33, 22 and 11kV, indoor and outdoor)
- Reclosers (33, 22 and 11kV)
- Sectionalisers (22 and 11kV)
- Ring Main Units (22kV and 11kV)
- Expulsion Drop-out fuses (33, 22 and 11kV)
- Structures and Buswork (66, 33, 22 and 11kV)

### Disconnectors

Units at all voltages other than 66kV are a rocking post design. Some units operating at 33kV and below



are fitted with load-break heads where load current exceeds the interrupting capacity of the bare disconnecter. The 66kV disconnecters are a double-break centre rotating design. Recent purchases of 66kV disconnecters have been sourced from off-shore. Several disconnecters were unsuccessfully fitted with remote operating mechanisms, which have now been removed. The rating of these disconnecters are all well in excess of the circuits they are installed on. Typical ratings are 630 and 800 amps. A number of older 33kV and 11kV disconnecters are still in use and they are more prone to failure than the modern designs. The decision has been made not to purchase any new 11kV or 22kV disconnecters for in-line use – buying gas switches instead. Disconnecters are still used to connect consumer's 11kV and 22kV cables to the network.

### Gas (SF<sub>6</sub>) Switches

A worthwhile addition to the EA Networks network are SF<sub>6</sub> load break switches designed for pole mounting. They offer very reliable operation when compared to a load-break disconnecter. The decision to purchase these devices was a balance between the additional cost and the significant benefits in distribution automation, operator safety, and lower future maintenance. The units that were purchased are 24kV 400 amp rated and have: stainless steel tanks, manual and motorised operation, internal current transformers (for measuring load or fault current), and can be converted to sectionaliser operation where required. The design of these units allows them to be used as isolation for working on lines, so no additional devices are required in series. To protect the unit and guarantee the insulation characteristics of an open switch, six surge arrestors are fitted to every gas switch (one per bushing). A photo of an installed gas switch is shown above.



### Circuit-Breakers and Reclosers

EA Networks have used a large range of circuit-breaker/recloser, indoor/outdoor equipment over the last fifty years, and this has caused difficulty in training personnel and maintenance. EA Networks have now attempted to limit the different makes/models of circuit-breaker in operation at the various system voltages. The philosophy taken is that two different makes of each category of equipment will be selected and on each occasion either make will be awarded a contract for equipment supply. This limits the variety of equipment to two, while ensuring a competitive contract price.

Still in use today are a range of bulk oil circuit-breakers and reclosers manufactured by AEI, and Reyrolle and other, mainly British, companies. These units remain suitable for areas with low device operation counts.

A recent addition to the ranks of circuit-breakers are what have traditionally been considered ring-main units. Some manufacturers have produced competitively priced ring main units that contain vacuum circuit-breakers instead of fuses. This has opened up a number of possibilities for additional fault isolation in both urban and rural settings. Many of the installed ring main unit circuit-breakers do not currently have protection enabled and are categorised as ring main unit switches. Once SCADA and auto-reclosing is resolved, the protection will be enabled on many and they will be recategorised as circuit-breakers.

### Voltage Transformers

Voltage transformers are not actually capable of switching anything. They are however closely associated to switchgear. 11kV and 22kV voltage transformers are fitted to most indoor circuit-breaker switchboards and are used to control and monitor voltage and calculate feeder power in modern protection relays. The gas switches purchased for 11kV and 22kV are also fitted with a 500VA 3% accuracy voltage transformer when remote control is required (the voltage transformer provides power to charge the batteries for the switch as well as providing an indication of the phase to phase voltage). 33kV and 66kV voltage transformers are mounted outdoor on stands and these are used to monitor voltage and provide a reference for directional and/or distance protection relays protecting subtransmission lines.

### Sectionalisers

EA Networks own two oil-filled sectionalisers that are located on lines that cannot justify a recloser but

require the ability to detect earth-faults (fuses cannot). The two units are in use to supply relatively short lengths of feeder across the Rangitata River and beyond Montalto into the foothills.

### Ring-Main Units

Three different models of ring-main unit (RMU) are owned and used by EA Networks. The vast majority are resin insulated 12kV Eaton Holec Magnefix units or 24kV Eaton Holec Xiria units. The majority of ground-mounted 11kV kiosk substations have a Magnefix unit installed. The other brand of unit is a single Felten & Guillaume 24kV unit. All brands of RMU have the option of either fuses, or more recently circuit-breakers, installed in certain models. It is now possible to purchase a reasonably priced vacuum circuit-breaker in a Magnefix unit and this option has been used in one location. During 2015-16 the last of the oil-filled RMUs (a Lucy unit) was removed from service and scrapped.

<b>HV Switchgear Summary by Type</b>					
<b>Type</b>	<b>66kV</b>	<b>33kV</b>	<b>22kV</b>	<b>11kV</b>	<b>Total Units</b>
<b>Disconnectors</b>	69	60	471	55	655
<b>Load Break Disconnectors</b>	-	-	95	3	98
<b>Circuit-Breakers or Reclosers</b>	56	21	87	82	246
<b>Voltage Transformers</b>	13	3	16	21	53
<b>Gas Switches</b>	-	-	95	-	95
<b>Sectionaliser</b>	-	-	-	2	2
<b>Drop-out Fuses</b>	-	1	4,720	2,319	7,040
<b>Pacific Glass Fuses</b>	-	-	-	47	47
<b>Ring Main Unit Circuit-Breakers</b>	-	-	204	1	205
<b>Ring Main Unit Switches</b>	-	-	175	714	889
<b>Total Units:</b>	138	85	5,863	3,244	9,330
<b>Resin/Air Ring Main Units</b>			116	280	396
<b>Oil Ring Main Units</b>				0	0

This table summarises the presently documented population of high voltage switchgear. There are quantities of switchgear that are in storage awaiting disposal or refurbishment. The stored switchgear is not counted in these totals.

### Expulsion Drop-out Fuses

The most common HV protective device in the distribution network is the expulsion drop-out (EDO) fuse. Manufactured by a large number of companies, most fuse-link carriers tend to be compatible with one another and the simplicity of operation, low price (for bases and replacement fuse-links) and relative reliability and safety make them very attractive. EA Networks have significant quantities of these type of fuses (33kV, 22kV and 11kV) as well as a rapidly diminishing number of "Pacific" glass tube fuses (11kV only) which are being replaced by EDO fuses as required.

EDO fuses are located at (or on the supply to) every pole-mounted transformer providing fault and heavy overload protection and at strategic locations on the distribution network (line fuses) to sectionalise faults.

Note that the drop-out fuse quantities are an estimate of transformer fuses plus an accurate inventory of system numbered devices. Fuses supplying transformers directly (on the same pole) are presumed to be one per transformer in this total. The quantities are the number of installations not the number of individual phase items.

### Structures and Buswork

At many locations where HV switchgear is located an outdoor busbar system is also present. These busbars and associated switchgear require support and interconnection. EA Networks have a range of structural supports and busbar types. These range from simple wooden poles on the roadside with flexible jumpers as the bus, to galvanised steel flange-mounting posts in zone substations, supporting post insulators and

75 mm diameter hollow aluminium buswork. Other supports are made of reinforced concrete or short wooden poles. The bus systems can also be made from tubular copper, stranded copper, stranded AAC or ACSR conductor. All of these methods are in use at EA Networks.

## Condition

### Circuit-Breakers

Ground-mounted outdoor and indoor circuit-breakers in use at EA Networks are all in reasonable condition.

Metal-clad switchgear deteriorates with age resulting in ageing of insulation materials, such as formation of voids and penetration of moisture. Visible compound leaks and audible corona discharge often accompany this.

Replacement is justified primarily on reliability/risk of failure grounds and consumer service operating limitations. There is potential for explosive failure, which occurs infrequently (historically, approximately one such failure every ten years – almost entirely caused by one particular model of older switchgear).

As personnel work in close proximity to the equipment, and a few of the older equipment are oil filled, there is an increased risk of personnel injury. Best practice appears to suggest that adopting designs such that new oil filled equipment is not installed indoors (or at all) and substantial walls are installed between old equipment and places where personnel are required to work for extended periods.

Modern SF<sub>6</sub>/vacuum replacement installations, with air or resin insulated bus chambers (rather than the old oil or compound insulated types) are virtually maintenance free. There is a high cost associated with maintenance of old oil filled and compound insulated equipment, which usually requires major service after faults.


The typical economic life of EA Networks' indoor 11kV metal-clad switchgear installations has been assessed to be 50 years based on past experience. At present, more than 60% of indoor circuit-breakers are less than 15 years old. As 66kV and 22kV conversion proceeds, the older indoor circuit-breakers will be progressively replaced with modern equivalent assets decreasing the average age even more.

The bulk-oil indoor 11kV SoHi units have had failures at other power companies. EA Networks has experienced two non-catastrophic failures in the past. A series of projects are in place to gradually remove the remaining SoHi units from service. By 2019 all SoHi units will be decommissioned.

The population of outdoor circuit-breakers has been largely trouble-free, with wildlife usually the principal cause of damage.

### Pole-Mounted Reclosers

The range of pole-mounted reclosers that EA Networks own covers three voltage levels (33kV, 22kV and 11kV) and several technologies (oil, SF<sub>6</sub> and vacuum). The only units to cause some problems are the 33kV models. These have flashed over on the bushings on many occasions (despite having surge arrestors mounted adjacent to the terminals) and two of these remain out of service as a result. The units remaining in service have had insulated tails fitted to cover the top skirt on the bushings and this appears to have reduced (but not completely eliminated the problem). It is likely that this type of circuit-breaker will be scrapped or sold after decommissioning at 33kV. The conversion of several zone substations from 33kV to 66kV has liberated a number of less troublesome 33kV circuit-breakers for redeployment in place of the damaged units. Ultimately, as 33kV equipment is decommissioned it may be redeployed at 22kV.

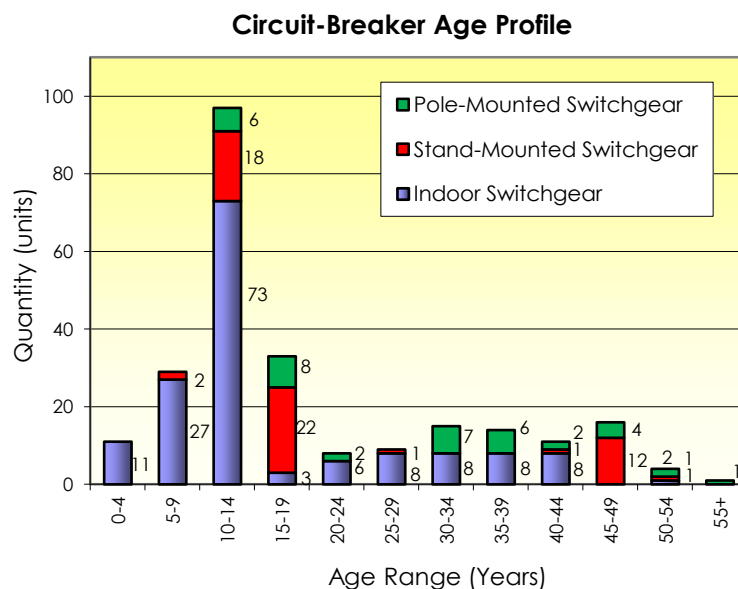

The more recent 22kV and 11kV reclosers have been largely trouble-free with no problems on the high-voltage side of the devices. A minor technical problem with the control circuitry was attended to by one particular manufacturer at no cost to EA Networks.

An older generation of oil-filled 11kV reclosers have had some problems in the wound primary CT chamber. These problems are now well known and largely eliminated. As necessary, these units will be upgraded with new units and either scrapped or shifted to uses which represent a lower risk to security, reliability and on-going maintenance. With rural 22kV conversion many older 11kV reclosers are becoming redundant.

### **Voltage Transformers**

The population of voltage transformers at EA Networks had historically proven to be trouble-free until about 2006. A particular make of 66kV voltage transformer failed on three occasions and based on the post-fault analysis it appeared that the manufacture of the units was at fault. An inspection of all of the suspect units occurred and all of them have been replaced. One set of the recovered units has been kept as emergency spares but will not be placed in service under normal circumstances. After assessment, some of the additional recovered units may be reused at a lower voltage (monitoring 22kV NER voltages - where they are not exposed to voltage unless an earth fault occurs).

### **Sectionalisers**

The two sectionalisers in service with EA Networks are relatively new (1992) and are expected to remain trouble-free for the duration of the planning period.

### **Disconnectors**

The disconnectors in use at all voltages have been reasonably reliable in the low-pollution environment of Mid-Canterbury. Some of the older disconnectors have had problems with failing insulators, but the occurrence of this type of failure has been infrequent enough not to require a special replacement programme. Remedial action will be taken on these affected units as they come to notice. There are a number of very old two insulator disconnectors that are in a state of decline but at this stage they have not proven to be particularly unreliable but are subject to operational restrictions on breaking load. As 22kV conversion proceeds any 11kV disconnectors (which includes all old units) are recovered.

The population of 22kV and 66kV units is very new and as such are in very good condition.

### **Expulsion Drop Out (EDO) Fuses**

The population of EDO's in the EA Networks network includes 33kV, 22kV and 11kV variants. The different makes of 11kV fuse bases and carriers have at times contributed to different reliability issues. A type manufactured locally for many years experienced some problems at EA Networks and other power companies. EA Networks have moved to alternative suppliers who manufacture to an international design standard.

The 33kV EDO fuses are used at Fairton zone substation for transformer protection. These units have on occasion failed in the insulator section. Repairs have overcome the problem and these can be classified as in serviceable order.

The 22kV EDO (24kV class) is the only voltage rating of EDO now purchased. The unit is in some cases the same as is offered for 11kV use. These have been trouble-free and are expected to remain so for the duration of the planning period.

The glass "Pacific" fuse is prone to failure when interrupting heavy faults or when it is exposed to salt spray. The spray covers the glass tube and when the element melts, tracking occurs down the outside of the glass tube gradually causing heating until either it fails catastrophically or disintegrates when an attempt is made to remove it.

### **Gas (SF<sub>6</sub>) Switches**

This type of switch was installed from 2003 to 2010. They are in very good condition. The ruggedness of the switch and mounting arrangement was shown during the 2006 snowstorm when one switch's bushings had to support the three wires of an entire span of snow laden conductor after the crossarm failed. The only damage to the switch was the bushing terminals were bent. No gas leaked and the unit has returned to service.

## Ring Main Units

Three different types of ring-main unit are in service. All types are in satisfactory condition and should remain so (with suitable servicing) for the duration of the planning period. A decision was made to replace the solitary remaining oil-insulated ring main unit with a modern resin or gas insulated item in 2015. This reduced the number of types of ring main units to three and increased operator familiarity and safety.

## Structures and Buswork

The structures and bus-work that form switchyards and switching locations come in many forms and represent different risks. The majority of 66kV and 33kV bus structures are very sound and in satisfactory condition.

The support structures put in place in recent times are all steel with a hot-dip galvanised coating. This will ensure that they remain in service for many decades with no major maintenance work required.

An unexpected issue has arisen with the 66kV buswork used at all of the 66kV sites. Aeolian vibration is occurring on the longer unsupported spans of 75mm diameter tubular aluminium buswork. A vibration logger has been installed and it determined that the installation of some suitably large ACSR conductor inside the tube effectively damped the motion. It is planned to install this ACSR solution to all affected spans as outage windows permit.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of HV switchgear is still being developed. Purchasing specifications are fully documented and all new HV switchgear is audited for compliance.

## Maintenance

### Inspections, Servicing and Testing

#### Circuit-Breakers

Circuit-breakers are subjected to minor and/or major maintenance routines in accordance with the requirements of the manufacturer's maintenance standards. Fault maintenance is also carried out on oil or SF<sub>6</sub> circuit-breakers when a unit has completed a specified number of fault trippings.

Modern vacuum circuit-breakers are subjected to minor services and condition monitoring tests only at 4-5 yearly intervals. Invasive major servicing/adjustment is not scheduled and would be carried out only if required and indicated by condition monitoring tests.

As with power transformers, there are two levels of servicing:

- minor servicing, involving external servicing (non-invasive)
- major servicing, which involves invasive servicing

The frequency and scope of servicing is defined uniquely for each type, make and model of circuit-breaker, and costs per breaker vary significantly. Typically, minor servicing is carried out as recommended by the manufacturer at a relatively low cost per service. While major servicing, is typically undertaken every 2 to 10 years at a more significant cost per service. There are breaker types that lie outside of these ranges both for frequency of service and service cost.

The tests performed as part of zone substation inspection and testing cover indoor switchgear.

#### Other

Disconnectors, ring-main units, sectionalisers and drop-out fuses are operated sufficiently regularly to identify any servicing requirements. Generally, this is limited to lubrication and cleaning.

### Fault Repairs

#### Circuit-Breakers

Fault repairs to switchgear take place as required, but as the population of older bulk-oil reclosers diminishes in line with the replacement programme and enhancement and development projects, the

occurrence of these faults has greatly diminished.

Failures in indoor switchgear are also relatively rare, and with the replacement programme of units prone to failure, it is expected that the fault rate will continue to decrease over the next five years. There have been no failures during the intervening period since the last plan.

### **Disconnectors**

Disconnectors normally fail due to deterioration of the operating arms with corrosion or from an arc developing across two or more phases. By identifying under-rated disconnectors and replacing these with gas switches, the incidence of arcing faults should be reduced. Where the disconnector is required to interrupt load a gas switch will replace it.

### **Expulsion Drop-out Fuses and "Pacific" Glass Fuses**

"Pacific" glass fuses are subject to pollution contamination in coastal areas and fragility when operating. Any fault in these fuses will result in replacement with modern EDO fuses. They are also replaced when any planned work takes place in the vicinity.

### **Resin Ring-Main Units (RMU)**

Only one problem has occurred with some RMU's that resulted in a component failing in a safe manner. The manufacturer has provided replacement units at no cost to EA Networks.

## Planned Repairs and Refurbishment

Planned repair work in respect to circuit-breakers relates to additional corrective work and refurbishment identified during routine services, inspections and tests, or following failures. Refurbishment work planned includes overhaul of decommissioned circuit-breakers prior to placing in stores.

## Replacement

EA Networks has determined its replacement programme for high voltage switchgear based on the following criteria:

### *Safety*

Where equipment presents a higher than normal risk to personnel during operating or maintaining the equipment e.g.

- generic types of aged bulk oil circuit-breakers with history of failures
- circuit-breakers requiring local hand closing

### *Technical Suitability*

This applies to equipment that is no longer suitable for its service application e.g.

- disconnectors and circuit-breakers unreliable or inconsistent in performing their functions due to excessively worn mechanisms
- equipment which fails to meet EA Networks' seismic requirements
- electrically under-rated equipment
- where the existing circuit-breaker is not able to be remotely controlled
- where there is a need to obtain more metering information.

### *Economics*

This is where replacement is justified purely for economic reasons, e.g.

- equipment is excessively expensive to maintain or repair
- high cost of spares or where spares can no longer be purchased
- maintenance intensive equipment installed at a sensitive supply location

## Circuit-Breakers

In line with the practice of overseas utilities as reported by CIGRE, EA Networks has a policy, subject to project-specific economic analysis, of replacement rather than life extension of aged deficient bulk oil and minimum oil circuit-breakers by major refurbishment.

Circuit-breakers are also replaced for the following reasons

- where they have high maintenance costs
- where they are unreliable due to an increased defect rate
- where a system node requires a maintenance-free circuit-breaker i.e. maintenance outages cannot be tolerated.

It is internationally recognised that forty years is generally the "time expired" life of oil circuit-breakers. Some types have an economic life greater or less than this figure. Bulk oil breakers generally have a longer life, while minimum oil breakers typically last only 30-35 years.

While age is not itself a criterion for replacement, analysis based on likely total economic lives for each type, make and model of circuit-breaker provides a means of assessing likely future replacement requirements. The replacements themselves would be determined by safety, economics and reliability assessments at the time.

Following a number of incidents involving a particular make and model of indoor bulk-oil circuit-breaker, a decision has been made to schedule the progressive replacement of all such units within the EA Networks network.

## Voltage Transformers

A thorough inspection of 66kV voltage transformers confirmed that a particular make/model was substandard and needed replacement as a result of poor quality control during manufacture. All of the potentially faulty units have now been replaced. EA Networks are not currently aware of any other issues with voltage transformers.

## Ring Main Units

The last oil-filled ring-main unit in service on the urban 11kV network was replaced during 2015-16. This reduced the types of ring main unit in use to three and eliminates some equipment that is aged and represented an operating limitation based on field experience.

## Other

None of the other high voltage switchgear identified in this plan meets the criteria for replacement within the planning period.

Disconnectors are scheduled for replacement when they develop a history of unreliability or failures, when their maintenance costs become unacceptably high, or when they are identified as being electrically under-rated. Should a disconnector require replacement, current policy would see it replaced with a gas switch.

Aged instrument transformers are only replaced when they fail, or when they are about to fail as diagnosed by testing. They are then replaced with a similar unit, usually a spare. Other replacements occur during site development works and depending on whether the condition and ratings etc. of the transformer are suitable for use at another site, they may be scrapped.

## Enhancement

See [sections 5.4.3, 5.4.4, 5.4.5](#) and [5.4.6](#) for details.

## Development

A significant increase in high voltage switchgear is purchased during the planning period. This is predominantly circuit-breakers and disconnectors associated with the 66kV subtransmission developments but includes items at 11kV and 22kV. See [section 5.4](#) - Network Development for details.

## 4.11 Low Voltage Switchgear Assets

### Description

Housed in various enclosures are a range of LV switchgear, which perform various protective and operational functions. The simplest item in this category is a fuse connecting a consumer to the LV network from a pole or pillar box. Most pole-mounted substations will have a single set of fuses on the LV side to protect the connected cable or conductor from fault. These have traditionally been porcelain bases with HRC fuses. Extensive use has now been made of underhung DIN style fuse-disconnectors where loads have approached the rating of the porcelain equivalent.

The most extensive use of LV switchgear is in kiosk distribution substations and roadside link/distribution boxes. DIN fuse disconnectors of various sizes ranging from 100 amps to 1,200 amp ratings form the LV switchboard in these applications. Two standard types are used, a full size DIN unit for substations and a proprietary compact unit for roadside boxes.

A full inventory of all LV switchgear types, locations and quantities is gradually being gathered. Once complete, additional quantitative details will be given in the plan. An estimate of these quantities is as shown in the table at right. Additional locations and types will be detailed once the data is available.

<b>LV Switchgear by Type &amp; Location</b>	
<b>Switchgear Location &amp; Type</b>	<b>Number 3ph</b>
Link Box (JW3 Porcelain Fuse)	434
Link Box (DIN Fuse Switch)	1,104
Distribution Substation (JW3)	199
Distribution Substation (DIN)	1,459
<b>Total 3ph (Estimated)</b>	<b>3,196</b>

### Condition

Low voltage switchgear is dispersed widely across the area EA Networks service. The vast majority of these devices are in good order. Some link boxes and distribution substation switchboards use a particular type of fuse base and porcelain carrier (JW3) that is prone to overheating when approaching its rated current. Under normal loading conditions they are very reliable. The condition of heavily loaded JW3 installations will be monitored closely for deterioration. The JW3 also has exposed live terminals on it and is definitely not touch-safe in the open or closed position.

The modern DIN switchgear used in most distribution substation switchboards since 1988 is very reliable and no electrical failures have been recorded. Several failures of link box LV DIN fuse units have been recorded. After researching the issue, it was noted that the loads had exceeded the unit rating and the derating of multiple adjacent units in a small enclosure had not been considered. More monitoring is taking place. These devices can be described as in very good condition.

### Standards

Documentation of the standards presently used for testing, inspection and maintenance of LV switchgear is still being developed. Purchasing specifications are fully documented and all new LV switchgear is audited for compliance.

### Maintenance

#### Inspections, Servicing and Testing

This asset requires only low-level inspection and servicing. The sites where these items are located tend to be visited for operational reasons and this is when the very infrequent problems are found. An infra-red non-contact thermometer is routinely used to check for thermal issues.

#### Fault Repairs

There is a minimal amount of fault repair work required on this asset class. Fault repair generally falls into the replacement category.



## Planned Repairs and Refurbishment

These assets tend not to be repairable as such. The value and construction of the items generally involves complete replacement of the asset.

## Replacement

Some of the larger distribution substations (500kVA and larger) have a type of low voltage fuse (JW3) that is known to cause problems as it approaches its maximum rating. These are being progressively replaced with DIN type switchboards at the rate of two per year. The safety of the JW3 switchboards is also suspect and this provides additional justification for replacement. The cost of this is part of the general scheduled underground work.

## Enhancement

There is no practical means to enhance this class of asset.

## Development

The majority of LV switchboard development is in conjunction with the underground conversion programme and any new urban subdivision that occurs.

## 4.12 Protection System Assets

### Description

#### Electrical Fault Protection

Electrical Fault protection is one area that has made rapid technological advances in recent years. Historically, electromechanical devices were required to respond to various electrical inputs and then trip a circuit-breaker. This is how the name "relay" evolved. Modern protection is closer to a personal computer than a click/clack relay. The steps between these two extremes were solid state electronic relays, then "intelligent" relays that used the analogue solid state information, and we are now at the point where we have "numeric" relays which calculate all the necessary parameters from raw current and voltage inputs.

EA Networks have some of each of these technologies. In some applications, the earliest technology still does a reasonable job. The major benefits of numeric protection devices are the flexibility to alter the logic of the device as well as being able to "talk" to it using a SCADA system or a local computer. Once you are connected to it you can extract any information that it has. This information is almost limitless. The numeric relay replaces chart recorders, stand-alone panel meters, SCADA transducers, SCADA RTUs and switches. All of these are built into the one box.

Zone substations tend to have a proliferation of protection devices and this is where the majority are located. Reclosers have the protection built into the supplied equipment and these are also becoming increasingly sophisticated. The modern pole-mounted recloser controller can measure current,

Numeric Protection Relays by Model	
Relay Model	Quantity
Schweitzer 2440 Numeric RTAC	2
Schweitzer 311C Numeric – Mk0	13
Schweitzer 311C Numeric – Mk1	18
Schweitzer 311L Numeric	2
Schweitzer 351-6 Numeric	4
Schweitzer 351S Numeric	2
Schweitzer 387L Numeric	30
Schweitzer 551C Numeric	1
Schweitzer 587Z Numeric	14
ABB RACID	8
GE Multilin SR745 Numeric	1
GE Multilin URF35 Numeric - H/W rev 3	9
GE Multilin URF35 Numeric - H/W rev 5	11
GE Multilin URF35 Numeric - H/W rev 7	1
GE Multilin URT60 Numeric - H/W rev 3	6
GE Multilin URT60 Numeric - H/W rev 5	9
GE Multilin URT60 Numeric - H/W rev 7	3
<b>Total</b>	<b>134</b>

voltage, power, direction of power flow and many other useful parameters. EA Networks have approximately 134 numeric relays in service in zone substations at the time of writing.

This number will climb further over the next few years as the 66kV network replaces the 33kV network. A full inventory of protection equipment age and condition is still being prepared and will be available in a future plan.

### Overvoltage Protection

The area in which EA Networks operate is not particularly prone to lightning which is a blessing for the asset manager. Lightning causes very large voltages on the lines and cables of the electrical network and these tend to "flash-over" to earth at the weakest point. In many cases this point is the earthed tank of a transformer or circuit-breaker. Once a flash-over has occurred, significant damage can be done to the bushings, insulation and contacts in the device.

Nothing can truly protect a device from a direct strike by lightning, the energy involved is too great to contain. There is equipment that can protect a device from indirect strikes or switching surges. These are called surge arrestors.

EA Networks apply distribution class

surge arrestors to any equipment deemed sufficiently at risk or critical to network security. This has generally involved line-mounted circuit-breakers and sectionalisers, zone substation transformers and any cable termination.

Accurate quantities of surge arrestors will be obtained for inclusion in future Asset Management Plans.

EA Networks have an additional consideration when applying surge arrestors. The 66kV network, 33kV network and the 22kV network are all earthed using neutral earthing resistors. During a single-phase to earth fault the "healthy" phases can rise to a voltage 70 % higher than the normal phase to earth voltage. Surge arrestors must be selected taking this into account.

## Condition

### Electrical Fault Protection

The electrical fault protection system (protection system) is designed and manufactured to be inherently reliable and low maintenance. This is certainly true of the modern numeric relays that, through self-monitoring, are very low maintenance. The in-built monitoring of these units can detect when a problem has occurred and alert the relevant control system to create an alarm.

The electromechanical relays in the network are beginning to show their age in some cases. These devices are much like a mechanical clock and require reasonable attention for optimum performance. Even some solid state relays are now failing as electronic components age. Solid state relays are not usually repaired when they fail, they are replaced with complete spare units or a modern numeric device.

The age of some of the early numeric relays is now being watched closely. Component availability as well as economic viability may mean that the repair or refurbishment of aged (>15 years) numeric relays is doubtful. The features and price of numeric relays continue to improve and it is unlikely a numeric relay will be repaired. A replacement would be purchased and the faulty unit kept for spares or scrapped.

The tests that have been performed on a regular basis reveal any relays in poor condition and they are promptly repaired or replaced. As such, the condition of the modern solid-state relays can generally be reported as good and the electromechanical units are ageing but still serviceable.

The register of devices is incomplete and represents only the protection relays located at zone substations. There are a range of other protection relays associated with reclosers and ring main units that will have additional data captured about them over time.

### Surge Arrestor by Operating Voltage

Arrestor Operating Voltage	Number 3ph
66kV	51
33kV	15
22kV	892
11kV	434
<b>Total 3ph Sets</b>	<b>1,392</b>

## Over-voltage Protection

The surge arrestor population on the EA Networks network is limited to critical items of plant and cable terminations. The rate of surge arrestor failure is relatively low and adequately testing these items in or out of service is difficult. The anecdotal evidence would suggest that the population is still in reasonable condition and should remain so for the duration of the planning period.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of protection equipment is still being developed. Purchasing specifications are fully documented and all new protection equipment is audited for compliance.

## Maintenance

Although referring to two distinct classes of asset, fault protection and over-voltage protection, this section makes no further reference to overvoltage protection, as the devices in question are low maintenance, low cost and generally very reliable. Additionally, there is little data to provide meaningful analysis of asset condition.

### Inspections, Servicing and Testing

The policy in this area is to maintain protection schemes with alternate major and minor services every 4-8 years, on each protection device depending on the type of protection (numeric/electronic/mechanical). Electromechanical types are tested more frequently while numeric types are tested less frequently.

It should be noted that "maintenance" on protection equipment is essentially "recalibration and testing" rather than the conventional view of maintenance, which would imply replacement of consumable parts. Protection maintenance is mainly required to re-affirm that the protection is calibrated within tolerance and will operate when called upon to do so. Some of this maintenance is as simple as checking relay logs to ensure it has operated correctly on a fault condition in recent times.

There are international trends towards reduced maintenance. Typically intervals are being increased to between 5 and 10 years in other utilities comparable to EA Networks, in particular where microprocessor (numerical) protection systems are used. These protections have in-built self-testing and monitoring routines which reduce the necessity for manually driven maintenance testing. Once the input linearity/accuracy of the device has been proven (this can be done with load current and line voltage), a simple timing test should establish that the internal processes are working correctly. Other sources of information to prove the status of the equipment include event records which show both operation and pick-up on faults, along with the associated currents, voltages and times.

An advanced relay test set has been purchased to facilitate maintenance testing. This will be used for commissioning of new protection (developments and enhancements) as well as maintenance.

### Fault Repairs

Fault repairs on protection are not generally carried out. Thorough examination of the entire scheme is generally done and a complete service of the scheme advanced from the next planned service.

### Planned Repairs and Refurbishment

The expenditure planned over the review period is mainly in the following areas

- replacement of aged lead acid batteries
- seismic strengthening of protection panels
- seismic restraints for batteries

## Replacement

Many protection relays will be replaced during the planning period. This is likely to be in conjunction with larger zone substation and subtransmission developments and could be considered in the enhancement category due to the extra functionality that they provide - making some other assets redundant.

A number of 11kV or 22kV switchboard replacements will occur within the plan horizon and this will also see replacement feeder protection installed in most cases.

## Enhancement

Additional load could require enhanced protection assets in some locations, however it is not anticipated that this is likely.

In conjunction with the SCADA expansion programme it is possible that some protection equipment may be replaced as the most cost-effective way to integrate remote control and data collection into the sites. Other reasons for replacing older equipment would be lack of protective features or reliability of operation.

## Development

It is obvious that there are significant development projects for the protection system during the planning period. The majority of these projects involve the installation of replacement or additional relays in zone substations protecting 66kV lines, 66kV transformers or distribution feeders ([Section 5.4.2](#) and [Appendix B – Projects and Programmes](#) identifies the location and extent of expenditure).

## 4.13 Earthing System Assets

### Description

Earthing systems form an important part of the electricity network. Under normal circumstances no electricity should flow from a circuit into earth. This allows protective devices to sense when a fault has occurred, such as a tree touching a line or a person touching a toaster that has become live. In order to provide this protection, the connection to earth of the electrical supply system must be adequate to allow a certain minimum amount of current to flow. For a high voltage network this value is generally 20 amps or more. This corresponds to a value of earth resistance of no greater than 100 ohms (for 11kV) once all of the equipment in the fault loop has been accounted for and a safety margin added.

Distribution Earth Count by Location	
Location	Quantity
Distribution Substation	6,586
Disconnecter	834
Recloser/Sectionaliser	34
Surge Arrestor	707
<b>Total</b>	<b>8,161</b>

All equipment that has conductive components that can be touched must be earthed in a safe manner. Any neutral connection must be earthed at the source. This means that all distribution substations need a substantial earth, as do surge arrestors (necessary for correct operation), disconnecter handles, recloser operating boxes, cable terminations and any other item designed to be "screened" or "bonded" to earth.

Much larger earth mats are installed at zone substations and these must take into account voltages that develop on the ground and on equipment within the substation. Additional buried conductors can control these voltages to a safe level and all zone substations have been reviewed to ensure safe conditions exist.

At zone substations with 22kV supply busbars, a device called a neutral earthing resistor (NER) has been installed in the neutral connection of the supply transformer(s). An NER restricts the amount of current that can flow into any type of earth fault. This makes for a safer system, but it can make it more difficult to detect very high resistance faults such as trees brushing the line.

In the future, it is likely that earthing installations will be identified individually within the GIS and Assets information system and the items of plant using that earth will then be associated with it. This will enable an accurate inventory of earths to be kept (all earths are known and measured but several devices may share the same earthing system and not all of these can be associated with it in the GIS or Assets databases).

The total number of earths in the EA Networks network is currently obtained by adding together the quantity of equipment known to have earthing systems (excluding zone substations).

## Condition

The 2010 Electricity (Safety) Regulations state that all works must have earthing systems that are:

*designed, installed, operated, and*

*maintained to ensure, as far as practicable,—*

*(a) the effective operation of protection fittings in the event of earth fault currents; and*

*(b) that the voltage of each conductor is restricted to a value consistent with the level of insulation applied; and*

*(c) that step voltages, touch voltages, and transferred voltages are controlled to prevent danger to any person.*

If an earthing system complies with Electrical Code of Practice (ECP) 35 it is deemed as compliant with this clause of the regulations. In EA Networks' situation, because of the very high soil resistivity that is often encountered, a risk based process must be employed to establish a practical means to comply with the Regulation. The EEA Guide to Power Systems Earthing (August 2009) provides guidance and advice on safe earthing practices for high voltage a.c. power systems adequate to meet the requirements of electricity safety legislation. EA Networks are using this document as a benchmark for compliance.

The Regulations do require that earthing systems be tested *regularly*, and EA Networks has been addressing this issue in earnest. To meet the requirements, a programme of continuous earth testing is underway and will continue to progressively test the total substation population at no more than ten-yearly intervals. Any distribution substation, disconnector or surge arrester that is altered, has its earthing retested and improved if it is substandard.

Based on experience, it is expected that during the testing phase, a number of substandard earthing installations will be identified that are capable of being practically upgraded. A programme of upgrading these earth systems using driven rods and extra copper conductor will follow on directly from the earth testing exercise. The single most important criterion for earth improvement will be - that the resistance of the earth system at any site must provide an earth path of low enough resistance to ensure the HV feeder circuit-breaker operates under all circumstances if a single phase to earth fault occurs at that site. The exercise of earth improvement is not trivial and it is probable that over time significant resources will be required to attend to this problem.

Large earthing systems such as that found in zone substations are regularly measured to ensure on-going integrity of the conductors and rods. None of the zone substation sites have shown a level of deterioration that requires attention.

Urban distribution substations have the multiple-earthed neutral as a continuous metallic connection from the zone substation out to the earthing point. The result is that urban earthing is never a problem in terms of the value of resistance achieved. Because the earth resistance is low the currents that flow are much higher and connectors must be checked for integrity whenever the earth is inspected/measured.

EA Networks has an electrical earthing installation at every substation, disconnector, recloser, sectionaliser, and surge arrester connected to its network. All of these earths are required to serve a specific purpose related to personnel and/or equipment safety. The ability of an earth to achieve an acceptably low resistance (to a truly remote earth) is dependent on two major parameters. The first and most important is the earth resistivity<sup>2</sup> of the soil, stones and rocks into which the earth installation must be placed. The second parameter is the physical extent of the installation itself. EA Networks operate in an area where earth resistivity varies considerably. The best locations achieve an average of 300 ohm-metres, which is considered poor in many other regions. The worst locations are almost ten times this at an average of 2,800 ohm-metres. Achieving a desirable low earth resistance value (such as 10 ohms) in these conditions is next to impossible. EA Networks have adopted a pragmatic approach to the problem and concluded that the primary criterion for each installation's earth resistance is that should the phase wire of any high voltage line come into contact with metalwork connected to that installation, the operation of a high voltage circuit-breaker must occur. Another Canterbury lines company with a similar range of earthing conditions established this principle. The impedance of the earth fault loop has a safety factor of two. The guidelines that have been established and compliance with the Regulations will be used as the criteria to improve the

<sup>2</sup> The resistivity of a material is the ease which current flows through the material when a voltage is applied to it.

performance of the EA Networks earthing system.

EA Networks are watching the implementation and user experience of resonant earthing systems in other networks. A resonant earthing system reduces earth fault currents to very low values making step and touch hazards much lower. It could be that resonant earthing systems are an option for the future.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of earthing systems is in place. Construction standards are fully documented and all new earthing systems are audited for compliance.

## Maintenance

### Inspections, Servicing and Testing

Regular earth testing is performed on all of the earth installations in the EA Networks network. The typical return period for any one site is 10 years. In conjunction with normal line inspections, the above-ground portion of the earthing system is inspected every 5 years. All of the data gathered is saved in the "Assets" database system.

### Fault Repairs

A faulty earth typically requires either complete replacement or significant enhancement.

### Planned Repairs and Refurbishment

Whenever a substation is altered in any way (this includes a transformer change) the earth installation is retested. If these tests do not meet the established guidelines the site is given priority for earth improvement. A description of the earth improvement programme is shown in the enhancement category.

### Earth Testing and Restoration

As a result of regular testing, where existing earths on substations and switchgear have deteriorated to the point of non-compliance, these are restored to EA Networks' current standard.

## Replacement

There are no proposals to replace any earth installation during the planning period.

## Enhancement

Based on data held in the Assets system a statistical assessment has been made of the number of earth installations requiring improvement. This is approximately 350 earths, which represents 4.5% of the total earth population. It has been determined (both theoretically and practically) that the only reliable technique to establish a lower earth resistance is to deep drive rods in to the ground. Extending the earth horizontally simply extends the hazardous area without necessarily lowering the resistance appreciably. Surge arrestor earth installations will be installed to the same guidelines as distribution transformer earths. Disconnectors may be solved in a different manner. The only reason a disconnector must be earthed is the continuous metallic path between the disconnector assembly proper and the operating handle. If the operating handle is electrically isolated from the disconnector the need to provide a substantial earth is removed. It is proposed to use a 1 metre fibreglass section in the pipework to isolate the handle from the switch and then bond the handle to an earthed conductive operating pad (which is EA Networks' standard practice). This ensures that regardless of the condition of the disconnector, the operators do not have any voltage difference between hands and feet.

To achieve the goal of improving the earthing system to an acceptable level of performance will take a long-term effort. The time scale will determine the annual cost to EA Networks. The earthing improvement programme is currently targeting the highest 10% of non-complying earths per annum. This equates to about 50 earths each year.

## Development

Whenever a new substation is constructed, an earth is also installed. These earths must meet the established guidelines of tripping a high voltage circuit-breaker for a single-phase fault. An annual allowance has been made for the duration of the planning period to provide for the number of new earths that have been installed in recent years. Several zone substation projects incorporate significant earthing systems, but this development is incorporated in the overall zone substation project cost.

### 4.14 SCADA, Communications and Control Assets

This includes all communications equipment and radio repeater sites as well as vehicle-mounted equipment and the Supervisory Control and Data Acquisition plant including the Master Station in the Control Room and any equipment installed at remote sites for the purposes of remote control.

#### Description

EA Networks have a SCADA system in operation that covers all of the modern zone substations.

##### **Master Station:**

A system supplied by QTech Data Systems has been progressively implemented and upgraded since 1993.

The system comprises the following equipment:

- SCADA Master station incorporating a Human Machine Interface (HMI)
- Power Management Controller.
- Data storage systems
- Alarming and alerting (SMS and email systems)
- Communication systems using both fibre optic cables and radio
- Substation servers

A detailed description of the SCADA system will not be given, as such information could be beneficial to someone with a malicious intent. Suffice to say that the necessary information and control will be available to those personnel that require it.

SCADA systems enable fast responses to situations as they arise. The information and control that SCADA provides can shorten restoration times considerably. The historical data that accumulates is also of value to the asset manager as substation asset utilisation is readily apparent. Dynamic rating capabilities can be evaluated at some sites as temperatures are transduced on some zone substation power transformers.

##### **Remote Stations**

The concept of an RTU at EA Networks' modern zone substations is largely redundant in that the modern protection relay has sufficient inputs and outputs to control and monitor substation functions and can transduce, calculate and record virtually any electrical parameter.

The functionality of the protection devices connected to the transformers and feeders is such that they handle virtually all of the I/O and transducing. An industry standard protocol is used to communicate with the protection devices.

At sites requiring SCADA that do not have advanced numeric protection relays, a small conventional RTU is installed to provide the necessary control and data gathering.

##### **Communications System**

The EA Networks communications network consists of a mix of a number of technologies of various ages and age profiles. This equipment provides bearers for operational speech, operational SCADA and load management information. It also permits engineering access to a range of devices allowing remote detailed interrogation.

Primarily driven by the need for fast acting differential protection on its subtransmission systems, EA Networks has developed an extensive fibre optic network that now links all but three of its zone substations. Of the remaining three one is a temporary substation, one is shortly to be completely rebuilt (and is currently serviced by a radio link) and the third is economically challenging. All fibre links are duplicated with very few common paths. Even the primary radio repeater site is serviced by fibre with a microwave backup.

Built on top of the fibre network is a fully routed layer three IP network providing logical redundancy to all connected zone substations. Currently, speeds of 1Gbps are provided. This can be raised to 10Gbps using the existing switching infrastructure. The availability of reliable high bandwidth communication paths has enabled new features such as VoIP phones and video surveillance to be delivered to connected zone substations. Because EA Networks also provides a public fibre based broadband network, we are able to use this where it passes remote controllable devices to have secure, reliable communication to those devices.



As the control centre has moved off site from the Ashburton substation, for real time control applications the new corporate office is connected to the communications hub by redundant 10Gbps links. In due course, one of these links will be routed via a backup control and disaster recovery centre in Methven.

The fibre optic network is a separate business function and as such the asset management of that network is not part of this plan. Only fibre optic cables fully contained within a zone substation site and dedicated to power system functions will be considered in this plan.

The DMR radio system has the benefit of being 100% digital. Consequently, the system can transport non-voice data transparently. This has been used to supplement the SCADA system by utilising a small DMR data unit as a remote control 'mini RTU'. These devices will be used where it is difficult to obtain access to the fibre network.

### **Mobile Speech Network**

The mobile speech network is a digital repeater system used exclusively by the Network and Contracting divisions of EA Networks.

EA Networks had considered moving to a P25 digital mobile radio system from the analogue system previously used. Just as deployment of that network had commenced, developments in the DMR digital radio system caused EA Networks to rethink that decision. As a result, EA Networks entered into a beta trial program with a commercial manufacturer of tier 3 DMR systems. Having completed that trial and subsequent evaluation, a DMR network using 5 repeaters has been fully rolled-out across the EA Networks fleet.

The DMR radio system is supplemented by a VoIP phone installed in every connected substation and communications facility.

At many modern zone substations a 19 metre concrete communications tower has been installed and this serves as the platform for all radio communications needs to and from the site.

## **Condition**

### **SCADA**

The SCADA system presently being implemented is comprehensive at the sites it covers. Backup systems are already in place for data and power supply. Maintenance of the SCADA system should be limited to occasional hardware repairs (for which spares are readily available) and software upgrading of the protection relays, SCADA application or other operating system revisions.

### **Communications**

EA Networks has now successfully rolled out a digital DMR system. This system provides GPS location of all



vehicles and handheld radios and in the future will potentially have a degree of in-field data coverage.

As mentioned previously, the trunked DMR system can also provide remote control and indication of pole top and other remote devices.

The building housing the communications facilities at Gawler Downs has been replaced in 2009 and in 2012 communication facilities were constructed to house both the SCADA IP based systems and the public broadband system.

The analogue UHF network had equipment dating back to the mid-1980s and has been withdrawn from service with the exception of the backup Microwave link to the Gawler Downs hill-top repeater site.

The condition of other communications assets is adequate for the required level of performance.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of SCADA, communication and control systems is still being developed. Construction standards are fully documented and all new SCADA, communication and control equipment is audited for compliance.

## Maintenance

### Inspections, Servicing and Testing

#### SCADA

The integrity of the main hardware and software system at the control room is of the highest importance to the on-going management and safety of the electricity network. EA Networks' Network Division staff manage the computer system and maintain the operational state of the software and hardware systems. Full 24hr monitoring of SCADA equipment is provided by automated systems. This is a 24-hour per day task with staff on call if required to ensure high availability of equipment. The main SCADA computer hardware is non-proprietary and suitable spares are readily available, as are entire workstations should the need arise. The base station operates in hot-standby mode and failure of the main server causes the back-up one to take control.

The Network Division maintains most equipment external to the master station and sufficient spares are held to guarantee prompt response and repair times.

#### Communications

The intra-substation fibre optic cables that EA Networks own are brand new and in excellent order. Automated monitoring equipment monitors all communication links and supporting hardware such as UPS's 24 hours a day.

The inter-substation fibre optic cables that EA Networks own (in a separate business unit) are brand new and in excellent order. Automated monitoring equipment monitors all communication links and supporting hardware such as UPS's 24 hours a day.

### Fault Repairs

In recent times, contract maintenance technicians have had to respond to relatively few SCADA or communications faults in any particular year.

### Planned Repairs and Refurbishment

#### SCADA

It is not planned to repair or refurbish any of the SCADA plant. To date the QTech system has not required any significant repairs.

#### Communications

A replacement and augmentation project for our fixed communications bearers is nearing completion. The only remaining issue is communication into the valleys in the foothills of the Southern Alps.

## Replacement

### SCADA

As with all computer-based systems, it is expected that some upgrading of the operating system, software-applications and possibly hardware will be required throughout the planning period.

### Communications

It is not planned to replace any communications equipment during the planning period.

## Enhancement

### SCADA

With the advent of industry-wide performance monitoring, EA Networks is benchmarked against other Electricity Companies in terms of system reliability and continuity of supply. Furthermore, consumers are becoming more aware of fault outages, this being partly due to the increase in the number of electronic home appliances and the resulting reliance on a continual supply of electricity. For these reasons, it is becoming increasingly important to cut down on fault restoration times.

One way to do this is by automating remote switches. This greatly reduces the travelling time required for a faultman during sectionalising of faulted line sections. It also means that fewer staff are required to isolate the fault, reducing the overall cost of fault restoration.

It is proposed that critical main line switches continue to be automated at the rate of five to ten per annum. This process will be in conjunction with the use of gas switches and rural ring main units which are purchased ready for remote control. Good progress is being made with this programme.

### Communications

None of the communications equipment identified in this plan will require enhancement during the planning period.

## Development

See [section 5.4.10](#) – Network Development.

## 4.15 Ripple Injection Plant Assets

### Description

EA Networks own three 33kV ripple injection plants with one each at Ashburton 33/11kV Substation (ASH), Transpower Ashburton Substation (ASB), and Methven33 (MVN) Substation. All plants are solid state and manufactured by Landis & Gyr Ltd (formerly Zellweger Ltd), and use the Decabit code system. The plant at the Ashburton 33/11kV substation is used as the primary 33kV injection plant. The plant at ASB is used to inject ripple onto the 66kV network via a 33/66kV autotransformer. The ASB plant and the ASH plant are centrally controlled from the QTech power management system. The Methven plant is a standby unit for use if the ASB plant fails and it can cover a significant portion of the northern 66kV network.

### Condition

EA Networks sold all of its ripple relays to the incumbent retailer (Trustpower) on 31 March 1999 along with exclusive use of channels in use at that time. The ripple injection plants were retained for the purpose of load control as well as providing a load switching service to retailers under contract.

All ripple injection plant components appear to be in acceptable order, but at up to 26 years old they have the potential for age-related issues. There have been two injector failures (ASH plant and ASB plant). The ASH failure was resolved with the supplier and a modern replacement injector unit was installed at ASH. The ASB failure was solved by purchasing the 'spare' injector held by Landis & Gyr. Both the ASH and ASB plants are now a hybrid of a new high capacity injection component and older low capacity high voltage coupling components.

Because of the solid-state construction of the injection plants, faults are unlikely to be a frequent occurrence. If they do occur, the consequences can be considerable extra cost of an unconstrained system peak at the Transpower GXP and high loadings on network equipment. Some consideration will be given to early replacement of critical components in an attempt to prevent faults occurring. The age of some of the solid-state components (> 25 years) is such that spare parts are becoming difficult or even impossible to source.

## Standards

Documentation of the standards presently used for testing, inspection and maintenance of Ripple control systems is still being developed. Construction standards are fully documented and all new Ripple control systems are audited for compliance.

## Maintenance

EA Networks' two in-service ripple injection plants (a smaller spare unit exists at Methven33) are both of the same make (Landis & Gyr), making lifecycle management easier to implement. Although not identical, the plants have some interchangeable components and operate in an identical manner. Recently some components were used from Methven33's plant to temporarily repair the Ashburton33 plant. The Methven33 plant has since been restored to operational capability. The injection plant supplier has stated that they terminate support for any particular generation of equipment 10 years after it has ceased production.

### Inspections, Servicing and Testing

Monthly checks are carried out as part of regular zone substation visits which include the visual inspections of the

- converters
- coupling transformers
- coupling cells

Advice received from the manufacturer indicates a higher risk of intermittent faults can be expected as the plant age nears 20 years. With this in mind, a service contract is in place with the manufacturer, which includes an annual test on performance plus a full inspection. Tests include injection levels, current balance, optimum tuning and load sharing with other units.

### Fault Repairs

The solid-state construction of the injection plants means that faults are very infrequent.

On rare occasions, the high-power output transistors may require replacement or the logic board may require repair.

Vermin may get into the high

voltage coupling cells causing flashover although this has not occurred on any of EA Networks' plants.

The redundancy built into the injection network is becoming less robust. Failure of the ASB plant could severely impact on overall ripple signal propagation causing loss of load and tariff control. The MVN plant can inject over most of the northern 66kV network keeping many ripple relays operating correctly but the southern 66kV ring is likely to be uncontrolled.

### Planned Repairs and Refurbishment

Minor repairs are required on the coupling equipment and converters from time to time as a result of fault events.

There is no repair and refurbishment program planned for this equipment which is in relatively good

Summary of 33kV Ripple Injection Plant Components			
Site	Capacity	Install Date	Manufacture Date
Ashburton 33 (ASH)	440/60kVA	2007/1985	2007/1985
Ashburton 220 (ASB)	200/60kVA	2010/1992	2010/1988
Methven 33 (MVN) - Spare	25kVA	1985	1985

condition. It is expected that the plants should give ten years of service.

## Replacement

As a consequence of component failure, two of the older (1985/88) inverter units were replaced in 2007 and 2010. One of these has been sized to suit future use at 66kV. The other was the only available option at the time. EA Networks continues to consider alternative signalling technology as a range of technical and commercial challenges appear. Presuming ripple is still the preferred signalling technology in 2026, the 33kV ripple plant (by then acting as a back-up) is scheduled for replacement [00504].

## Enhancement

The capacity of the existing ripple equipment is limited and provides no room for 66kV network expansion. As the network configuration changes, there will be a need to look at ripple plant control technology, location and size.

## Development

With the imminent conversion of all load to 66kV, the ripple control system needs to be reconfigured/replaced to provide adequate security and signal level. The addition of a third 220/66kV transformer supplying EGN from ASB has lowered the available signal level.

It has been decided that a new 66kV ripple plant will be installed at EGN in 2017 which is capable of signalling the entire network [11067]. The existing 33kV plant at ASB will be left as a back-up plant capable of signalling most of the network under most loading conditions.

See [section 5.4.11](#) – Network Development for details.

# NETWORK DEVELOPMENT


<b>Table of Contents</b>		<b>Page</b>
5.1	Network Development Processes	159
5.1.1	Network Characteristics	159
5.1.2	Network Performance	160
5.1.3	Equipment Characteristics	161
5.1.4	Design Standardisation	162
5.1.5	Statutes, Regulations, Standards and Policies	166
5.1.6	Network Development Initiation	166
5.1.7	Network Development Implementation	167
5.1.8	Network Development Options/Considerations/Methods	167
5.1.9	Network Development Prioritisation	170
5.2	Load Forecasting	171
5.2.1	Introduction	171
5.2.2	Derivation of Forecasts	171
5.2.3	Significant Drivers	172
5.2.4	Future Load Projections	176
5.3	Network Level Development	178
5.3.1	66kV Subtransmission	179
5.3.2	22kV Rural Distribution	180
5.3.3	Urban Underground Conversion	181
5.3.4	Core Urban 11kV Network	182
5.4	Strategic Plans by Asset	184
5.4.1	Transpower Grid Exit Points	184
5.4.2	Subtransmission Network	186
5.4.3	Zone Substations	195
5.4.4	Rural 11kV and 22kV Distribution Network	201
5.4.5	Urban 11kV Distribution Network	213
5.4.6	Industrial 11kV Distribution Network	227
5.4.7	Low Voltage Network	228
5.4.8	High Voltage Switchgear	229
5.4.9	Protection Systems	234
5.4.10	SCADA, Communications and Control	236
5.4.11	Ripple Injection Plants	238
5.4.12	Distributed Generation	239



## 5 NETWORK DEVELOPMENT

### 5.1 Network Development Processes

This section of the Plan attempts to outline the processes and criteria used for network development. It cannot be completely authoritative because the network development environment is not purely technical in nature and normal business negotiations can provide solutions that would otherwise not have been considered.

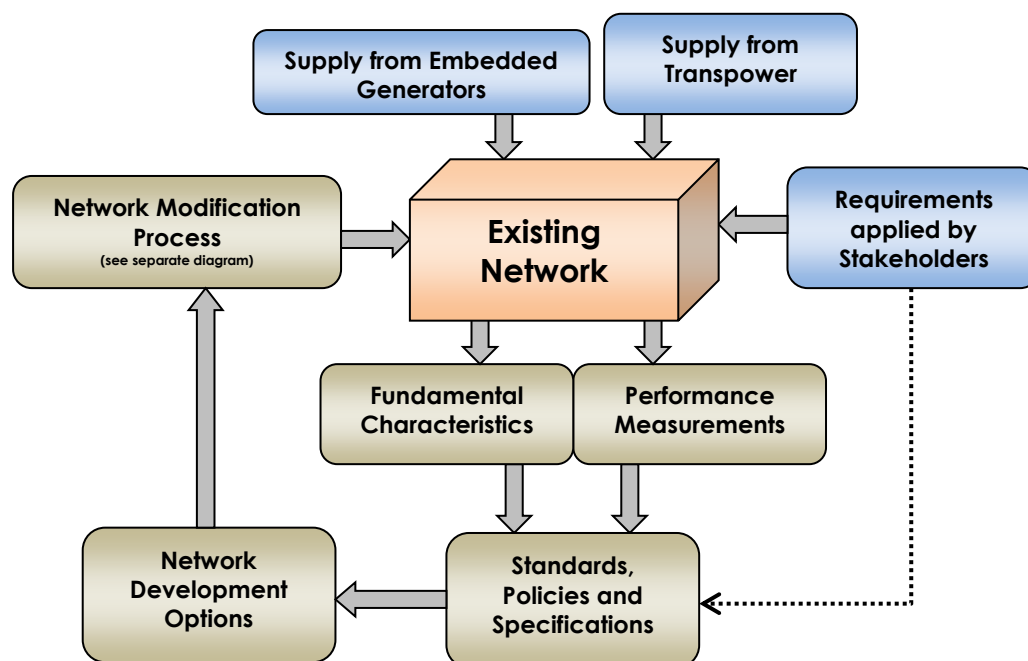

The EA Networks electricity network that exists today exhibits characteristics and levels of performance that may or may not be adequate to satisfy stakeholder requirements now or in the future. These stakeholder requirements are encapsulated by standards, policies, statutes, regulations, specifications, and contracts/agreements between EA Networks and other parties. If the performance of the network is considered to be inadequate because it does not meet one or more of the stakeholder requirements or a new requirement occurs, some form of network development must be initiated. Once initiated, there are a vast range of methods available to modify the characteristics or performance of the network.

#### 5.1.1 Network Characteristics

An electrical distribution network is fundamentally simple to characterise in electrical terms. Its prime purpose is to transport electricity from one location to another with maximum reliability and minimum loss. The inputs are from either Transpower or a directly connected generator. The outputs are to consumers who are connected to the EA Networks network.

At each point in the EA Networks network the fundamental characteristics are voltage and fault level. The voltage is what consumers observe. The fault level defines how the network responds to demands placed upon it either by loads or faults.

EA Networks use standard voltages that are industry norms and have international standards that support their use. The range over which these standard voltages can vary is partly controlled by standards and regulations. This is particularly so for standard low voltage supplies (230/400 volts). Higher voltages have standard prescribed upper limits that equipment is built to tolerate both in steady state and in temporary overvoltage situations. EA Networks have determined operational limits for all voltages in use. The standards and operational limits are detailed in the following table.

Voltage	Normal Operational Range (Design)	Contingency Operational Range	Maximum Rated Voltage <sup>1</sup>	Short-Time Withstand	Impulse Withstand
<b>66kV</b>	105% to 92.5%	106.5% to 89%	72.5kV	140kV	325kV
<b>33kV</b>	105% to 92.5%	106.5% to 89%	36kV	70kV	250kV
<b>22kV</b>	103% to 96%	103% to 94%	24kV	50kV	125kV
<b>11kV</b>	103% to 96%	103% to 94%	12kV	28kV	75kV
<b>230/400V</b>	106% to 96%	106% to 94%	n/a <sup>2</sup>	n/a <sup>2</sup>	n/a <sup>2</sup>

<sup>1</sup> Maximum rated voltage is approximately 9% above nominal voltage but other limitations preclude operating at this level.

<sup>2</sup> Because consumers are directly connected at this voltage the voltage limits are determined by appliance tolerance to overvoltages and appliance standards vary. No overvoltage tolerance is assumed.

Fault levels vary depending upon the electrical path taken from the respective supply points. The maximum fault levels observed on the network determine minimum equipment specifications and minimum consumer connection standards. It is possible to control some additions to fault level by specifying new equipment so that it restricts the contribution it can make to the total fault level. High fault levels cause equipment heating, mechanical stresses on equipment, and require the capability for equipment to interrupt high currents.

EA Networks have established limits to the maximum prospective fault current at each voltage level. These are based upon a combination of historical fault levels that Transpower provide, likely future GXP expansion, typical transformer impedances, and future embedded generation. The maximum fault levels are detailed in the following table.

Voltage	Maximum Prospective 3Ø Fault Current <sup>1</sup>	Power Equivalent	Typical 3Ø Fault Current <sup>2</sup>	Minimum 3Ø Fault Current <sup>3</sup>	Typical 1Ø Phase-Earth Fault Current <sup>4</sup>
<b>66kV</b>	16 kA	1,800 MVA	7.5 kA	1.3 kA	1 kA
<b>33kV</b>	16 kA	900 MVA	5.5 kA	0.7 kA	1 kA
<b>22kV</b>	16 kA	600 MVA	7 kA	0.5 kA	0.3 kA
<b>11kV</b>	20 kA	380 MVA	9 kA	0.5 kA	0.3 kA
<b>230/400V</b>	20 kA	14 MVA	9 kA	0.5 kA	9 kA

<sup>1</sup> This value represents the assessed highest future fault current anywhere on the EA Networks network rounded up to the next standard IEC value.

<sup>2</sup> This value is the typical fault current close to the source of that supply voltage.

<sup>3</sup> This value is at the extremes of the EA Networks network with at least one network element out of service.

<sup>4</sup> All voltages other than 230/400V have Neutral Earthing Resistors restricting the total maximum earth fault current to that shown. Actual currents flowing to earth in a fault would normally be less than this value.

### 5.1.2 Network Performance

Given a network with the characteristics detailed above, applying the electrical loads, reliability expectations, and power quality requirements of the stakeholders tests the capability of that network to deliver satisfactory performance. The reliability of the network is continuously measured and reported in documents such as this Plan. The two things that determine reliability are fault frequency and the ability of



the network to tolerate that fault with minimum or no interruption to consumer's supply. Fault frequency can only be influenced when probable causes can be prevented. Network resistance to faults can be influenced by asset availability, design and operation. Power quality is influenced by many factors, only some of which are able to be directly controlled by the network owner.

### **Reliability Requirements**

The stakeholders determine the acceptable level of reliability by providing feedback to EA Networks using the methods detailed in [section 2.2](#). This information is used to set desirable network performance criteria which are then measured against the required stakeholder-influenced targets. If these targets are not able to be met using the existing asset configuration or operational methods then a network development process is initiated. Once triggered, this process is likely to influence the security requirements in some way.

### **Security Requirements**

In simple terms, the security level is determined by the level of redundancy built in to the electricity network either by quantity and/or configuration. [Section 2.5](#) details the criteria EA Networks apply when evaluating the suitability of the network to deliver the required level of reliability.

### **Power Quality Requirements**

The simplest power quality measure is the presence or absence of voltage. Very short blackouts (less than 2 seconds) are typically considered as a power quality issue rather than a reliability issue. The effects can be very similar to a much longer outage but the cause is generally very different. Another fundamental power quality issue is low or high voltage. Consumer-observed low voltage is typically an indication that the LV feeder load has increased to a point that the network cannot keep within the voltage design range. This unexpected issue would initiate the network development process.

A range of other power quality measures are considered as network development initiators including harmonic distortion and flicker. If reliable measurements show that the network is delivering unacceptable levels of any power quality measure, a response will be initiated.

[Section 2.6](#) details the power quality criteria that EA Networks apply when assessing the performance of the network.

### **Safety Requirements**

If it is apparent that the network is providing elevated levels of risk to people or property the risk will be quantitatively assessed and, if it is unacceptably high, a network development response will be initiated. [Sections 1.7.1](#) and [2.7](#) outline the primary criteria integrating safety into asset management.

## **5.1.3 Equipment Characteristics**

Any item of electrical equipment should perform satisfactorily when it is used within the parameters considered when it was designed. It is important to respect the limits of any items capabilities while still considering any limited scope to use temporary overload capacity to increase security. An important set of network development criteria relate to the specification of equipment used within the network as the 'network' is simply an assemblage of many individual items of equipment. Once the equipment is in the network, how it is operated is as important as how it was specified.

### **Specifications**

EA Networks specify all equipment to exceed the relevant electrical parameters detailed in the Network characteristics section above. This ensures the item will operate reliably regardless of its location within the network. Each type of equipment (transformer, circuit-breaker, cable etc) has additional characteristics that are specified on a case by case basis, but every effort is made to specify standard models of equipment with standard ratings tested to internationally accepted specifications such as IEC.

The capacity and performance requirements of each asset type is detailed in [Section 5.4](#).

### **Operating Range**

Every item of electrical equipment has a rated current and a rated voltage. Utilising these ratings to their maximum (or above) during contingencies can provide a more secure network. In order to do this reliably, good knowledge is required of the overload capabilities of the equipment and the effects any overload will have on continued equipment operation.

To allow adequate margin for contingent operation, the normal level of operation must be below the rated maximum capacity. Different categories of asset may permit unique (over)loading characteristics.

EA Networks have a largely radial distribution network with multiple interconnections to adjacent zone substations. The same principle applies for urban 230/400 volt distribution between distribution substations. This network architecture makes the assumption that if an item of equipment fails, the distribution network will be able to back-feed from adjacent feeders. In most cases this will mean a faulted feeder will have at least two adjacent feeders that can provide back-up and a faulted transformer would have two adjacent substations to provide back-up. These principles allow the following general design/operation thermal limits to be stated in the following table .

Asset Type	Assumed Conditions	Normal Operation	Contingent Operation	30 minute Operation
<b>Power Transformer</b>	Still Air @ 25°C	100%	125%	150%
<b>Overhead Conductor</b>	1ms <sup>-1</sup> Air @ 25°C	75%	100%	110%
<b>Underground Cable</b>	Ducted	75%	100%	110%
<b>Feeder Circuit-Breaker</b>	25°C	75%	100%	100%
<b>Disconnect /Switch</b>	25°C	50%	100%	100%

For specific network development designs these general guidelines for normal operation are indicative only. Certain situations may require lower or permit higher loadings than those shown. The contingent operation limits are fixed and determine the required nominal rating of each item of equipment based on any contingent scenarios considered at the design stage.

The operational voltage limits of equipment have been incorporated into the network characteristics contingency limits detailed above (see [Section 5.1.1](#)).

#### 5.1.4 Design Standardisation

An approach to design that encourages standardisation has many advantages that can provide tangible cost efficiency gains. Provided the standard designs are not over-specified for the average application (a design that considers the anywhere anytime worst possible case is generally over-specified) then EA Networks will normally consider adopting the design for use elsewhere.

The standardisation approach is particularly prudent when external design expertise has been used to certify or validate a design such as seismic or structural elements. Repeated use of external consulting to 'optimise' a design is frequently a loss-making exercise (the cost saving in optimised equipment is less than the consulting cost of the expert). In these circumstances, the designer is advised of the need to consider the design to be a 'standard' design and document the environmental and operation limits of the design so that it can be reused with confidence within those limits.

The tangible benefits of standard design include:

- Lower equipment population lifetime engineering costs, although the initial standard design process may be much more time consuming than a one-off design.
- Standard designs can be applied by personnel with less design expertise provided they appreciate and keep within the limits of the design.
- Staff and contractors are familiar with the techniques used to construct and operate the design, which should promote a safer operating environment and more cost-effective construction.

- Design staff have confidence that the design will perform as expected (based upon experience already gained with the design).
- Minimising the stock of spare equipment that must be kept for repairs and on-demand new projects.
- Incremental design improvements can normally be incorporated without affecting backwards compatibility.
- The components for the standard design can be purchased in bulk which encourages cost-effective procurement.
- Standard designs based upon standard components can be more cost-effective assuming the components are in turn based upon some common standard that allows multiple competitive sources for the component.
- Any issues that may arise with a standard design can be attended to with a universal solution rather than individually engineered solutions.

EA Networks' standard designs are identified by the frequency of use and the incremental cost of both the equipment and the design resource required to adequately engineer a solution. If a design is expensive to do and the equipment relatively inexpensive then it makes sense to standardise the design. Alternatively, if the incremental cost of equipment is expensive and the design is relatively inexpensive it could make sense to individually examine each application of the equipment to ensure it is necessary and not excessive in that particular circumstance.

An example of expensive design and relatively inexpensive equipment is protection schemes. The design effort required to specify and document the details of a 66kV bus zone scheme are typically more than the cost of the protection relay hardware, so it makes sense to standardise the design. Conversely, long runs of 66kV cable are incrementally expensive to increase in size and it pays to spend sufficient design time to ensure the optimal choice is made (within a preferred selection of sizes).

The following table identifies the range of standard designs (either in full or in part) that contribute to the cost efficiency of EA Networks' asset management:

<b>GXP</b>	
Transformer Size	Compatible with transformer n-1 situations i.e. firm capacity is n-1 x transformer capacity rather than sum minus largest single unit.
<b>Zone Substation</b>	
Transformer Design & Size	Standard size, foundation interface, HV outdoor interface, MV cable interface, control cable interface, impedance, tap range etc allow any 66kV transformer to be relocated to any other site without redesign. All units can be parallel connected if needed.
66kV Bus and Line/Transformer Bays	Seismically certified stand designs and buswork designs are reused at each new/expanded site.
Foundation Design	Seismically certified foundation designs are reused at new/expanded sites.
Building Design	A standard seismically certified building design is reused where appropriate.
Protection Design	Standard protection designs are reused at new/expanded sites for 66kV lines, 66kV bus, 66kV transformer, and 22kV feeders.
22kV Switchgear Type	A restricted range of 22kV switchgear types maintains compatibility with standard buildings/foundations, mounting frames, and seismic restraints.
66kV Switchgear Type	Standard styles of 66kV circuit-breakers (dead tank) and disconnectors (centre rotating) ensure foundation, stand, and mechanical interfaces are all compatible with the standard designs.
<b>66kV Overhead Line</b>	
Structure Designs	All 66kV structures are standardised other than for very rare specific applications.


Conductor Type & Size	A limited range of conductors is used at 66kV (currently only 2). This assists in minimising structural design and inventory of spares and production stock.
<b>66kV Underground Cable</b>	
Cable Size & Type	Wherever possible, one of a limited selection of standard cable sizes are used. Only one cable type has been used.
Trench Profile	A standard trench profile/backfill has known thermal and mechanical performance characteristics which do not require further design for reuse.
<b>22kV Overhead Line</b>	
Structure Designs	All 22kV structures are standardised other than for very rare specific applications.
Conductor Type & Size	A limited range of conductors is used at 22kV (currently 4) when building new lines. This ensures spares and production inventory is kept to a minimum.
<b>22kV or 11kV Underground Cable</b>	
Cable Size & Type	A limited selection of cable sizes and types is used to keep the stock of spares and accessories to a minimum.
Trench Profile	A standard trench profile/backfill has known thermal and mechanical performance characteristics which do not require further design for reuse.
<b>Distribution Substation</b>	
Foundation Designs	Several standard foundation designs are in use. A number are precast designs which are recoverable for reuse should the site be decommissioned.
Kiosk Cover Designs	A range of standard kiosk covers with matching foundations allows a versatile mix of standard modular substation components to be combined. An example would be a high capacity substation consisting of: MV kiosk for MV switchgear, a precast pad for the transformer, and a LV kiosk for the LV switchgear.
Switchgear Support Frame Design	Support frames for MV and LV switchgear is standardised and allows different standard switchboard design combinations to be accommodated.
<b>Distribution Transformer</b>	
Size	Standard sizes based upon industry standards.
Bushing Interface Design	Interchangeable outdoor (porcelain) and indoor (bushing wells for screened elbows) bushings, which mean the transformer manufacturer's standard configuration can be accommodated under kiosk covers (no special layout for EA Networks).
Foundation Interface Design	All GM transformers have standard hold down positions which ensures standard foundation use, full interchangeability and certified seismic strength.
<b>HV Switchgear</b>	
Mounting Design	Gas switches, RMUs, 22kV or 66kV zone substation CBs all fit on standard mounting frames or foundations.
<b>LV Switchgear</b>	
Model Range Limitation	Three styles of LV switchgear are used and each has standard housings and mountings. The link/distribution box switchgear has a standard busbar backplane that accommodates modular switch types. Only the necessary modules are initially installed but any combination is possible after installation.
DIN Standard Design	The use of DIN standard design LV Fuse Disconnectors allows standard busbar mounting and interchangeability with multiple manufacturers' equipment.

**LV Underground Cable**

Cable Size & Type	A limited range of cable sizes and types is used to keep the stock of spares and accessories to a minimum.
Joint Types	Standard joint types for standard cable sizes allows stocks of spares to be kept to a minimum.
Box Designs	Standard box designs and layouts allow spare box stock to be kept to a minimum and known capacity of LV switchgear can be accommodated. Also allows production of preassembled boxes for stock.

**SCADA & Communications**

SCADA Protocol	Use of the industry standard DNP3.0 protocol ensures that engineering work is limited to settings 'per device'. Combined with standard protection designs this encourages engineering efficiency.
Ethernet Switches	The layer 2 Ethernet switches in use within the SCADA data communications infrastructure are all industry standard devices which are interchangeable with various makes and models.

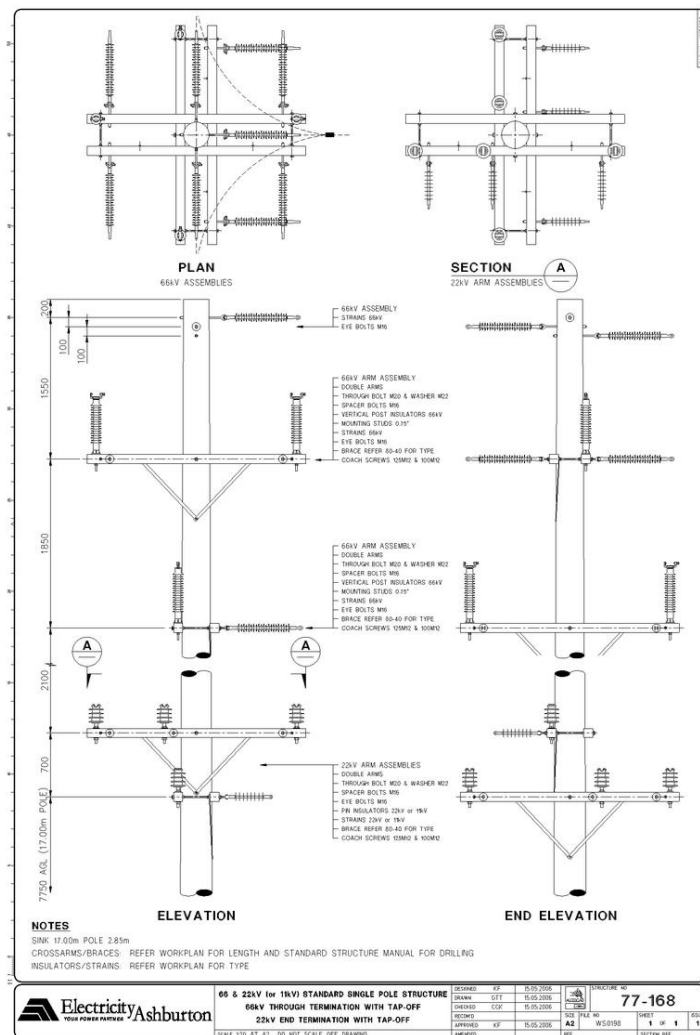

Standard Design Drawing for 66-22kV Overhead Line Structure

### 5.1.5 Statutes, Regulations, Standards and Policies

Almost all network development will be in response to one or more non-compliant network performance measures which are in turn based upon statutes, regulations, standards, policies, codes, specifications, contracts or agreements. The range of documents this covers is significant and only those that have broad application will be detailed here.

- **Safety.** Overarching all of the other criteria is the requirement to design, build and operate the network in a safe manner.
- **Statutes and Regulations.** Statutory/regulatory obligations are a given and the network is operated and developed to comply with all statutory requirements.
- **Service Levels.** Service levels are set by agreement with stakeholders and these can change from time to time. Service level standards flow through in to many technical standards which are intended to result in a network that meets the service level standards.
- **Technical Standards.** These cover the bulk of asset intensive network activities. Areas covered by technical standards include: Equipment Specifications, Procurement Standards, Design Standards, Construction Standards, and Maintenance Standards.
- **Financial Requirements.** EA Networks need to make an adequate return on new network development. Any network addition must meet minimum criteria for financial viability. The viability threshold is normally a particular rate of return set by the board from time to time. A determination of viability can however be a trade-off with other (possibly future) benefits that are less tangible in the short term.
- **Use of System Agreement.** All consumers who connect to the EA Networks network are bound by the obligations of the use of system agreement via their Retailer. This document encapsulates references to other policies and standards that ensure consumers do not cause unexpected effects on the network or other users of the network. Equally it obliges EA Networks to provide the levels of performance prescribed by the multitude of standards and policies currently in force. The Connection Standard referenced by the Use of System Agreement includes obligations on consumers regarding underground connection, power factor, harmonics limitation, motor starting limitation and consumer owned equipment safety.

The policies and standards of EA Networks are based on certain underlying principles. The following list provides a broad summary of these:

- The network will not present an elevated safety risk to staff, contractors, the public or their property;
- The network will be designed and operated to meet or exceed all statutory requirements;
- Procurement and installation of network equipment will be compliant with network standards and manufacturer's instructions to ensure optimal life and performance.
- Network developments will provide an acceptable commercial return for EA Networks;
- Different consumer connection groups will have different reliability and security standards applied to them which represents the price/quality trade-off;
- The reasonable electricity capacity requirements of a consumer will be met;
- A prudent level of additional capacity is designed into the network to allow for predicted load growth;
- All network assets will be operated within the design thermal and voltage ratings to ensure they are not damaged by overloading or overstressing.

### 5.1.6 Network Development Initiation

The network development planning process is tightly integrated with this plan. The diagram of [section 1.7.1](#) gives some idea of the continuously looped sequence of events that deliver the network development strategies presented in this plan. Given that there is an existing network that exhibits certain characteristic levels of performance, the best place to enter the loop is by measuring the performance of the network


'Monitor Asset Performance'.

There are essentially two key reasons the network development process will be initiated.

- (1) If an existing or new stakeholder approaches EA Networks with either new or increased electrical demand or a desire for enhanced requirements/characteristics at the interface(s) with EA Networks.
- (2) One or more of the statutes, regulations, standards, policies, codes, specifications, contracts or agreements is not being complied with.

Once the process is initiated it goes through the same series of tests and justifications as any business proposal.

## Network Development Initiation and Modification Process

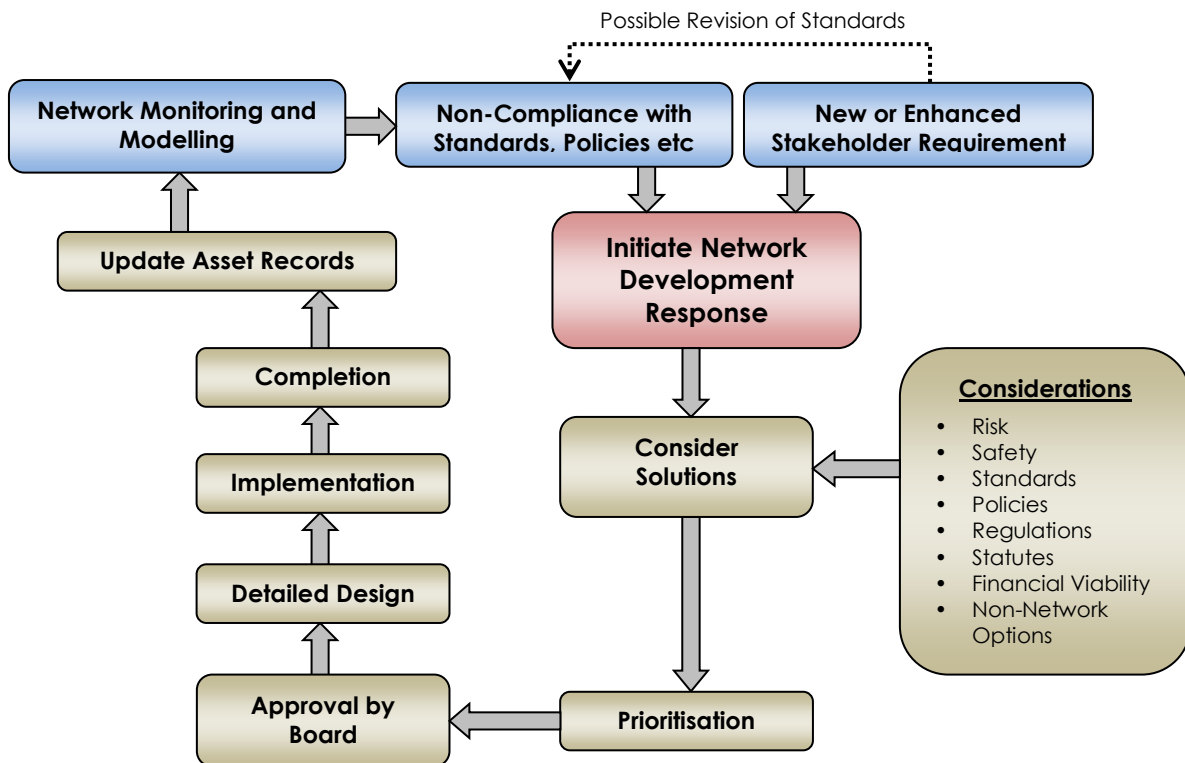

### 5.1.7 Network Development Implementation

Once an option or strategy has been adopted and approved, it is incorporated in to the internal policy documents as well as the Asset Management Plan. This will cause any new project or programme to comply with these approved strategies. An example of this would be the continuing use of 22kV conversion as a solution to increasing distribution system capacity and quality issues as the norm. 11kV reconductoring projects would require a different style of approval mechanism as they do not fit an approved strategy.

Once a project is approved by the Board it enters the normal process for scheduling, detailed design and construction. This is typically completed using internal resources. Once complete, the new/altered asset is incorporated into the asset records and the fiscal/accounting aspects completed.

### 5.1.8 Network Development Options/Considerations/Methods

There are a number of possible reasons the network development process has been initiated. Not all of these will involve changes in load or security, although the majority do. At times stakeholders will request

changes in perceived safety or even aesthetics and the Shareholder Committee, Board and management will consider these requests with the same rigour as any other.

The options available to respond to changes in load or security are very similar in many cases. They will typically involve a change of operating technique for existing assets, an upgrade of existing assets, or the addition of new assets. Non-network solutions are considered but must be suitable to the stakeholder both commercially and practically.

Each of the following options is carefully evaluated based on economic efficiency and technical performance. Wherever possible, capital-intensive development is delayed until absolutely necessary and non-asset intensive solutions used where these are not incompatible with future development plans. The first three solutions listed are essentially non-asset intensive (non-network in some cases).

The options include:

- Tariff structure (Non-network)

Demand based tariffs give the end user strong incentives to reduce peak demand and maximise plant load factors. This results in less peak demand and better regulation on the EA Networks network.

- Demand side management (Non-network)

Use of Demand Side Management is linked to the tariff structure and allows the consumer or EA Networks to control the internal demand by shedding non-essential load at peak periods. The success of demand side management is related to the value the consumer places on electricity at peak times versus the cost of supplying electrical demand at that peak time.

- Line drop compensation (Non-network)

Line Drop Compensation (or LDC) can be used in specific circumstances to boost the sending end voltage on a feeder to improve down line regulation. This effectively increases the available capacity on some feeders.

- Voltage regulation

Voltage regulators can be a useful measure if load growth can be reliably predicted. If the load exceeds the rating or boost capacity of the regulator, a new larger unit must be purchased requiring the smaller unit to be relocated, stored or sold. Regulators can increase losses and are an increased security risk as they can fail (a spare is therefore required).

- System reconfiguration

System reconfiguration is the first choice of any asset manager in accommodating additional load. Caution must be exercised to ensure that the combination of reconfiguration and new load does not compromise the security levels offered to existing and new consumers. Typically, the capacity liberated by reconfiguration is limited.

- Reactive compensation (capacitors or power electronic devices)

Installing capacitors at strategic points in the network where voltage constraints are present or imminent can postpone the need for more asset intensive solutions. In some cases, load growth for a particular installation may require increased reactive support, and the consumer is required to contribute to the capital expenditure involved. High harmonic levels on the EA Networks network make a capacitor option more expensive than on many other networks.

Recent development of lower cost power electronic devices that can provide power compensation are another option. These may be able to simultaneously provide other functions such as harmonic filtering.

- Conversion to a higher voltage

Conversion to higher voltage is particularly effective solution. Doubling the voltage (from 11kV to 22kV as an example) provides a four-fold increase in capability when the line is voltage constrained. The cost of voltage conversion is higher than some of the other solutions, but it provides a capacity increase that none of the other options can.

- Reconductoring

Reconductoring is asset intensive and can require involve significant cost if the poles supporting the



existing conductor are insufficiently strong for the larger conductor. The additional capacity introduced by reconductoring depends on the pre-existing conductor size. The most one could typically expect to achieve on the same poles would be a 100% increase in capacity (for example going from a Mink sized conductor to Jaguar – an increase from 220 amps to 500 amps).

- Overlaying with a higher voltage

Overlaying with a higher voltage (LV with 11-22kV or 11-22kV with 66kV) is very asset intensive, and often cannot be justified in terms of the cost involved. In many cases this cost must be borne by the consumer requesting the new or increased supply, and becomes their decision in the final analysis.

- Additional SCADA remote control

Automation allows timely pre-emptive or reactive responses to impending or actual events. This can effectively increase reliability and can possibly liberate additional capacity.

- Load Diversity

Ensure that the diversity within and between different types of consumer groupings are accurately modelled. If the peak demands of each group do not coincide then capacity is either liberated or not required.

- Loading Knowledge

Accurate information about the existing network loading is essential to permit accurate calculations of spare capacity and the need for upgrades or additions.

- Long-Term Planning

Every solution should be compatible with the long-term plan for network development. This will ensure minimum long-term cost and disruption.

- Coordinated Development

All of the proposed projects on the EA Networks network (development, maintenance, replacement etc) must be fully coordinated to ensure any possible synergistic benefits are realised.

The load growth estimates are used as a basis for determining the likely timing of projects which are justified by load growth and/or security.

The performance targets are used to develop strategies to accommodate both increased demand and other (presumably) improved performance targets. These strategies cover all voltage levels and asset classes and include non-asset solutions. The different strategies are evaluated against each other and the feasible options are then presented to the Board for consideration (see [section 1.7](#)).

Network/asset performance is multidimensional. There are capacity, regulatory, cost, reliability, safety, environmental and power quality dimensions that trade off against each other. For example, in order to have the lowest possible risk to personnel there is likely to be a compromise with either cost or reliability. It is generally more expensive to do live line techniques than to have an outage and work with the network earthed, but the trade-off is that live line work makes the reported system reliability higher while incurring some additional risk. EA Networks presently take the approach that live line work is only used where the benefits comprehensively outweigh the risk and cost.

The measurement of all network performance must be objective and complete.

The capacity of the network is the biggest issue that is debated between the regulator, funder, network designer, network owner, network operator, and consumer (all stakeholders). Too much capacity and it is seen as wasteful. If there is too little (or it is delivered too late) then it is seen as poor service. While there are no simple ways to measure performance in this area, the Board have adopted an objective that any small-medium consumer (typically <500 kW) that applies for a new or enhanced connection before the end of one irrigation season can expect to be connected before the next season starts. It must be explained that the term 'irrigation season' implies that an application received before April would be connected by September. Most other urban and industrial connections are easily achieved within this timescale. In order to provide a prudent level of capacity, the estimated 10 year future load (as per [Appendix C](#)) is used as a minimum to size distribution assets when they are installed.

Regulatory performance is a given. All personnel are fully conversant with the regulations that cover their area(s) of responsibility and they are expected to comply with them at all times (see [section 1.7.6](#)).

Measuring performance in this arena is as much about peer awareness and external observations (such as other organisation's performance and practices) as it is about internal processes and systems. There have been rare occasions when non-critical regulatory requirements were unable to be achieved. These are generally resolved in the shortest possible timeframe and the necessary resources engaged to prevent a recurrence. Unless the non-compliance is consequential it is not explicitly reported.

EA Networks believe that they are painstaking in their efforts to ensure the network reliability indices reported reflect all incidents that require inclusion in those indices. All outages are 'traced' using the electrically connected model included in the Power-View GIS system to obtain a list of affected connection points. All faults are then entered in to the 'Faults' database and this allocates all connection points interrupted by that fault to it. This allows every connection point interruption to be identified and, if necessary, individual CAIDI and CAIFI values reported. The 'Faults' database provides the storage and analysis of EA Networks' reliability data.

The financial performance indicators are as accurate as the data they are based upon. This presumes that the categorisation of all projects is precise and that allocation guidelines are followed in every instance. These financial values are subject to audit and consequently there is no reason to doubt their precision.

Safety, power quality and environmental performance is measured and recorded in systems that are best suited to each area.

The safety performance data is integrated with competence, training and other personnel specific information in a system that runs in parallel with the asset management environment. Any safety issues that are linked to asset performance are reported via the Safety Committee to the Network Manager. The Network Manager then obtains engineering advice on available solutions to mitigate or eliminate the source of risk. Where necessary, that solution will be inserted into the asset management approval process for acceptance into the appropriate methodology by the management and/or Board.

The power quality performance (other than outages) is monitored in a less sophisticated fashion than some other parameters. Consumer level voltage performance tends to be monitored on demand using small data loggers that provide files that can be analysed for compliance with standards of steady state voltage as well and momentary excursions. These are registered as a simple 'justified' or 'not justified' tag for the purposes of a 'Voltage Complaint' index. A relatively new (for EA Networks) power quality parameter is harmonic distortion. In the last few years we have become aware of the distortion levels on the EA Networks network. A collection of both portable and fixed harmonic monitoring equipment has been purchased/installed. These devices will begin to accumulate large volumes of data that can be analysed for both compliance with standards as well as examining trends in background/average values. As mitigation measures are enforced, their effectiveness can be measured over time. Future plans will include a commentary on this performance.

Environmental monitoring has been limited to compliance with the relevant legislation and Regional/District Plan rules. This particularly concerns noise, gas and liquid discharges, and District Plan aesthetic rules. EA Networks monitor and, where necessary, record the loss levels of gases (such as Sulphur Hexafluoride) as well as fluids such as transformer and hydraulic oil or storm-water from transformer bunds. The aesthetic rules relate to all new plant being underground in urban and fringe urban zones. These zones are well known and there have been no issues of non-compliance.


### 5.1.9 Network Development Prioritisation

Particularly during periods of rapid demand growth, there is a tension between various projects that need EA Networks' available financial, physical and intellectual resources. The resolution of which issue requires priority is not necessarily straight forward. The general methodology and criteria for the technical and financial evaluation of network development projects can be summarised in the diagram shown below.

The required economic rate of return is set in the Statement of Corporate Intent. This rate of return can occasionally be discounted when other less tangible benefits can be identified.

Any capital expenditure must be fully justified and in normal circumstances such a project is expected to add value to the company by providing a competitive Return on Investment (**ROI**) over a 40 year life. Competing projects are compared using Internal Rate of Return studies (**IRR**), and this is used to prioritise the order of projects in terms of Net Present Value (**NPV**). This determines which projects can be justified for funding out of a limited capital budget.

Ultimately, it is the Board that dictates the immediate focus for the company and they consider not only the advice offered by management but also external factors including matters such as public perception, politics and overarching business strategies.

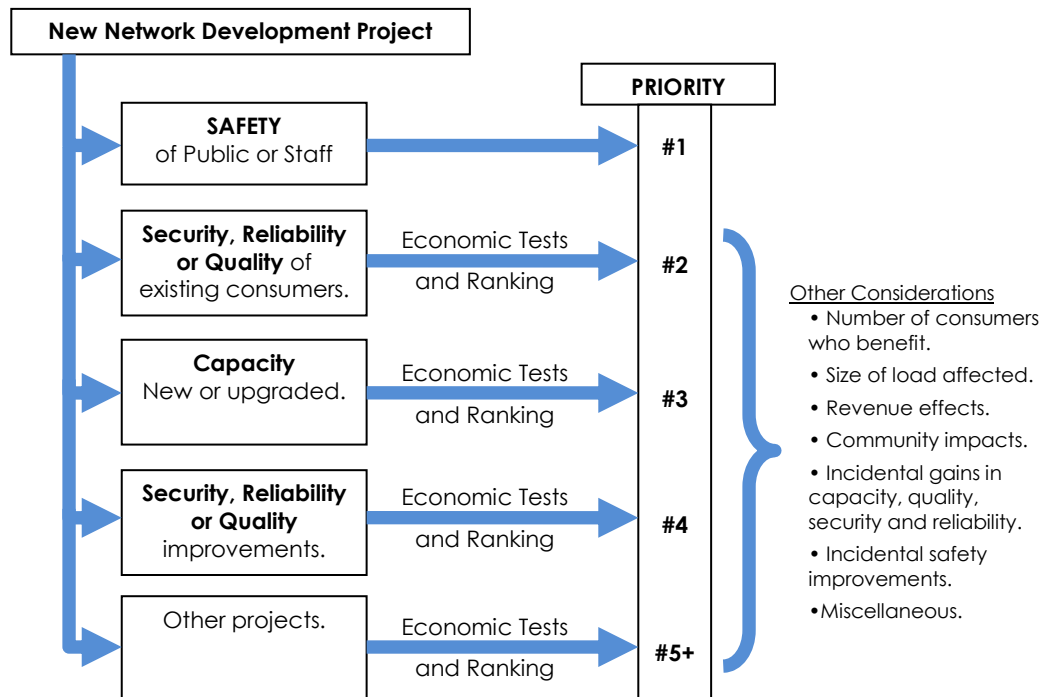

## 5.2 Load Forecasting

### 5.2.1 Introduction

Future load projection is a difficult task and is based on a complex multivariate environment. A careful and rigorous approach must be taken to developing future load projections based on historical trends, available information and estimates on future changes.

### 5.2.2 Derivation of Forecasts

Forecasts of maximum demand on the subtransmission system have been derived from internal modelling work. Sources of information include:

- Historical demand and energy usage data,
- A report commissioned by EA Networks from farm management consultants Englebrecht, Evans & Co Ltd,
- Discussions with real estate agents, well drilling contractors, irrigation system consultants and other service/equipment providers for rural industries,
- Major consumers connected to the network,
- The "Canterbury Groundwater Study: Sustainable Yield of Aquifers in Ashburton District" – April 2005,
- The "Ashburton District Development Plan" – June 2005,
- The "Canterbury Irrigation Peak Electrical Load" report prepared for Transpower NZ Ltd by Aqualink Research Ltd – November 2010,
- "The economic value of potential irrigation in Canterbury" prepared for Canterbury Development Corporation by AERU Lincoln University - September, 2012,
- "Canterbury Strategic Water Study (CSWS) Stage 3" Lincoln Environmental – 2008,
- "Canterbury Water Management Strategy" Canterbury Mayoral Forum – November 2009,

- "The economic impact of increased irrigation" NZIER - November 2010,
- Environment Canterbury reports and resource consent applications.

These information sources have been used to generate two forecasts. Forecast A (Projection) is a statistical projection of the system maximum demand growth rates, which offers a GXP maximum demand forecast. Because it is based on trends, forecast A includes some consideration of future unknown loads that are likely to occur. Forecast A is also prone to large errors in a period of fluctuating load growth. The alternative, Forecast B (Estimation), analyses individual zone substation maximum demands based on present demand with likely additional load allocated by each zone substation for the next ten years. This model has the advantage of locating the estimated load within the subtransmission and distribution networks allowing analysis of the capacity utilisation of many network components. The disadvantage of forecast B is that unknown future loads are not accounted for.

The two models have always been divergent. The statistical projection cannot account for the now observed downturn in irrigation load growth caused by water extraction restrictions. On the other hand, the individual load estimation reflects that downturn but does not account for unknown future load. The projected load growth is now considered unrealistic. The estimated load growth has been revised to reflect water extraction and now nutrient run-off restrictions recently imposed by ECAN. The summer system maximum demand will probably be about 188 MW by 2026.

### 5.2.3 Significant Drivers

Some factors that could significantly affect electricity consumption have been taken into account in the forecasting process, and these have been projected forward. They are:

#### **Population Impact**

Population projections, broken down into local supply areas are provided by Ashburton District Council's District Plan. The impact of population growth on load is largely that of additional domestic consumption, although population-based industries such as entertainment and retailing also tend to grow. Domestic loads are typically peaking at meal times and early morning and are obviously concentrated in urban areas. Cold weather will also cause domestic consumption to rise and the coldest weather typically causes the regional/national peak in electricity demand. Hot weather is also beginning to increase demand as domestic heat pump/air-conditioning units become much more ubiquitous. The impact of purely population driven demand is much lower in the EA Networks network than in many others as a consequence of the dominant irrigation demand. There has been no measurable impact on demand caused by Christchurch residents shifting to Mid-Canterbury.

#### **Price Impact**

In an efficient environment, energy prices (at least for marginal sales) should be close to marginal cost. Marginal prices have spiked very high in some years due to a shortage of fuel for generation. Electricity growth could begin slowing down as prices increase. This may not impact on the growth in system maximum demand however, since maximum demand is measured over any half-hour period - a short time for energy consumption. The use of energy may become more selective - only when the return on expenditure is high (a very dry year in the case of irrigation).

To date, the increasing price of electrical energy does not appear to have changed usage patterns or volumes to any measurable degree. The majority of people see electricity as an essential service that they cannot do without and are not currently making decisions based on doing without. Industries may be looking for more efficient technologies to use electricity, but few are abandoning its use for alternatives.

#### **Major Industries Impact**

Most forecast increases in load are an indirect response to economic and demographic pressures, and cannot be related to any particular electricity consuming development. Some major industrial loads can be anticipated however, particularly in the food processing industry. Unfortunately these are also the most difficult to predict or quantify as they depend on investment decisions from major industries. Historically, final commitments on these projects have been deferred to a very late stage, often involving significant last minute load revisions, leaving EA Networks in a difficult situation from a planning perspective.

Meat processing industries and the food processing industry generally are of sufficient size (and in specific locations) to need to be studied separately. These industries are generally year round with relatively consistent loads and are not weather dependent. The existing industrial loads greater than 1 MW are

limited to RX Plastics (plastic product manufacturing), ANZCO Seafield (meat processing), Talleys Fairton (vegetable processing), Silver Fern Farms Fairton (meat processing), Mt Hutt ski-field (snow making & tows) and Trustpower BCI Highbank (irrigation water pumping). ANZCO are served directly via a dedicated zone substation and security is negotiated directly with them. Silver Fern Farms Fairton is likewise served directly via a zone substation which also serves Talleys via a relatively short 22kV feeder. Mt Hutt ski-field has a dedicated zone substation. The large (2 x 950 kW) air compressors for snow-making have recently been replaced with a smaller set of compressors and this has decreased the ski-field load. The water pumps associated with the snow-making system cause large voltage depressions on the zone substation 11kV bus during starting. No other consumers see this voltage depression. Mt Hutt is a winter only load. Trustpower BCI Highbank has six 1.5 MW pumps (1.4MW loaded) that run during summer. The supply to these pumps is from a Trustpower owned 66/11kV transformer. EA Networks provide a single circuit 66kV supply to this transformer. All of these loads have to some degree individually negotiated their capacity and security.

Dairy farming and irrigation are the dominant industrial loads in the EA Networks network and these have been growing at a significant rate. Irrigation load has been the dominant contributor to system peak demand for many years and will continue to be so for the foreseeable future. Total chargeable irrigation load now exceeds 140 MW (including almost 9MW of pumping at Highbank Power Station). It has been suggested by most informed industry commentators that spray irrigation development of farms (both dairy and cropping) will continue but it is limited by both water availability and nutrient run-off issues. The other factor with potential to affect electrical irrigation load is the piping of historically open race irrigation schemes. This conversion can provide gravity pressurised water at the farm gate displacing the previous electric pumping. The new BCI scheme is also predominantly a gravity pressurised piped scheme. Some pumping is required when insufficient gravity head is available. It is unknown whether the reliability of the piped schemes is sufficient for farmers to forego the back-up of a deep well electric irrigator. Only a handful of farmers have so far chosen to permanently disconnect pumps.

The irrigation load is very dependent on weather conditions. During a "wet" summer the diversity in use of irrigation plants increases considerably, which in turn lowers the simultaneous demand placed on the EA Networks network. A "dry" summer tends to remove the diversity from irrigation load and can cause very significant jumps in maximum demand from year to year. As an example 2005-06, had a summer peak demand of 104 MW while a year later (with the addition of 8 MW of new irrigation plants) the summer peak demand dropped to 100 MW because of a less arid summer. The current irrigation season started as a dry summer with only small amounts of rainfall before Christmas 2015. In 2010-11 the summer demand peaked at 148 MW. A year later the demand peaked at 143 MW despite the addition of 17MW of irrigation load. In summer 2015-16 an all-time high maximum demand of 177 MW occurred. 168 MW was the previous record maximum demand and that occurred in a 'normal' year (2014-15).

Large irrigation plants can range up to 300 kW in size for an individual pump (this is equivalent to about 100 residential homes). The irrigation "season" can start as early as August and last until as late as April. Once operating, an irrigation plant can typically be left to run for days or even weeks - particularly the centre pivot types. Electrically irrigated farms were historically restricted to more coastal parts of Ashburton district. Over the last two decades deeper and deeper water wells have been funded by the improved economics of intensive farming. This has caused the load density to intensify closer to the Southern Alps which is further from EA Networks' GXP. This increases losses in the subtransmission network.

Historically, irrigators have indicated (after being consulted specifically on the issue) that they would prefer to pay higher charges than be subject to control at times of maximum demand. The network has evolved to suit that requirement. This attitude does not appear to have changed and the returns from irrigation are sufficiently high that it has been assumed that there would have to be a major change in global food demand to influence prices sufficiently to make load control an acceptable option.

Two significant irrigation developments have been implemented in recent times. The schemes are generally described as the 'Barrhill Chertsey Irrigation (BCI)' scheme and the 'Acton' scheme.

The BCI scheme consists of an 8 m<sup>3</sup>/s water intake from the Rakaia River supplying a pumping station lifting up to 8 m<sup>3</sup>/s (4m<sup>3</sup>/s initially) of the water from river level to the normally empty end of the Rangitata Diversion Race (RDR) and a piped pressurised water distribution network on the plains. In electrical terms, the item of interest is the pumping load. The initial pumping station is a load of 9.0MW composed of 6 x 1.5 MW motors. More motors are being mooted, potentially taking the total load to 12MW. The impact of this load on the subtransmission network is considerable and it has been arranged so that it is interruptible during subtransmission outages. Additional pumping load on the distribution network has been allowed for as the scheme will liberate water for on-farm pumping from other parts of the RDR. The water distribution

network will be a gravity pressurised pipe network which will only require small amounts of electrical pumping to boost pressure at the initial points of off-take from the RDR. This may actually reduce the overall electrical pumping load on the EA Networks network over time.

The Acton scheme is a canal-based distribution network fed from a river level intake in the vicinity of Rakaia township. The canal required no electrical pumping but the on-farm electrical pumping needs have been estimated at approximately 3 MW. This load increase has been shared across Overdale, Pendarves and Dorie zone substations and was in addition to existing irrigation pump load.

### **Regulatory Uncertainty**

ECAN (Environment Canterbury – Canterbury Regional Council) are presently being run by a Government appointed commissioners. One of the reasons the Government has taken this move is to provide a clear path forward for water management in the Canterbury region. A 'Canterbury Water Management Strategy' has now been prepared, facilitated by the Canterbury Mayoral Forum. The strategy has been embraced by ECAN as a suitable way forward. The Canterbury Natural Resources Regional Plan is a parallel process that ECAN must progress that set environmental flows in a number of Canterbury rivers. As the strategy matures and the recommendations of stakeholders in various district committees are presented to be enacted the impact of their decisions on EA Networks will be considered.

If the underlying assumptions about water availability and portability were changed by ECAN, it could result in another surge of irrigation demand in areas currently assumed to be fully electrically serviced for available irrigation demand. Until there is additional clarity about the nature of any changes, future load estimates will assume there are no material changes to the availability of ground water (as presently constrained by ECAN) caused by the regulatory environment.

A recent ECAN commissioner decision appears to have liberated additional ground water for use by 49 applicants in an area to the northwest of Ashburton township. The nature of the ruling does not easily allow an accurate assessment of the likely additional electrical load that will result. A crude assessment based on published data would suggest about 3.5 MW of additional pumping load distributed over a wide area.

The ECAN Water Regional Plan, Plan Change 2 has been advertised in February 2016. This plan change has placed restrictions on further intensification of irrigation to address the over-allocation of water resources and nutrients in the Hinds/Hekeao Plains Area. This will be achieved through limits on nitrate levels in groundwater and nitrogen leaching from land areas. The outcome of this variation is that additional irrigation development south of the Ashburton River is very limited.

### **Economic Uncertainty**

Economic activity is difficult to predict accurately over a period of 10 years, and this will have consequential effect on electricity demand. Likewise, factors such as population, price of electricity and the effect of other fuels are uncertain over this period.

The global and national economies are currently at a low ebb. How this affects the primary industries that EA Networks' peak load is driven by is uncertain. It is possible that existing load will continue to operate but the connection of new load may be delayed or cancelled. To some degree the estimated load forecast takes this downturn into account, the projected load forecast does not. It has been observed that while inquiries for new irrigation and dairy sheds dropped significantly in late 2009 into early 2010 they have since recovered but not to pre-2009 levels. There is still interest in dairy conversion in the rural community and the perceived constraints at this time are the availability of finance, milk fat price, and water availability.

Over time, the electricity used per unit of production will change, and automation may result in electricity replacing labour. The extent to which this will happen over the next decade is hard to predict.

Similarly, there may be improvements in energy efficiency, so that over time energy requirements (per unit of production) may diminish. This will not necessarily reduce electricity consumption, as in many instances efficient use of electricity may be a better use of fossil fuel resources than their direct use. Energy efficiency measures can also see a rise in peak demand while lowering average demand.

### **Demand Structure**

The characteristics of the various classes of load; domestic, commercial, irrigation and industrial are quite different. In particular, domestic consumption has a low daily load factor and is a major contributor to system peaks (despite the use of water heating load control). Irrigation has a high daily load factor during summer but a low annual load factor. The base load varies from commercial/domestic heating in the

winter to industrial/irrigation load in the summer. Tariff structures reflect these load characteristics and allocate cost where it falls but this does not necessarily materially affect the behaviour of consumers.

Recent irrigation scheme changes have provided farmers with the option to purchase the right to use water from piped schemes that deliver pressurised water onto the farm. These schemes are providing both new water resources as well as converting existing open race schemes to piped schemes. The impact of these changes on actual and future electrical demand has been complex. Where the farmer has not had access to water previously or used flood irrigation, these schemes have had little impact on connected irrigation demand. There is likely to be some additional demand from farms that convert to dairy production as a consequence of new irrigation with new dairy sheds being developed. A significant number of farms that have signed up for pressurised water delivery already have either deep well irrigation plants or surface water pumping systems. These farmers are retaining their deep well electrical pumping facilities on alternative tariffs to provide high reliability irrigation during periods of restrictions on the piped scheme water sources. A consequence is that the electrical load is no longer identifiable as an irrigation pump – merely as a business rate load that is unlikely to be used most years. This latent demand is a big risk for the EA Networks network as it can be simultaneously activated after being dormant for many years - potentially overloading assets that were historically adequately sized. Consideration is being given to a method to retain historic pump information against the ICP to guard against the possibility of unexpected overloading by 'hidden' load.

A major impact looming on the horizon is that of electric vehicles. The energy and demand impacts of widespread use of home charged electric vehicles are enormous. The small vehicles currently being introduced to the market are useful city cars with enough range for a daily commute. The smallest battery pack on these electric cars has a capacity of 16 kWh. The specified recharging time is 7 hours from a standard 10 amp socket. At almost 100% efficiency that represents 2.3 kW of demand per vehicle. As car and battery technology advances it can only be assumed that much larger vehicles with improved range and performance will be developed. A vehicle/battery with 50 or even 100 kWh is likely and the consumer will expect to be able to recharge this overnight at home or substantially more quickly at dedicated recharging facilities. A household is likely to have more than one vehicle. Considerable thought needs to go into the way electric vehicles will be integrated into both the national and local infrastructure that presently adequately serves the existing load. At this stage, no specific allowance has been made for the additional demand electric vehicles would place on the EA Networks network, other than providing a path for urban network reinforcement should that be necessary.

The Canterbury Regional Council (ECAN) has introduced clean air requirements for solid fuel space heaters. This strategy is aimed at reducing the quantity of airborne pollution, particularly that caused by domestic solid fuel heaters. The requirements have seen additional electrical heating demand come on to the residential portions of the EA Networks network and the majority of the appliances are inverter style heat pumps. The impact on the peak demand has not been considerable and may be offset to some degree by the new heat pumps displacing resistive heating in homes that would have used fan heating for initial comfort in the early evening or morning. No specific allowance has been made for the impact of the clean air strategy but significant numbers of heat pumps have been installed in recent years (prior to the clean heat strategy) and the rate of winter load growth reflects this. The possibility of these heat pumps being used for cooling during times of peak demand in summer is of more consequence to overall system demand and this will be monitored.

### **Diversity**

Peak demands for different supply points do not necessarily occur simultaneously. The natural diversity among loads can be used to advantage. Since a zone substation MD (Maximum Demand) will be less than the sum of individual distribution substation MD's served from it, the major distribution elements can be designed to a smaller capacity than the sum of individual consumer connections. Similarly, the expected system demand for EA Networks and each GXP (Transpower Grid Exit Point) will be less than the corresponding sum of the zone substation totals.

Diversity can also work against the Asset Manager. The diversity in the connected irrigation load EA Networks has varies considerably with the weather. During a season with average rainfall, the diversity is average. When the season is particularly dry (every five years or so), there is minimal diversity and all pumps that can be operated are. This can cause a false sense of security for the Asset Manager during the preceding four years and may have implications for emergency capacity.

### **Distributed Generation**

Distributed generation has the potential to reduce the peak demand EA Networks impose on the Transpower grid. It must however be of such a scale and be sufficiently reliable (both mechanically/electrically and with its source of fuel) to guarantee that EA Networks can avoid investment in major system components while retaining the appropriate level of security to service load. If the distributed generation was for example wind powered, a calm summer day during a dry year would cause peak demand on the EA Networks network, but none of the wind turbines would be generating because of lack of wind. The Highbank hydro power station is another example that generates only during winter (off-peak for EA Networks, but presently during the period of peak regional demand that Transpower charges for). Only distributed generation with very high availability, some form of fuel storage (for generation on-demand) or a diverse range of independent fuel sources will offset the need for network investment.

The estimated future network demands have not allowed for the existing distributed generation plants (Barrhill – 0.5MW, Cleardale – 1.0MW, Montalto - 1.6MW and Highbank - 26MW) to be operating. The nature of the plants (single penstock, run of the river, single turbine) means that they can be (and sometimes are) unavailable at peak times. In terms of energy, the existing embedded generators are predicted to supply about 14% of the 698 GWh to be delivered to consumers during the 2015-16 year.

A range of generation proposals have been discussed in recent years. Most of the projects are still commercially sensitive. [Section 5.3.12](#) has details of the type and scale of these potential developments. None of these projects are sufficiently mature and/or large to be included in the load estimates although some of them could have a meaningful effect on substation and system demand should they proceed. Once firm details are available, the impact on peak load will be assessed and included in the demand estimates.

Photovoltaic solar panels have been installed on a number of residential and small business premises (more than 100 installations as of January 2016). The distributed nature of these installations and the modest output has not caused any measurable impact on the distribution network. One installation has highlighted the small size of LV lines connecting it to the distribution transformer, but the remainder are operating without any negative impact.

### **Demand Management**

The only form of direct demand management currently in place is that of ripple control of hot water and night storage heating facilities. Indirect demand management by signalling of price is accomplished by a tariff structure that makes night energy cheaper than day energy. EA Networks do not have in place any dynamic signalling of demand peaks to consumers. There are currently no plans to implement dynamic demand signalling to individual consumers.

Future demand management would certainly be imposed on electric vehicle recharging.

During 2014 there were a range of network security options placed before the Board for consideration. One of the options discussed was contingency load management. This would require that certain types of load be automatically interrupted during faults. Restoration of this load would then be done by remote control (either feeder by feeder or over larger areas - depending on the type of fault). This action would, under many circumstances, allow the remaining connected loads to be supplied via un-faulted network paths while the fault is repaired. Contingency load management could be an appropriate response to a low likelihood high impact event such as a zone substation transformer failure. Well managed, contingency load control could provide capacity for all essential load and share the remaining capacity in an equitable manner. This would not be possible if the larger, non-critical, interrupted loads remained connected. No immediate commitment was made and future plans will disclose the results of any Board decisions.

In the set of forecasts that follow, no specific allowance has been made for intangible factors, other than in line with historical trends. Increasingly, it may be possible to control load so that appropriate action can be planned ahead. Thus, for example, as a particular subtransmission circuit approaches capacity, it may be preferable to improve the efficiency of utilisation in the area rather than immediately increase capacity.

## **5.2.4 Future Load Projections**

Statistical forecasts have been developed and are prepared on a "high", "medium" and "low" basis. All




things being equal, the "medium" figures would be the expected projected forecast. There is a small chance that demand will exceed the "high" figures, and an equally small chance that they will be less than the "low". These uncertainties are subjective, but reflect uncertainties in population, price of electricity, economic activity and the intensity of use of electricity in industry. They are simply bands of uncertainty around a statistical projection of historical data.

Forecasts of estimated maximum demand indicate a medium 10-year growth averaging less than 1% p.a. in summer ADMD (After Diversity Maximum Demand). This is a lot lower than the average of the last ten years. Winter ADMD is predicted to grow at about 1.6%.

[Appendix C](#) contains additional data used to derive this forecast plus the estimated individual zone substation maximum demands for the next ten years.

The estimated growth in individual zone substation loads is a subjective process in that it relies on the opinions of a range of people who are knowledgeable within the various industries that contribute to the majority of electrical demand in the Ashburton district. For irrigation, localised trends are prepared for each zone substation and incorporated in the future load figures. A recent report prepared for Transpower has provided some additional estimates of future irrigation load and these have been considered when preparing our own estimates. Other industries contribute likely step load increases and these are allocated individually to zone substations at the expected load commissioning date. Residential and general supplies are trended in percentage growth terms and this is seen as acceptable, bearing in mind the difficulty in alternative models and the relatively low impact of this growth on the total peak loads (particularly at subtransmission levels).

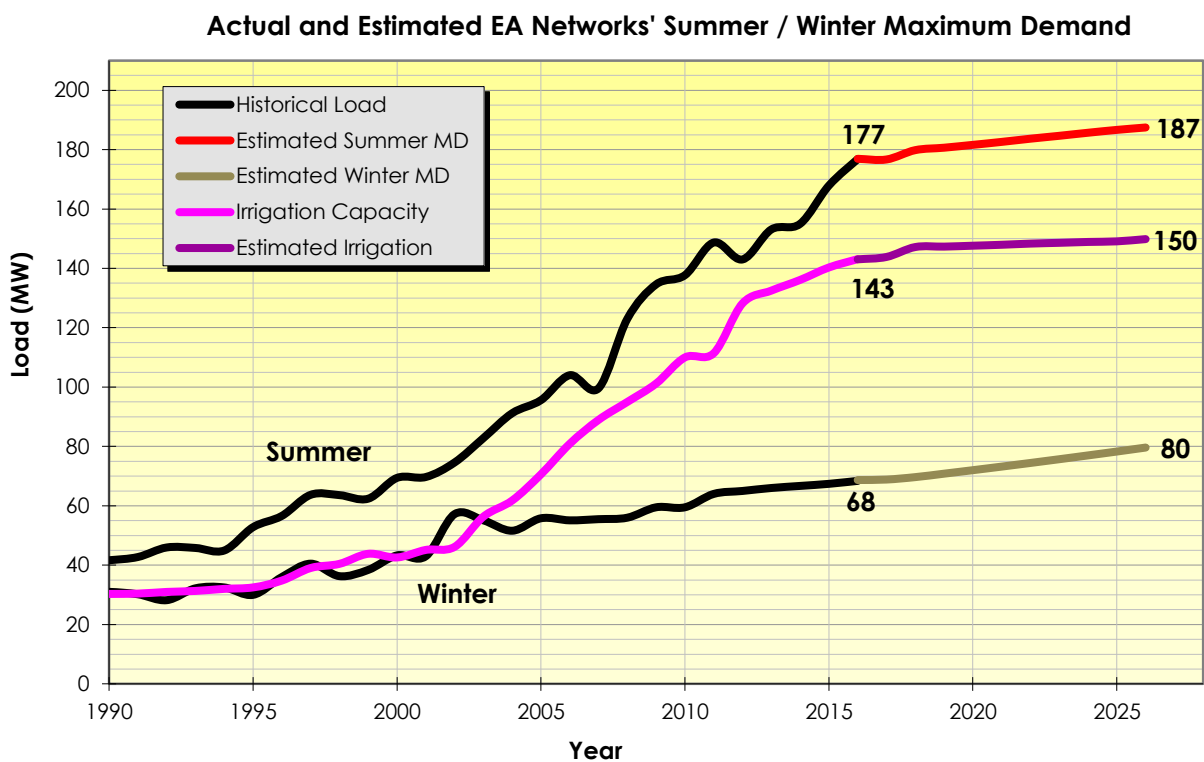


Some additional estimates of maximum regional irrigation demand were provided in the "Canterbury Irrigation Peak Electrical Load" report. The estimates for the total irrigation demand on the EA Networks network varied between 114.4 MW to 167.4 MW depending upon the assumptions made. The highest value assumed intensive irrigation of all available area including large portions of the high country basins. This would appear to be highly unlikely at the energy densities assumed in the report. EA Networks have used a similar technique for estimating system wide demand in the past but the sensitivity to assumed energy intensity is so great that it is only broad quantitative indicator rather than a precise forecasting tool. EA Networks' estimate of complete consentable district irrigation using existing demand density is around 146 MW although the uncertainty surrounding this is likely to be at least  $\pm 10\%$ . The estimated irrigation load of 158 MW in 2025 contained in the report is within this band of uncertainty. The lower regional load estimate of 114.4 MW is actually a considerable reduction in load caused by increased use of gravity pressurised pipe schemes. Several of these schemes have been installed in recent years and appear to be

successful. Where they are converting an existing open-race scheme to pipes, the electrical demand of surface spray irrigators is eliminated. When a new scheme is introduced using newly consented water (or water is conserved by piping) some deep well pumps are only used as dry year backup when the surface water supply may be restricted. The potential demand still exists but is not expressed during 'normal' years. If a new piped scheme proves to be reliable, the deep well consents may be sold to other interests within the same aquifer zone - shifting the electrical demand on the EA Networks network.

Growth at these estimated rates will still require development work on the EA Networks network in order to accommodate the load while continuing to meet the security standards.

The forecasts of projected maximum demand (statistically extrapolated at  $-3/4\%$ ,  $0\%$ , and  $+3/4\%$  of historical growth trends) indicate a 10-year summer growth averaging  $5.1\%$  p.a. in ADMD (After Diversity Maximum Demand). Winter ADMD is predicted to grow at a lower rate of about  $1.6\%$  p.a. This data is presented in the diagram below.

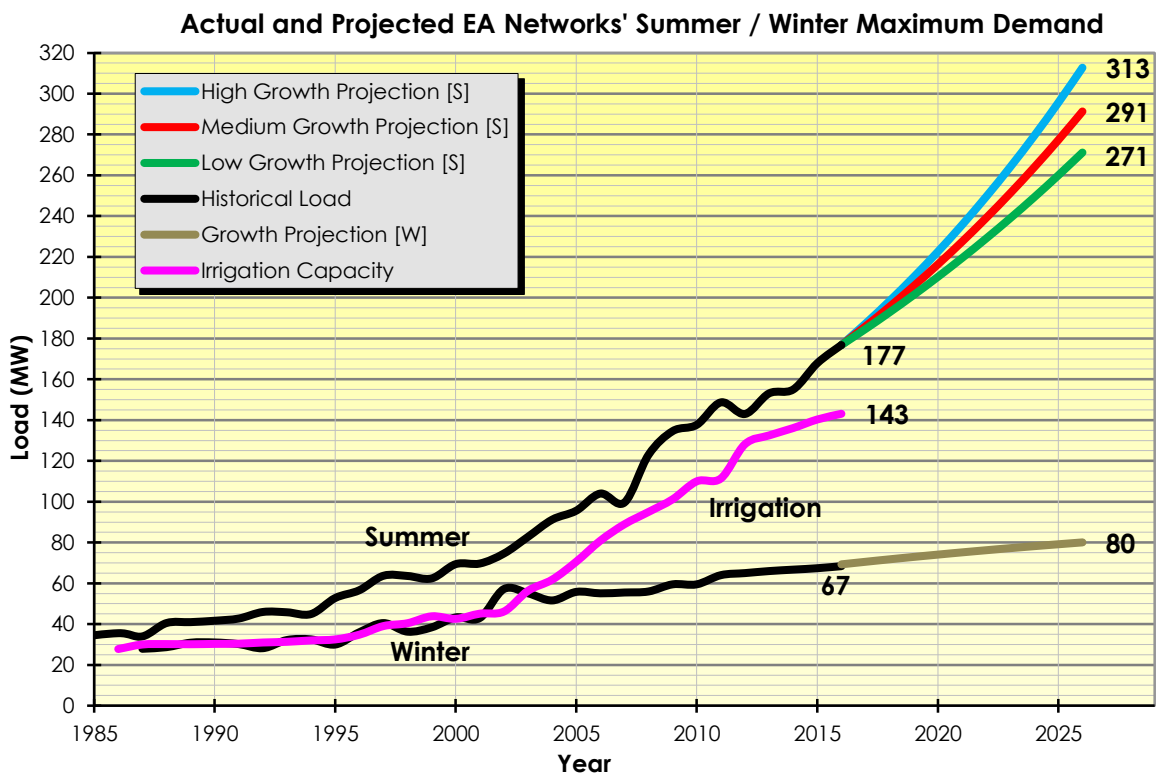

These load projections are looking hopelessly unrealistic now that gravity pressurised irrigation schemes are proving successful and levels of water availability are becoming more definitive. Water storage is the pervading sentiment as the way to advance irrigation water availability in the Canterbury region. Winter load growth is at a rate comparable with other urban networks.

Winter peak demand growth is constrained by regional load control strategies and the growth of uncontrolled load such as heat pumps. It is possible that widespread uptake of electric vehicles could potentially change the estimated/projected peak winter demand (increased demand) as could additional distributed generation (decreased demand). The scope for decreasing demand across significant parts of the network (thereby decreasing demand on upstream assets) depends on the location and scale of any distributed generation. Energy efficiency may slow the growth rate over time.

### 5.3 Network Level Development

All of the following network level developments provide energy efficiency benefits. By utilising the correct voltage and larger or more numerous conductors/cables the energy efficiency of the network is measurably higher. Although the primary reason for doing the developments was not energy efficiency it was certainly one of the influencing factors.

### 5.3.1 66kV Subtransmission

During the mid to late 1990s the EA Networks 33kV subtransmission network was showing its age. The incessant growth in irrigation had caused parts of the network to sag to 30kV with all circuits in service. This surge in demand caused large energy losses and meant there was zero security should a 33kV line fault occur. Some zone substation transformers were also operating on maximum boost tap. It was obviously time to reconsider the subtransmission development at EA Networks. The peak load at this time was a little over 60MW.

A range of options were investigated including the following:

- **More than one new 33kV GXP from Transpower**

Although the option of additional GXPs from Transpower was viable, the risk was that the load would grow to the extent that even three GXPs may not provide sufficient subtransmission capability without having to build many more large 33kV lines. The security of each GXP was also an issue. Each GXP would require at least two transformers to prevent loss of supply if one faulted. If one GXP was used only two transformers of appropriate size would be required (or three once the load grew even further). The poor flexibility and cost-effectiveness of this approach and its limited capacity at a distance (33kV volt drop) caused it to be discarded.

- **Many additional 33kV lines**

The single 33kV GXP with many new 33kV lines radiating from it was soon ascertained to be impractical. Analysis of the distances from the GXP and size of loads that needed serving soon showed that the number of 33kV lines required would occupy almost every roadside for many kilometres from the GXP. The absolute capability of this approach was also very poor. This option was discarded as impractical and poor value for money.

- **Migration to 66kV**

The option of using 66kV as a subtransmission voltage was immediately appealing. The ability to supply the scale of loads EA Networks were anticipating would occur and the distance from the GXP they would occur at was a good match. The techniques used to construct 66kV lines was similar to those used at 33kV so EA Networks personnel could build and maintain them without major reskilling or retooling. The cost of major components for 66kV were only 15-20% more costly than 33kV items. In some cases the cost was virtually the same. The increase in capacity was almost 400% for the voltage constrained parts of the network. 66kV appeared to be a very viable option as a solution to the subtransmission capacity constraints at EA Networks.

- **Migration to 110kV**

110kV substations and lines are considered to be a true transmission voltage (as opposed to 33kV and 66kV which are considered as subtransmission voltages). It soon became apparent that it would be much more costly to use 110kV subtransmission as the equipment costs were beginning to rise considerably above 66kV equipment. The scale of line construction was also right at the limits of the capability of EA Networks machinery which meant that construction and maintenance may in some cases need to be outsourced (not necessarily a problem, but an emergency response is several hours delayed as a result). The capacity that 110kV offered was also well in excess of the forecast need on the EA Networks subtransmission network (at the time, one 110kV circuit would have supplied the entire EA Networks load). The solution was viable technically and was very appealing from a capacity perspective but could not really be justified as the excess capacity would potentially be unused for several decades.

So, the options (including approximate costs) were presented to the Board for discussion and it concluded with a request to provide an estimate of cost for a conversion of a significant portion of the 33kV subtransmission network to 66kV. A project to solve the immediate 33kV problem with 66kV operation was approved. Once that commitment had been made, the Asset Management Plan became the vehicle to communicate future subtransmission plans to the Board. In subsequent years, as the pace of irrigation load growth accelerated even further, the Board further endorsed the principle that the future of the subtransmission network was with 66kV. In future, if the 66kV subtransmission system begins to reach its limits, a second 66kV GXP would provide immediate and on-going relief.

### 5.3.2 22kV Rural Distribution

The late 1980s had already seen significant irrigation load growth occurring on the EA Networks distribution network. This was putting the 11kV distribution voltage under stress in a number of places on the network. Energy losses were high and power factor was dropping (high kVAR losses in the reactive overhead lines). In some cases the measured distribution voltage was as low as 10.3 kV (minus 6.5%) which made motor starting and running very difficult and the voltage range consumers were experiencing was exceeding the standard range that EA Networks had prescribed as acceptable. In some cases, attempting to start one motor would stop an adjacent one. The 11kV fault levels were becoming inadequate for the increasing size of individual loads being supplied.

A solution to this issue was required. Forecast load growth was increasing and these voltage regulation issues were going to be very widespread if nothing was done. A range of potential solutions were considered including the following options that were analysed in detail:

- **11kV reconductoring**

The most obvious option was to increase the size of the conductor on the existing pole lines. In reality, this results in a relatively small incremental change in capacity as the existing poles can typically only double the area of conductor at best. So, a line carrying Mink conductor (75mm<sup>2</sup>) may be able to be restrung with Dog (120mm<sup>2</sup>) but this results in a 40% increase in capacity at best (if the entire line is restrung) with no further options for size increase without reconstructing the entire line with stronger poles (expensive). The extent of the potential voltage problems were sufficiently widespread that a lot of restringing would have been required with a capacity increase ceiling at the conclusion. The restringing network would still have very limited back-feeding capacity at times of peak demand (distribution security levels would not increase appreciably). The distribution system fault levels would perceptibly increase with this solution but motor starting would still be limited in many cases. Although this option was certainly viable it was not the long-term solution that would solve the issues facing EA Networks. This solution was not preferred or recommended to the Board.

- **11kV regulators**

Another method of boosting voltage was the in-line voltage regulator. This is essentially a localised solution for maintaining voltage on a distribution feeder. It does not increase fault levels (in fact they slightly reduce) so motor starting is still difficult for larger loads. It is a relatively low risk option in that the regulator can be relocated if necessary or additional ones can be installed to further boost voltage. On the downside, system losses begin to increase and back-feeding through a regulator is not always straight-forward. The extent of distribution system reinforcement required would have involved the purchase of dozens of voltage regulators and this would essentially be solving one of the symptoms of an overloaded distribution network without solving the underlying problem. This solution was not preferred or recommended to the Board.


- **Additional zone substations**

An expensive but technically viable option would be to build additional zone substations between the existing ones thereby shortening the 11kV feeder length by approximately 50%. This has a number of technical advantages but is very costly. It doubles the number of 11kV feeders, each with half the number of consumers per feeder, which means any distribution fault only affects half the number of connections. The load per feeder is halved which solves the voltage drop issues and the fault level increases as a consequence of shorter line lengths from the 11kV source. It seems to be a good solution but the downside is certainly the cost and complexity of many more zone substations of half the size that would otherwise be required. A loss of load diversity means that each smaller zone substation would actually be more heavily loaded than 50% of the one that originally supplied the entire load. The fact that the 33kV network was showing signs of duress and that 66kV was already being contemplated as an option meant that the cost of building twice the number of new 66kV substations was not very appealing economically. This solution was not preferred or recommended to the Board.

- **22kV conversion**

Although the option of converting to 22kV seemed costly, in reality there was little waste in the exercise. The main costs are in reinsulating existing overhead lines (a relatively low cost (three insulators for most poles) and replacing the existing distribution transformers with 22kV units. The transformers can be reused on 11kV portions of the network or sold to other networks. In the worst case, the very old ones are scrapped. The overwhelming technical advantages of 22kV were plain to see. The percentage voltage


drop on the same conductor falls by 75% allowing 4 times the load for the same voltage drop as 11kV. The fault level also increases considerably and stays much higher over the entire feeder length. This allows much larger motors to be started without causing interference with neighbouring consumers. Existing poles and conductor could be retained and the only things needing replacement were the insulators, the fuses and switchgear, and any surge arrestors. The incremental cost of 22kV equipment over 11kV equipment varies from zero to at most 20% (overall 8%). In many cases the equipment is the same as it is not cost effective to manufacture both voltage classes of equipment. The source of 22kV could be provided by 11/22kV star connected autotransformers which maintained zero phase shift and allowed them to be moved along a feeder as conversion proceeded. This solution was recommended to the Board as a solution that could be applied where 11kV was likely to no longer be adequate for the loads being served.

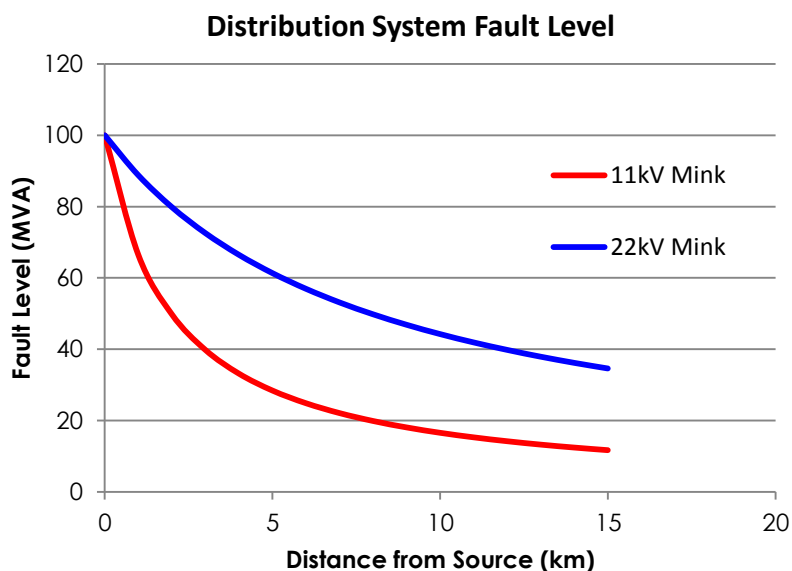

The Board were presented with the various options that had been considered and were content that 22kV conversion offered the best long-term value for money. It was pointed out that within a decade or so the subtransmission network and a portion of the rural distribution network could be renewed and the opportunity to migrate to what is generally accepted as the modern distribution voltage class of 24kV was one that should not be missed. The fact that the subtransmission voltage at the time was 33kV (only 50% higher than 22kV) tended to reinforce the notion that it too was under pressure.

Ultimately, the Board agreed that 22kV was the best choice overall for stakeholders where significant distribution system voltage regulation was an issue.

In hindsight, had the move to 22kV not occurred, the dramatic load growth that occurred from 2000 to 2010 would have overwhelmed the 11kV network and loads would have been turned away. This would not have been a good situation for the local or national economy. The combination of 66kV subtransmission and 22kV distribution seems to be close to the perfect match for the scale and distribution of loads presently on the EA Networks network.

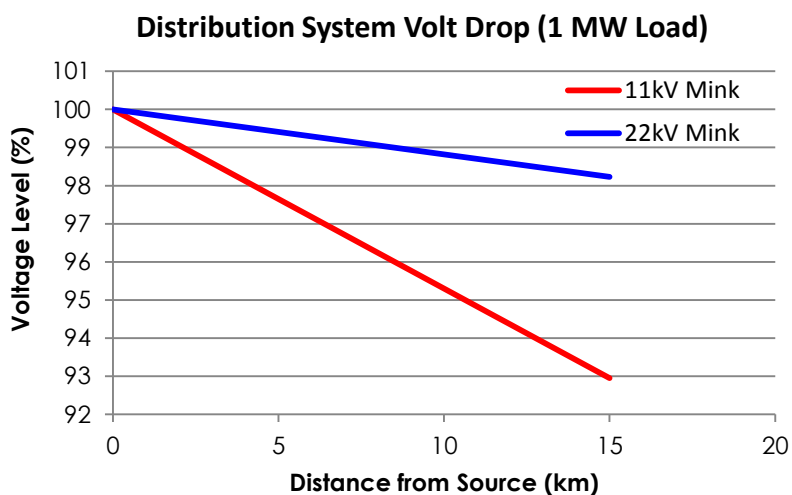

### 5.3.3 Urban Underground Conversion

As a cooperative company, the ownership structure of EA Networks encourages the Board to make decisions that are in the long-term best interests of the shareholders/consumers and other stakeholders that use or interact with EA Networks network. One of the areas that EA Networks Board have chosen to reinvest in the community that they serve (and where the vast majority of shareholders reside) is by continuing to convert end-of-life urban overhead lines to underground reticulation. The Board are well aware of the alternative, which is to rebuild the network as overhead lines. Overhead lines are certainly less costly but they provide very few of the other benefits of underground cables:

- Underground cables are immune to the frequent snow and wind storms that Mid-Canterbury

experiences. One such storm in the 1970s caused virtually every pole in Methven to fail and power was not restored for several weeks as a consequence.

- The safety of an underground system is several powers of magnitude greater than overhead lines due to its largely buried situation. The exposed nature of overhead lines (particularly in an urban area) is a significant risk and adverse weather, trees, vehicles, kites, fireworks, vandalism etc. can all place the urban dweller at greater risk of accessible or damaged overhead conductors.
- The capacity of an underground cable is typically much greater than the equivalent overhead line as it serves only half the number of consumers and is usually of greater cross section (lower voltage drop).
- The flexibility of interconnected underground cable systems normally means planned outages are very infrequent as the various parts of the network can be isolated without interrupting supply.
- The aesthetic benefits cannot be ignored. Residents are much more satisfied with underground reticulation.
- The reliability of underground networks is significantly higher than overhead networks, so the consumer has a better power quality and lower outage duration. When a fault does occur, restoration is typically much faster also.
- Energy losses are typically much lower in underground networks, largely as a result of the larger conductors and lighter loading of individual LV circuits.
- Fewer (but larger) distribution transformers are required (all of which are ground-mounted). This minimises the potential oil spill risk.

Feedback from consumers has shown that they are very satisfied with the continuing underground conversion programme. The Shareholders' Committee (the elected/appointed shareholder representatives) have also supported the urban underground conversion philosophy. In addition to the technical and service benefits, there are on-going political drivers. As a cooperative company the return to shareholders needs to be fairly distributed and with considerable investment in the rural area to support irrigation and farming generally, there needs to be a counterbalance for the urban consumer/shareholders. All conversion programs are driven by the need to replace existing overhead lines owing to diminished capabilities and condition.

An underground conversion programme has now been included in the plan which provides for the removal of all distribution voltage power poles from the townships within the Ashburton District. The programme identifies projects by specific streets. These projects are based upon assessed overhead line condition and the timing of the replacement with underground cable is scheduled to ensure the risk of pole failure before conversion is acceptably low.

### 5.3.4 Core Urban 11kV Network

A recent revision in the EA Networks "Reliability by Design" guidelines has put greater emphasis on the number of consumers supplied from (or affected by) any particular electrical asset. Of particular importance is the number of consumers supplied from a zone substation feeder circuit breaker. Currently, there are a number of individual urban 11kV feeders supplying more than 1,000 consumers each. As of 2016, a 1,000 consumer feeder represents more than 5% of the total EA Networks consumer count. A fault causing this circuit breaker to operate will rapidly impact on the reliability measures such as SAIDI and SAIFI as well as inconvenience 1,000 households or businesses.

The Ashburton urban area has about 9,000 consumers supplied from two zone substations. The two substations have about 26 existing or potential 11kV feeders. This is an average of more than 340 consumers per feeder. To bring this down to the design guideline of 200 consumers would require another 19 feeders (a total of 45 feeders).


In order to comply with the new guidelines on maximum number of consumers per feeder, there are several possible approaches.

- (1) **Nineteen additional 11kV feeders from existing zone substations.** Although this is possible it is particularly asset intensive. New switchboards are required and cabling will have to be installed and extended to a location in the existing network where it can create new smaller feeders. The new switchboards will require enlarged or additional buildings on the zone substation sites and this may

involve obtaining additional land which could be a difficult prospect in an urban setting. This option is not the preferred option.

- (2) **Two new zone substations in urban locations distant from Ashburton and Northtown zone substations.** This is also possible, but even more asset intensive than option (1). This would require two new sites, at least four new transformers, new buildings, switchboards, protection and supporting infrastructure. New 11kV cables would also need to be run from the new sites to integrate with existing 11kV cabling forming the 19 new feeders. Initial estimates place the cost of this option at several times that of the other options with no particular benefits other than a doubling of the already adequate total 11kV infeed capacity. This option is not the preferred option.
- (3) **An additional layer of high capacity 11kV distribution.** This option involves a new network of core 11kV circuits that do not directly connect to distribution transformers. The core 11kV would be a transport level only. An 11kV circuit breaker switchboard at a network centre or zone substation would provide the termination point for each end of a core 11kV circuit. Core 11kV circuits will form closed rings (the core circuits operating in parallel) between network centres and zone substations. Several new (or repurposed existing) circuit breakers would be required at each existing zone substation. The initial assessment of Ashburton and Northtown substations suggests there are sufficient circuit breakers to fulfil the requirements. New network centres would need to be constructed at various locations in the urban area and obtaining land for these may be an issue. Each network centre would have at least two core circuits terminating at it and between three and five lower capacity 11kV feeders radiating from it. After consideration, this solution was chosen as the preferred option.

This diagram gives some idea of the core 11kV network concept. The bold black lines are the high capacity circuits. The grey lines are the low capacity feeders. The orange objects are network centres. The larger circles are circuit breakers. The smaller green circles are open RMU switches at distribution substations.

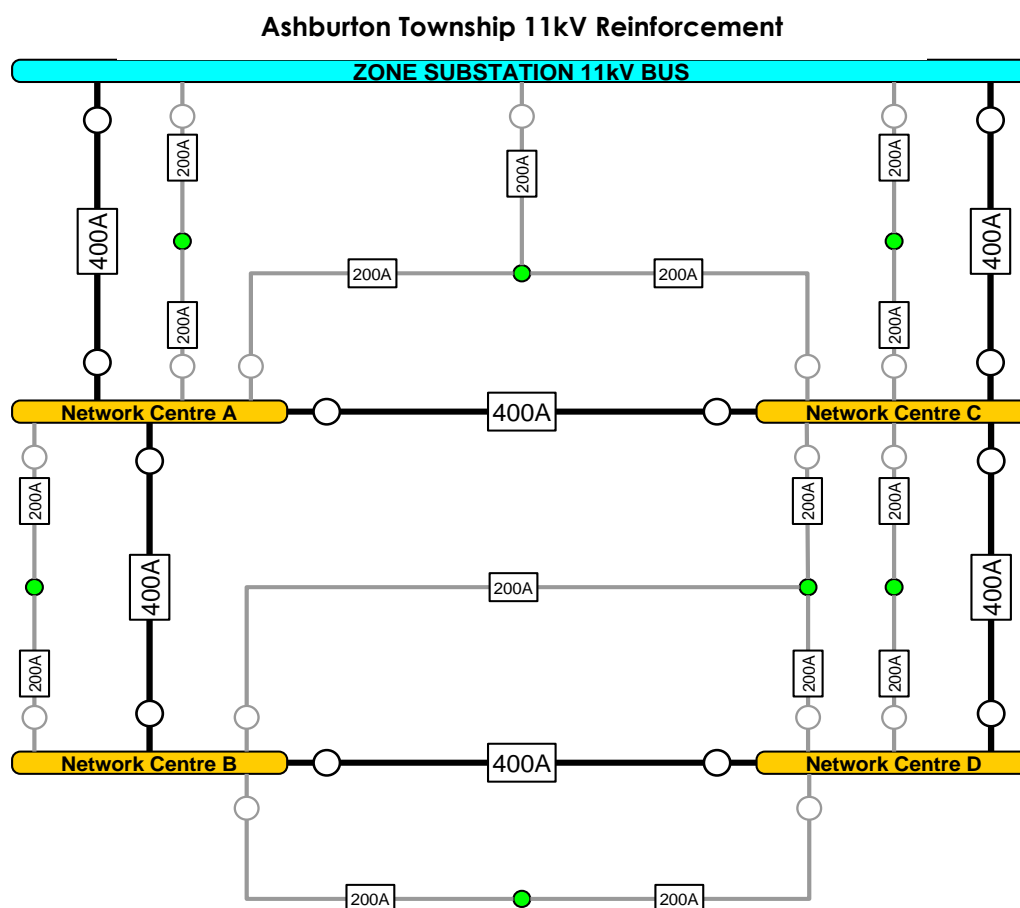

The scale of this core network development is significant. It will involve a number of years of work to fully implement and a commitment is needed to continue the work to completion. Partial implementation would not achieve the desired improvements and could make the impact of some faults more extensive.

Previous Asset Management Plans had allowed a programme to cover this work (named “Ashburton UG works to reinforce distribution”) starting in 2017 and continuing until at least 2023. The initial stage of this programme is to secure sites for network centres and establish them. Once that has been done new core and feeder cables can be terminated via the switchboards and used - albeit initially not in a fully secure core network configuration.

## 5.4 Strategic Plans by Asset

Once the rate of growth has been predicted and assumptions have been made about the location of the additional load, decisions must be made on how to accommodate it on the network. This section identifies each major voltage level and functional grouping and then goes on to describe what impact the additional load will have and what changes will be necessary to cater for it.

Please note that the [10045] type reference in each project title is the project code for reference to financial detail in [Appendix B](#). Project costs can be seen in [Appendix B](#) - referenced by the year and project code. A year in [red] indicates that the project has unexpectedly carried over from the previous year without budget allowance.

### 5.4.1 Transpower Grid Exit Points

EA Networks have two grid exit points (GXP) that are geographically at the same Transpower Substation - a site approximately 7km south-east of Ashburton township. Transpower call this substation Ashburton Substation but for clarity (EA Networks also have an Ashburton Substation in Ashburton township), it is known as Ashburton220 (220kV is the highest voltage on Transpower’s Ashburton site).

Ashburton220 provides EA Networks with a 33kV GXP as well as a 66kV GXP. Immediately adjacent to Ashburton220 is an EA Networks substation called Elgin. This provides two major functions. Firstly, it takes the three 66kV supplies from Transpower and splits them into the individual circuits that form the 66kV subtransmission network. Secondly, it provides a (normally open) link between the 33kV GXP and the 66kV GXP in the form of a 60 MVA autotransformer. This autotransformer currently allows a 33kV ripple injection plant to serve the 66kV network.

The capacity and configuration of the Ashburton220 substation largely determines the security and reliability of the GXPs at that site. It is the responsibility of EA Networks to plan the configuration of those GXPs and the way the connections to GXPs are made in order to promote high performance and good value. The cost of Transpower assets that are dedicated to supplying EA Networks are passed on to EA Networks in the form of an annual charge that reflects a rate of return and some assessment of maintenance requirements. This charge is in turn passed on to the consumers that use the EA Networks network.

The existing arrangement meets the security standards at peak load times and for the foreseeable future. The addition of a third 220/66kV transformer during 2013-14 enabled full security policy compliance. The total 2015 summer maximum demand of 177 MW is within the new firm site 66kV GXP capacity of 220 MVA. The 33kV GXP firm capacity exceeds the 33kV maximum demand. By 2019 the 33kV GXP will be relinquished, as all load will have been transferred to the 66kV GXP.

### Capacity of New Equipment

The security standards effectively set the requirements for immediate capacity and security ([section 2.5.3](#)). The margin allowed for growth is the only parameter that is not predetermined by the security standard. The prospective staged transfer of load from the 33kV GXP to the 66kV GXP will require consideration as will the load forecast detailed in this plan. The marginal cost of additional capacity now versus the cost at a later date will also need to be evaluated. For example, it is cheaper to obtain a single 120 MVA transformer now than a 100 MVA unit now and a 20 MVA unit in 5 years' time once the value of combined transformers and additional ancillary equipment such as protection, circuit-breakers and civil works is added to the installed cost. As there is only one site containing two GXPs (which will be one GXP in the medium term and then probably two geographically distinct GXPs in the longer term) the capacity needs have been considered and a third 120 MVA 220/66kV transformer (T9) was installed during 2014. If a proposal for contingency load management is viable and approved by the Board the need for a second GXP may be delayed for some time (until the combination of risk and consequence become unacceptable).



## Projects & Programmes


### 80004 [2025] ASB GXP Capacity Increase (GXP2 - Stage 3) – System Growth

The 220kV bussing project that Transpower completed several years ago forced a rapid decision on the 220kV bus configuration for all of the transformers supplying EA Networks. The conclusion that was reached is that each transformer required a separate 220kV bus section to prevent capacity limitations (caused by multiple transformer outages) during planned or unplanned bus (or other equipment) outages. The site redesign has accommodated this requirement and each transformer is now connected to a separate section of 220kV bus which is electrically distinct from the other transformers.

Having connected a third 220/66kV GXP transformer (T9) and implemented a 3 section 66kV ring bus, the 66kV GXP and Elgin site now meet current security requirements. It is unlikely that further development will occur at this GXP as the routes leaving the site are fully occupied with 66kV lines and these lines are loaded at near capacity during n-1 events.

The trigger point for a second geographically distinct 66kV GXP is still being considered and a realistic case of 2025 has been included. There are many factors that need consideration including; GXP loading, GXP/network security, new GXP lead time, 220kV capacity, 66kV subtransmission constraints, practical GXP sites, and new GXP cost compared to alternatives. The biggest factor for triggering the need for a second GXP is load growth and the associated load security. At this point in time it is unlikely that significant irrigation load growth will continue. Many factors are influencing this and EA Networks will continue to improve the background information and modelling on irrigation density, economics, options, and any possible new generation that could tie in with water distribution schemes.

### Elgin 66kV Bus Configuration

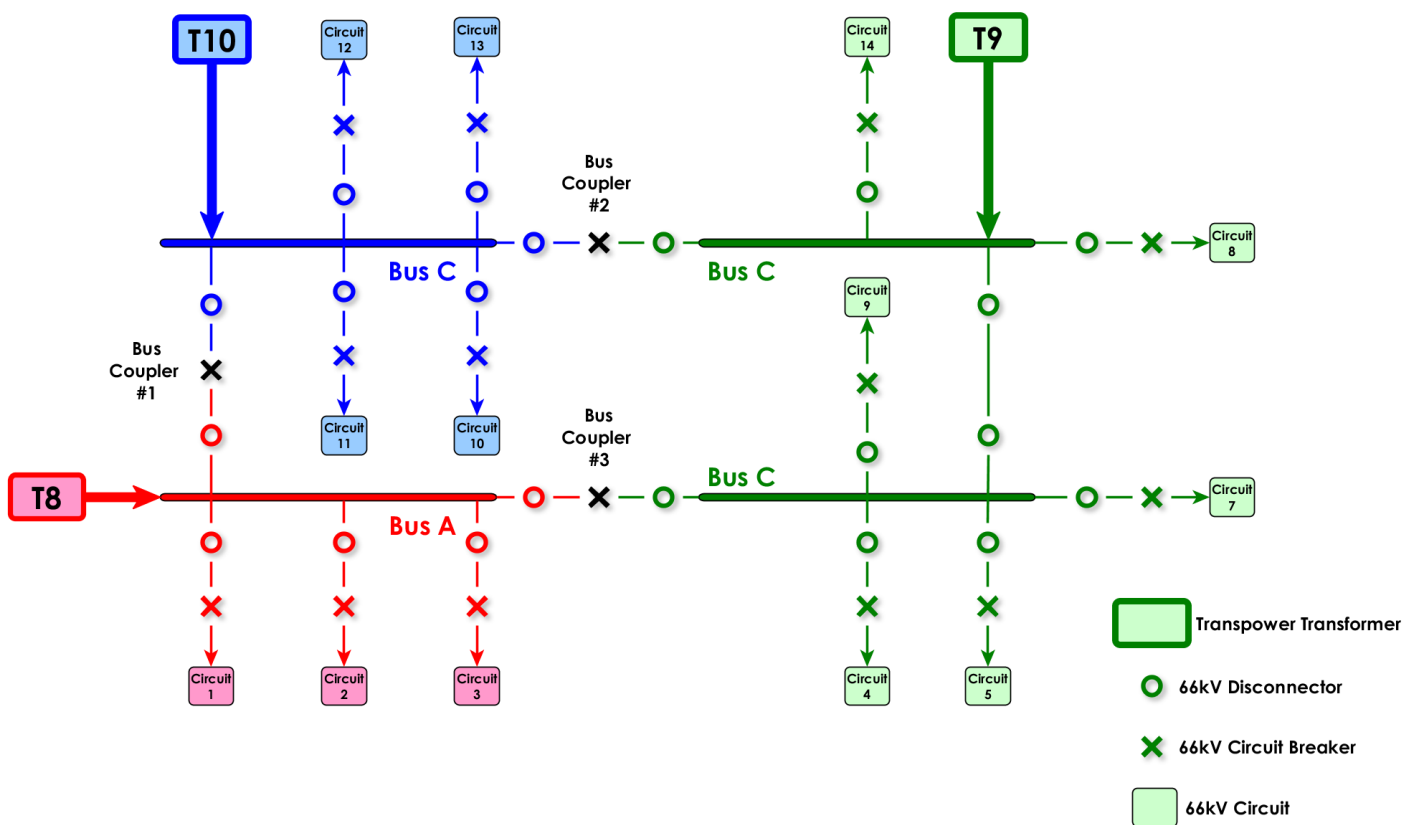

Once a consensus is reached on the new GXP trigger point it will be documented in a future plan. The 'likely' date has been placed in the current plan from a timing perspective.

Stage	Possible Timescale (years)	Possible Configuration
1	Exists	The existing 60/100 MVA 220/66kV transformer (T8), 60/120 MVA 220/66kV transformer (T10), and 60/120 MVA 220/66kV transformer (T9) working in parallel. The two existing 50 MVA 220/33kV transformers also working in parallel. 33kV bus firm capacity – 50 MVA. 66kV bus firm capacity – 220 MVA minimum.
2	3-4	Transfer all load to the 66kV GXP and relinquish both of the 50 MVA 220/33kV units. 66kV bus firm capacity – 220 MVA.
3	8-10+	Once load approaches 185+ MW (195 MVA), develop a separate 66kV GXP on a different site to diversify risk and lower 66kV subtransmission losses. This stage may involve relocation of one of the three transformers from Ashburton GXP and installing a new unit to pair it with at the new GXP. This would provide a firm capacity of 120 MVA at each GXP with a total (fast switched) firm capacity of 340 MVA over both GXPs. Project [80004].


## 5.4.2 Subtransmission Network

The 66kV subtransmission network is becoming the backbone of the EA Networks network (more than 80% of the peak load is on it). The capabilities of a 66kV network are in keeping with the scale of loads that EA Networks serve. All EA Networks load is presently supplied from a single Transpower substation. Thermally, the same conductor offers twice the capacity at 66kV than at 33kV. If voltage drop is the limiting factor, the same conductor running at 66kV offers approximately a four-fold increase in carrying capacity over a 33kV operating voltage. At 66kV, the subtransmission network capacity is thermally limited in some sections close to the GXP and generally voltage limited in other sections more remote from the GXP. The 33kV network has served well with the loads that are presently imposed upon it. Thermal limitations exist on the 33kV lines supplying Ashburton. It is important to consider the amount of prior planning that has been incorporated into the majority of subtransmission development projects that are included in this plan. Rather than making an attempt to exhaustively justify the choice of the particular solution for each project, the reader is reminded that the scope and scale of the 66kV strategy was researched, justified and authorised at an early stage and documented in internal reports predating the first EA Networks Asset Management Plan. The vast majority of the subtransmission and zone substation projects are simply jigsaw pieces that are used to complete the big picture that EA Networks are committed to. Having said that, the migration of all load to the 66kV network will be determined by a combination of load growth, security, and limited 33kV line capacity. If the anticipated load growth does not occur, it is likely that some of the projects identified in this section will not proceed or will be heavily modified to reflect the changed circumstances.


### Capacity of New Equipment

The capacity of any new subtransmission line is determined by a combination of required mechanical strength, thermal rating constraints and voltage drop considerations. The specification of these parameters is as follows:

For all foreseeable n-1 contingencies the thermal rating of any subtransmission line must not be continuously exceeded and the voltage at any point on the subtransmission network must not drop below 90% of its nominal value. A load considered to be probable 10 years into the future will be applied to a model of the entire subtransmission network (as it is planned to be in 10 years into the future) to measure compliance with these parameters. The mechanical strength of all subtransmission lines will be such that it adequately resists all reasonable environmental influences for the duration of its life.

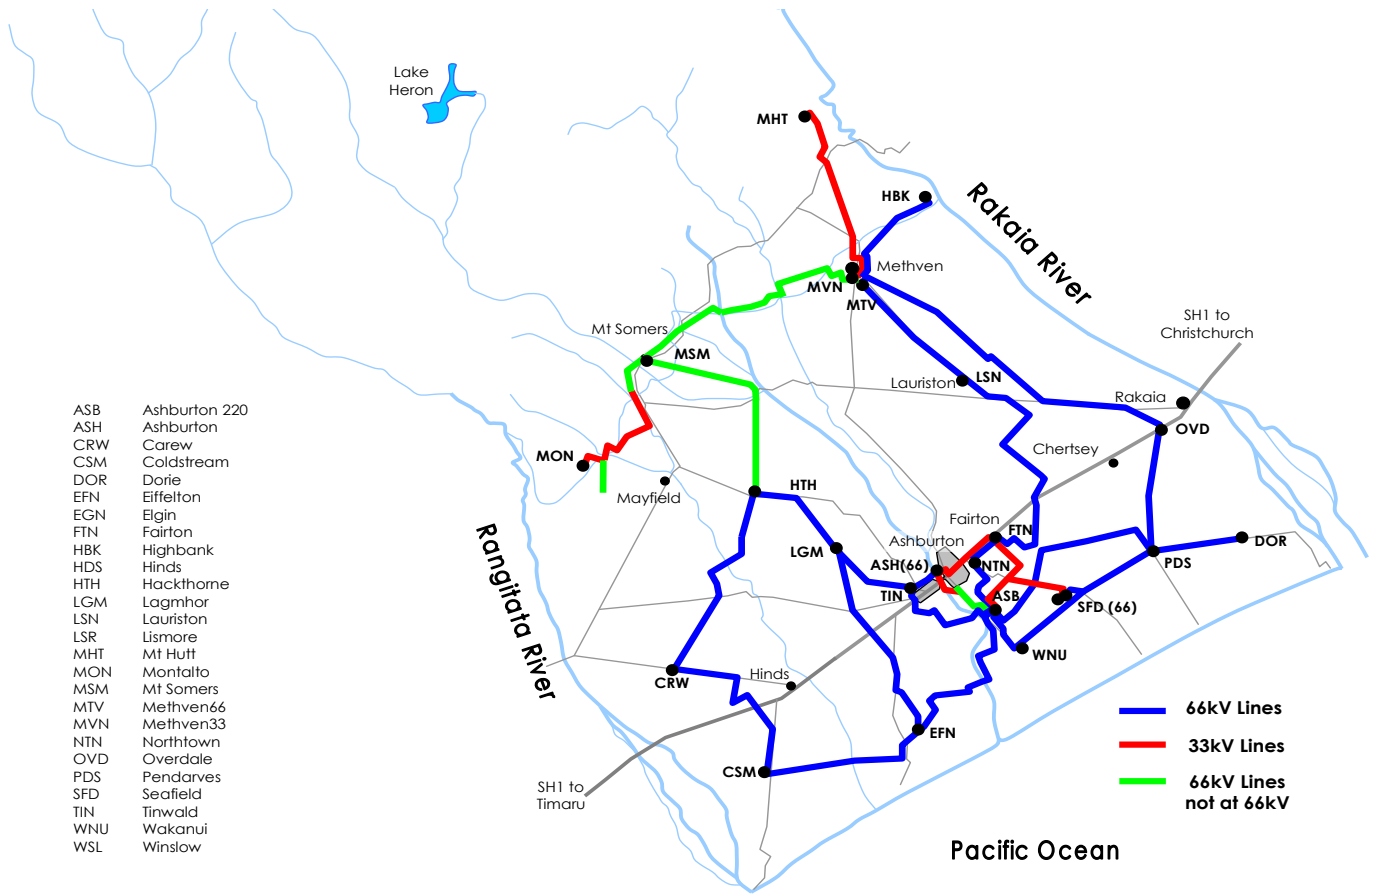

### 2016 Electricity Ashburton Subtransmission Network

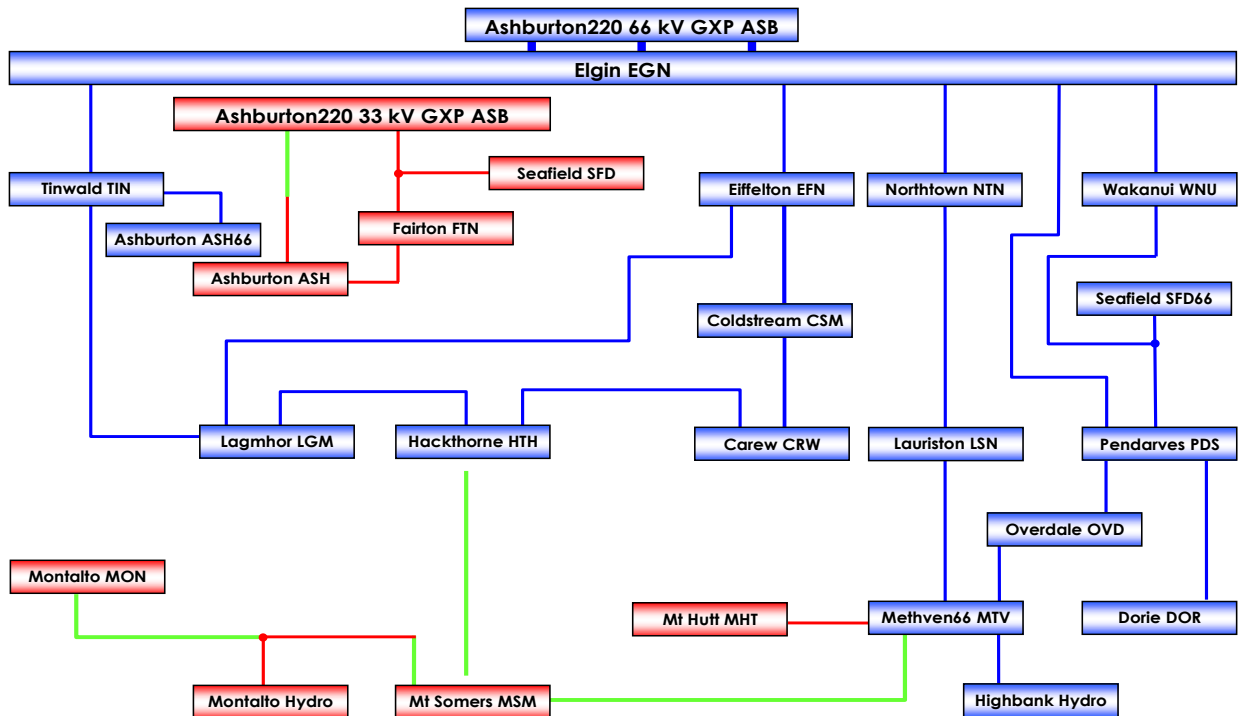

The Ashburton District Plan contains a rule that makes any new line in excess of 110kV or 100 MVA capacity a non-compliant activity. This does not mean that it cannot be built, it flags that a resource consent is required. Resource consent applications can be a difficult, time consuming, and costly process. It is likely that additional subtransmission reinforcement will be justified, meeting the security standards, if load grows

significantly beyond that used to test compliance with security standards.

Other considerations will also come into play when determining new subtransmission equipment capacity including: energy losses, expected equipment life, pollution resistance, aesthetic impact etc.

## Projects & Programmes

Most of the projects in this subtransmission section are in some way linked. As an example, if 66kV supply is introduced at the source of a subtransmission circuit, the need to convert existing lines connected to the same source line or build new alternative ones becomes unavoidable.

Around 1997, before the first 66kV line was built or the first 66kV substation was even designed, a broad concept was provided to the EA Networks Board for their consideration. It showed the evolution of the then overloaded 33kV and 11kV networks to a predominantly 66kV and 22kV system. Budgetary estimates of the cost to develop the 66kV aspect of the concept were provided and the benefits in capacity and security were outlined. After evaluating the alternatives (massive increase in size and quantity of 33kV lines, 110kV & 33kV, or not supplying the new load) the Board provided an endorsement to proceed with system development keeping this ultimate 66kV concept in mind. This initial endorsement has been subsequently reinforced by approval of many projects that fit into the concept. This must be borne in mind when considering many of the subtransmission projects identified below. The substantive alternatives have already been considered as part of a much larger 'all of network' concept and EA Networks are not aware of any new technologies or opportunities to use non-network options that would provide an adequate substitute for the solution included in the initial concept. Should an alternative solution become apparent it will be evaluated and the decision documented in future plans.

To provide a sense of where all of the individual projects are taking the network, a series of diagrams have been included. Each one represents a stage in the evolution of the subtransmission network from where it is now in 2016, to where it will be during 2018, to the end of the planning period - where it is entirely 66kV with a second 66kV GXP.

The first diagrams (2016 & 2018) show the network with two geographically coincident Transpower GXPs one at 33kV and one at 66kV. The 33kV subtransmission is a combination of one ring and several radial lines. The 66kV network consists of:

- \* a northern interconnected closed ring supplied by three circuits with several radial lines supplying individual sites,
- \* a southern closed ring supplied from two circuits.

The associated geographic map provides the location of each of the sites described in the schematic diagram.

The steps through the change from 33kV to 66kV will be somewhat more progressive than the diagrams illustrate, with a range of intermediate configurations that may satisfy load and security considerations for a period.

### **10697 [2017] Upgrade MSM to MTV 33-66kV Line Stage 3 (6.5km) – Asset Replacement**


The circuit that presently supplies Methven 33kV substation, Mt Somers, Montalto and Montalto Hydro from Methven 66kV substation is at the end of its useful life. This project will replace the final one third of the existing line with a new 66kV line. Stage A and B of this work has already replaced two thirds of the line. This is in preparation for Mount Somers [00516] and Montalto [00513] zone substations operating at 66kV.

Alternative solutions to meet the anticipated demand and security requirements utilise 22 and 11kV distribution level proposals and do not represent good value for money when the benefit to the entire subtransmission network is taken into account. The project was split into stages and sections to ensure adequate time was available each year to complete the line in the non-irrigation season (winter).


This project has partly carried over from 2016.

### **10994/10995 [2017] New MON to MSM 33-66kV Line Stage 2 (4.4km) – Asset Replacement**

The 33kV circuit from Mt Somers to Montalto Hydro is in poor condition from Mt Somers zone substation to Arundel Rakaia Gorge Road. The chosen solution is to rebuild the existing 33kV line as 66/22kV overhead line. This is compatible with the medium term evolution of the subtransmission network and a separate project [00520] completes the 66kV line from Mt Somers to the new Montalto site.

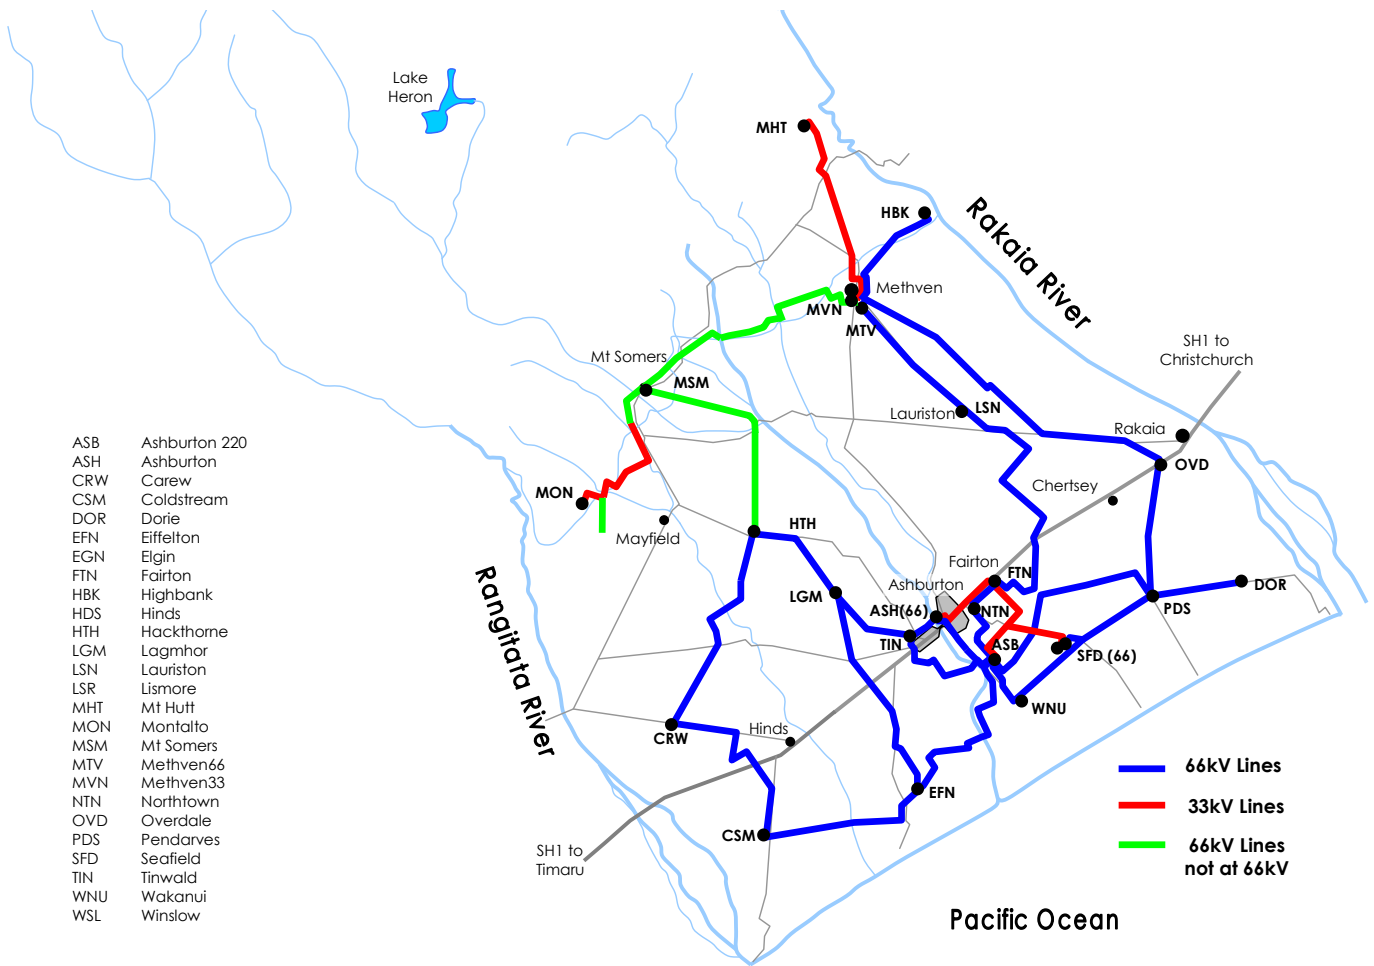

### 2018 Electricity Ashburton Subtransmission Network

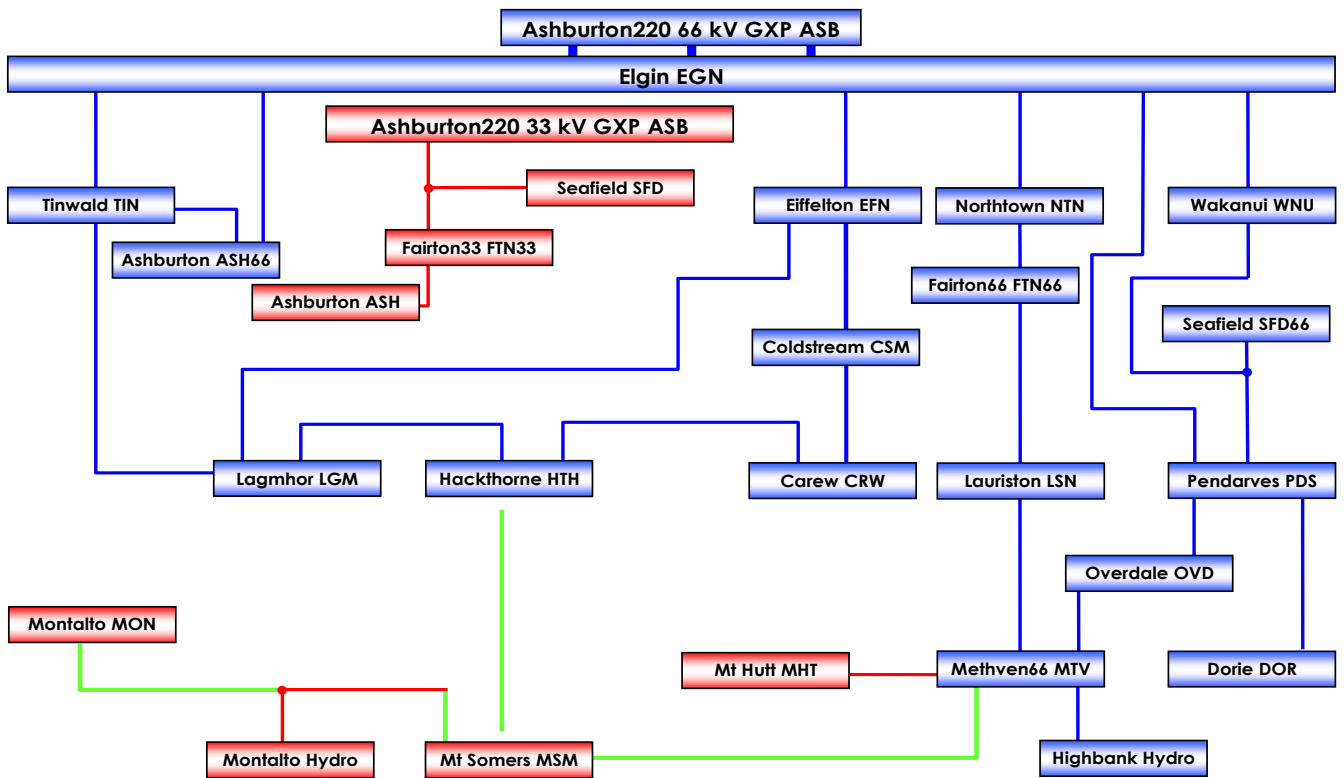

The project consists of two sections to ensure construction remains manageable.

This project has partly carried over from 2016.

#### **11089 [2017] MTV to MHT 33-66kV Line Conversion (0.7km) – Legislative & Regulatory**

The Ashburton District Council's District Plan was reviewed in 2012-2014 and became operative in August 2014. EA Networks were aware of new rules that were proposed that would limit the ability to convert 33kV overhead lines to 66kV (the proposed rule would require resource consent for this activity). During 2012 EA Networks applied for a series of Certificates of Compliance to protect the right to complete projects that were conceived before the Plan change was initiated. One of these certificates was for the conversion of a small section of the 33kV line between Methven66 zone substation and Mt Hutt zone substation. The certificates have a five year validity period from issue. This certificate will expire in March 2017.

Although the operation of the MTV-MHT 33kV line is unlikely to be converted to 66kV operation in the immediate future, the long-term likelihood of this is high. Under the Operative District Plan a line can be operated at its construction voltage (called minor upgrading):

*“Minor upgrading shall not include any increase in the voltage of the line to or above 66kV unless the line was originally constructed to operate at a higher voltage but has been operating at a reduced voltage.”*

The conversion of this short piece of line to 66kV will permit its later use at 66kV. The alternative is to apply for resource consent at a later date to convert the line to 66kV operation. The significant risk with this is that the resource consent application could be rejected and the line would have to be placed underground at considerable cost (between 5 and 10 times the cost of a new 66kV overhead line).

#### **11086 [2017] EGN to FTN New 66kV Line Stage 1 (1.1km) – System Growth**

This project represents stage 1 of a larger project to rebuild an existing 33kV line at 66kV [00511].

This section of the line needs to be completed before a Certificate of Compliance issued under the prior District Plan rules expires in March 2017 (see [11089]). The land through which this line passes has been rezoned as Business F in 2014 and the Operative District Plan rules do not allow reinsulation of 33kV lines to 66kV. The Certificate of Compliance permits this line to be reinsulated prior to March 2017.

The much longer second stage of the line will be rebuilt as a 66kV line in 2019.

The project has been split into two stages to ensure completion of each stage during the short non-irrigation season available to do the work. The second stage is the following year.

#### **00510 [2018] EGN to ASH 33-66kV Cable Urban UG Design and Construction (2.0km) – Asset Replacement**

The existing 33kV circuit through Ashburton township is difficult to maintain and is reaching the end of its useful life. The circuit is the main 33kV supply to Ashburton zone substation. Location, urban development, and system loading has made it very difficult to maintain. The southern 66kV ring is complete and the Transpower Ashburton 66kV GXP offers at least 220 MVA of firm capacity. The conversion of Ashburton and Fairton substations to 66kV is arriving as n-1 security is compromised by 33kV subtransmission circuit capacity. Conversion of the urban section of this line to underground cable will drastically lower maintenance requirements, remove the present 33kV overhead circuit from private property, and improve urban safety. Economic considerations may also drive this project as the cost of retaining the 33kV GXP is significant when a viable alternative (66kV GXP) exists.


Replacing this 33kV overhead circuit with an underground 66kV circuit was considered to be the only viable solution.

Design work is likely to be outsourced as it is a significant project that requires specialist knowledge and thermal analysis tools to ensure adequate cable rating is maintained along the entirety of the chosen route. The design deliverables will include the cable sizing, design and documentation of the new cable route, and the specifications for its installation.


The project was broken into stage 1 and stage 2 in previous plans. These have now been combined into one project as it is highly likely the design and installation will be outsourced and thus be completed within one financial year.

#### **00518 [2018] HTH to LSN New 66kV Line Stage 1 (12 km) – System Growth**

As a consequence of the BCI irrigation scheme development, a large pumping load (9 MW) has been placed beyond Methven substation on the extremity of the 66kV network. Voltage support for this load is

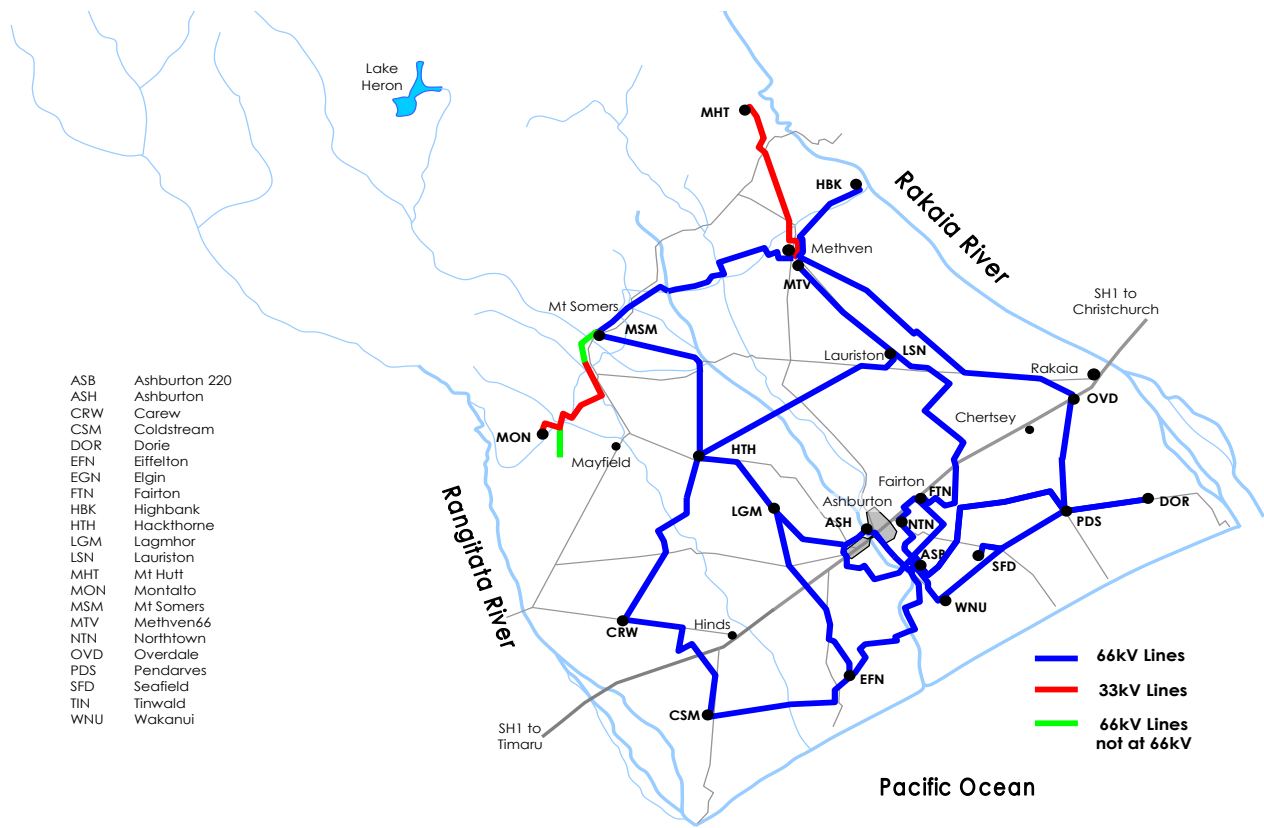

### 2020 Electricity Ashburton Sub-transmission Network

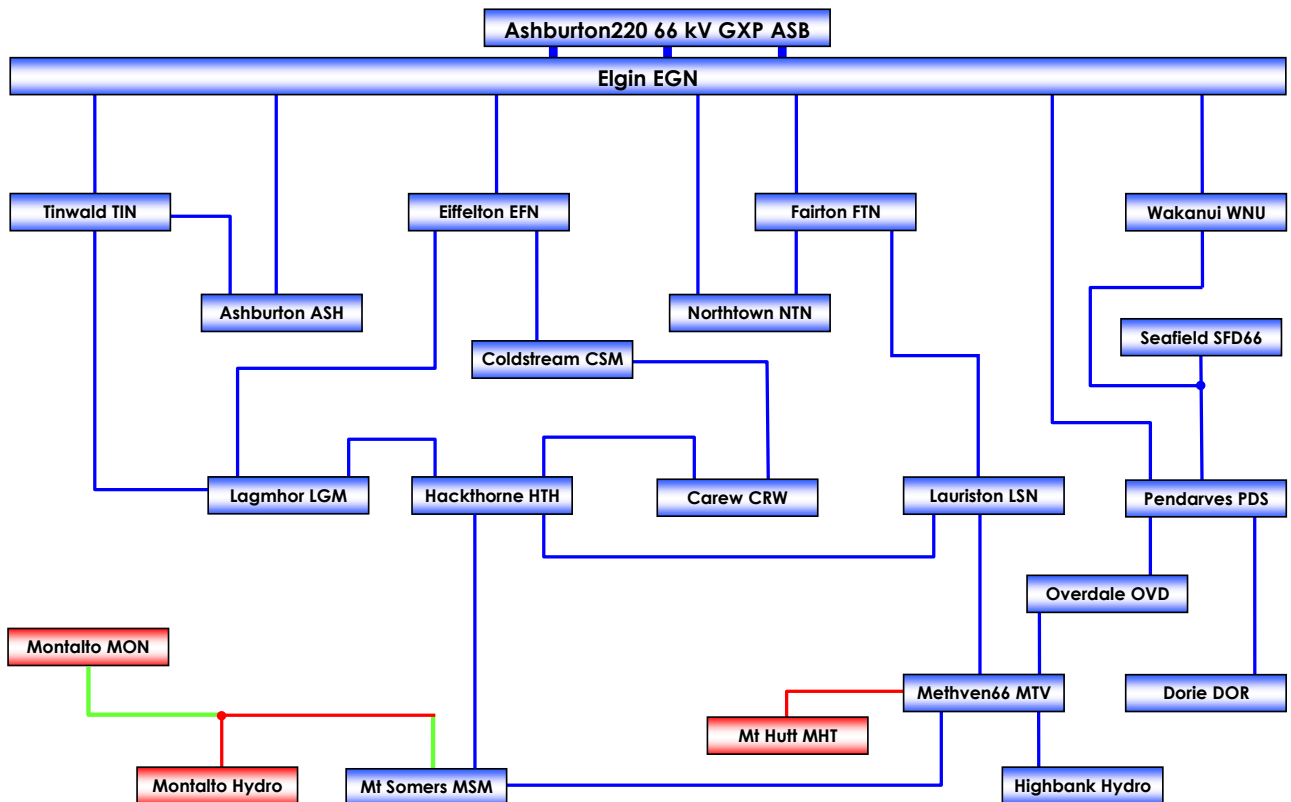

required once stage 2 is commissioned (a prospective total of 12 MW in 2018) and a new 66kV line linking the southern and northern 66kV rings will assist in providing this. The BCI load will continue to be interruptible during critical n-1 subtransmission events which will cause 66kV undervoltage. The new line will also assist in securing the southern 66kV ring during certain 66kV line outages.

The proposed location for a second 66kV GXP would take advantage of this line to supply into the southern

66kV ring.

Alternatives to this solution may still be available and continue to be investigated. The initial stages of the BCI scheme have been completed, but the scheme has not been fully developed. Once additional irrigation water is required from the Rakaia River this project will almost certainly be necessary to service the 12 MW load during n-1 outages as well as to keep 66kV voltage at an acceptable level when all 66kV circuits are in service. Alternative options (both network and non-network) will continue to be investigated and the most prudent selected.

#### **00519 [2019] HTH to LSN New 66kV Line Stage 2 (12 km) – System Growth**

Stage one of this project started as [00518].

#### **00511 [2019] EGN to FTN New 66kV Line Stage 2 (9km) – System Growth**

This 9km line will be needed to offer n-1 security to Northtown and Fairton substations. Now that the Northtown 66kV conversion has occurred, this project will be proceeding. The route is established with an existing 33kV line already occupying the entire path. As the final 66kV route to be built from Elgin it is possible that the capability for two circuits will be provided along a significant portion of its length. This would allow for future subtransmission reinforcement without the need for lengthy line outages while many poles were replaced.

It is unlikely viable alternative solutions exist although these will be researched prior to any commitment to proceed.

A small portion of this line will be completed in 2017 [11086] to satisfy changes in District Plan rules.

#### **00499 [2019] HTH-MSM 22kV Line - 66kV Conversion (21km) – System Growth**

This existing 66kV line operating at 22kV will require conversion to operate at 66kV. The conversion will add the underbuilt 22kV circuit where it is currently absent. Once complete, this project will permit the Mt Somers 66/11kV substation to have two 66kV circuits supplying it. It will also provide a second 66kV route tying the northern and southern 66kV networks together (HTH-LSN is the other one [00518/00519]).

This project is part of the long-term plan for the 66kV system development.

#### **00570 [2021] WNU-SFD 66kV Line Rebuild (8km) – Asset Replacement**

This project is a complete rebuild of a line which was originally constructed as a 33kV circuit and later converted to 66kV by the addition of steel pole extensions and 66kV insulators. The line will be 39 years old in 2021 and the high security requirements of the 66kV network as well as the retrofitted nature of the line suggest that it is prudent to rebuild the circuit before it becomes prone to failure.

Close inspection of the lines may delay or advance this project by several years. This line represents the “bump” in the 66kV pole age profile of [Section 4.3.1](#).

#### **00571 [2022] SFD-PDS 66kV Line Rebuild (7.5km) – Asset Replacement**

This project is a complete rebuild of a line which was originally constructed as a 33kV circuit and later converted to 66kV by the addition of steel pole extensions and 66kV insulators. The line will be 36 years old in 2022 and the high security requirements of the 66kV network as well as the retrofitted nature of the line suggest that it is prudent to rebuild the circuit before it becomes prone to failure.

Close inspection of the lines may delay or advance this project by several years. This line represents the “bump” in the 66kV pole age profile of [Section 4.3.1](#).

#### **00520 [2022] New MON to MSM 33-66kV Line Stage 3 (7.6km) – System Growth**


In preparation for the commissioning of the new Montalto zone substation [00513], this line will provide a 66kV supply from the existing Mt Somers substation into Montalto and Montalto Hydro. The line will be operating at 66kV and the 33 & 11kV load will be transferred and supplied at 22kV from a new Montalto zone substation.

This MON-MSM 66kV line is being built in three stages. The first stage has been completed and stage two is in the process of completion.


Bearing in mind the existing 33kV subtransmission arrangement does not meet the EA Networks security standards, this project is the only one of relatively few alternatives that can provide a degree of compliance and ultimately contribute to a fully compliant solution of two 66kV lines [00507/00508]




supplying MON substation.

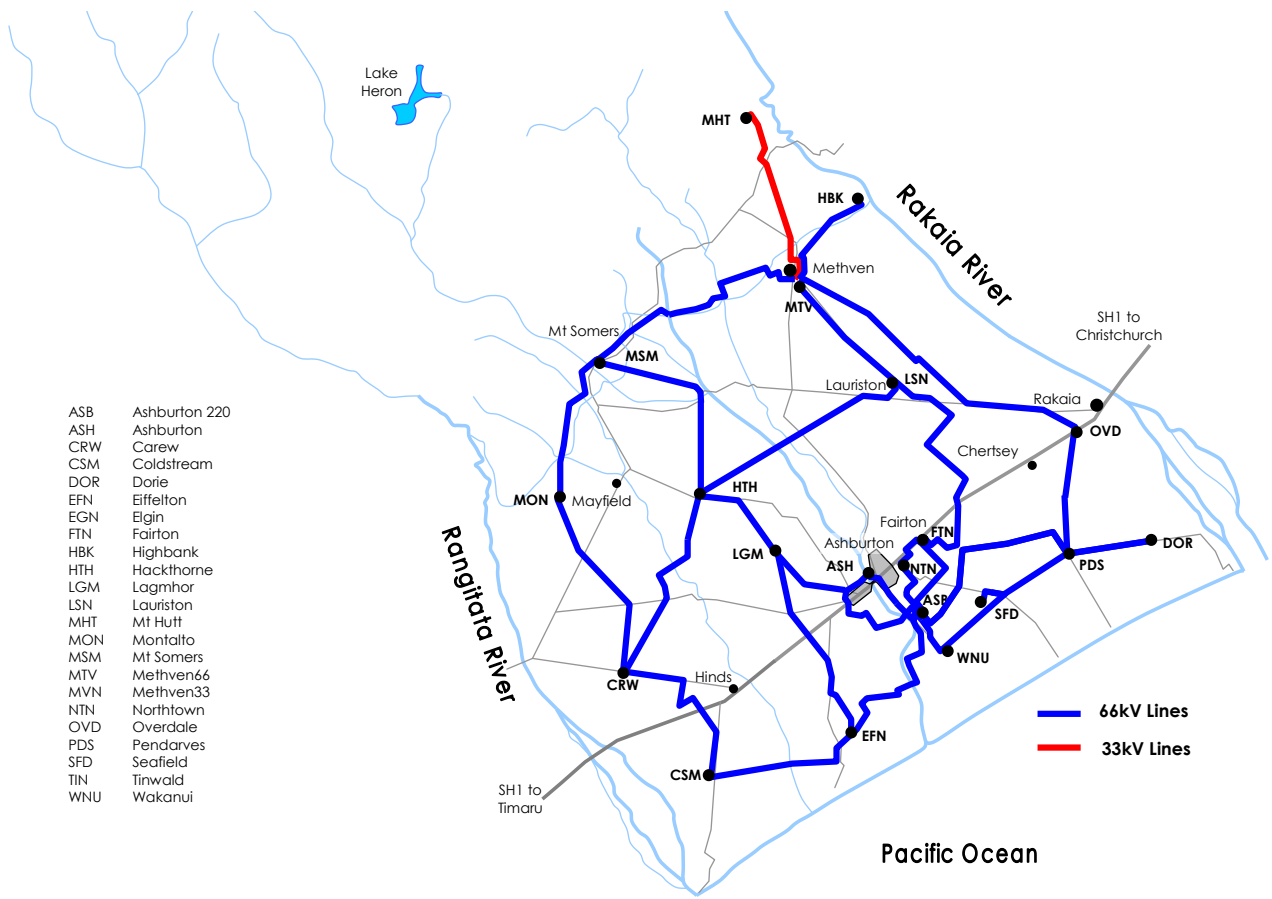


### 2024 Electricity Ashburton Sub-transmission Network

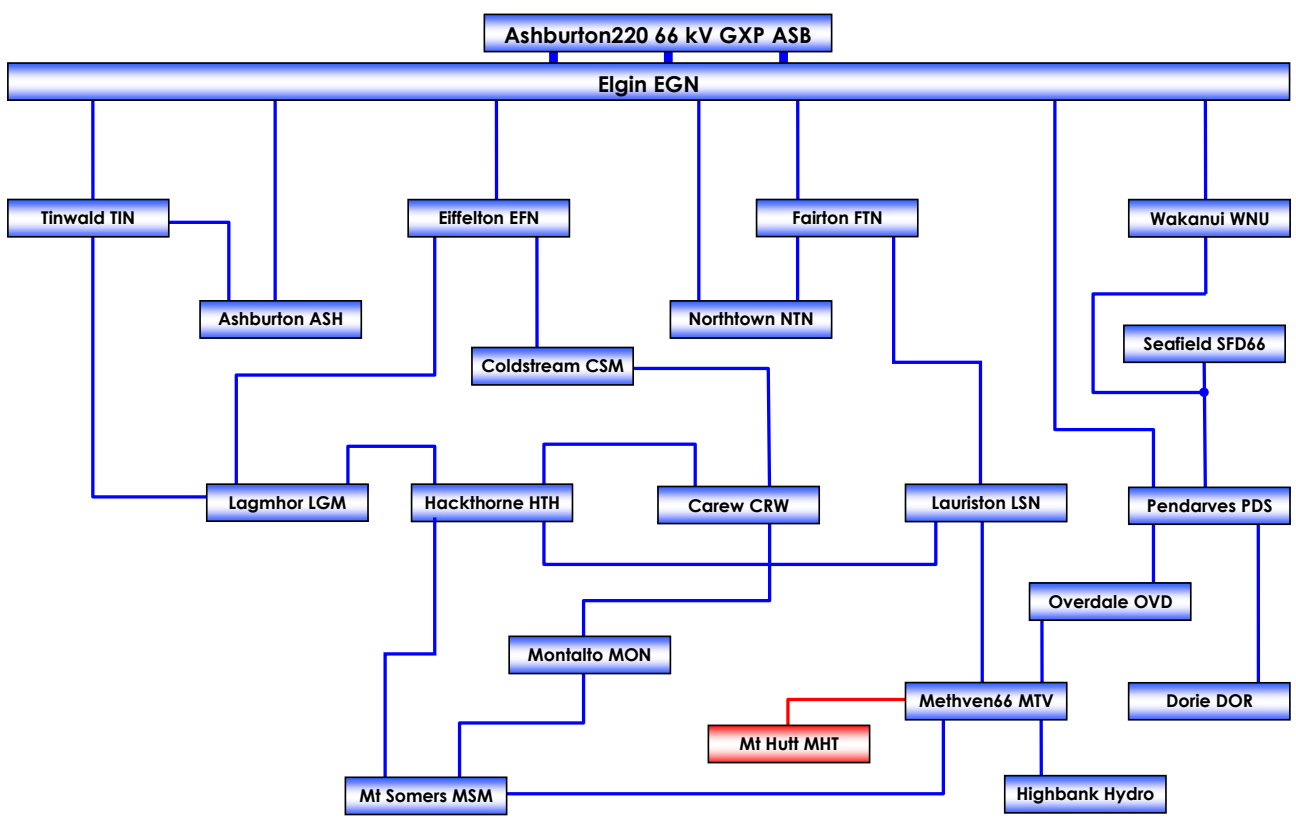

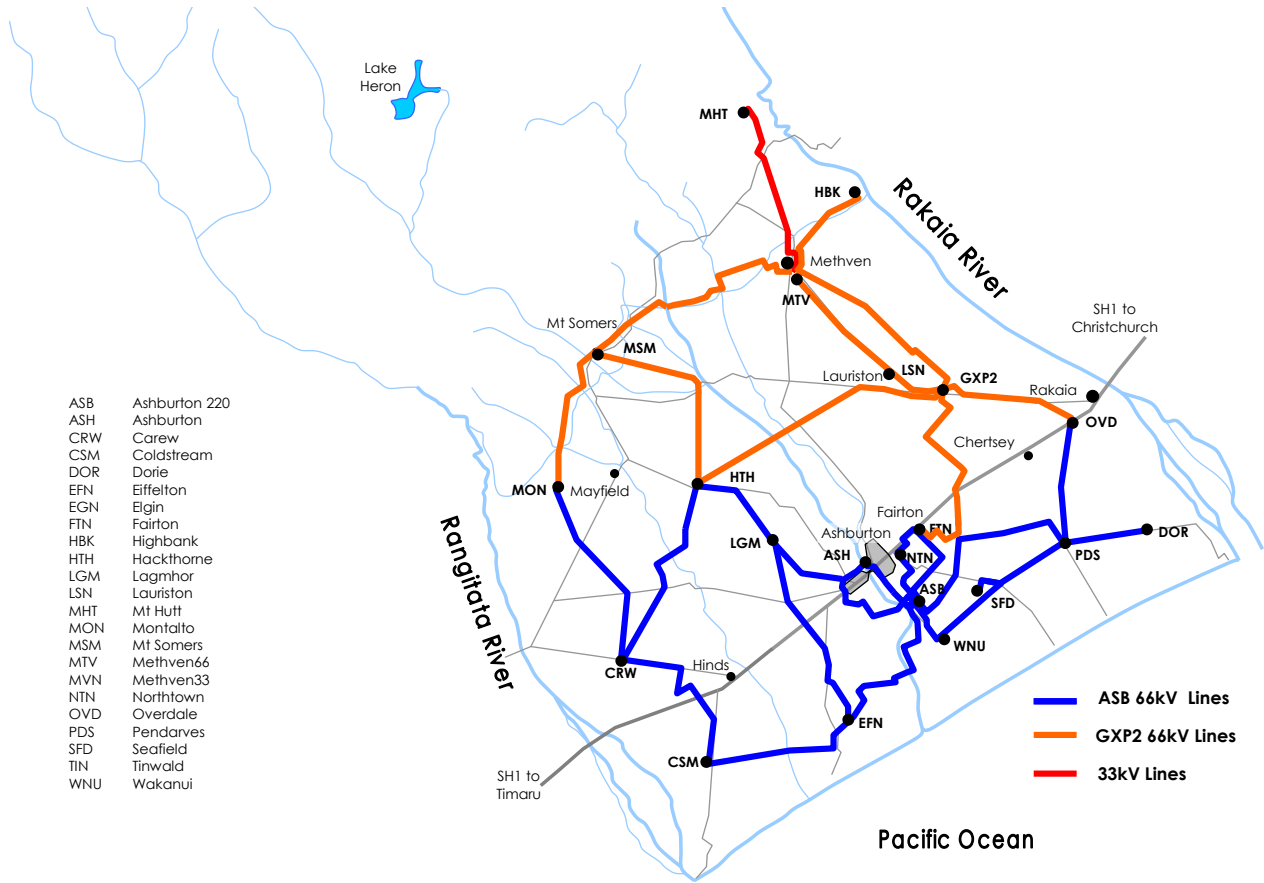

### 2025+ Electricity Ashburton Sub-transmission Network (including GXP2)

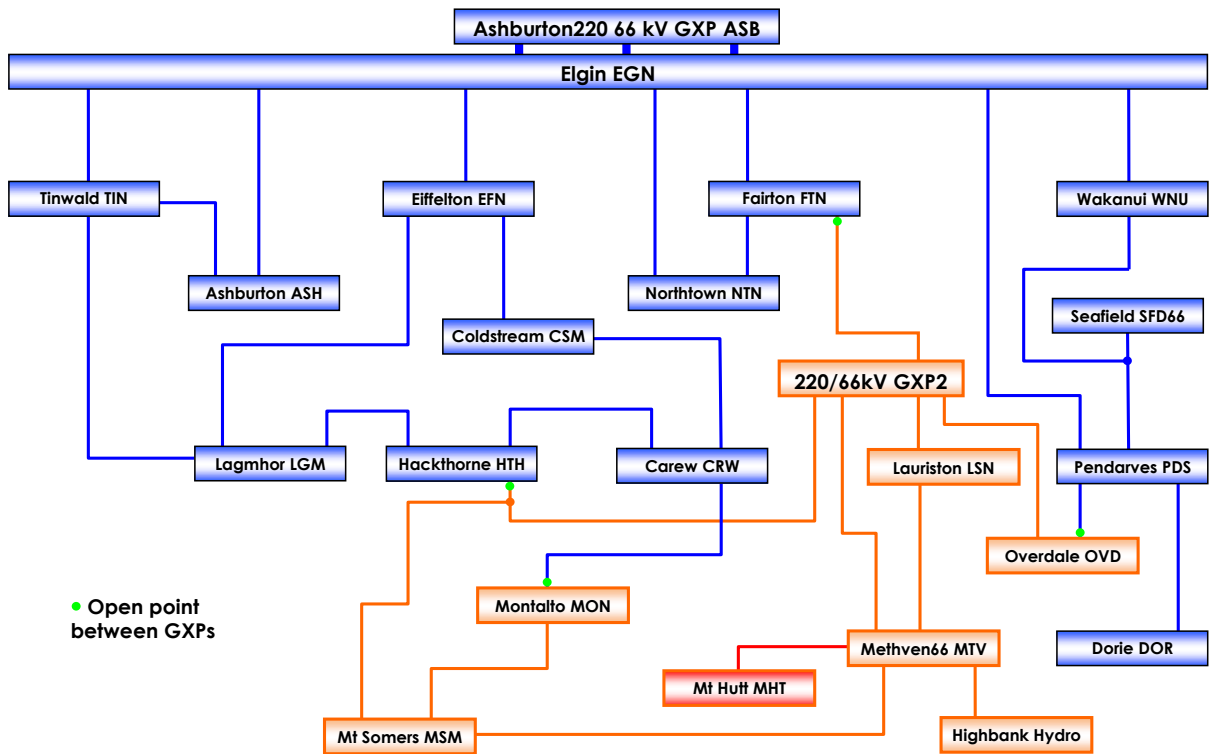

Given that the Montalto substation requires at least one subtransmission supply, there are no alternatives to this project.

This is the third stage of the 66kV line to connect the new MON zone substation [00513] to a 66kV supply. This line is part of the minimum solution to supplying the load presently connected to the temporary MON 33/11 kV substation and the generation at Montalto Hydro once the MTV-MSM line is running at 66kV (2019).

#### **00572 [2023] PDS-DOR 66kV Line Rebuild (8.3km) – Asset Replacement**

This project is a complete rebuild of a line which was originally constructed as a 33kV circuit and later converted to 66kV by the addition of steel pole extensions and 66kV insulators. The line will be 40 years old in 2023 and the high security requirements of the 66kV network as well as the retrofitted nature of the line suggest that it is prudent to rebuild the circuit before it becomes prone to failure.

Close inspection of the lines may delay or advance this project by several years. This line represents the “bump” in the 66kV pole age profile of [Section 4.3.1](#).

#### **00507 [2023] CRW to MON 66kV Line Stage 1 (10km) – Quality of Supply**

Should the load or generation on Montalto substation dictate that a higher security level is justified, a 66kV circuit can be provided between Carew substation and Montalto substation. This will allow loss of the Montalto to Mt Somers circuit or the Montalto to Carew circuit without an outage at Montalto substation.

There are no alternative solutions that can offer the no-break capacity of a second 66kV circuit. An assessment of the need for this level of security will be made and if the requirement is deemed to be a no-break supply, this project will be the only possible solution.

#### **00508 [2024] CRW to MON 66kV Line Stage 2 (10km) – Quality of Supply**

This project is the second and final stage of the project started as [00507].

### **5.4.3 Zone Substations**

The development at zone substations is typically a very costly and important part of network development. The drivers for doing this work are generally load growth and security. It may be that as the number of substations running at 66kV increases, another driver will emerge, and that is an economic one. Transpower costs are based on peak demand and Transpower assets employed. It is probable that, as 33kV load reduces, EA Networks can supply load at 66kV more economically than persisting with a 33kV supply from Transpower. The economics of this would have to be periodically examined. A case in point is the Ashburton and Fairton 33kV substations and whether to convert them to 66kV. By discontinuing the 33kV GXP and spending money on the EA Networks 66kV network, the decrease in GXP costs may actually result in overall savings.

EA Networks currently has 15 sites operating at 66kV and once fully developed, an additional 7 to 9 sites will be either decommissioned, converted from 33kV, or constructed from scratch. The zone substations operating at 33kV are typically less secure with less capacity than the ones operating at 66kV.

#### **Capacity of New Equipment**

A range of equipment is introduced when a new zone substation is constructed. The most critical and high cost items are the power transformers and the circuit-breakers.

The capacity of a new power transformer is influenced by a range of parameters, some of which relate directly to the load being served and some of which are externally derived.



The only power transformers that EA Networks now purchase are units with 66kV primary voltage. The secondary voltage is either 11kV or 22kV. All units purchased so far have been capable of both secondary voltages by the use of a series/parallel connection of the windings. This configuration allows operation at 66/22kV, 66/11kV and 33/11kV. The transformer power rating is based on the minimum economical size of 66kV transformer while keeping a degree of standardisation amongst the installed population of units. To date, two sizes of unit have been purchased, 10/15 MVA and 10/20 MVA. These share the same impedance as well as a common external electrical and mechanical connection arrangement which allows any unit to be exchanged with any other unit. The security standard ([section 2.5.6](#)) dictates the combination of single or dual transformers that are required to be installed to serve particular size and types of load. 10-20 MVA units are a close match to these security requirements.

Circuit-breakers and disconnectors are a simpler specification. At both 66kV and 22kV the continuous thermal and short circuit ratings of the majority of available equipment exceeds the requirements at both voltage levels. Minimum ratings of 630 amps and 16 kA are easily met by virtually all equipment. With the exception of urban Ashburton sites, all new distribution equipment is 22kV rated. All new subtransmission equipment is 66kV rated.

## Projects & Programmes

### **10960 [2016] PDS Install T1/T2 Firewall – Quality of Supply**

There are two transformers at PDS zone substation and a fire in one of these units could quickly involve the other one. One of these units is EA Networks system spare and loss of both would be catastrophic.

A fire resistant wall will be constructed that separates the two units to allow time to extinguish the fire in the other unit before functional damage occurs to the non-faulted one. In order to achieve this, the units may need additional separation. This may involve modification or replacement of the existing transformer pad.

A feasibility study with a fire engineer will be the first stage of design.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that some portion of this work will carry over in to 2017.

### **10986 [2016] 66kV Cable Screen Arrester Installation – Quality of Supply**

The cable screens of most 66kV cables are connected to earth at one end only. This prevents circulating currents during steady state loading. Unfortunately, during lightning strikes the screen voltage at the non-earthed end can reach levels that can put the plastic sheath's integrity at risk. In the worst instance the sheath and screen would be punctured allowing moisture into the cable.

To prevent this, all 66kV cables will have 2.5kV cable sheath arresters installed at the unearthed end.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that some portion of this work will carry over in to 2017.

### **10969 [2016] CRW Second Transformer Civil Works (Stage 1) – System Growth**

The continued growth of load at all 66kV zone substations has caused consideration of the security available to adjacent substations at peak loading periods. Several different sites would not be able to offer the adjacent site any significant back-feed capacity should a transformer fault develop at the adjacent site. This project is an allowance to begin the process of reinforcing the capacity of at least one of these sites. Carew has been identified as one possible candidate for reinforcement although it may be that after consideration a different site may be chosen as more optimal. Once installed the transformer would also serve as the second spare unit to cover for periods when the first spare has been called upon because of transformer failure. The repair/replacement time for a power transformer can be considerable (9-12 months).

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that a significant portion of this work will carry over in to 2017.

### **10957 [2016] New FTN 66kV Substation Stage 1 (Civil Works) – System Growth**

EA Networks are now committed to a single voltage subtransmission network. In order to achieve this the existing substations directly supplied from Transpower at 33kV require conversion to 66kV. The logical sequence to progress conversion requires Fairton 66/22-11kV substation to be commissioned prior to

Ashburton 66kV substation being fully converted to 66kV with the consequent loss of two 33kV circuit supply to Fairton 33kV substation. This project is the initial stage of this sequence.

The new site will have 66/22kV and 66/11kV transformers installed in two new 66kV bays along with three 66kV lines connected to three new 66kV bays. New 22kV and 11kV switchboards will be installed to service the entire load presently supplied from Fairton 33/11kV substation plus some served from Northtown, Pendarves, Wakanui, Overdale and Lauriston substations. A 22/11kV interconnecting transformer will provide 10MVA of firm capacity to the two 66kV transformers.

This project covers the civil works associated with a new Fairton substation which is being built in close proximity to the existing Fairton 33kV substation. The green field nature of the new site allows a progressive construction to take place over an extended period (not restricted by planned outages). This stage will encompass; site preparation, earth grid, ducting, direct buried cabling, equipment foundations and pads, building shell, fencing and surface finish. The second and final stage is [11066] with an associated project being [11060].

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that some portion of this work will carry over in to 2017.

### **11066 [2017] New FTN 66kV Substation Stage 2 (Structural/Electrical) – System Growth**

This is stage 2 of the Fairton 66kV substation construction process. Work encompasses all above-ground work including; 66/11kV transformer procurement and installation, 66/22kV transformer procurement and installation, 22/11kV transformer procurement and installation, 66kV support stands, 66kV buswork, disconnectors, procurement and installation of 66kV, 22kV and 11kV circuit breakers, control cabling, NER's, building fit-out, 110V dc systems, 400V ac systems, protection (66kV line, transformer bus, 11-22kV feeder and NER), and all other works required to operate as a 66kV substation. This is a significant project and will require substantial resources to complete in a timely manner.

### **10955 [2017] New TIN 66kV Switching Station Stage 1 (Civil Works) – Quality of Supply**

The Tinwald 66kV line is now periodically loaded by Ashburton 66/11kV substation and one of two things must occur. The existing three terminal line between Elgin, Ashburton and Lagmhor will remain or a new Tinwald switching station will be constructed. The switching station option would have three subtransmission circuits switched by circuit-breakers to offer Ashburton a more secure Elgin to Ashburton line (faults between Tinwald and Lagmhor would be cleared by a Tinwald circuit-breaker, as would faults between Elgin and Tinwald). Currently, a fault anywhere in the three circuit limbs causes loss of supply to Ashburton 66/11kV substation.

Both options are valid but security requirements have determined that the switching station option is the preferred option.

A small portion of this project has carried over from 2016.

The project has been split into three distinct stages that cover different aspects of the construction process. This first stage is the site preparation, earth grid, ducting, direct buried cabling, equipment foundations and pads, building shell, fencing and surface finish. The other two stages are [11092] and [11065].

### **11092 [2017] New TIN 66kV Switching Station Stage 3 (11-22kV Electrical) – Quality of Supply**

This project is to procure and install distribution level equipment in the new Tinwald 66kV switching station. Located on the outskirts of urban Ashburton it is a suitable site to interconnect the 22kV and 11kV networks using a 10MVA 22/11kV Yyn0(d1) transformer. An 11kV switchboard, a 22kV switchboard and various feeder and transformer protection will be needed to complete the arrangement.

This equipment will allow back-feeding between the Ashburton 66/11kV substation and the Lagmhor 66/22kV substation. During n-1 events this will provide a great increase in flexibility that will assist in reducing outage durations and help cover for significant equipment failure. A future development may see a 66/11kV transformer situated at the Tinwald site [00504].

### **11095 [2017] EGN Roadside Site Completion – Legislative & Regulatory**

The rural roadside frontage at Elgin substation is presently unsealed and angled away from the road. The Ashburton District Council require private entrances from sealed roads onto property to be sealed for a minimum distance to prevent shingle spilling onto the sealed road. This site requires this work to be done. In addition, the sealing will ensure a better all-weather surface for personnel and vehicle access which can

currently be challenging in wet weather.

#### **11093/11094 [2017] HTH & CRW Personnel Gate Upgrade – Safety**

The Hackthorne and Carew substations have personnel gates that are not operating at a modern standard. These gates will be replaced with new standard personnel access gates that are secure and reliable.

#### **11090 [2017] CRW Second Transformer Electrical Works (Stage 2) – Quality of Supply**

The continued growth of load at all 66kV zone substations has caused consideration of the security available to adjacent substations at peak loading periods. Several different sites would not be able to offer the adjacent site any significant back-feed capacity should a transformer fault develop at the adjacent site. This project is an allowance to begin the process of reinforcing the capacity of at least one of these sites. Carew has been identified as the site for reinforcement in the southern area. Once installed the transformer will also serve as the second spare unit to cover for periods when the first spare has been called upon because of transformer failure. The repair/replacement time for a power transformer can be considerable (9-12 months).

As part of this project the 22kV switchboard will be replaced and this liberates a 5 panel switchboard as a system spare. EA Networks currently do not have a system spare switchboard. The new switchboard will add two additional 22kV feeders, which reduces the consumer count per feeder to a level complying with the design security standard.

#### **11091 [2017] HTH 22kV Switchboard Extension – Quality of Supply**

The current 22kV switchboard at Hackthorne zone substation has four 22kV feeders in it. The location of Hackthorne substation at a six way intersection was intentionally chosen for the ease of feeder egress. The addition of two extra feeders to the existing switchboard will provide options for a dedicated feeder to Mayfield township as well as reduce the load and area supplied by existing feeders. One of the existing feeders has more than 5.2 MW of load on it and this is the same 22kV feeder that links to (back-feeds) Mt Somers substation during an outage of the MTV-MSM subtransmission circuit.

The project adds three 22kV circuit breakers to the switchboard (two feeders and one incomer for a future second transformer). A second feeder protection relay is also installed to accommodate the two new feeders. An underground cable project [11082] installs the connection between the switchboard and the 22kV overhead termination poles.

#### **00505 [2018] ASH Zone Substation 66kV Conversion (Stage 2) – System Growth**

One consequence of securing the southern 66kV ring was a reduction in security to Ashburton 33/11kV substation. This is because the Tinwald subtransmission circuit (previously 33kV) now operates at 66kV. Loss of one of the two 33kV circuits that feed Ashburton, Fairton and Seafeld 33/11 kV substations would place the remaining 33kV circuit at or above its rating.

The first stage of Ashburton 66kV substation returned a degree of security to the Ashburton substation 11kV busbars. This leaves Ashburton with a 27 MVA 33kV subtransmission circuit direct from Transpower's GXP, a 17 MVA 33kV underground circuit from Fairton substation, and a 40 MVA 66kV subtransmission circuit from Tinwald. Two 66kV line bays and a 66kV transformer bay were constructed including line, bus and transformer protection. The new 10/20 MVA 66/11 kV transformer is used in hot-standby configuration so that at short notice it can be used to relieve or back-feed the entire load presently on the Ashburton 33/11 kV substation.

The timing of this work is load and security related. If the load cannot be adequately managed between Ashburton and Northtown substations due to distribution limits (keeping Ashburton substation load below 17 MVA), the case for complete 66kV conversion is more compelling. If the peak load is over 17 MVA, this work will be required to prevent sequential tripping or thermal damage of 33kV circuits.

There are no realistic alternatives to this project.

This project is the final stage of converting Ashburton to an entirely 66kV site. This would involve installation of a second 66/11kV transformer and the completion of protection in a second line bay for a 66kV circuit direct from Elgin [00509]. This would provide more complete security to the Ashburton 11kV bus and, in conjunction with Northtown substation, provides a long-term platform for growth in Ashburton.

**00517 [2018] HTH and LSN New 66kV Line Bays – System Growth**

The construction of the 66kV line from Hackthorne to Lauriston [00518/00519] necessitates new line bays and line protection at both substations.

The project will involve civil works, a section of 66kV bus, two 66kV circuit breakers, three disconnectors, a line termination structure, line protection, bus protection, 66kV VTs, and 66kV line protection.

Given that the line will be built and requires connection, there are no alternatives to this project.

**00516 [2019] MSM Convert to 66kV – System Growth**

It is likely that some additional load will appear around Mt Somers. If this load exceeds the capacity of the Mt Somers substation (5/10 MVA), it will trigger the redevelopment of the Mt Somers site to increase transformer capacity and prepare it for 66kV operation. Additionally the zone substation security requirements may trigger 66kV conversion as Mt Somers presently does not have any firm subtransmission capacity (single radial 33kV line and single 66/33kV transformer source supply).

This project involves the procurement and installation of civil works, 66kV buswork, 66kV disconnectors and circuit-breakers, line protection, bus protection, a 22kV NER, a new 66/22-11kV transformer and new incomer cables.

To permit Montalto and Montalto Hydro to continue operating at 33kV it is planned to install an 11/33kV step-up transformer to feed the existing 33kV line to Montalto until 2022 [00513]. The cost of the 11/33kV step-up arrangement will be low as it will reuse existing 33kV and 11kV equipment.

It may be possible to delay the conversion to 66kV, and therefore this project, provided the 33kV voltage is still within security limits at Lismore and Montalto. A larger 33/11kV transformer has been installed in the present site but it is likely security concerns will eventually compel the conversion to 66kV.

**00498 [2019] HTH New 66kV Line Bay – System Growth**

The conversion of Mt Somers substation to 66kV will also involve the conversion of the HTH-MSM line to 66kV [00499]. This requires the provision of a line bay at Hackthorne substation to terminate the line.

The project will involve civil works, a 66kV circuit breaker, disconnector, line termination structure, and 66kV line protection.

**00555 [2019] MTV New 66kV Line Bay – System Growth**

The conversion of Mt Somers substation to 66kV will also involve the conversion of the MTV-MSM line to 66kV. This requires the provision of a line bay at Methven substation to terminate the line.

The project will involve civil works, a 66kV circuit breaker, disconnector, and 66kV line protection.

**00496 [2019] EGN Reconfigure Site (T1) as 66/22kV Substation – System Growth**

The 66/33/12.7 kV YNa0(d1) autotransformer located at Elgin is presently used for ripple injection onto the 66kV bus. Once the 66kV ripple injection system has been replaced [00371] the autotransformer will only serve as an injection path for the existing 33kV ripple plant acting as a back-up. When it was purchased this eventuality was considered and the delta tertiary winding was specified as 12.7 kV and all of the winding ends were externally terminated. This offers the possibility to reconfigure the autotransformer as a 66/33/22kV YNyn0 transformer with a 15/20 MVA rating. By doing this and installing a 22kV switchboard and feeder cabling from Elgin, the load on a number of 66/22kV substations can be reduced thereby unloading the 66kV subtransmission network. The 33kV tapping on the 66kV winding will continue to have occasional use with the 33kV back-up ripple plant.

Zone substations that would benefit from this project by off-loading include: Wakanui, Fairton, Eiffelton, and Pendarves. Other zone substations such as Ashburton, Northtown, and Seafield would consequently have additional back-feed capacity available during n-1 contingencies.

**00495/00514 [2020] MTV Convert T1 to 66/22kV. Add T4 and T5 to 22/11/33kV Step-Up – System Growth**

The load on the Mt Hutt ski-field is winter only and in recent years has decreased through more efficient snow-making facilities. Once Mt Somers and Montalto substations have been converted to 66kV operation, the 18/25 MVA transformer at Methven substation will only be supplying the Mt Hutt Substation. It is likely that an evaluation of the economics of retaining the transformer as 66/33kV versus supplying Mt Hutt using alternative means will come out strongly in favour of converting the 18/25 MVA transformer to

66/22kV operation and supplying Mt Hutt from the 22kV supply. A 22/11 kV autotransformer and 11/33kV OLTC transformer would be significantly cheaper than a small 66/11kV transformer and 66kV line conversion that would otherwise be required.

When the transformer was purchased in 1999 the possibility of 33kV abandonment was considered and the 33kV star winding was specified with a fully rated 22kV tapping. Some simple reconfiguration of the internal leads via a hatch will allow operation as 66/22kV.

Converting MTV T1 transformer to 66/22kV provides a much more secure situation for MTV load. The 11kV and 22kV loads will be served by T1 (66/22kV), T2 (66/11kV) and T3 (22/11kV). This provides full n-1 security for a transformer failure (fast restore - not firm capacity). The 22kV supply will be used to supply the surrounding rural area and also provide local switched firm capacity to Methven township at 11kV via a 10 MVA 22/11 kV YNyn0(d1) transformer. The 22kV supply will also be able to provide significant back-feed capacity to Lauriston substation.

In order to minimise the total cost of supplying Mt Hutt, the intention is to reuse some of the assets that have been made surplus by 11-22kV conversion and 33-66kV conversion. A 5MVA, YNa0d1, 22/11kV autotransformer will be placed in series with a 5MVA, YNyn0(d1), 11/33kV, OLTC transformer (both already owned) to provide a regulated 33kV 5MVA supply to the existing Mt Hutt 33kV circuit and substation. EA Networks hold spares of both types of transformer and should a failure occur could replace the failed unit quickly.

Alternatives are the status quo, converting the entire Mt Hutt circuit and substation to 66kV, or supplying at a different voltage. The only limiting factor is the large pumps on the ski-field that require a reasonable fault level to limit voltage drop during starting (although this may be catered for with modern starting technology). Unless a better value for money solution arises the proposed solution will be used.

#### **10054 [2022] New MON Zone Substation – System Growth**

The [BCI irrigation](#) project has become a reality. The injection of water at the bottom of the Rangitata Diversion race has liberated water at the top end (near Montalto). This water is available for pumping onto farms. In time, the additional load could exceed the capacity of not only the 2.5 MVA transformer at the temporary Montalto substation but also cause additional voltage drop in the 33kV network. The first response to this will be to construct a permanent Montalto 66/22kV substation on a new site

A raft of alternatives exist for this project and some may yet be utilised. The chosen solution will depend upon the scale and rate of BCI/irrigation inspired load growth and local hydro generation.

A very recent ECAN decision has seemingly placed almost complete restriction on new irrigation south of the Ashburton River in Mid-Canterbury (Montalto is in this area). This restriction is via nutrient discharge limits. The only reason this project may proceed is a desire to increase security and reliability to the Montalto district and surrounds. The situation will be monitored for developments.

#### **00573 [2022] New 66kV Line Bay MSM Zone Substation – System Growth**

The construction of Montalto 66kV substation will also involve the conversion of the MSM-MON line to 66kV. This requires the provision of a line bay at Mt Somers substation to terminate the line.

The project will involve civil works, a 66kV circuit breaker, disconnect, and 66kV line protection.

#### **00554 [2022] Montalto Hydro Injection at 22kV – Consumer Connection – Other**

Once 66kV conversion of Montalto substation is certain, the existing Montalto Hydro generation station (33/3.3kV) will need to be injected at a different network location and a different voltage. The new Montalto substation is in close proximity to Montalto Hydro and the opportunity to inject at 22kV will exist as soon as the substation is commissioned at 66kV. This would involve changing the existing (Trustpower owned) 33/3.3kV transformer to a 22/3.3kV unit and plumbing in the end of the existing 33kV line to a 22kV feeder.

Alternatively, should a raft of small additional hydro generation opportunities be pursued, the total generation in the area could approach 20 MW (this appears unlikely as of 2016). This level of injection would be most suited to 33kV as the injection voltage and this would provide the opportunity to retain Montalto hydro as is and inject the generation into the Montalto substation 66kV bus via a 66/33kV transformer.



**00506 [2023] New 66kV Line Bays CRW and MON – Quality of Supply**

The construction of the 66kV line between Carew and Montalto substations [00507]/[00508] will require a 66kV line bay at each substation. The line bays will involve the procurement and installation of some civil works, 66kV disconnectors, 66kV circuit-breakers, and line protection relays.

Given that the line is being built, there are no alternatives to this solution.

**00504 [2026] Tinwald Substation 66/11kV Transformer and 11kV Switchboard – System Growth**

Presuming the load in Ashburton continues to grow, there will be a need to provide additional firm capacity within urban Ashburton. It is sensible to have geographically diverse 11kV supply points and the Tinwald 66kV switching station will be available to house a 66/11kV 10/20 MVA transformer supplying the existing 11kV switchboard.

**00500/00501/00502/00503/00504 [2021]-[2026] Contingency Projects – System Growth / RSE Other**

As the title suggests, these projects have been included as ‘unknown’ issues that are bound to arise over a ten year period. Examples could include some form of disruptive technology such as electric vehicles, battery storage, or solar PV.

Whatever the problem that requires solution, it is unlikely to be in the year 2024/25 or cost \$906k, but these projects are representative of some relatively modest, uncertain, development requirement.

**5.4.4 Rural 11kV and 22kV Distribution Network**

The loading, security and load growth on each of EA Networks' rural distribution feeders is assessed annually and this assists in preparing enhancement and development projects for this plan. The need for reinforcement is typically driven by the security standards and how the HV distribution network would cope with loss of an overhead line segment. Once a candidate feeder has been identified, the potential solutions are developed and then rigorously analysed to select the option offering best value.

Rural feeders are almost always limited by voltage drop. There are a range of solutions that can be applied to reinforce these feeders to meet the security standards. These include (but are not limited to):

- increase the conductor size
- reconfigure the network
- install capacitors
- install voltage regulator(s)
- convert to higher operating voltage
- install additional inter-feeder tie lines
- install additional feeders from the zone substation
- install additional line reclosers to increase segmentation

The vast majority of rural load is summer peaking irrigation load. Although peak demand load determines the feeder capacity it may not determine the feeder configuration or its compliance with security standards. A lightly loaded rural feeder with little irrigation load may have many consumers supplied from it and consumer numbers rather than load may dictate the appropriate level of security.

**Capacity of New Equipment**

The capacity of new rural distribution lines is nearly always determined by voltage drop and mechanical considerations. The primary requirement in sizing rural overhead lines is to ensure that no part of the feeder in question experiences a voltage below 95 % of nominal during a foreseeable n-1 security event using the load probable 10 years into the future. Thermal constraints can exist in the portion of line immediately beyond the feeder circuit-breaker. These are considered on a case by case basis but generally will not require a rating exceeding 300 amps (11 MVA at 22kV).

Rural distribution transformers are sized based upon the scale and type of load being served. Small domestic and non-irrigation loads will be provided with transformers closely matched to the load. Irrigation pumps were historically provided with transformers that were larger than normal due to the harmonic derating effect of variable speed drives (compulsory harmonic limits now preclude the need for derating).

## Projects & Programmes

### **10679 [2017] Rawles Crossing Road 22kV (1.9km) – Quality of Supply**

A project to provide additional MV distribution interconnectivity. It is intended to provide a connection between the Lagmhor zone substation supply area and the Ashburton zone substation supply area. These two areas are separated by the Ashburton River and there are very few distribution links across it. This will allow a significant section of rural overhead line to be normally supplied from the rural Lagmhor substation rather than the urban (and largely underground) Ashburton 11kV network. Historically the rural faults have caused significant power quality issues for the Ashburton urban residents. It also provides a means to relieve the Ashburton zone substation of some load while increasing the load on the Lagmhor zone substation which has spare capacity. This project was initiated in 2014 but the river crossing portion remains to be completed. This project will see the line finished.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that some portion of this work will carry over in to 2017 (<30% still to complete).

### **11064 [2017] Fairfield Road 22kV Underbuild (0.9km) – System Growth**

The construction of Fairton 66/22-11kV substation provides a substantial source of 22kV capacity that will be utilised to relieve heavily loaded 22kV feeders from Pendarves, Overdale and Wakanui substations. In order to achieve this a section of 66kV line requires the addition of a 22kV circuit underneath it. This project provides that 22kV circuit.

### **11085 [2017] Gibsons & Smalls Rd 22kV Underbuild (2.4km) – Quality of Supply**

In order to maximise the benefit of converting the supply into Lake Hood residential area to 22kV [11104], there needs to be a second 22kV supply available to the area. The area to the south of Lake Hood is still 11kV and rather than purchasing an 11/22kV transformer it was decided to source the second supply from across the Ashburton River utilising an existing 66kV river crossing. This project provides for the installation of an underbuilt circuit on the route of the 66kV line.

### **11084 [2017] Hepburns Road New 22kV Line (1.1km) – Quality of Supply**

This project provides a link around Ashburton township to remove the rural overhead lines from an urban 11kV underground feeder. The imminent conversion of this rural area to 22kV also dictates that a new supply for the lines must be found and Fairton 66/22-11kV substation is the obvious choice. The connection to the substation requires the installation of this section of line.

### **11087 [2017] Maronan Road New 22kV Line (1.09km) – Quality of Supply**

Maronan Road has a significant number and density of rural consumers who are currently supplied on a radial circuit form an urban feeder. This arrangement is deficient in two ways; the consumer count exceeds the Reliability by Design guidelines for consumers affected by a single distribution fault, and the line exposes the partly underground urban feeder to rural faults. This project provides an in-fill section of 22kV line to link the Maronan Road line to an adjacent 22kV line at its southern end. The Maronan Road area is also being converted to 22kV during 2017 [11072] and both ends will have a 22kV supply at the conclusion of the project.

### **11088 [2017] Winslow-Westerfield Road New 22kV Line (2.94km) – Quality of Supply**

The 22kV conversion of the area West of Ashburton township has created the opportunity to utilise the Lagmhor 66/22kV substation more fully. In order to do this a 22kV line must be built to interconnect the substation to the existing 22kV network in the Greenstreet area. This project constructs the necessary 22kV line to achieve this goal. The alternative is to connect the Greenstreet area to an existing heavily loaded 22kV circuit that would compromise the Reliability by Design guidelines.

### **11060 [2017] FTN Zone Substation 22kV Feeder Integration (2.5km) – System Growth**

When the Fairton 66/22-11kV substation is built [11066], it will require additional distribution cabling to integrate it into the 22kV and 11kV networks. This project covers the approximately 2.5km of underground cabling necessary to achieve this. It will result in five 11kV feeders and four 22kV feeders being fed from the new site.

Given that the new Fairton substation is necessary, the district plan requires new network to be underground in the business zoned areas surrounding the new site. There is no alternative to this project.

**11083 [2017] CRW 22kV Feeder Integration – System Growth**

The Carew substation second transformer will see the addition of two 22kV feeders at Carew substation. These feeders require integration into the existing distribution network. This project will involve the installation of about two hundred metres of 22kV underground cable.

This project has no alternatives.

**11082 [2017] HTH 22kV Feeder Integration – System Growth**

The switchboard extension at Hackthorne substation adds two new 22kV feeders. These feeders require integration into the existing distribution network. This project will involve the installation of about two hundred metres of 22kV underground cable.

This project has no alternatives.

**11136 [2017-26] Unscheduled Consumer Connections – Rural LV/Rural Transformer**

When a new connection is supplied there is typically some modification or extension to the distribution network. This can range from a replacement pole through to a significant 22kV extension of several kilometres with several new substations.

Being unscheduled, this work is essentially completed on demand (assuming the new or altered connection load is advantageous to EA Networks). The solution chosen to supply a new/altered load is typically agreed during consultation with the consumer to determine a price/quality/security trade-off they are happy with.

**00512 [2022] MON 22kV Feeder Integration – System Growth**

The new Montalto substation requires integration into the existing distribution network. This project will involve the construction of several kilometres of Dog conductor 22kV overhead line. Dog conductor will allow Montalto to supply some or all of the loads presently connected to Lismore, Mt Somers and Montalto (temp) substations and offer back-feed opportunities during adjacent substation or feeder outages.

This project has no alternatives.

**PROGRAMME [2017-26] Overhead Line Replacement 22kV – Asset Replacement**

The programme of rebuilding rural overhead lines when they reach the end of their useful structural life is an accepted routine activity. With a legal requirement to maintain the supply to existing consumers in place there is no option but to replace the old line with a modern equivalent overhead line using 22kV components and a standard conductor size/type. With few exceptions, no additional explanation is given for each of these projects.

<b>10943</b>	<b>[2016]</b>	<b>Arundel Rakaia Gorge Road, 33-22kV (3.9km)</b>	<b>Asset Replacement</b>
--------------	---------------	---	--------------------------

A routine rebuild of an end-of-life 33/11kV line as a 33/22kV line.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that some portion of this work will carry over in to 2017 (<50% still to complete).

<b>10940</b>	<b>[2017]</b>	<b>Springfield Road West, 11kV (3.2km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------


A routine rebuild of an end-of-life 11kV line as a 22kV line.

Carried over from 2016 (<50% still to complete).

<b>11131</b>	<b>[2017]</b>	<b>Arundel Rakaia Gorge Road, 22kV (1.3km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

Ex-33kV line with 11kV underbuilt circuit. Is at the end of its useful structural life.

The line will be rebuilt as 22kV only by reusing the 33kV Dog conductor replacing the existing deficient single strand galvanised steel 11kV conductor.

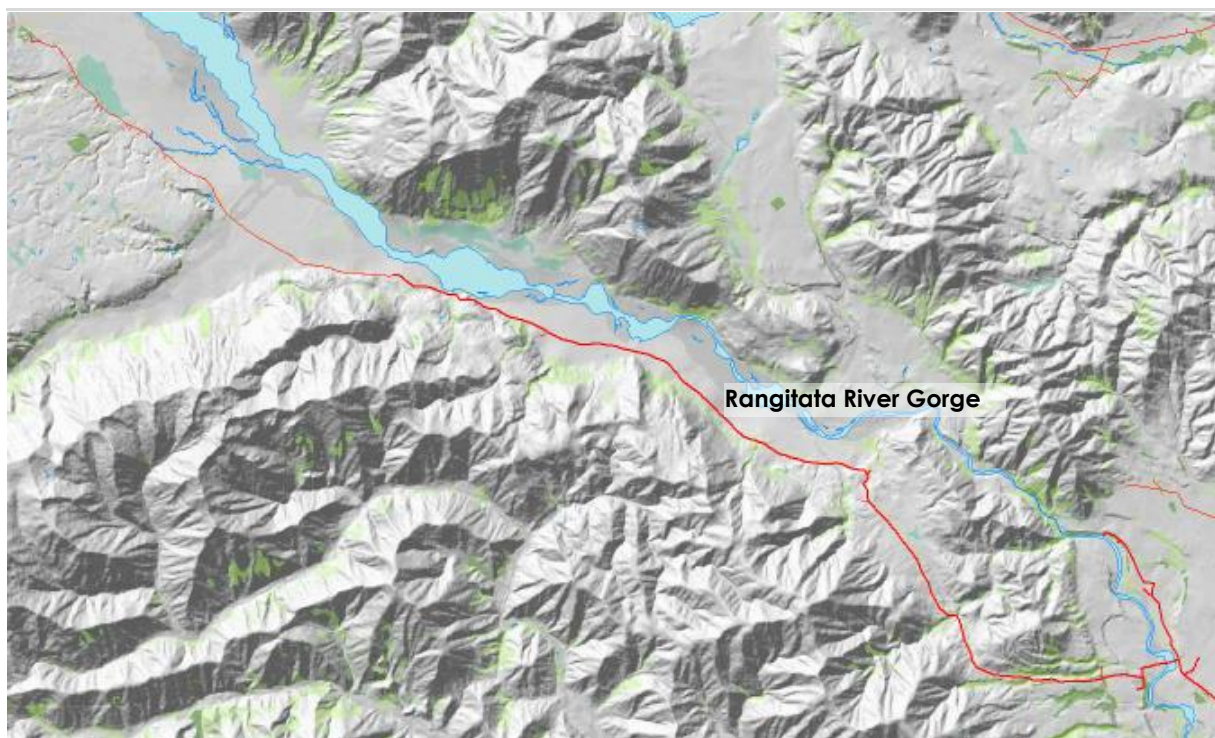

<b>11133</b>	<b>[2017]</b>	<b>Rangitata River Gorge 22kV, Stage B (5km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

This line is one of the few EA Networks lines that is considered remote. It was built in 1966 and at 47 years old it has surpassed its expected life. It regularly experiences lightning, gale force winds and heavy snow during winter. This 34km line supplies relatively few connections (about 40) and was built with the assistance of the Rural Electricity Reticulation Council. That assistance is no longer available and a decision needed to be made about the viability of maintaining these lines to remote areas. The Board have indicated that they wish to continue to provide a service to the consumers in these remote valleys using a conventional overhead solution. This is largely driven from the cooperative company approach of sharing risk and return and operating the network in a manner that has no location penalty. Given this stance, it is planned to rebuild the line in several stages, of which one stage has been completed. This project is stage B. Each stage will progressively target the sub-section of line that is in the poorest condition. See map above.

<b>11129</b>	<b>[2017]</b>	<b>Ashburton Staveley Road Section 1 (0.5km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

A routine rebuild of an end-of-life 11kV line as a 22kV line.

<b>11125</b>	<b>[2017]</b>	<b>Ashburton Staveley Road Section 2 (2km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

A routine rebuild of an end-of-life 11kV line as a 22kV line.

<b>11122</b>	<b>[2017]</b>	<b>Barnswood Rd to Boltions Rd (0.7km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

A routine rebuild of an end-of-life 22kV line.

<b>11126</b>	<b>[2017]</b>	<b>Chertsey Road (1.5km)</b>	<b>Asset Replacement</b>
--------------	---------------	------------------------------	--------------------------

A routine rebuild of an end-of-life 22kV line.

<b>11123</b>	<b>[2017]</b>	<b>Dobsons Ferry Road (1.9km)</b>	<b>Asset Replacement</b>
--------------	---------------	-----------------------------------	--------------------------

A routine rebuild of an end-of-life 22kV line.

<b>11130</b>	<b>[2017]</b>	<b>Gardiners Road (0.8km)</b>	<b>Asset Replacement</b>
--------------	---------------	-------------------------------	--------------------------

A routine rebuild of an end-of-life 22kV line.

<b>11124</b>	<b>[2017]</b>	<b>Maronan Rd Rebuild (Lills Rd West) (1.2km)</b>	<b>Asset Replacement</b>
A routine rebuild of an end-of-life 11kV line as a 22kV line.			
<b>11121</b>	<b>[2017]</b>	<b>Mitcham Rd (2.3km)</b>	<b>Asset Replacement</b>
A routine rebuild of an end-of-life 11kV line as a 22kV line.			
<b>11120</b>	<b>[2017]</b>	<b>New Park Road (0.8km)</b>	<b>Asset Replacement</b>
A routine rebuild of an end-of-life 11kV line as a 22kV line.			
<b>11132</b>	<b>[2017]</b>	<b>Old Main South Road (2.6km)</b>	<b>Asset Replacement</b>
A routine rebuild of an end-of-life 22kV line.			
<b>11128</b>	<b>[2017]</b>	<b>Tinwald Westerfield Mayfield Road (0.5km)</b>	<b>Asset Replacement</b>
A routine rebuild of an end-of-life 22kV line.			
<b>11127</b>	<b>[2017]</b>	<b>Winters Road (0.6km)</b>	<b>Asset Replacement</b>
A routine rebuild of an end-of-life 22kV line.			
<b>11105</b>	<b>[2018-26]</b>	<b>Unscheduled Asset Replacement and Renewal</b>	<b>Asset Replacement</b>
<p>The overhead rebuild programme is still being researched to give an accurate 5-10 year assessment. By using the stored age of overhead lines a provisional assessment has been made of the quantity of lines needed to be rebuilt within the planning period. This assessment has been costed and included in the plan as an average annual cost.</p> <p>The next plan will have a more fully populated 5 year programme identifying the likely rebuild candidates.</p>			
<b>00576</b>	<b>[2019]</b>	<b>Upper Rakaia River Crossing</b>	<b>Asset Replacement</b>
<p>EA Networks take an 11kV supply from Orion at the very top end of the Rakaia River. This area this line supplies has 13 consumers in it. The line was originally built with the assistance of the Rural Electricity Reticulation Council fund that subsidise uneconomic lines during the early '70s when the line was built. The river crossing portion of this line is in need of replacement. The Rakaia River is approximately 2 km wide at the point the line crosses it. All of this width is extremely exposed to large volumes of high speed water during floods. Access to the riverbed is difficult and limited to certain times of the year.</p> <p>A consequence of the remoteness and construction difficulties is that it is very expensive to rebuild the river crossing. Alternative approaches are still being considered and it may be that one of these alternative is ultimately chosen.</p>			

#### **PROGRAMME [2017-2024] Rural Underground Conversion – Asset Replacement**

The state highway network through mid-Canterbury covers about 100km of rural road. EA Networks have electricity lines along the side of a significant length of this highway network. NZTA have road safety as a primary goal. In order to achieve this they have indicated the desire to remove roadside obstacles including power poles. EA Networks have come to an arrangement with NZTA to part-fund the removal of poles from any state highway when the opportunity arises. This is typically considered when the line in question reaches the end of its useful structural life.

Such an arrangement obviously has some pros and cons for the line owner. The principal requirement is to replace the existing end-of-life overhead line with a line of the same or similar functionality.

A new overhead line would achieve this but would not improve the fault resistance of the line (weather, wildlife, vehicles, vandalism etc would still pose a threat). NZTA would not contribute to the replacement as it has no road safety benefits and in fact extends the roadside pole hazard for another 40 or more years. This option is the cheapest option but the least safe for the public.

Placed underground, the line is almost entirely immune to traditional (and common) sources of rural faults. It is exposed to the hazard of someone digging into it in ignorance (the law is not on the side of the person excavating) and the infrequent above ground portions can be exposed to vehicles, heavy flooding and vandalism. The line will typically be of larger cross section and lower voltage drop than the overhead line it replaces. The removal of poles will attract some funding from NZTA in the interests of road safety. It is highly likely that during the following 40 years, one or more lives will be saved by avoiding a high speed car versus pole collision. This option is more expensive than the overhead alternative.

<b>10935</b>	<b>[2016]</b>	<b>Rakaia Highway (Chertsey - Railway) (1.5km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

There is a short section of 22kV overhead line north of Chertsey on SH1 that is composed of many bates Steel poles that are more than 60 years old. The line is at the end of its useful life. This project replaces that line.

In about 2012-13 EA Networks were aware of the impending state of the line and, when NZTA were doing some road works in the area, discussions were held to see if there was a mutual benefit in coordinating works. The outcome was that NZTA funded the installation of ducting along the length of SH1 coincident with the deteriorating line on the understanding that the poles would be removed. The installation of cable in this duct is relatively simple and removes much of the difficulty in working on SH1 - with minimal excavation required.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that some portion of this work will carry over in to 2017 (<50% still to complete).

<b>10936</b>	<b>[2016]</b>	<b>Waimarama Road, Highway 77 (2.8km)</b>	<b>Asset Replacement</b>
--------------	---------------	---	--------------------------

Waimarama Road is actually a portion of State Highway 77 (SH77) and the line that occupies a 2.8km length of is approaching the end of its useful life. At 40 years old, in a high wind and high snow load environment, the line needs replacement.

Being on a state highway, a discussion was held with NZTA about the suitability of the route for replacing the line with a new overhead line. NZTA indicated that they would be prepared to contribute towards a solution that removed the poles from the roadside. As such, EA Networks have proposed to covert the 11kV overhead circuit to a 22kV capable underground circuit.

The high wind and frequent snow experienced in this area certainly reinforces the benefits of having an underground network that is largely immune to the vagaries of the weather.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that some portion of this work will carry over in to 2017 (<30% still to complete).

<b>10937</b>	<b>[2017]</b>	<b>Arundel Rakaia Gorge Road, Highway 77 (1.8km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

This section of the Arundel Rakaia Gorge Road that this line runs alongside is actually a portion of SH77. This section of single phase 11kV line is at the end of its useful life and needs to be replaced.

Being on a state highway, a discussion was held with NZTA about the suitability of the route for replacing the line with a new overhead line. NZTA indicated that they would be prepared to contribute towards a solution that removed the poles from the roadside. As such, EA Networks have proposed to covert the 11kV overhead circuit to a 22kV capable underground circuit. The distribution transformers required for this work are accounted for by a separate project.

The high wind and frequent snow experienced in this area certainly reinforces the benefits of having an underground network that is largely immune to the vagaries of the weather.

This project has been identified in the expenditure projections as a 15% carry over from 2016. It is looking highly probable that almost all of this work will carry over in to 2017 (<90% still to complete). Hence, the allocated 2017 budget appears too low.

<b>10473</b>	<b>[2017]</b>	<b>Methven Highway (Farm Rd - Digbys Bridge) (3.0km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

This project is an underground conversion project to replace end-of-life HV rural overhead network. The location of this line is Methven Highway (SH77). In the section in question the road is quite narrow and bordered by irrigation races which make pole placement very difficult. Access to adjacent rural-residential land for rebuilding overhead would prove to be very challenging. There have been a number of vehicle versus pole incidents on this section of road. NZTA have a policy of 'encouraging' overhead utilities to stay away from the State Highways if possible. Collectively all of these factors have influenced the decision to continue a trial of rural underground conversion. While it is definitely more expensive than overhead lines, the mole-ploughing technique that EA Networks are using minimises the installation cost. The significant area of cost is the cable itself and the associated switchgear, kiosk covers and terminations. The distribution transformers associated with this conversion are accounted for by a separate project.

This project has been delayed by several years because of a biological contamination scare. A truck carrying commercial seed polluted with Black Grass seeds travelled through the area of this project and spilled small quantities of seed on the roadside. The relevant government agencies have restricted the ability to excavate or even drive off the road surface for fear of transporting the seeds elsewhere. Agreement has now been reached between all parties removing the major impediments to the project proceeding.

<b>11118</b>	<b>[2017]</b>	<b>Hinds Hwy (Longbeach Rd - Tinwald) (2.5km)</b>	<b>Asset Replacement</b>
--------------	---------------	---	--------------------------

This project is an underground conversion project to replace end-of-life HV rural overhead network. The location of this line is Hinds Highway (SH1).

The project will replace the existing overhead line with underground cable and extend the 22kV network to the fringes of Ashburton township.

<b>11119</b>	<b>[2017]</b>	<b>Methven Hwy (Winchmore - Rooneys Rd) (2.2km)</b>	<b>Asset Replacement</b>
--------------	---------------	---	--------------------------

This project is an underground conversion project to replace end-of-life HV rural overhead network. The location of this line is Methven Highway (SH77).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00216</b>	<b>[2018]</b>	<b>Convert State Hwy OH crossings to UG</b>	<b>RSE Safety</b>
--------------	---------------	---	-------------------

Many of the existing 22kV consumer service connections are overhead lines that cross the road from the main 22kV line. These spans of conductor are typically not at normal working tension in order to relieve the sideways pull of the span on the network pole, this means they sag more in the middle of the span. They also "tap-off" the main line below the main circuit. This combination of factors means that the span crossing the road is lower than many of the other conductors on the roadside.

These spans are a significant hindrance when a "high load" is required to pass underneath such as a house being moved or a tilt-slab panel being shifted. EA Networks will provide a pilot vehicle when this type of load is shifted and on occasion certain spans crossing the road may require isolation before they can pass.

This project aims to replace some of the lowest 22kV spans crossing state highways (particularly SH1) with a short section of underground cable. This will remove the safety hazard and preclude the need to isolate the line during high load transit.

<b>00394</b>	<b>[2018]</b>	<b>Rakaia Hwy (Coplands Rd - Dromore) (2.1km)</b>	<b>Asset Replacement</b>
--------------	---------------	---	--------------------------

This project is an underground conversion project to replace end-of-life HV rural overhead network. The location of this line is Rakaia Highway (SH1).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00393</b>	<b>[2018]</b>	<b>Rakaia Hwy (Overdale - Chertsey Rail Crossing) (3.9km)</b>	<b>Asset Replacement</b>
--------------	---------------	---	--------------------------

This project is an underground conversion project to replace end-of-life HV rural overhead network. The location of this line is Rakaia Highway (SH1).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00402</b>	<b>[2019]</b>	<b>Waimarama Rd, Hwy 77 (Drayton - ARG Rd) (3.7km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

This project is an underground conversion project to replace end-of-life 11kV rural overhead network. The location of this line is Methven Highway (SH77).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00395</b>	<b>[2020]</b>	<b>Hinds Hwy (Chatmos - Windermere Rd) (1.9km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

This project is an underground conversion project to replace end-of-life 22kV rural overhead network. The location of this line is Hinds Highway (SH1).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00400</b>	<b>[2021]</b>	<b>Methven Hwy (Pole Rd - Methven) (2.5km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

This project is an underground conversion project to replace end-of-life 11kV rural overhead network. The location of this line is Methven Highway (SH77).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00396</b>	<b>[2021]</b>	<b>Methven Hwy (Rooneys - Shearers) (2.6km)</b>	<b>Asset Replacement</b>
--------------	---------------	---	--------------------------

This project is an underground conversion project to replace end-of-life 11kV rural overhead network. The location of this line is Methven Highway (SH77).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00399</b>	<b>[2022]</b>	<b>Methven Hwy (Thompsons Track - Pole Rd) (8.0km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

This project is an underground conversion project to replace end-of-life 11kV rural overhead network. The location of this line is Methven Highway (SH77).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00398</b>	<b>[2023]</b>	<b>Methven Hwy (Blands Cnr - Thompsons Track) (2.7km)</b>	<b>Asset Replacement</b>
--------------	---------------	---	--------------------------

This project is an underground conversion project to replace end-of-life 11kV rural overhead network. The location of this line is Methven Highway (SH77).



The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

<b>00397</b>	<b>[2024]</b>	<b>Methven Hwy (Shearers - Blands Cnr) (2.6km)</b>	<b>Asset Replacement</b>
--------------	---------------	--	--------------------------

This project is an underground conversion project to replace end-of-life 11kV rural overhead network. The location of this line is Methven Highway (SH77).

The project will replace the existing overhead line with underground cable and connect existing overhead spur lines using either ring main units or three way disconnectable joints ("elbow" connectors).

### **PROGRAMME [2017-26] Upgrade Rural Network 11kV to 22kV – System Growth/Quality of Supply**

The 22kV conversion programme is a carefully considered decision between upgrading existing 11kV lines in an area to provide a moderate incremental increase in capacity or converting to 22kV providing a significant step increase in capacity. Each proposal is treated on merit and what it can offer in the way of long-term benefits. Capacity (at a distance), earning potential, quality of supply, security, motor starting demands, future load growth, risk and outright cost are but a selection of the considerations made when the options are weighed. This programme is essentially "on-demand" as an alternative to other technical solutions available to all lines companies. A programme has been established that provides a progressive conversion of areas that require either reinforcement or additional back-feeding capability. The programme extends out for the entire planning period. The projects identified for the first five years are firm proposals to solve existing loading or security concerns. The full range of alternative solutions described in [section 5.3.2](#) are always considered alongside the conversion option. There are occasions when alternatives such as conductor size increase has been chosen over 22kV conversion but each situation is individually examined and only the optimal capacity and security enhancing solution chosen.

<b>10948</b>	<b>[2016]</b>	<b>33-22kV Conversion Boundary Road</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

Part of the 33kV network is a now redundant circuit heading south of Ashburton with an 11kV underbuilt circuit. An opportunity exists to convert this ex-33kV circuit to 22kV and use it to interconnect 66/22kV substations providing valuable 22kV back-feed capability at very little additional cost. It also provides a means to gradually convert the spur lines from the underbuilt 11kV line to 22kV (rather than having to do many lines at once). This project provides for the conversion and interconnection of the ex-33kV circuit at 22kV to the adjacent 22kV circuitry. The only alternative is to spend money removing the circuit - which is senseless.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that all of this work will carry over in to 2017 (100% still to complete).

<b>10912</b>	<b>[2017]</b>	<b>11-22kV Conversion – Greenstreet Completion</b>	<b>System Growth</b>
--------------	---------------	--	----------------------


This is a section of 22kV conversion which will connect a long 11kV line to 22kV at both ends. The load on this line has increased to the point where reinforcement is needed for voltage regulation and security. The relatively small conductor and long distances mean that 22kV conversion is certainly the most attractive option (the alternative is rebuilding a lot of 11kV line with larger poles and conductor or purchasing an 11kV regulator that will eventually be redundant).

This project forms part of larger strategy in the centre of the Ashburton District to secure load by converting to 22kV. The distribution voltage map on a previous page shows the red area of interest to the north of Ashburton township which is becoming enveloped by the surrounding 22kV network. A separate project caters for the new 22kV distribution transformers required for this project.

This project has partly carried over from 2016.

11073	[2017]	11-22kV Conversion - Hollands Rd, Tinwald Westerfield Mayfield Rd	System Growth
-------	--------	--	---------------

A smaller conversion area that borders on Ashburton township and is presently fed from the township's feeders. The need to relieve the urban feeders of load and consumers requires this rural area to be converted to 22kV so it can be supplied from the Lagmhor zone substation at 22kV. This has an additional benefit of removing fault prone 22kV overhead lines from the predominantly underground urban feeders. A side benefit is the increased ability to back-feed the 22kV lines via an open ring configuration. This project also improves the quality of supply to the more numerous urban consumers.

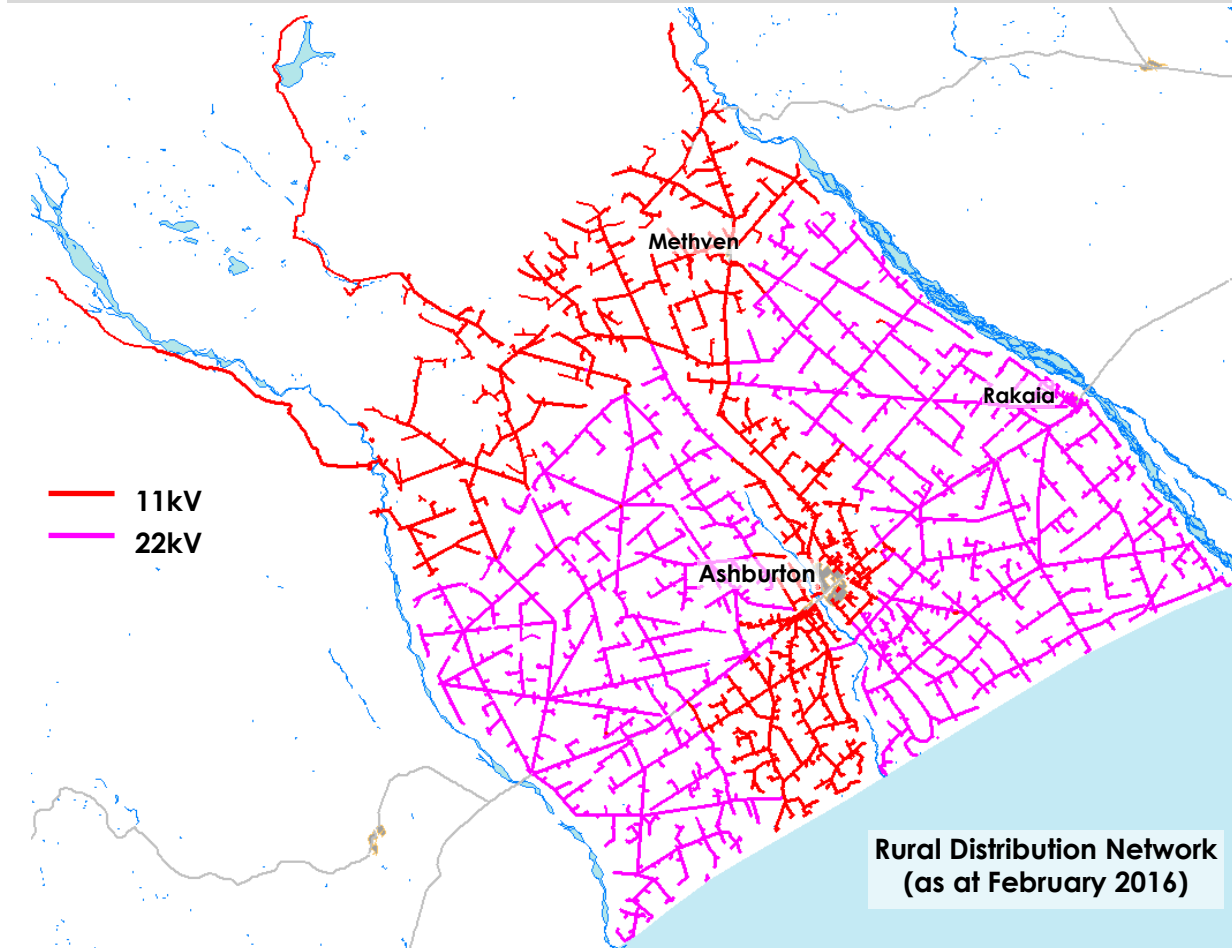

11104	[2017]	11-22kV Conversion - Lake Hood	Quality of Supply
-------	--------	--------------------------------	-------------------

Lake Hood is a man-made lake with surrounding residential subdivision development. It has become quite popular and the quantity and density of consumers has determined that the present supply arrangement is insufficient to satisfy the Reliability by Design guidelines. In keeping with the general philosophy of using rural 22kV conversion to solve significant problems of back-feed capacity, that solution has been chosen here. The area is presently supplied from an urban Ashburton feeder.

The entire subdivision has been designed and built with 22kV operation in mind and the location of Lake Hood lends itself to conversion to 22kV and subsequent improvements in supply availability and back-feed capacity.

This project will provide the option of at least two different sources of 22kV directly to the expanding subdivision and further network back-feeding options are in close proximity.

11072	[2017]	11-22kV Conversion - Maronan Rd, Tinwald to 66kV crossing	System Growth
-------	--------	--	---------------

As load has grown in this area the demand on the urban feeder it is supplied from has reached the point where relief is required. Maronan Road begins in the urban area of Ashburton township and

intersects a 22kV feeder from Lagmhor zone substation near the end of the 11kV line. In order to offload the urban feeder, the Maronan Road 11kV line needs to be converted to 22kV.

This will reduce the urban feeder loading and supply the rural portion of Maronan Road from a more appropriate source.

<b>11071</b>	<b>2017</b>	<b>11-22kV Conversion - Mitcham Rd, Hepburns Rd</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

This project is one that reduces the need to reconductor and provide more capacity from both Ashburton and Lauriston substations. Converting these 11kV lines provides the opportunity to load the new Fairton 66/22kV substation and relieve the other two substations mentioned above.

The Ashburton feeder circuit that this project will ultimately relieve has more than 700 consumers on it and this project will reduce that significantly. The Lauriston feeder that serves part of this area has more than 290 consumers and this will be reduced to a level compliant with the Reliability by Design guidelines.

<b>00141</b>	<b>2018</b>	<b>11-22kV Conversion - Methven Highway Digbys Bridge to Winchmore Hall &amp; Racecourse Rd.</b>	<b>System Growth</b>
--------------	-------------	--	----------------------

Once projects [11071] and [10912] have been completed, this section of rural underground network on Methven Highway will be bordered by 22kV network. This lack of interconnectivity obviously limits the ability to distribute load more evenly across feeders.

The section of network this project would convert is presently supplied from a heavily loaded and populated urban 11kV feeder. This interconnection would assist in bringing it within the Reliability by Design guidelines.

<b>00087</b>	<b>2018</b>	<b>11-22kV Conversion - Methven Highway from Winchmore Hall to Springfield Rd plus side roads</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

This section of 11kV network is adjacent to [00141] and at the Springfield Road end will interconnect with existing 22kV network. The length of the present feeder from Lauriston feeding this area is such that before the conversion of the feeder root an 11kV regulator was stationed on Springfield Road. The interconnection of two areas of 22kV network will allow much better voltage regulation by selectively supplying previously voltage constrained loads from other substations/feeders. This project also assists in bringing various feeders into line with the Reliability by Design guidelines.

<b>00083</b>	<b>2018</b>	<b>11-22kV Conversion - Springfield Rd West</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

This project is another 11kV area that has become islanded by 22kV conversion around it. This has limited the ability to distribute the existing load across the available feeders due to the 11-22kV voltage difference. It also restricts the ability to back-feed through the 11kV area during faults and planned outages (something that was previously possible).

<b>00143</b>	<b>2018</b>	<b>11-22kV Conversion - Winchmore Lauriston Rd, Methven Hwy to end of line</b>	<b>System Growth</b>
--------------	-------------	--	----------------------

This is a large radial circuit that is supplied from the area of project [00087]. There have been historical voltage regulation issues down this circuit and conversion to 22kV is the logical and chosen solution given the upstream 22kV conversion.

This project has been separately identified for the purposes of keeping the scale of single projects to a manageable level.

<b>00142</b>	<b>2018</b>	<b>11-22kV Conversion - Winchmore School Rd</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

This is a circuit that radiates from the area of project [00141] and is bounded by existing 22kV network at the other end. This project must be completed to allow the upstream 11kV network to be converted to 22kV.

This project has been separately identified for the purposes of keeping the scale of single projects to a manageable level.

<b>00089</b>	<b>2019</b>	<b>11-22kV Conversion - Staveley Area</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

The Staveley area is nestled up under the foothills of the Southern Alps and once Mt Somers substation is converted to 66kV an important choice will need to be made about the secondary operating voltage (11kV or 22kV). Given the strategy of rural 22kV and the benefits for serving load it is likely that it will be 22kV.

Converting the Staveley area to 22kV will permit additional interconnectivity between feeders (which is pointless at present because of 11kv voltage regulation). This will allow feeders with small conductor size to supply additional consumers from adjacent feeders, assisting compliance with the Reliability by Design guidelines.

<b>00088</b>	<b>2019</b>	<b>11-22kV Conversion - Tramway Rd</b>	<b>System Growth</b>
--------------	-------------	--	----------------------

Once the commitment to project [00089] is made the area in Tramway Road will become an island of radial 11kV. This again limits the flexibility of the distribution network to comply with the Reliability by Design guidelines. The voltage strictly defines the consumers that must/can be supplied from the circuit. Converting to 22kV will permit complete flexibility to allocate consumers/load to the appropriate feeder.

<b>00090</b>	<b>2020</b>	<b>11-22kV Conversion - Methven Highway Springfield Rd to Methven, Alford Forest to Newtons Corner</b>	<b>Quality of Supply</b>
--------------	-------------	--	--------------------------

This is a large area of 11kV that will be supplied by a single 11kV line bordered by 22kV network. The circuit will have more than 250 consumers on it and no back-feeding options for a fault at the root of the feeder. The only viable solution is 22kV conversion as it is bounded by 22kV on two of three sides and the other adjacent 11kV is incapable of supporting any additional load.

This project is large but, at its conclusion, it will provide a significant boost to the security and reliability of the connected consumers. Compliance with the Reliability by Design guidelines will be greatly assisted by the work.

<b>00271</b>	<b>2021</b>	<b>11-22kV Conversion - Flemington, Huntingdon &amp; Windermere Area.</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

Eiffelton zone substation will still be operating at 66/11kV until the surrounding area is converted to 22kV. This limitation is quite severe in that attempting to transfer any amount of load from other feeders or substations is very difficult because of voltage regulation. Transporting 5MW over a distance of 5km using Dog at 11kV will cause approximately 8% voltage drop. This is unacceptably high and would not only exceed the legal limits but would cause significant issues for consumers. The exact same circuit and load operating at 22kV would only have 2% voltage drop and could therefore offer vastly more capacity to adjacent feeders and zone substations.

The rural loads EA Networks experience are very significant and the only viable option to eliminate operational constraints that have arrived with the increase in load that has occurred over time is to complete the conversion to 22kV in the area served by Effelton zone substation. This is one of the projects that achieves this.

<b>00375</b>	<b>2022</b>	<b>11-22kV Conversion – Eiffelton</b>	<b>System Growth</b>
--------------	-------------	---------------------------------------	----------------------

This project is a signal of the general intent to convert the Eiffelton area to 22kV. All of the surrounding rural area will be 22kV and the benefits in back-feed capacity and interoperability will be compelling. As this scheduled date approaches closer examination of the benefits will occur to determine the scope and exact timing of the project.

<b>00376</b>	<b>2023</b>	<b>11-22kV Conversion - 2023 Assessment</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

This project represents the intent to continue with 22kV conversion on 11kV network towards and in the

foothills of the Southern Alps. By the mid-twenties there will only be a limited amount of rural 11kV remaining and the cost of converting it to 22kV is likely to have dropped as older 11kV lines are rebuilt as 22kV capable. At this stage the presumption is that the 22kV conversion programme will continue until no rural 11kV remains.

<b>00377</b>	<b>2024</b>	<b>11-22kV Conversion - 2024 Assessment</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

As per [00376] above.

<b>00378</b>	<b>2025</b>	<b>11-22kV Conversion - 2025 Assessment</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

As per [00376] above.

<b>00379</b>	<b>2026</b>	<b>11-22kV Conversion - 2026 Assessment</b>	<b>System Growth</b>
--------------	-------------	---	----------------------

As per [00376] above.

## 5.4.5 Urban 11kV Distribution Network

"Urban" distribution feeders are restricted to Ashburton, Methven, and Rakaia townships. Other townships are typically connected to a rural overhead feeder with additional network segregation using line reclosers to offer the township a more secure supply.

In recent times, additional cables have been laid to secure the supply from the Methven66 zone substation to the Methven urban area. If load continues to grow an additional cable may be required from the Methven66 zone substation to service the Methven urban area (giving a total of three 11kV underground feeders). This work is likely to occur during the planning period.

Urban reinforcement solutions are typically implemented by adding additional cable routes from a zone substation, although a point is reached when congestion makes this impractical. Ashburton substation is nearing this situation and the chosen solution has been to introduce Northtown substation.

During the planning period there is likely to be a need to provide reinforced 11kV ties and distributors from both Northtown and Ashburton substations. As circuits reach thermal capacity and security suffers, a decision on how to increase security and capacity is likely to lead down the path of an additional layer of 11kV cabling within the Ashburton urban area. These large capacity cables (400-500 amps) would be used to transport energy away from the substations to other nodes and between nodes. Normal capacity distribution feeders (200-300 amps) would then radiate from these nodes, interconnecting with existing feeders.

### Capacity of New Equipment

The capacity of a new urban 11kV underground distribution circuit is typically sized between 200 amps and 300 amps. The exact sizing is determined by likely feeder loading and its function during n-1 security events. Typically this will mean the load will be no more than 50% of the thermal capacity to allow for growth and adjacent feeder back-feeding during n-1 events.

Urban distribution transformers are sized using either an average diversified load for domestic consumers (4kVA) or assessed load information from industrial/commercial consumers. Maximum demand meters in the distribution substation ensures calculated values can be readily confirmed.

### Projects & Programmes

#### **10933 [2016] Morgan Street, Cushmor Drive to Forest Drive Methven – System Growth**

Over the last 20 years (since Methven underground conversion was completed) the town has grown and recently an additional 11kV feeder was constructed from Methven 66/11kV substation to provide sufficient security should one of the existing two feeders fail. The 11kV circuit configuration within Methven has a bottle-neck which prevents the new feeder from being well integrated into the system and during a fault may not be able to inject its full capacity.

This project creates an additional 11kV circuit linkage within Methven giving much greater flexibility during steady state operation as well as during n-1 events. A 350m length of cable will be installed and connected to existing cables to provide this link.

There are no alternatives to this work except the unacceptable status quo.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that all of this work will carry over in to 2017 (100% still to complete).

#### **00070 [2016] Agnes Street 11 Distribution Substation – Asset Replacement**

An aging 300kVA urban substation in poor condition requires rebuilding to bring it up to a modern standard of functionality and safety. The foundation of the pad also appears to have failed and the kiosk is leaning considerably, indicating a significant seismic risk.

This project will involve the removal of all of the existing substation (pad, transformer, kiosk cover, 11kV RMU, LV switchboard) and the refurbishment of the transformer and RMU. A new kiosk cover, LV switchboard, RMU & LV switchboard mounting frame, and ancillary equipment will be reinstalled to provide a much more secure, safer and flexible substation.

Leaving the substation in its present state is not acceptable and there are no other alternatives.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that part of this work will carry over in to 2017 (<50% still to complete).

#### **00069 [2017] Kermod Street 71 Distribution Substation – Asset Replacement**

An aging 750kVA CBD substation in poor condition requires rebuilding to bring it up to a modern standard of functionality and safety.

This project will involve the removal of most of the existing substation (transformer, kiosk cover, 11kV RMU, LV switchboard) and the refurbishment of the transformer and RMU. A new kiosk cover, LV switchboard, RMU & LV switchboard mounting frame, and ancillary equipment will be reinstalled to provide a much safer and flexible substation.

Leaving the substation in its present state is not acceptable and there are no other alternatives.

#### **11081 [2017] Mt Somers Alternate Supply – Quality of Supply**

The recent underground conversion project in Mt Somers township replaced a single circuit 11kV overhead line supply into the township. This was an acceptable situation when overhead as fault repairs can be achieved in relatively short timescales. Now that the supply to the township is via an 11kV underground cable the situation has changed and should the solitary cable fail, a much longer repair time would ensue.

This project is to add a second supply option to the township of Mt Somers so that restoration times are kept at an acceptable level. The alternative is to do nothing which is not considered acceptable for the 200 consumers fed by the cable.

#### **10685 [2018] West Street-Walnut Avenue Traffic Lights – Asset Relocation**

NZTA and the Ashburton District Council have indicated that an existing roundabout will be replaced with traffic lights on SH1 within Ashburton township. This will require the relocation of one ground-mounted distribution substation and the associated 11kV and LV cables.

This project and associated work is fully funded by the parties requesting the relocation.

#### **11059/78/79/11105 [2017-26] Unscheduled - System Growth/Quality of Supply/Asset Replacement/RSE Other**

A small amount of budget is set aside for unscheduled work that occasionally occurs. This could involve one or many classes of asset. It has been included in the urban distribution section as a significant proportion of EA Networks' consumers reside there. It is therefore likely that some of the demand for unscheduled work would come from these areas.

It should be noted that the Ashburton District Plan does not permit the installation of additional poles in the urban and fringe urban zones and replacement poles must be of the same or similar height and scale and in the same or similar location. This precludes significant changes to any overhead line if it was going to be rebuilt.

### **11058 [2017-26] Unscheduled Consumer Connections – Urban (Transformer/LV/Alteration) & Other**

When a new connection is supplied there is typically some modification or extension to the distribution network. This can range from a replacement pole through to a significant 11kV or 22kV extension of several hundred metres with a new substation.

Being unscheduled, this work is essentially completed on demand (assuming the new or altered connection load is advantageous to EA Networks). The solution chosen to supply a new/altered load is typically agreed during consultation with the consumer to determine a price/quality/security trade-off they are happy with.

Although subdivision work is categorised as Consumer Connection – Other, as it is triggered by the desire to take additional electrical connections to the network, it does not immediately create any new ICPSs. In fact, the bulk of new connections generally occur a year or so later as the marketing takes effect. A consequence of this is that there are generally no new ICPSs reported next to subdivision work in the disclosure documentation. Other types of new connections are charged directly against the project creating them and can be resolved back to the relevant connection category.

---

### **PROGRAMME [2017-25] Ashburton Core Urban 11kV Network – System Growth**

---

The adoption of the Reliability by Design guidelines by the Board has added impetus to the need to reduce the scale of urban 11kV feeders. The new guidelines have a maximum of 250 consumers per feeder before action is deemed necessary to reduce that number to below 200. There are many urban feeders that exceed that number by a significant margin and a range of initiatives are underway to close the gap to complying with the guidelines. This "Core Urban 11kV Network" programme ([Section 5.3.4](#)) is one of the most significant ones, and it will provide additional feeders from network centres embedded within the urban areas.

The planned reinforcement would take the form of relatively few, new, high capacity (7 MW) 11kV Core Network circuits radiating from both Ashburton and Northtown substations. These circuits would terminate in new switching centres that would interconnect (via circuit-breakers) with the smaller (4 MW) existing distribution feeders and also additional feeders created by utilising existing and new 11kV cables. Distribution substations would not be directly connected to these new Core Network circuits. These high capacity circuits would then interconnect between Network Centres (switching centres) to provide an 11kV backbone which could be used to shift load during cable faults and zone substation transformer outages. An added benefit is that the existing smaller feeders would be more than halved in length and load so any cable fault should affect less than half as many consumers and restoration to the un-faulted sections would be significantly faster.

With the continuing use of heat pumps to displace solid/liquid/gas fuel heating, the introduction of home-recharged electric cars, and the general growth in electricity demand continues, it is very likely that additional distribution system capacity will be needed in the Ashburton urban area. This programme will increase the capacity to supply load under both normal and contingency conditions.

This programme of works would only be undertaken as necessary. The addition of unforeseen load may accelerate the programme and equally a prolonged period of low growth may postpone parts of the programme. Once started, there will be key points where a pause can take place but these points must be reached as incomplete closure of a ring of the core 11kV circuits would heavily compromise security. The progress of the programme will be optimised by coordinating with the urban underground conversion programme.

Alternative distribution architectures may yet surface that provide a viable solution. These new technologies will be considered as part of any solution as will future load shifting or embedded generation or energy storage technologies.

This part of the programme identifies the 11kV cabling. The network centres are identified in [Section 5.4.8](#).

<b>00566</b>	<b>[2018]</b>	<b>11kV Core Network Cables – Ashburton (2.0km)</b>	<b>System Growth</b>
--------------	---------------	---	----------------------

A representative project installing 2km of 400 amp rated cable in Ashburton. The source and destination network centres will be detailed in the next plan as exact locations and names are still to be decided.

<b>00557</b>	<b>[2019]</b>	<b>11kV Core Network Cables – Ashburton (2.0km)</b>	<b>System Growth</b>
--------------	---------------	---	----------------------

A representative project installing 2km of 400 amp rated cable in Ashburton. The source and destination network centres will be detailed in the next plan as exact locations and names are still to be decided.

<b>00560</b>	<b>[2020]</b>	<b>11kV Core Network Cables – Tinwald (2.0km)</b>	<b>System Growth</b>
--------------	---------------	---	----------------------

A representative project installing 2km of 400 amp rated cable in Tinwald. The source and destination network centres will be detailed in the next plan as exact locations and names are still to be decided.

<b>00562</b>	<b>[2021]</b>	<b>11kV Core Network Cables – Ashburton (3.0km)</b>	<b>System Growth</b>
--------------	---------------	---	----------------------

A representative project installing 3km of 400 amp rated cable in Ashburton. The source and destination network centres will be detailed in the next plan as exact locations and names are still to be decided.

<b>00561</b>	<b>[2022]</b>	<b>11kV Core Network Cables – Tinwald (3.0km)</b>	<b>System Growth</b>
--------------	---------------	---	----------------------

A representative project installing 3km of 400 amp rated cable in Tinwald. The source and destination network centres will be detailed in the next plan as exact locations and names are still to be decided.

<b>00563</b>	<b>[2023]</b>	<b>11kV Core Network Cables – Ashburton (3.0km)</b>	<b>System Growth</b>
--------------	---------------	---	----------------------

A representative project installing 3km of 400 amp rated cable in Ashburton. The source and destination network centres will be detailed in the next plan as exact locations and names are still to be decided.

<b>00564</b>	<b>[2024]</b>	<b>11kV Core Network Cables – Ashburton (3.0km)</b>	<b>System Growth</b>
--------------	---------------	---	----------------------

A representative project installing 3km of 400 amp rated cable in Ashburton. The source and destination network centres will be detailed in the next plan as exact locations and names are still to be decided.

<b>00565</b>	<b>[2025]</b>	<b>11kV Core Network Cables – Ashburton (3.0km)</b>	<b>System Growth</b>
--------------	---------------	---	----------------------

A representative project installing 3km of 400 amp rated cable in Ashburton. The source and destination network centres will be detailed in the next plan as exact locations and names are still to be decided.

## **PROGRAMME [2017-24] Urban Underground Conversion – Asset Replacement/Quality of Supply**

During the 1960s and 1970s a significant amount of the urban electricity network was (re)built to service the new influx of electric ranges, electric heaters, electric washing machines, fridges and freezers. The network has lasted very well but is now overdue for replacement. The last urban overhead line that was rebuilt in 1993 is now 23 years old, many other lines are considerably older. Although the Ashburton District Plan allows the replacement of overhead lines with the same or similar type of construction there are no additional new poles allowed and all extensions and subdivisions are required to be completely underground. EA Networks has a policy that all new network connections are required to connect via underground cable.

As discussed elsewhere in this plan, the stakeholders and Board have shown considerable support for the




progressive removal of overhead lines from the urban areas. The widespread support of the consumers/shareholders lends additional weight to the other less obvious advantages that accrue from this work. The additional quality of supply, security, capacity, flexibility and low maintenance characteristics all contribute to greater consumer/shareholder satisfaction. Other stakeholders are also encouraging of this work.

The individual projects funded by this programme are prioritised by the following factors:

- 1) The condition of the existing overhead lines
- 2) The benefits to reliability and security obtained by underground conversion
- 3) The need to increase line or transformer capacity in an urban area

This programme targets the lines in poorest condition as a priority. Once they have been replaced with underground network the remaining overhead lines will have continued to age and at the end of the programme the major components of the final line to be removed will be 30 years old.

### February 2016- Remaining 11kV and LV Overhead Lines in Ashburton Township

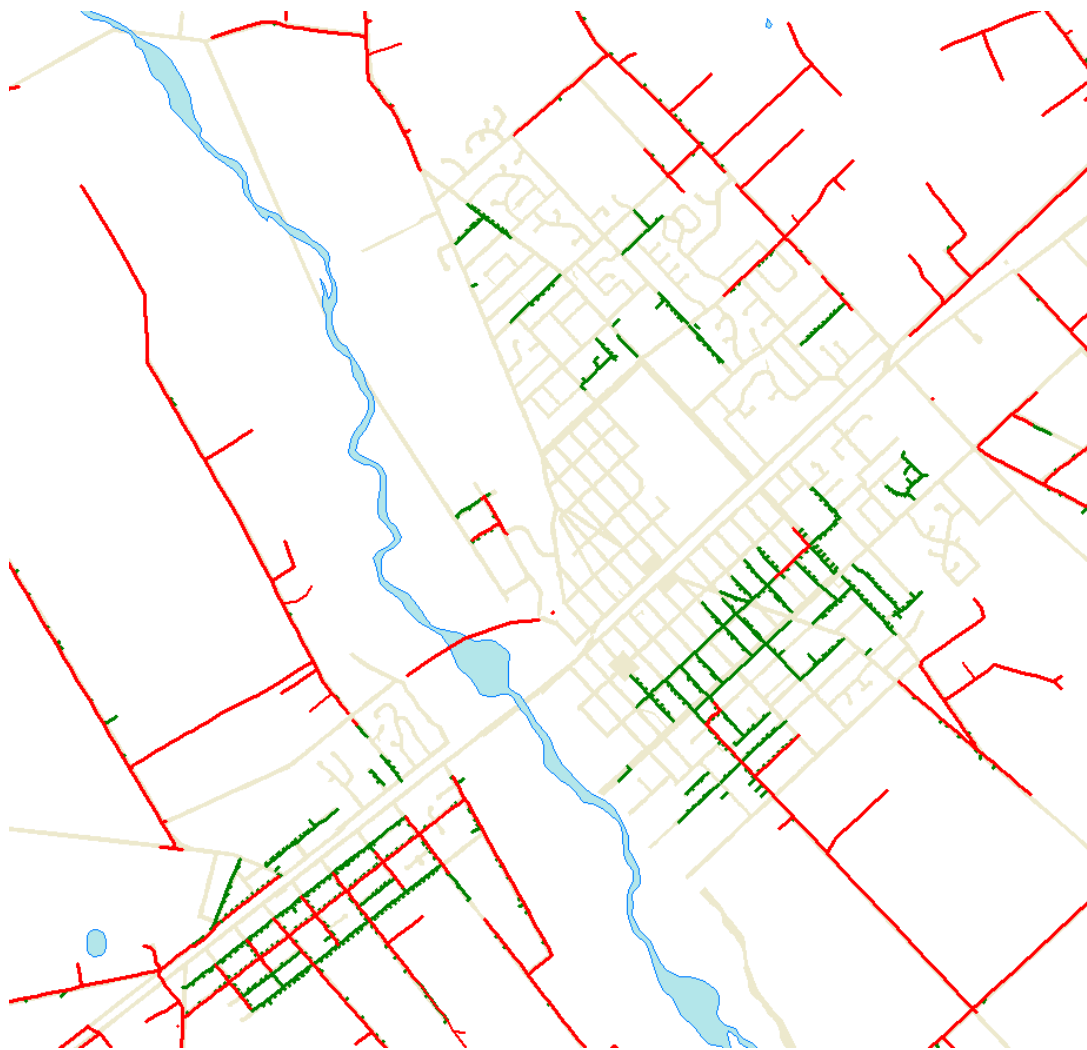

10917	[2016]	McDonald Street	Asset Replacement
<p>An underground conversion project to replace end-of-life (1965) LV urban overhead network. The route will be used for some 11kV cable as well providing additional inter-circuit connections. The project is in line with the Board's approach to urban network renewal.</p>			

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that part of this work will carry over in to 2017 (<20% still to complete).

<b>10919</b>	<b>[2016]</b>	<b>Carters Road</b>	<b>Asset Replacement</b>
--------------	---------------	---------------------	--------------------------

A small underground conversion project to replace end-of-life 11kV suburban overhead network. The project is in line with the Board's approach to urban network renewal.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that part of this work will carry over in to 2017 (<20% still to complete).

<b>11111</b>	<b>2017</b>	<b>Aitken St (William - Cass)</b>	<b>Asset Replacement</b>
--------------	-------------	-----------------------------------	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>11110</b>	<b>2017</b>	<b>Albert St (McDonald - Bridge)</b>	<b>Asset Replacement</b>
--------------	-------------	--------------------------------------	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>10991</b>	<b>2017</b>	<b>Barrhill Village</b>	<b>Asset Replacement</b>
--------------	-------------	-------------------------	--------------------------

The (very) small settlement of Barrhill (zoned residential) has a number of protected features under the Ashburton District Plan. These include architectural aspects, historical aspects and the established trees. The overhead network supplying Barrhill is at the end of its useful life and needs replacing. Considering the restrictions placed upon infrastructure in the village and the desire of the local community to retain as many of the special features as possible, it has been decided that an underground conversion is the preferred option, replacing the end-of-life overhead lines.

The work will involve one new ground-mounted substation, approximately 200m of 22kV cable and about 200m of LV cable. This will remove all poles and overhead electricity network from the village. Carried over from 2016.

<b>11108</b>	<b>2017</b>	<b>Beach Rd</b>	<b>Asset Replacement</b>
--------------	-------------	-----------------	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>11115</b>	<b>2017</b>	<b>Bowen St East (Bridge - Railway Tce East)</b>	<b>Asset Replacement</b>
--------------	-------------	--	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>11114</b>	<b>2017</b>	<b>Elizabeth Ave East (Bridge - Tancred)</b>	<b>Asset Replacement</b>
--------------	-------------	--	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>11116</b>	<b>2017</b>	<b>Eton St (Albert - Nelson)</b>	<b>Asset Replacement</b>
--------------	-------------	----------------------------------	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>11080</b>	<b>2017</b>	<b>Eton St (Beach - Tancred)</b>	<b>Quality of Supply</b>
--------------	-------------	----------------------------------	--------------------------

An Ashburton township underground conversion project that is required to remove 180m of 11kV overhead line remaining in the area which compromises overall urban reliability. Although the line is being replaced before the assessed end of its structural life, the poles are actually 45 years old.

<b>11106</b>	<b>2017</b>	<b>Fairton Township</b>	<b>Asset Replacement</b>
--------------	-------------	-------------------------	--------------------------

A project for the underground conversion of Fairton township that is part of the condition driven urban

overhead network replacement programme.

<b>10918</b>	<b>2017</b>	<b>Galbraith St</b>	<b>Asset Replacement</b>
--------------	-------------	---------------------	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>11109</b>	<b>2017</b>	<b>George St</b>	<b>Asset Replacement</b>
--------------	-------------	------------------	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.


<b>11117</b>	<b>2017</b>	<b>Harrison St (Oak Grove - Cross)</b>	<b>Asset Replacement</b>
--------------	-------------	--	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>10732</b>	<b>2017</b>	<b>Rakaia 22kV security. Railway Tce East to Mackie St</b>	<b>Quality of Supply</b>
--------------	-------------	--	--------------------------

A project to reinforce the 22kV links within Rakaia township. Currently only one overhead 22kV circuit crosses the railway line through Rakaia township which leaves the town's population exposed to overhead faults during extreme weather events (see schematic at left – additions in blue). This project will add some 22kV cabling and switchgear to provide an alternative supply through the township. The chosen route will also fortuitously cause some end of life LV overhead lines to be replaced with underground cable.

The project is in line with the Board's approach to urban network renewal and the Ashburton District Plan does not permit new urban overhead construction. Partly carried over.

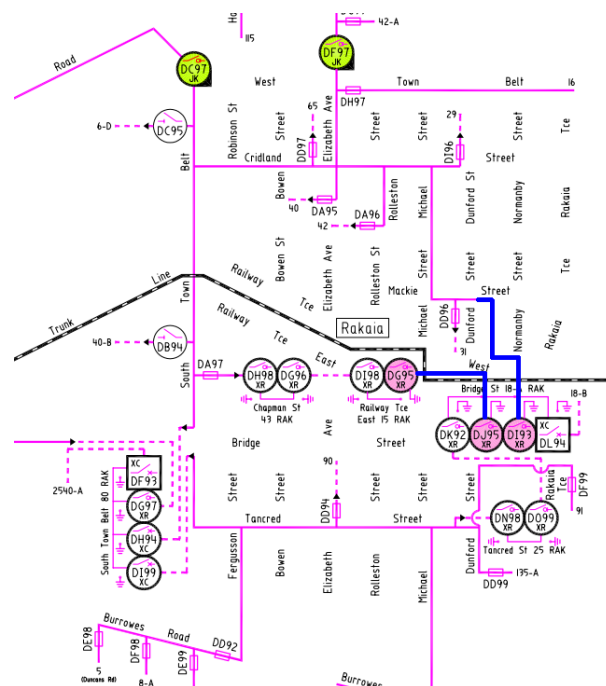

<b>11107</b>	<b>2017</b>	<b>Nixon St</b>	<b>Asset Replacement</b>
--------------	-------------	-----------------	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>11053</b>	<b>2017</b>	<b>Pitt St, Rakaia</b>	<b>Quality of Supply</b>
--------------	-------------	------------------------	--------------------------

A Rakaia township underground conversion project that is required to remove some older LV overhead lines that are in conflict with trees and cause ongoing reliability issues. The project is LV only and very low cost.

<b>11113</b>	<b>2017</b>	<b>Railway Tce West (Shopping Centre)</b>	<b>Asset Replacement</b>
--------------	-------------	---	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>11112</b>	<b>2017</b>	<b>Walnut Ave (Chalmers Ave - Intermediate School)</b>	<b>Asset Replacement</b>
--------------	-------------	--	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.


<b>278</b>	<b>2018</b>	<b>Belt Road (Racecourse Rd - Hanrahan St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>392</b>	<b>2018</b>	<b>Bowen St East (Bridge St - Burrowes Rd)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>277</b>	<b>2018</b>	<b>Chalmers Ave (Wakanui Rd - Wellington St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>292</b>	<b>2018</b>	<b>Chapman Street (STB - Bowen St)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>281</b>	<b>2018</b>	<b>Church Street (Beach Rd - Wellington St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>283</b>	<b>2018</b>	<b>Leeston Street (Beach Rd - River)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>288</b>	<b>2018</b>	<b>Reid Cres (Elizabeth St - Cross St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>280</b>	<b>2018</b>	<b>Tancred Street (William St - Cambridge St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>287</b>	<b>2018</b>	<b>Victoria Street (Wills St - William St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>285</b>	<b>2018</b>	<b>William Street (Dobson St - Princes St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>293</b>	<b>2019</b>	<b>Cox St (Cass St - Chalmers Ave)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>303</b>	<b>2019</b>	<b>Dunford Street (Bridge St - Tancred St)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			

<b>301</b>	<b>2019</b>	<b>Grey St (William St - Eton St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>297</b>	<b>2019</b>	<b>Grove St (Catherine St - Wilkin St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>300</b>	<b>2019</b>	<b>Harland St (Johnstone St - Manchester St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>295</b>	<b>2019</b>	<b>Harrison St (Bathurst St - Lane St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>299</b>	<b>2019</b>	<b>James St (Alford Forest Rd - Harrison St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>302</b>	<b>2019</b>	<b>Millichamp St</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>304</b>	<b>2019</b>	<b>Normanby Street (West Town Belt - Cridland St)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>305</b>	<b>2019</b>	<b>Porter St (Bridge St - McDonald St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>294</b>	<b>2019</b>	<b>Sudbury St</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>298</b>	<b>2019</b>	<b>Wilkin St (Millbrook Pl - Grove St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>312</b>	<b>2020</b>	<b>Anne St</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>316</b>	<b>2020</b>	<b>Cambridge St (Nelson St - Wakanui Rd)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			

<b>317</b>	<b>2020</b>	<b>Cameron St (William St - Chalmers Ave)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

### February 2016- Remaining 11kV and LV Overhead Lines in Rakaia Township

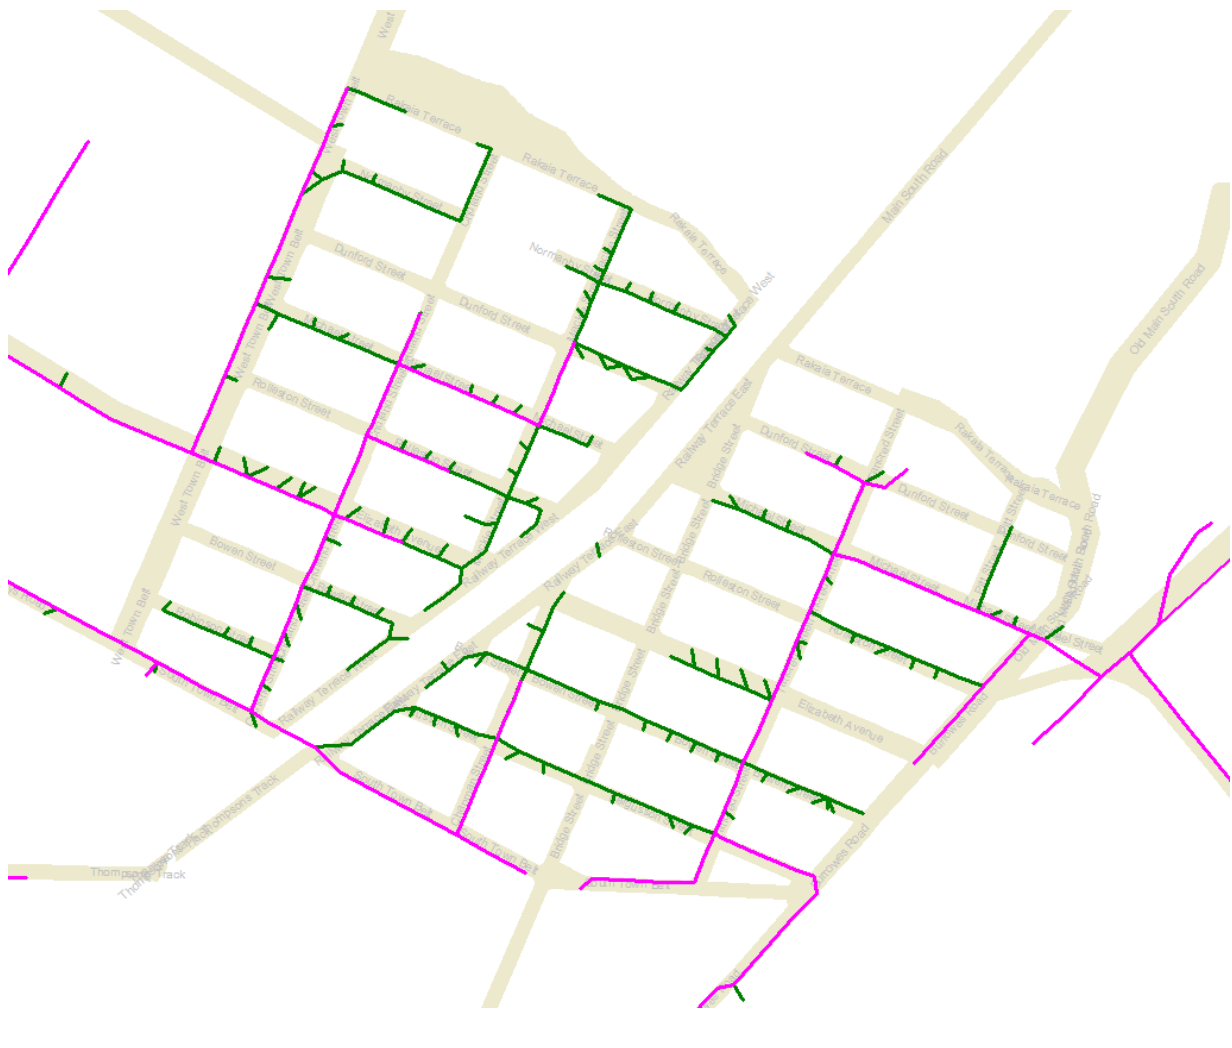

<b>306</b>	<b>2020</b>	<b>Cridland Street (Elizabeth Ave - Michael St)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>310</b>	<b>2020</b>	<b>Elizabeth Ave West (North Side, West Town Belt - Cridland St)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>313</b>	<b>2020</b>	<b>Lauriston Township</b>	<b>Asset Replacement</b>
------------	-------------	---------------------------	--------------------------

A project for the underground conversion of Lauriston township that is part of the condition driven urban overhead network replacement programme.

<b>311</b>	<b>2020</b>	<b>McMurdo St (Hassel St - Wilkins St)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>314</b>	<b>2020</b>	<b>Peter Street (William St - Cass St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>307</b>	<b>2020</b>	<b>Robinson Street, Rakaia (West Town Belt - Cridland St)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>315</b>	<b>2020</b>	<b>Wills St (Victoria St - William St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>326</b>	<b>2021</b>	<b>Cracroft St, Hinds (Peters St - Nugent St)</b>	<b>Asset Replacement</b>
A Hinds township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>328</b>	<b>2021</b>	<b>Cridland Street (West Town Belt - Elizabeth Ave)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>329</b>	<b>2021</b>	<b>Elizabeth Ave West (South Side, West Town Belt - Railway Tce West)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>324</b>	<b>2021</b>	<b>Gray St, Hinds (Cracroft St - Isleworth Rd)</b>	<b>Asset Replacement</b>
A Hinds township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>319</b>	<b>2021</b>	<b>Isleworth Rd, Hinds (Peters St - Nugent St)</b>	<b>Asset Replacement</b>
A Hinds township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>321</b>	<b>2021</b>	<b>Johnstone St, Hinds (Peters St - Nugent St)</b>	<b>Asset Replacement</b>
A Hinds township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>333</b>	<b>2021</b>	<b>Mackie Street HV Only (Rolleston St - Michael St)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>331</b>	<b>2021</b>	<b>Melcombe St (Anne St - Maronan Rd)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>325</b>	<b>2021</b>	<b>Michael St (East Side, Bridge St - Burrowes Rd)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			

<b>318</b>	<b>2021</b>	<b>Michael Street (West Side, West Town Belt - Railway Terrace West)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>330</b>	<b>2021</b>	<b>Moore St (William St - Chalmers Ave)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>320</b>	<b>2021</b>	<b>Peters St, Hinds (Cracroft St - Isleworth Rd)</b>	<b>Asset Replacement</b>
A Hinds township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>323</b>	<b>2021</b>	<b>Rakaia Terrace</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>332</b>	<b>2021</b>	<b>Rolleston Street West HV Only (Cridland St - Mackie St)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>322</b>	<b>2021</b>	<b>West Town Belt (Elizabeth Ave - Rakaia Tce)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>343</b>	<b>2022</b>	<b>Bowen St West (Cridland St - Rakaia Terrace West)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>344</b>	<b>2022</b>	<b>Burrows Road (STB to Elizabeth Ave)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>340</b>	<b>2022</b>	<b>Carters Tce</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>341</b>	<b>2022</b>	<b>Fergusson Street (Rakaia Terrace East - Burrows Rd)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>334</b>	<b>2022</b>	<b>Harland St (Catherine St - Graham St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>338</b>	<b>2022</b>	<b>Johnstone St (McMurdo St - Grove St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			



<b>346</b>	<b>2022</b>	<b>Mackie Street (Elizabeth Ave - Dunford St)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>336</b>	<b>2022</b>	<b>Manchester St (McMurdo St - Harland St)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>339</b>	<b>2022</b>	<b>Oxford St (Beach Rd - Wellington St)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>348</b>	<b>2022</b>	<b>South Town Belt East (Bridge St - Burrowes Rd)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>347</b>	<b>2022</b>	<b>Tancred Street, Rakaia (South Town Belt - Dunford St)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>335</b>	<b>2022</b>	<b>Thomson St (Carter Tce - Wilkin St)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>337</b>	<b>2022</b>	<b>Wilkin St (McMurdo St - Millbrook Pl)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>356</b>	<b>2023</b>	<b>Agnes St (McMurdo St - Grove St)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>369</b>	<b>2023</b>	<b>Allens Road (Harrison St-Alford Forest Rd)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>368</b>	<b>2023</b>	<b>Allens Road (Racecourse Rd-Carters Rd)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>350</b>	<b>2023</b>	<b>Farm Rd (Middle Rd - Racecourse Rd)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>355</b>	<b>2023</b>	<b>Grahams Street (McMurdo St - Grove St)</b>	<b>Asset Replacement</b>
------------	-------------	---	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>353</b>	<b>2023</b>	<b>McNally St (Range St - McGregor Ln)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>349</b>	<b>2023</b>	<b>Racecourse Rd (Farm Rd - Russell Ave)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>352</b>	<b>2023</b>	<b>Robinson St (McNally St - Smallbone Dr) &amp; Watson St (Range St - Robinson St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>354</b>	<b>2023</b>	<b>Thomson St (Wilkin St - Grove St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>360</b>	<b>2024</b>	<b>Burrowes Road (Elizabeth Ave - Michael St)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>366</b>	<b>2024</b>	<b>Catherine St (McMurdo St - Grove St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>365</b>	<b>2024</b>	<b>Jane St (McMurdo St - Grove St)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>357</b>	<b>2024</b>	<b>Melcombe St (Anne St - Lagmhor Rd)</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>401</b>	<b>2024</b>	<b>Mt Hutt Station Rd (Methven – Holmes Rd)</b>	<b>Asset Replacement</b>
A Methven township underground conversion project that is part of the condition driven urban overhead network replacement programme. Although the current Methven township has a completely underground electricity network, the expansion of the town will see it encompass some existing overhead line that will be at the end of its useful life within the planning period. It will be replaced with underground and incorporated into the Methven urban distribution network.			
<b>361</b>	<b>2024</b>	<b>Rolleston Street (Tancred St - Burrowes Rd)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>363</b>	<b>2024</b>	<b>Rolleston Street West (Mackie St - Cridland St)</b>	<b>Asset Replacement</b>
A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.			
<b>359</b>	<b>2024</b>	<b>Shearman St</b>	<b>Asset Replacement</b>
An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme.			

overhead network replacement programme.

<b>362</b>	<b>2024</b>	<b>South Town Belt - West (West Town Belt - SH1)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

A Rakaia township underground conversion project that is part of the condition driven urban overhead network replacement programme.

<b>364</b>	<b>2024</b>	<b>Thomson St (Grahams St - Hassel St)</b>	<b>Asset Replacement</b>
------------	-------------	--	--------------------------

An Ashburton township underground conversion project that is part of the condition driven urban overhead network replacement programme. The Thomson Street line is the youngest of all urban overhead lines. Although the replacement of this line with underground network may be slightly premature, all of the surrounding network will be underground and there will be new underground network fed from it. It is logical to complete the underground conversion programme by replacing this mid-late life line although the project may be delayed if deemed necessary.

Once completed, this project should see that last electricity pole removed from all of the urban areas supplied by EA Networks.

### 5.4.6 Industrial 11kV Distribution Network

The major industrial zoned areas of Ashburton, Methven and Rakaia are generally close to existing or proposed zone substations. This has made planning for the security and capacity requirements of these areas relatively straightforward. As necessary, additional feeders will be taken into these areas to ensure compliance with the security and power quality standards. A new industrial park is being developed to the northeast of Ashburton township and it is in close proximity to both Fairton and Northtown substations.

A number of industrial plants are directly connected to EA Networks' HV distribution network and these consumers have individual arrangements with regards the security, reliability and quality of supply they wish to receive. Most of these consumers are adjacent to a zone substation and they take ownership of the HV distribution network (generally excluding transformers) as it enters the plant boundary. Any alteration of the supply up to the boundary is done either at the request of the consumer or by negotiation with the consumer. Any alteration to the HV network within the plant boundary is the responsibility of the consumer and although EA Networks can offer advice on solutions it is up to the consumer to ensure adequate capacity and performance.

#### Capacity of New Equipment

The majority of equipment is sized to suit individual industrial consumers. Consumers are asked to reveal any expansion plans so this can be factored into the sizing calculation. Most industrial consumers of note are served by a dedicated distribution substation and the cost to the consumer indirectly reflects the investment in these assets i.e. the consumer gets the capacity and security they pay for.

#### Projects & Programmes

##### **11059/11105 [2017-25] Unscheduled - Asset Replacement, System Growth**

Any work identified here is to secure industrial load as part of the underground conversion programme. Most of this load is on a radial feed, and work would typically increase security while relieving feeders that are heavily loaded.



##### **11058 [2017-25] Unscheduled Consumer Connections – Urban**

When a new connection is supplied there is typically some modification or extension to the distribution

network. This can range from a replacement pole through to a significant 11kV or 22kV underground extension of several hundred metres with a new substation.

Being unscheduled, this work is essentially completed on demand (assuming the new or altered connection load is advantageous to EA Networks). The solution chosen to supply a new/altered load is typically agreed during consultation with the consumer to determine a price/quality/security trade-off they are happy with.

### 5.4.7 Low Voltage Network

The LV distribution network is heavily interconnected in the urban area. This generally permits reconfiguration to solve capacity problems. If a new consumer load exceeds the additional capacity reconfiguration can liberate, a new cable is normally run from either a suitable distribution substation or higher capacity LV node. Should the load exceed the ability of the LV network to meet the security standard, a new distribution substation is the most common alternative. Essentially the LV network is extended or installed on demand.

The low consumer count on each LV segment typically precludes a high level of security at the individual connection. Some larger consumers will be supplied from a switching point from which two supplies can be selected. This allows restoration of supply relatively quickly after an LV segment fault, while others directly connected to the segment will have to wait for either physical isolation of the faulted cable or the full repair time.

The LV network in Ashburton is approximately 65% underground by area. This underground area is largely fault-free. Occasional terminal or connector problems arise and there have been some instances of older single core PVC insulated aluminium cables corroding causing an open circuit fault.

The capacity of the LV underground network is adequate for the planning period except for a few very early underground subdivisions where the cables were undersized by modern standards. These are not causing a problem at the moment but could become an issue before the end of the planning period as both the thermal rating and guideline voltage drop limits are exceeded.

Urban Methven has been completely underground for several years and has a low-maintenance LV network. Load growth is typically hotels, accommodation houses, restaurants or smaller industrial loads. The accommodation houses and restaurants are usually supplied from the LV network and have consumed much of the extra capacity built into the LV network at the design stage. Fortunately, the density of these developments has peaked and it appears that as a new one opens, another tends to close. The larger hotel and industrial loads are supplied from a dedicated distribution substation in most cases. When they are supplied from the LV network, care has been taken that the additional source impedance does not permit inrush loads such as motors to interfere with other consumers on the same LV segment.

Rural LV distribution is traditionally overhead and serves one or two consumers on each segment. Other than conversion to underground cable (normally at the consumer's cost) there is little that can be done to collectively and economically improve the security of these lines.

### Capacity of New Equipment

The value of the cable is typically a relatively minor component of the total cost of LV underground network installations. The standard cable in use at EA Networks is either 185 mm<sup>2</sup> aluminium or 240 mm<sup>2</sup> aluminium 3 core neutral screened XLPE insulated cable. This allows optimal spacing of distribution substations while ensuring adequate capacity to allow for adjacent distribution substation outages caused by maintenance or fault. The key parameter is that the voltage at any connection point must not drop below 95% of the nominal value during a foreseeable n-1 security event. The thermal rating of the cable must not be continuously exceeded at any time.

### Projects & Programmes

See the projects listed under [section 5.4.5](#) as they contain the majority of new LV network – installed in conjunction with MV work.

### 11058 [2017-26] **Unscheduled Consumer Connections – Urban**

When a new connection is supplied there is typically some modification or extension to the distribution network. This can range from a new pillar box through to a significant LV extension of a hundred metres.

Being unscheduled, this work is essentially completed on demand (assuming the new or altered connection load is advantageous to EA Networks). The solution chosen to supply a new/altered load is typically agreed during consultation with the consumer to determine a price/quality/security trade-off they are happy with.

### **PROGRAMME [2017-24] Urban Underground Conversion – Asset Replacement/Quality of Supply**

As the urban underground conversion programme progressively covers the urban areas, the security and capacity of the LV distribution network improves significantly. This programme is the only identifiable initiative to reinforce this section of the network to accommodate future demand and security objectives. The modern cable designs and installation techniques will guarantee a long trouble-free life for this plant. The consumer/shareholder enthusiasm for this programme is very high. All stakeholders in this plan are satisfied that the urban underground conversion programme is the best solution for an ageing urban overhead network.

## 5.4.8 High Voltage Switchgear

The range of high voltage switchgear in use at EA Networks covers 66kV, 33kV, 22kV and 11kV voltages; circuit breakers, disconnectors, load-break switches, fuse switches, fuses, links; and is located on poles, on the ground, inside kiosks, inside buildings, and inside zone substations. Although the voltage, type and location of the devices vary greatly they are all electromechanical in nature and share common asset attributes and maintenance requirements.

Generally new switchgear is installed as an adjunct to subtransmission, distribution or zone substation projects. There are a few projects and programmes that are explicitly switchgear focussed and they are described here.

### Capacity of New Equipment

Switchgear capacity is typically sized to comfortably exceed the load rating forecast for ten years into the future. The majority of high voltage switchgear has minimum ratings that significantly exceed EA Networks' requirements. The required fault ratings are determined by the parameters detailed in [Section 5.1.1](#).

Operational safety requirements are considered when new types of switchgear are evaluated for introduction into the EA Networks network.

### Projects & Programmes

#### **PROGRAMME [2017-25] Ashburton Core Urban 11kV Network – Quality of Supply**

As discussed in Section 5.4.5, this programme is to reinforce the urban 11kV network to reduce the impact of individual faults and provide greater feeder capacity.

This part of the programme identifies the 11kV network centres. The 11kV cabling is identified in [Section 5.4.5](#).

11076	[2017]	11kV Network Centres - Tinwald	Quality of Supply
-------	--------	--------------------------------	-------------------

The suburb of Tinwald in Ashburton township continues to grow and currently has about 1,500 network connections served by three feeder cables. The recent revision to the distribution security standards has resulted in a requirement to have no more than 250 connections per feeder. The standard stipulates that once 250 connections are exceeded a network reconfiguration or development should occur to reduce the connection count per feeder to no more than 200.

The situation in Tinwald has long been in excess of 250 connections per feeder and a reduction is now

needed. To achieve this, EA Networks have decided to introduce network centres and a core 11kV network.

In order to meet the security standard a total of 8 11kV feeders will be required, with the facility for more to account for township growth. The new Tinwald substation will provide 3 of these. At least two more strategically located sites are required to provide a logical network centre configuration.

This project will establish two network centre sites within Tinwald. These sites will be the focus of 11kV feeder development during the continuing urban underground conversion programme.

<b>00556</b>	<b>[2018]</b>	<b>11kV Network Centres - Ashburton</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A total of five network centres will be required in the Ashburton township and this project will provide two of them. The specific locations and names have yet to be determined and will be documented in the next plan.

<b>00559</b>	<b>[2019]</b>	<b>11kV Network Centres - Ashburton</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A total of five network centres will be required in the Ashburton township and this project will provide two of them. The specific locations and names have yet to be determined and will be documented in the next plan.

<b>00567</b>	<b>[2020]</b>	<b>11kV Network Centre - Ashburton</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A total of five network centres will be required in the Ashburton township and this project will provide one of them. The specific location and name has yet to be determined and will be documented in the next plan.

<b>00558</b>	<b>[2020]</b>	<b>11kV Network Centre – Tinwald</b>	<b>Quality of Supply</b>
--------------	---------------	--------------------------------------	--------------------------

A total of three network centres will be required in the Tinwald suburb and this project will provide one of them. The specific location and name has yet to be determined and will be documented in the next plan.

## **PROGRAMME [2017-21] Rural Ring Main Unit (RMU) Installation – Quality of Supply**

One of the programmes that has been pursued by EA Networks is the strategic use of ground mounted ring main units (RMUs) in the rural area where a three or four way intersection of circuits occurs. The use of a RMU provides a number of benefits over a conventional disconnecter. RMUs can be readily remote controlled and most have built in fault indication and voltage indication. The environmentally isolated switching and insulation systems ensure a much higher insulation integrity as well as traditionally higher reliability of operation. In-built fault-making earth switches (which can be remotely closed after on-site selection on the EA Networks RMUs) provide much safer isolation and earthing points than traditional pole-mounted switchgear. Some modern RMUs have vacuum circuit-breakers in the place of fuses and this allows not only repeated operation but also the potential for single operation auto-reclose.

Field staff have reported a great deal of comfort and confidence in using the RMUs for switching, isolation and earthing. The accessibility and relatively small amount of effort required to operate the switchgear (when remote control is not available) is certainly useful for a mixed gender workforce and a workforce with an age range spanning five decades. Some older pole-mounted switchgear is very challenging for individuals to not only access but also operate due to wind, rain, snow, vegetation, terrain, and mechanical effort required. All rural RMUs have a hotmix apron in front of the doors to provide a firm and even footing for the operator and ensure a very high resistance to earth when touching the metal parts of the RMU.

This programme covers the installation of a significant number of RMUs at various locations. All of the RMU ways are circuit breakers and will have protection and auto-reclose functions available and will be applied where it is deemed appropriate.

<b>11100</b>	<b>[2017]</b>	<b>RMU (3 x CB) - cnr Ashburton Staveley Rd and Allan Smiths Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>11062</b>	<b>[2017]</b>	<b>RMU (3 x CB) - cnr Mitcham &amp; Hepburns Rds</b>	<b>System Growth</b>
--------------	---------------	--	----------------------

A new rural RMU that will allow additional load segregation, relieve two urban feeders of surplus rural consumers, and provide the new Fairton substation with rural load that has grown without any other option for supply.

Any alternatives with similar functionality to a RMU are approaching the same cost without some of the inherent safety benefits.

<b>11101</b>	<b>[2017]</b>	<b>RMU (4 x CB) - cnr Hackthorne Rd and Ealing Montalto Rd</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>11098</b>	<b>[2017]</b>	<b>RMU (4 x CB) - cnr Hackthorne Rd and Valetta Westerfield Rd</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>11102</b>	<b>[2017]</b>	<b>RMU (4 x CB) - cnr Seafield Rd and Christys Rd.</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>11099</b>	<b>[2017]</b>	<b>RMU (4 x CB) - cnr Timaru Track Rd and Tinwald Westerfield Rd</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>11103</b>	<b>[2017]</b>	<b>RMU (4 x CB) - cnr Tinwald Westerfield Mayfield Road and Mayfield Valetta Road</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00247</b>	<b>[2018]</b>	<b>RMU (3 x CB) - cnr Bonningtons Rd &amp; Seaside Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00244</b>	<b>[2018]</b>	<b>RMU (3 x CB) - cnr of Dromore Methven Rd and Winchmore School Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is

used to connect each overhead line. All equipment is rated at 22kV.

<b>00245</b>	<b>[2018]</b>	<b>RMU (3 x CB) - cnr of Lyndhurst Rd &amp; Back Track</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00248</b>	<b>[2018]</b>	<b>RMU (3 x CB) - cnr of Wakanui School Rd &amp; Wilsons Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00446</b>	<b>[2018]</b>	<b>RMU (4 x CB) - cnr McDougalls Rd &amp; Fountaines Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00243</b>	<b>[2018]</b>	<b>RMU (4 x CB) - cnr Valetta Westerfield Rd &amp; Mayfield Valetta Rd</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00246</b>	<b>[2018]</b>	<b>RMU (4 X CB) - River Rd 1196, Hakatere</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00249</b>	<b>[2019]</b>	<b>RMU (3 x CB) - cnr of Longbeach Rd &amp; Dawsons Rd</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00258</b>	<b>[2019]</b>	<b>RMU (3 x CB) - cnr of Poplar Rd &amp; Davisons Rd</b>	<b>Quality of Supply</b>
--------------	---------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00260</b>	<b>[2019]</b>	<b>RMU (4 x CB) - cnr Anama School Rd &amp; Peters Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00259</b>	<b>[2019]</b>	<b>RMU (4 x CB) - cnr Coldstream Rd &amp; Boundary Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00257</b>	<b>[2019]</b>	<b>RMU (4 x CB) - cnr Coldstream Rd &amp; Emersons Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is



used to connect each overhead line. All equipment is rated at 22kV.

<b>00420</b>	<b>[2019]</b>	<b>RMU (4 x CB) - cnr Emersons Rd &amp; Brogdens Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00261</b>	<b>[2020]</b>	<b>RMU (3 x CB) - cnr of Corbetts Rd &amp; Acton Rd</b>	<b>Quality of Supply</b>
--------------	---------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00433</b>	<b>2020</b>	<b>RMU (3 x CB) - cnr of Longbeach Rd &amp; Surveyors Rd</b>	<b>Quality of Supply</b>
--------------	-------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00266</b>	<b>2020</b>	<b>RMU (3 x CB) - cnr of Mainwarings Rd &amp; McLauchlans Rd</b>	<b>Quality of Supply</b>
--------------	-------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00264</b>	<b>2020</b>	<b>RMU (4 x CB) - cnr Arundel Rakaia Gorge &amp; McLennans Rd</b>	<b>Quality of Supply</b>
--------------	-------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00262</b>	<b>2020</b>	<b>RMU (4 x CB) - cnr Dobsons Ferry Rd &amp; Mainwarings Rd</b>	<b>Quality of Supply</b>
--------------	-------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00263</b>	<b>2020</b>	<b>RMU (4 x CB) - cnr Methven Hwy &amp; Reynold Rd</b>	<b>Quality of Supply</b>
--------------	-------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00268</b>	<b>2021</b>	<b>RMU (3 x CB) - cnr Ashburton Staveley Rd &amp; Walkhams Rd</b>	<b>Quality of Supply</b>
--------------	-------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00270</b>	<b>2021</b>	<b>RMU (3 x CB) - cnr of Fords Rd &amp; Wheatstone Rd</b>	<b>Quality of Supply</b>
--------------	-------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00267</b>	<b>2021</b>	<b>RMU (3 x CB) - cnr of Mayfield Klondyke Rd &amp; Hinds Gorge Rd</b>	<b>Quality of Supply</b>
--------------	-------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00269</b>	<b>2021</b>	<b>RMU (4 x CB) - cnr Ealing Montalto Rd &amp; Trevors Rd</b>	<b>Quality of Supply</b>
--------------	-------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00412</b>	<b>2021</b>	<b>RMU (4 x CB) - cnr Ledgerwood Rd &amp; Dip Rd</b>	<b>Quality of Supply</b>
--------------	-------------	--	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

<b>00265</b>	<b>2021</b>	<b>RMU (4 x CB) - cnr Pendarves Rakaia Rd &amp; Rules Rd.</b>	<b>Quality of Supply</b>
--------------	-------------	---	--------------------------

A project to remove some overhead switchgear to provide a more reliable, safer and more flexible remote controlled alternative using a ground mounted RMU. A short length of underground cable is used to connect each overhead line. All equipment is rated at 22kV.

### 5.4.9 Protection Systems

The demands of the security standards and increased load require that the protection systems not only detect faults but also, whenever possible, prevent overloading of network components. As technology advances this is becoming more achievable. Devices now exist that can monitor and model many different power system components while offering fault protection functionality as their primary purpose. With an accurate model, many power system components can be run at higher than rated capacity for short periods without any detrimental effects. This can liberate previously unavailable capacity to supply either additional short-term peaking load or offer higher security to consumers reliant on that component as an alternative supply.

When any network is made more secure there is normally a protection relay that is providing the logic to keep the supply on to consumers. At subtransmission voltages this involves isolating the faulted path, leaving the unfaulted path(s) to carry the full load. This philosophy may also exist in heavily loaded HV distribution networks. In HV distribution the goal is usually to:

- (1) ensure the fault is not transient (a branch touching a line then burning away) - in which case the line will be automatically relivened (this is not used for underground cable circuits),
- (2) if the fault is permanent, interrupt only the faulted segment of network in the fastest possible time,
- (3) if it is possible to reconfigure the network to resupply consumers that are not connected to the faulted segment, do so in the shortest possible time.

All of these goals are to some degree achievable and, if implemented, can help increase compliance with security standards as load grows.

### Projects & Programmes

The zone substation replacement, development and enhancement projects all contain aspects of protection technology. Although it is possible that protection will be upgraded independently of these projects, the majority of new protection will be introduced as a result of zone substation work.

The introduction of closed 66kV rings requires some form of directional, distance or differential protection scheme to take full advantage of the additional security two 66kV lines per substation offers. EA Networks standard approach is to use line differential protection with a distance backup on all 66kV line terminals

and also use bus differential protection on each 66kV busbar. The line differential protection uses the EA Networks inter-substation fibre optic network. The 3 zone distance protection will also be the master control device for the line bay (marshalling or controlling items such as: status, analogue values, reclosing and remote control etc). Once complete, all equipment from the 66kV GXP to the zone substation 22kV (or 11kV) busbar will be covered by differential protection zones. This arrangement will provide selective operation of all circuit-breakers in the fastest possible way – minimising voltage depressions and outages experienced by consumers.

There are a range of alternative protection schemes that could possibly be engineered to perform a similar function (at significant engineering cost both initially and for maintenance) but none would offer the same level of performance on offer by the differential/distance combination. Also, none of the alternative protection schemes would scale up as easily or be as stable with the level of interconnectivity that the 66kV system will eventually exhibit.

### **10988 [2016] 66kV System Sync-Check – Quality of Supply**

The embedded hydro generator at Highbank is a synchronous machine that can create an island situation if the 66kV subtransmission network clears a fault that trips both of the 66kV lines that interconnect MTV substation with the EGN/ASB GXP. This situation can be catastrophic if the network is reconnected to the Highbank supplied island when it is out of phase with the EGN supplied network. The generator can suffer irreparable damage. Currently there is no automatic reclosing on the 66kV network and even during controller-initiated closures of 66kV circuit breakers Trustpower shuts down the Highbank generator to guard against out of synchronism events. The disadvantages of this mode of operation are clear. All 66kV circuit breakers fault operations must be patrolled before any thoughts of closing the circuit breaker and when that can occur, Highbank must be shut down. This all adds to delays and inefficiency.

This project is to provide a mechanism that guarantees that synchronism exists between EGN and MTV and communicates this to all of the nodes on the 66kV network. The approach that EA Networks intend to take is to install a device at EGN and another at MTV that sense the 66kV voltage and communicate samples of this with a very accurate time stamp (Synchrophasors) to a calculation device. The calculation device checks the absolute and relative phase angle of the two signals to see if it is stable and within acceptable bounds. If it is, a signal is propagated across the network to indicate that it is permissible to close a 66kV circuit breaker. The absence of this signal will be used to inhibit closing of all 66kV line circuit breakers.

Discussion with Trustpower will take place to ensure they are satisfied with the degree of security that this check offers and if agreement is reached the project will proceed.

The alternative of the status quo, while safe and low risk, is very inefficient and cumbersome. The only additional option would be to fit 66kV line VTs and synchronising relays to all line terminals in the EA Networks 66kV network. This would cost a considerable sum and is unlikely to be any more secure than the proposed solution.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that all of this work will carry over in to 2017 (100% still to complete).

### **00195/119 [2016] Fault Detectors – Quality of Supply**

A number of RMU fault indicators will be purchased to install at strategic parts of the network to assist with fault sectionalising. This is a result of using a neutral earthing resistor (NER) on the Northtown 11kV supply to Ashburton. Historically, staff could rely on the overcurrent fault indicators that come standard with the ring main units that EA Networks have purchased for several decades as the earth fault current would be several thousand amps. The NER has reduced 11kV earth fault levels to less than load currents and the traditional fault indicators no longer work for earth faults. The new fault indicators will be positioned at feeder midpoints and branch points on the underground network. These same fault indicators could also be used in the rural network at RMUs to provide fault passage indication.

The second project is for conventional overhead line fault indicators which are useful for rapid fault identification.

There are no alternatives other than to do without fault indication, which is not acceptable.

Although it has not been identified in the expenditure projections, at the time of writing it is looking possible that all of this work will carry over in to 2017 (100% still to complete).

**10961 [2017] MHT Transformer and Feeder Protection – Asset Renewal**

The protection at Mt Hutt substation was state of the art when it was first installed in 1987. In the 28 years that have followed the first generation ABB solid state/numeric relays have provided very reliable service. Discussion with various vendors of utility grade electronic devices have suggested that there are three thresholds when considering device age. 15 years is when you should begin to closely monitor the health of the device to see if it exhibits any loss of calibration or other signs of aging. At 20 years the device should be scheduled for replacement. At 25 years the device is at the end of its life and should be replaced as soon as possible. There have been some examples of these relays that have exhibited age-related issues.

This project replaces the entire transformer (1) protection and feeder (3) protection arrangement at Mt Hutt substation with modern numeric protection relays. There is no alternative available.

This project has carried over from 2016.

**00509 [2018] New EGN 66kV Line Protection for ASH Circuit – System Growth**

In preparation for the complete conversion of Ashburton 66/11kV substation to 66kV operation [00505], the reinsulated EGN-ASH circuit [00510] will require connection to the Elgin 66kV bus. Protection relays and associated ancillary equipment will be procured, installed and commissioned under this project.

**10099 [2019] EGN New 66kV Line Protection for FTN Circuit – System Growth**

The construction of a new Fairton 66kV zone substation [11066] and the 66kV line supplying it [00511] requires the installation of new line protection at Elgin zone substation. Protection relays and associated ancillary equipment will be procured, installed and commissioned under this project.

There are no alternatives to connecting the new Fairton substation and 66kV line.

**PROGRAMME [2017-25] Ashburton Core Urban 11kV Network – System Growth**

This programme will include a significant quantity of 11kV protection relays. They will be line differential relays operating across core 11kV circuits which will utilise interconnecting fibre optic links. There will also be a number of simple overcurrent feeder relays.

All of the projects, costs and associated work are included in the 11kV network centre developments ([Section 5.4.8](#)).

**5.4.10 SCADA, Communications and Control**

SCADA is an acronym for Supervisory Control And Data Acquisition, which essentially means remote control of power system equipment and getting information back from remote power system equipment. In this case "remote" is anywhere other than "here". SCADA systems are not new and have existed for many decades in various forms. The most rapidly changing aspect of SCADA systems is the devices they connect to in the substation and at other points on the network. Microprocessor-based protection relays and modern electronically controlled reclosers have a wealth of information on offer to SCADA systems about power system conditions and faults. It is now possible to look at real-time values of current, voltage, power, thermal demand, harmonic currents and voltages and virtually any other measurable power system quantity as well as historical logs of any of these values. If a fault has occurred, the relay can provide a surprisingly accurate estimate of distance to the fault and data to display the waveform of the currents and voltages before and after the event. All of this information can assist in planning a more responsive power system that can provide higher levels of fault immunity and assist in identifying under-utilised capacity such as when power factor is too low at peak times.

A SCADA system can also be used to schedule events such as switching on or off capacitors or generation that prevents overloading of a piece of equipment during a period of normal peak loading or during fault events when being used to supply load above normal levels.

Any reasoned decision that a human can make can now be programmed into a personal computer and it can then reproduce that logic for similar situations. In the future, with sufficient processing power, communications, data gathering and remote control, it will be possible to provide a much faster response

to loading and fault situations than is presently the case. It may even prove possible to reliably predict loading minutes or hours in advance (given sufficient data to derive an accurate model). These capabilities will be used to dynamically configure the network so that overloading is avoided and faults affect fewer consumers. This concept is the next step in a system called distribution automation. Distribution automation is currently a predominantly reactive process which attempts to restore supply once it has been lost.

A progressive expansion of the current SCADA system is envisaged to include all existing and new zone substations as well as many smaller switching and data gathering locations. Data communication to all zone substations has dramatically improved through the use of the new fibre optic network and allows reliable data, video and voice communication. The fibre optic provision is occurring as a separate commercial development by EA Networks which is not suitable for inclusion in this electricity network asset management plan.

## Projects & Programmes

No SCADA-specific projects have been identified. As new sites are developed they will incorporate SCADA functionality and will contribute to a more complete automation system. There are a small number of projects related to communications and control.

### **00133 [2016] Advanced Feeder Automation**

There is software/hardware available to automate the restoration of faulted feeders by isolating the faulted segment and reconfiguring the distribution network to leave only the faulted segment without supply. This has obvious benefits to the asset owner. The power is restored within tens of seconds (unless you are supplied from the faulted segment) and the asset owner does not have to spend time manually finding and isolating the fault. This type of system relies on sensing the fault location by passage of fault current through devices and either making independent decisions in the field or communicating the information to a central point and the central controller making the logic decisions. It is the latter style of system that EA Networks would prefer.

A central controller acts in tandem with the existing SCADA system to firstly gather fault detection data and then to control the distribution system to isolate the fault. There is no duplication of hardware in the field. The controller is essentially a piece of software that is configured to respond in a particular manner should a fault be detected. If necessary, a central controller can be overridden by the controller.

This project provides for the assessment and trial of a system to achieve some degree of automated feeder restoration.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that most of this work will carry over in to 2017 (95% still to complete).

### **00121/049 [2016] RMU Control Box Installation – Quality of Supply**

Many of the rural RMU units are not yet remote controlled or capable of single shot reclosing. This is disadvantageous as it requires personnel to visit the site to operate the circuit breaker or switch. In addition, it places the operator immediately adjacent to the RMU while opening/closing which is less desirable.

These two projects procure and install 15 control boxes and connects them to suitable communications (fibre where possible). One of the communications devices could be DMR [00138].

The alternative is to do nothing (no remote indication or control) which defeats many of the RMU benefits.

Although it has not been identified in the expenditure projections, at the time of writing it is looking possible that some of this work may carry over in to 2017 (50% still to complete).

### **00137 [2016] TIN Substation SCADA Implementation – Quality of Supply**

The new TIN 66kV switching station will require SCADA to be installed.

This project provides for the equipment and installation at the new site as well as configuration testing and commissioning.

Although it has not been identified in the expenditure projections, at the time of writing it is looking likely that all of this work will carry over in to 2017 (100% still to complete).

### **00138 [2016] DMR Radio Equipment Remote Control – Quality of Supply**

The DMR radio system that EA Networks use has the ability to transport data packets transparently. This feature can be used to implement a piece of hardware that acts as a combined radio and RTU. The DMR radio supplier that provisioned the voice system has developed such a product.

This project provides for the purchase and installation of 10 radio-RTU units for remote control of either rural RMUs or pole-top SF<sub>6</sub> load break switches. The device can also carry industry standard SCADA protocols and connect them via ports on the device.

Although it has not been identified in the expenditure projections, at the time of writing it is looking possible that some of this work may carry over in to 2017 (20% still to complete).

## **5.4.11 Ripple Injection Plants**

The ripple control system is a very useful way to control the maximum load at any given time. This system can be used in a variety of ways but is predominantly employed to shift water-heating and space-heating load to off-peak times. This limits the maximum load that the EA Networks electrical network must supply at peak times. Another term for the ripple control system is "demand side management".

During summer, the rural irrigation load causes the annual system peak to occur (currently about 177 MW). Somewhat uniquely, EA Networks has a summer peak demand and it is only during winter that the regional peak occurs. During these winter peaks, EA Networks use the ripple control system to minimise the demand placed on the Transpower GXP's. This has the coincident benefits of reducing total losses and lowering the required average capacity of EA Networks equipment that peaks in winter. The urban network is comparatively lightly loaded during summer and ripple control during summer does not assist in optimising urban network capacity.

During winter the energy retailing companies direct EA Networks to control the same heating loads when the cost of wholesale electricity is high. This winter control has the by-product of keeping urban distribution peak demand low, which frees up additional capacity for uncontrolled loads such as lighting, cooking and other household appliances. This peak control can also reduce the need for reinforcement of the urban network, although EA Networks do not currently control load for that reason.

Should a fault occur that limits the supply capacity into a particular portion of the network, ripple control can be used reduce the load to a level where all consumers have supply but only if they accept that controlled load is off until a repair is completed. This is a useful method to help achieve the security standards without dramatically inconveniencing consumers.

### **Capacity of New Equipment**

Because the investment in plant is relatively expensive and typically non-recoverable, the sizing calculation is very important for ripple injection facilities. The probable future network configuration is ascertained and a plant capable of injecting signal successfully across that proposed network will be specified.

### **Projects & Programmes**

Until 2005 there had been no firm projects planned to enhance the capability of the ripple control system. Failure of a critical component on one of the ripple injection plants in late 2005 caused a rethink as the age of the technology was such that it could not be fixed. The failed piece of equipment has now been replaced with a modern equivalent, sized to suit potential future use at 66kV. Reconfiguration of the GXP's over the next few years means that plans are in place for reinforcing the ripple signalling system.

### **11067 [2017] EGN New 66kV Ripple Plant – System Growth**

The current ripple injection system for the 66kV network is provided by a 33kV ripple plant coupled to the 66kV bus via a 60 MVA autotransformer at EGN. The capacity of this plant was sufficient when the 66kV bus was supplied from two 220/66kV transformers. A third 220/66kV transformer is now in place, and that, along with increasing 66kV load, has caused the signal strength to decrease to the point that some receiver maloperation has occurred. In addition, there is no viable alternative ripple source should the 33kV injection plant fail. As a consequence, a new larger capacity 66kV ripple injection plant and coupling cell is now required. Included in the project are the 66kV bay items such as circuit-breaker and civil works.

The original injector for the 33/66kV ripple plant failed during 2011 and a decision was made to purchase the spare unit that the manufacturer had available. The purchased unit is smaller than will ultimately be required for injection at 66kV but it is larger than the failed unit. The failed unit is no longer supported by the manufacturer and may not be repairable.

There is a complication with this proposal in that the proliferation of 6 pulse variable speed drives on irrigation pumps has caused a significant rise in harmonic distortion on the EA Networks network. The predominant harmonics generated by these drives are 5<sup>th</sup> (250 Hz) and 7<sup>th</sup> (350 Hz) multiples of the fundamental frequency (50 Hz). The ripple injection frequency used by EA Networks is 283 Hz. To suppress the distortion of these drives both new and existing installation will require compliance with IEEE519 and in practical terms this means that a harmonic filter will be required at each drive - limiting harmonic current distortion to no more than 8 %. Unfortunately, these filters can also attenuate the ripple signal and, regardless of the injection plant capacity, signal may be unavailable in large areas during summer (irrigation season).

There are commercial risks in installing new ripple injection plant(s) when other communication/control technology may supersede it and strand the asset. So called "Smart Meters" may be able to independently control the same load that ripple presently controls. This could mean a conflict between the retailer/meter owner/controller and the network operator who wish to shift load at different times for different reasons.

Alternative signalling technologies are available or nearly available and EA Networks have been actively investigating their suitability. The point has now been reached where the risk of failure is too high and a commitment to a new plant has been made.

As a back-up, the existing 33kV plant will be kept available to inject should the new 66kV plant not be available. The signal level offered by the existing 33kV plant will be sufficient at most times of the year and under many loading conditions. The 33kV plant's signal level can be improved by temporarily taking one of the three 220/66kV transformers off load while the 66kV plant is unavailable.

#### **00493 [2026] EGN Replacement 33kV Ripple Plant – Asset Renewal**

Although the existing 33kV ripple plant will not be in regular service from now until 2026, the age of the high voltage plant components (purchased 1988) will be such that replacement is warranted. This will ensure back-up plant availability.

It is possible that other technology may have superseded the ripple injection signalling by then and this replacement may not occur.

### **5.4.12 Distributed Generation**

Distributed generation can be broadly described as any type of electrical generator that is completely embedded within the network of a lines company. A distributed generator can range in size from a photovoltaic panel on a domestic rooftop that has an output of several hundred watts, to hydroelectric or wind generators of several tens of megawatts. Every generator has a different impact on the security and capacity of the network depending upon the size and location of its connection and its generation pattern.

A distributed generator can provide additional security/capacity to the EA Networks network but it also has security and capacity requirements of its own. A generator which can always operate during peak demand periods can reduce the required capacity of a portion of the immediate network. If an individual generator is not available, it cannot offset the need to provide network capacity for consumers without breaching security standards. Alternatively, a generator which is unable to dispatch its available generating capacity because a network fault either disconnects it from sufficient consumers, or limits its ability to inject into the network, is unlikely to satisfy the generator's security requirements.

EA Networks encourage connection of new distributed generation. The general philosophy is that generators do not pay any on-going asset charge to connect to existing network (provided it has the capacity to absorb the generation without alteration). Only the additional or upgraded assets required to connect the generation are considered for cost recovery. Any fiscal benefits from coincident demand reduction are shared with the generator. If the network is not loaded sufficiently, export into Transpower can occur which results in HVDC (export) charges, which are passed back to the generator. By

arrangement, during low load periods, the export risk can be signalled to the generator before export occurs.

If distributed generation becomes a widespread phenomenon, the diversity amongst a group of generators can make it a useful alternative to network reinforcement. This assumes that the generators do not have similar generation or fuel availability patterns that cause minimum generation at times of peak demand.

EA Networks already has significant distributed generation in the form of three hydroelectric generation plants one at Cleardale in the Upper Rakaia (1.0 MW), one at Montalto (1.6 MW) and one at Highbank (26 MW). New distributed generation of any scale is encouraged and will be connected subject to suitable commercial and technical arrangements made according to industry rules and guidelines governing these activities. The Electricity Governance (Connection of Distributed Generation) Regulations 2007 have required all lines companies to publish guidelines for the connection of distributed generation to their respective networks. EA Networks have done this ([www.eanetworks.co.nz](http://www.eanetworks.co.nz)) and since publishing one formal application has been made and connected (Cleardale). Several potential developments are detailed in the projects section below. The clarity these regulations provide is useful for all participants.

EA Networks are always reviewing the feasibility of locally connected distributed generation that would enhance the security and profitability of both the company and the community. Several preliminary studies have been undertaken and this has identified some promising options that will be detailed in the Asset Management Plan if they become a commercial proposal.

The photo above shows a distributed generation system which injects into the



EA Networks distribution network. This project made use of previously wasted energy from drops in a medium sized irrigation race that ran parallel to the property boundary. At 200kW maximum output it is sufficiently large to provide for all of the on-farm requirements plus a small surplus. Like most of these type of small schemes it has no storage and can only generate when the energy source arrives (water in this case, but equally the sun in the case of solar panels and a breeze in the case of wind turbines). Without storage of the energy they produce or the fuel that feeds them, peak system load on the EA Networks network may not be reduced significantly by distributed generation (consider a cold, calm, frosty, dark winter morning).

## Capacity of New Equipment

All equipment installed for generation plant is sized in agreement with the generation owner although this is usually only required where the generation exceeds 100 kW.

## Projects & Programmes

The opportunity for discussion with third parties who are interested in developing a wide range of small and large generation projects in the Mid-Canterbury region has continued in recent times.

The following table details the style of project by energy source, likely timescale, estimated capacity and a percentage rating of likelihood to proceed (based on information at hand).

Project	Energy Source	Timescale <sup>1</sup>	Estimated Capacity <sup>2</sup>	Likelihood <sup>3</sup>
A	Hydro	Commissioned	1.0 MW	100%



<b>B</b>	Hydro	3 – 10 year	17 MW	15%
<b>C</b>	Hydro	2 year	2.2 MW	15%
<b>E</b>	Hydro	5 year	20 MW	10%
<b>G</b>	Wind	Unknown	5 – 50 MW ?	10%
<b>H</b>	Wind	Unknown	30 – 80 MW ?	10%
<b>J</b>	Hydro	10 year	20+ MW	5%
<b>K</b>	Hydro	2 year	1.0 MW	30%
<b>L</b>	Hydro	Commissioned	0.5 MW	100%

<sup>1</sup> Timescale is an estimate by EA Networks based on generalised discussion with third parties.

<sup>2</sup> Capacity is either based on third party disclosure or, for larger proposals, an estimate by EA Networks.

<sup>3</sup> Likelihood is an entirely subjective assessment by EA Networks which does not imply any evaluation of feasibility or commercial viability. 0% likelihood means EA Networks believe the option is no longer feasible or even physically possible (grey highlight).

Project A (Cleardale) has been commissioned. A farmer in the Rakaia Gorge decided to irrigate his farm and in the process provided the opportunity for Mainpower Generation to install a 1 MW pelton wheel turbine. The electrical output of the installation will vary considerably during the year and there may be times when it is unable to run at all through lack of water. The installation is connected to the 11kV network and feeds in to Mt Hutt substation. Both parties are treating this as a learning exercise as this will be the first significant distributed generator directly connected to the 11kV distribution network. There are no problems foreseen, but the understanding of distribution network operation by the generator owner will prove valuable in resolving any issues that arise. Until the actual seasonal generation levels can be quantified, the minor impact on substation and GXP demand has been ignored.

Project L (BCI2) has been commissioned in early 2016. It is a cross-flow turbine and operates in conjunction with an irrigation scheme and will provide a modest output throughout the year. It is injected into the EA Networks 22kV network via a feeder from Lauriston substation. As irrigation demand builds, it is likely the summer output will drop and possibly not be available in few years' time (the summer water is diverted to irrigation). It is advantageous that this generation is operating at the same time as the electric pumps as it reduces the peak demand on the 22kV feeders, zone substation, subtransmission network and GXP.

The wind opportunity that has been listed is still very early in the investigation process and EA Networks had to make discrete inquiries to even determine who the potential developer was. It is possible that the EA Networks network may not be able to absorb the level of generation proposed, in which case it is not an issue that needs consideration other than for grid interconnection at a GXP.

An interesting discussion has been held with a proponent of wave power. The area off the Canterbury coast is apparently well suited to the type of device that the organisation is considering. The commercial and technical viability of wave power may be in its infancy, but if a commercially competitive product evolves it could hold a great degree of promise for an island nation such as New Zealand.

There have been no firm proposals for connection of non-hydro forms of distributed generation to the EA Networks network that would prudently affect the predicted maximum demand.

There are some other very small scale distributed run-of-the-river hydro generation opportunities that are being discussed and have in one case been developed, but their collective output accounts for only two or three typical irrigation pumps and in drought years they are unlikely to be generating because of water restrictions on river off-takes. It is also possible that the hydro turbine mechanical output will be used directly for mechanical water pumping with no electrical generation or pumping.

It should be noted that the economics for new generation investment are particularly poor at the present time. A flat wholesale price path for electrical energy and speculation that the Tiwai Point aluminium smelter may not be operating in several years, means that the incentives for new generation have reduced to the point that a number of significant renewable projects have been shelved.



# NON-NETWORK ASSETS

<b>Table of Contents</b>	<b>Page</b>
6.1 Non-Network Asset Description	245
6.2 Non-Network Policies	246
6.3 Non-Network Programmes and Projects	247




## 6 NON-NETWORK ASSETS

The definition of these assets is “assets related to the provision of electricity lines services but that are not a network asset”. Examples given are land, buildings, furniture, vehicles, tools, plant, machinery, IT systems, asset management systems, software etc. Every effort will be made to identify these assets. The non-network asset quantities are unlikely to be as definitive as the network assets as they are not generally included in the same datasets or maintained in the same way.

### 6.1 Non-Network Asset Description

#### Land and Buildings

EA Networks have a long history in the Mid Canterbury district. Since inception, the main office was in the middle of Ashburton adjacent to what was the NZED Ashburton substation which supplied the town and surrounds with electricity at 11kV. This site had evolved over the years and the town had evolved around it. The age of many of the buildings, the surrounding retail environment, the recent Canterbury earthquakes, the dispersed nature of storage, among a host of other pressures lead to a decision by the Board to search for a new base. Fortuitously, the Ashburton District Council were developing a new business park at his time. In

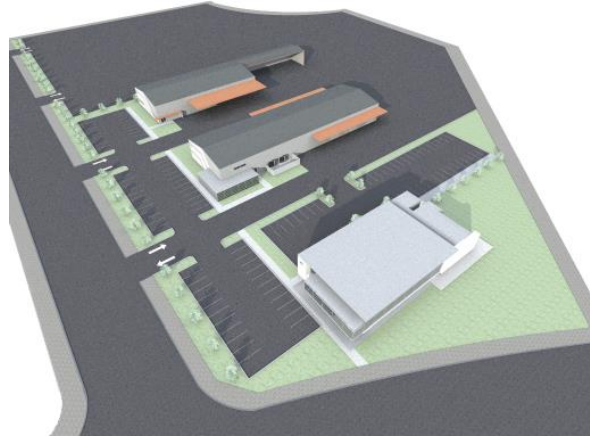

late 2012, EA Networks shifted from Kermode Street (in the CBD of Ashburton township), to a brand new purpose-built facility in the Ashburton Business Estate north of Ashburton. The new site covers about 3.6 hectares and is fully self-contained with main office, contracting office/workshops, and main store/pole yard. The site has diesel fuel facilities, is fully generator backed-up, has multiple access roads to/from the site, and is designed for heavy traffic egress. The buildings have been designed as ‘IL4’ facilities which provides assurance that during and after a significant seismic event they will remain fully functional and permit EA Networks to respond to any earthquake damage without having to remediate or shift from its base facilities first.

Other interests in land and buildings include:

- The old site and buildings in Kermode Street which is currently partly leased to tenants but is ‘on the market’. Area approx. 1.4 hectares.
- A small number of decommissioned substation sites that have yet to be disposed of or retasked.

#### Furnishings

The new buildings have been furnished with new equipment in most cases. Desks, storage cabinets, chairs and tables are almost all new.

#### IT Hardware Infrastructure

In almost every case, the desktop PCs and monitors were reused from the Kermode Street site as they were in serviceable condition. The LAN wiring is obviously all brand new.

The back-office systems such as telephony and server infrastructure are adequate, although on-going development will ensure additional performance and functionality will be provided. Extensive use is made of server virtualisation which ensures high levels of flexibility and relative ease of recovery from server

hardware failures.

### Vehicles

There are a range of vehicles associated with the provision of the electricity line service function. These range from executive vehicles (some with private use as part of salary packages) through to a forklift, a small flat-deck truck, and a pole handling vehicle for use in the stores yard. All of the contracting/works/construction vehicles are part of that business function and as such are assets of the contracting division of EA Networks.

The quantities are as follows:

Car/Wagon/SUV	16
Utility	7
Forklift	1
Pole Handler	1
Truck	1

The total book value of the vehicles is about \$569,000.

### Tools/Plant/Machinery

The inventory of tools, plant and machinery is reasonably extensive but is not categorised in a fashion that permits meaningful reporting. Additional categorisation will be added to the dataset to enable a meaningful schedule of these items in future plans. Included in this area are items such as electrical test equipment, portable power quality recorders, thermographic equipment, etc.

### Software and IT Systems

EA Networks have a range of software licences ranging from desktop operating systems and general document editing software through to advanced technical analysis software. Corporate server based systems include financials, stores, asset database, payroll, and other typical back-office systems.

The major corporate investments are:

- Financial/Stores Technology One
- GIS Intergraph G/Technology
- Assets EA Networks developed SQL Server based system - to be superseded by Technology One
- Technical Analysis DigSilent and ETAP load flow and fault analysis

Desktop licences include:

- Microsoft Office
- Custom Software - QuickMap
- Assets - MS Access front-end

## **6.2 Non-Network Policies**

There are a limited range of formal policies relating to non-network assets.

Buildings are currently all brand new and as such there is no policy relating to development. The maintenance and renewal of the buildings will have a formal policy prepared to ensure the standard of maintenance is sufficient to guarantee full functionality and value is retained. It will be some time before any age-related building renewal will be required.

Vehicles are covered by a corporate policy and this states that a vehicle will be replaced whenever it is 5 years old and exceeds 150,000 km.

Office furniture has no formal policy but any reasonable ergonomic requirement can be accommodated and furniture is expected to last a minimum of 5 years with 10 years being a practical end of life for many

chairs.

Desktop PCs have an average replacement cycle of 3 years. This ensures computing platforms are kept current and PCs are replaced before components begin to fail causing data loss and unnecessary downtime for the employee.

The IT Infrastructure is generally upgraded as and when required rather than on any set timescale. When an update occurs, it generally provides a significant increase in performance and until that performance advantage is eroded to an unacceptable level, the status quo will prevail.

## 6.3 Non-Network Programmes and Projects

There is a background level of expenditure on non-network assets such as vehicles, plant and IT that is routine and largely constant. Periodically, larger sums will be required for specific development, replacement or upgrade projects/programmes.

There are a number of projects in the coming year (2015-16) that have been identified.

### **00212 [2016] GIS Electrical Project**

The recently implemented GIS (Intergraph) is currently utilised for the fibre optic network only. During the 2015-16 year the electrical implementation will be completed. Some development work may spill in to the 2016-17 year.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that some of this work will carry over in to 2017 (20% still to complete).

### **10954 [2016] Survey Accurate GNSS Unit**

A survey accurate GNSS (GPS) unit will be purchased to permit accurate capture of network assets as well as assist in one-person surveying of new or existing line routes. Currently, the lines surveyor requires an assistant to hold the staff which is sighted by the optical survey instrument. A high precision GNSS receiver can resolve its location to within a few cm. This instrument will hopefully permit more office based pre-design and cut the labour cost of surveys by close to 50%.

The device will probably have a myriad of other uses such as capturing as-built cable routes and any other buried plant locations that are difficult to identify once the ground has been reinstated.

Although it has not been identified in the expenditure projections, at the time of writing it is looking probable that all of this work will carry over in to 2017 (100% still to complete).

### **00216 [2016] Enterprise Resource Planning (ERP) System**

Currently the links between GIS, the operational network asset database, and the financial systems are disjointed. This project formalises and creates a robust relationship between these 3 sources of information which are currently mainly independent. This connection will improve decision making across the organisation.

When completed, the ERP project will also include CRM and Human Resource management systems which may be part of the ERP or feed into the ERP.

This project will be carried forward into 2017.

### **00545 [2017] Asset Management System**

This is the next stage of project 00216 and will see the migration of the existing asset register in to the new system and some development of that system to integrate with other data structures such as GIS, document management, and ICP management.

This project is partly carried over from 2016.

### **00541 [2017] Network Billing and CRM Software (ICP Management)**

The current network billing environment is an EA Networks developed solution. It may not be adequate for the regulatory environment that is now being ushered in. In 2015-16 the systems were assessed and a solution with the best value for money was conceptualised. This is currently being scoped in conjunction with another lines company as a new commercial development. The software (or associated software) will also be expected to perform CRM (Customer Relationship Management) functions.

This project is a carryover from 2016.

### **10982 [2017] Document Management System**

EA Networks currently do not have a formal documents management system. This is causing considerable angst amongst some staff as the information they need is not readily available and if it is there are many duplicates copied around to personal data locations.

A document management system can provide a multi-faceted view of documents that is only limited by the metadata that is stored about the document. Searches can be performed on any aspect of the document and results narrowed by sophisticated filters. Versioning of documents can be used to allow a complete history of its evolution through to the current version.

This project allows for the purchase and initial implementation of a document management system.

This project is a carryover from 2016.

### **005## [2017] Various Small Software Solutions**

There are a variety of small software solutions that have been identified to provide additional productivity or functionality. These include legal compliance software, replacement payroll software, ongoing website development etc. These will occur on a regular basis and form part of [01033] atypical I.T. projects in future years.

### **11074 [2017] Electricity Network Outage Management Software**

EA Networks have been holding back from pursuing a software solution that can administer many aspects of operating an electrical network. These systems have historically proven to be very expensive and reasonably complicated. Although they remain complicated, several vendors have now realised that there is a market in New Zealand for a cut-down version of the full-blown (costly) solution. There are also niche vendors who provide more economical solutions but have historically not been in the New Zealand marketplace.

This project will procure a core solution that will provide some of the desired functionality such as real-time schematic and dynamic tracing of all connected network. Other features such as call management and workforce management may also be enabled, but the successful vendor's offer will determine which features can be provided – no one system offers all features.

It is likely that this project will represent stage one of two stages of development. Until a system is chosen the scale (if any) of a second stage is unknown and has not been specifically allowed for in the financial projections.

### **00543 [2017] Data Warehouse**

The data help by EA Networks is currently stored in a variety of different databases and maintained by a variety of applications for a specific purpose. This arrangement does not lend itself to ad-hoc analysis of combined data sets. A data warehouse will be established that provides a normalised and consistent source for a variety of data sets that will be the single source for analysis. This will ensure that not only is the data readily available but that it can be trusted to provide the correct interpretation rather than one that is assumed by uninformed data combinations.

This project establishes the data warehouse and populates it with datasets from various sources that are either live-linked to the source or regularly updated in a timely fashion.

### **00549 [2017] Video Conferencing Facilities**

EA Networks' new main office building has a number of rooms that are equipped with large flat screen video monitors. One of these rooms will be set up to act as a terminal for video conferencing. A reasonably high quality system will be installed and this should displace some travel costs as personnel can participate in remote interactive meetings without leaving the building.

### **00547 [2017] Core and Storage Switches**

The main computer networking switches that control virtually all I.T. activity need to be upgraded to keep up with demand for bandwidth and other services (such as video).

### **10915 [2017] MVN Back-up Facility**

The ex-Methven 33 zone substation site will be used as a backup control and command centre should the



Ashburton based building be unavailable. A substantial and robust A-frame building in good order exists with toilet and kitchen facilities. This building will be modified to make it suitable for use as a back-up command/control centre. It is possible that some room may be made available for civil defence use as well.

It is prudent to have a plan for the non-availability of the IL4 (very robust) main control centre. It is not only natural disasters that can render a site unavailable. A criminal or terrorist act or even a biological hazard could mean the main control centre cannot be used.

The fact the MVN building exists and can be converted at relatively low cost makes for a good argument to proceed with this project.

Delays in decommissioning the site/building as an active zone substation have caused this project to be carried over from 2016.

#### **11077 [2017] Electric Vehicle Charging Solution**

The effects of Electric vehicle (EV) fast charging systems on the distribution system are largely unknown. In order to research these devices and obtain operating experience with these systems, EA Networks are going to initially install three in urban areas within the Ashburton District.

The systems will have either a 50kW or 100kW charging capacity and it is hoped that having these available in convenient locations will assist in the uptake of EVs both locally and nationally. The research data that is gathered will be used to determine the acceptability of the impact of such devices in both business and residential areas of the townships in the Ashburton District.

If the chargers are well utilised, it is possible further units may be introduced in suitable locations in future years.

#### **90022/23 [2017/23] Aerial Photography**

EA Networks have joined a consortium of Canterbury organisations that procure aerial photography for a variety of uses. There are two key variants: rural with 0.4m GSD (ground sample distance ~ pixel size), and urban with 0.12m GSD. These allow data capture of pole and other asset location as well as preclude the need for many site visits when (re)designing assets. The photography is reflown every 4 or 5 years and this has been allowed for in the plan.

#### **01032/01031 [2017-26] Non-Network Routine Information Technology & Office Equipment (Plant)**

These projects accommodate the many small items that are too small to individually identify or are unknown at the time of budget preparation.

#### **99030 [2018] Information Technology – Field Mobility**

EA Networks presently have little in the way of field data devices. This is inefficient in a data-rich world when a cheap tablet can replace many paper forms and eliminate the time spent transferring that information into a corporate system.

This project provides for the purchase and implementation of a field data collection solution.

This project has been postponed from 2016 to allow for other I.T. data systems to develop and stabilise.

#### **00198/99013 [2018-26] Routine Replacement Vehicles**

The replacement of network vehicles occurs at a rate of about 4 per annum.

These projects provide for the replacement vehicles and any accessories necessary to make it suitable for use (flashing beacons, canopies, storage boxes, aerials and DMR radio, etc).

#### **01033 [2018-26] Non-Network Atypical Information Technology Projects**

Although they are not individually identified, there will inevitably be I.T. projects that are required to keep the business operating at a reasonable level of efficiency and application sophistication.

This programme provides for one or two medium sized I.T. developments each year to ensure the business does not fall behind with the IT tools that keep it within the peer business norms of I.T. usage.

#### **01034 [2018-26] Office Building Alterations and Improvements**

This programme provides for some minor alterations and improvements to the main office building to either

improve the working environment for existing staff, or rearrange the internal configuration to accommodate additional staff.

# RISK MANAGEMENT

<b>Table of Contents</b>	<b>Page</b>
7.1 Introduction	253
7.2 Safety	254
7.3 Environmental	254
7.4 Risk Assessment	255
7.5 Risk Mitigation Proposals	257



## 7 RISK MANAGEMENT

### 7.1 Introduction

Management of risk is a daily activity for all of us. We may not realise it but we are constantly assessing risk and making decisions about options for our safety, wealth, emotional well-being and just about every other thing that affects us. This section of the plan will consider the risks that EA Networks' electrical network faces from all sources and also the risk it presents to people and the environment.

There are some useful documents that describe processes to assess and treat risk. AS/NZS 4360:1999 is one such document and the methodology outlined in this standard has been used as a guide for risk management of the EA Networks electricity network. In the future, AS/NZS ISO31000:2009 will be used as a basis. The broad steps involved in risk management are:

1. Establish the context
2. Identify risks
3. Analyse risks
4. Evaluate risks
5. Treat risks



The EA Networks network is periodically exposed to events or incidents that subject elements of the electrical network to a high risk of failure. If the location of these events coincides with a critical component of the electrical network, the result is a high risk to the integrity of the electrical network. This risk of failure can in turn lead to high risks for consumers, either as individuals or as larger collective groups.

The range of events that can place the network at risk are extensive and range from a mouse entering a protection panel in a substation to a 747 aircraft crashing into a Transpower substation. These two examples could have similar immediate effects (loss of supply to a wide area) but the likelihood of each one happening is particularly disparate.

A full Risk Management Plan (RMP) is still nearing completion after an in-depth look at EA Networks' operations and environment. The risk assessment is complete and is periodically updated. The actions required to reduce risk have been identified and some projects have been initiated. The largest area of work still remaining to be done is that of contingency plans. These form a large proportion of the low risk/high consequence situations that have been identified.

EA Networks network assets can be at risk from:

- Natural disasters – earthquakes, flood, slippage, climatic conditions etc.
- People related – excavations, vandalism, poor workmanship etc.
- Non-supply – non-supply by Transpower, Generators.
- Asset failure – capacity, reliability, structural, cost.

Natural disasters will be assessed by evaluating the risk cost for each event (probability times the consequences of failure cost) and developing appropriate contingency plans and procedures to ensure business continuation and mitigation of impacts respectively.

The probability and consequences of failure from people risks will also be used to quantify risk cost and identify the need for contingency plans and specific network security/management policies.

The risk of non-supply of electricity is managed by way of service agreements/insurance cover and is outside the scope of this plan.

## 7.2 Safety

As required by statute, EA Networks has systems in place to identify, assess and manage potential hazards in the workplace. EA Networks' Health and Safety Committee actively pursues all workplace hazards and ensures appropriate management of hazards takes place. The committee is made up of personnel from all parts of the organisation.

All employees of, and contractors to, EA Networks are regularly reminded of the need for diligence when working in an environment as potentially hazardous as the electricity industry. Worksites are regularly audited for compliance with the relevant regulations and codes of practice. Contractors must provide full details of Health and Safety plans and will not be employed if the plan is deficient in any way.

Introduction of new equipment, or modification of existing equipment, is documented and presented at appropriate training sessions. This training ensures all personnel are fully informed about the capabilities, limitations and any specific requirements needed to safely operate or utilise the new equipment.

## 7.3 Environmental

There are three main possibilities that exist for the electricity network to harm the environment.

### Oil

The remote possibility of oil spilling from a transformer or circuit-breaker on to the ground exists wherever they are located. The potential for these spills to occur has been strategically minimised by bunding larger transformers so that all oil spills are contained. Other mitigation measures include:

- emergency oil spill response kits located at each zone substation and in vehicles where staff regularly deal with oil filled equipment
- training for all staff on oil spill management
- reporting and investigation of all oil spills to develop preventative measures
- contaminated material is disposed of at a facility approved by regulatory agencies
- liaison with regulatory agencies at the earliest opportunity

To date, oil spills have been rare and the sites have been returned to original condition within weeks.

### SF<sub>6</sub> Gas

A high percentage of modern high voltage electrical switchgear contains SF<sub>6</sub> (sulphur hexafluoride) gas. This gas is a known greenhouse gas and has a global warming potential per molecule thousands of times that of a molecule of carbon dioxide. Of course, if it is not released into the atmosphere it cannot have an effect. If it is released into the atmosphere it is too late to do anything about it.

EA Networks attempt to minimise the use of SF<sub>6</sub>, but it is ubiquitous in switchgear over 33kV and since EA Networks are using a 66kV subtransmission network the gas the 66kV circuit-breakers contain must be managed. A voluntary SF<sub>6</sub> management regime has been established and EA Networks is a member. This regime requires members to manage SF<sub>6</sub> in an environmentally rigorous fashion and provide an auditable register of quantities of the gas.

The mitigation used for SF<sub>6</sub> is to handle it with extreme precision so that there is never an intentional discharge to the atmosphere at any time.

Contaminated gas is either purified and retested or sent to an internationally recognised disposal agency.

### Fire

One of the most common effects the electricity network has on the rural environment is initiating small brush or grass fires. To date these fires have been small and very localised. The fire brigade is usually called but the fire is often out by the time they arrive. To completely eliminate these fires would be extremely costly and could not be justified by the reduction in environmental harm. Every effort is made to ensure the network is as fault resistant as possible but external factors such as farm machinery and irrigators can damage lines, dropping live wires to the ground where they can be a source of ignition for dry material.

## 7.4 Risk Assessment

A thorough analysis of the risks facing EA Networks' electricity assets has been completed and entered into a risk register. This register provides a risk score for each identified piece of equipment or installation. Using the register, all risks can be ranked for score and the highest scoring ones prioritised for mitigation.

A snapshot of a typical risk assessment item from the register is shown here.

The assessment identifies the piece of equipment at risk, the supply at risk, the risk elements and the likelihood of each element depriving the network of the equipment, the initial deprivation time and quantity delayed (initial consequences of the risk event), the delayed deprivation time and quantity (repair time or delayed consequences of the risk event). This information is then used to form a maximum risk score, which combines the maximum risk element score with the duration and quantities of deprivation.

The next screenshot shows the way in which the element and duration scores are derived. A score of 1 in the categories is a low likelihood and consequence whereas a score of 5 is very high likelihood and very high consequences.

**Risk Register**

Risk Item | Risk Treatment | Site Summary | Definitions

Category: Network

Site: DOR66

Equipment: 22 kV Feeder Cables

Type	Score
Calamity	2
Equipment	2
Fire	1
Flood	1
Lightning	2
Mechanical	2
Sabotage	2
Seismic	1
Vehicular	2
Wildlife	2
Wind	1
*	0

Commentary: The feeder cables can be either repaired or bypassed reasonably quickly. Significant back-up capacity is available from Pendarves.

Initial Deprivation Time: 2  
Initial Deprivation Quantity: 3  
Delayed Deprivation Time: 0  
Delayed Deprivation Quantity: 0

Risk Score: 12

Month Assessed: January  
Year Assessed: 2010

Record: 19 of 222 | Unfiltered | Search

Other tabs in the register detail the risk treatment decisions that have been made, who is responsible for acting on them, the risk score after treatment, the year for treatment action, the monitoring technique, and the date of the most recent review.

A site summary tab details the risks facing the site overall and any coordinated mitigation that is necessary to reduce the risk to an acceptable level.

Widespread risks to a particular type of equipment that could be affected by an area-wide event are assessed without reference to any particular site.

The recent rapid rate of network development has resolved some of the most critical historical risks that have been identified in the past.

**Risk Register**

Risk Item | Risk Treatment | Site Summary | Definitions

Duration Score 1	Immediate	Up to 30 minutes	
Duration Score 2	Short Time	15 minutes to 4 hours	
Duration Score 3	Medium Time	3 to 12 hours	
Duration Score 4	Long Time	8 to 48 hours	
Duration Score 5	Extended Time	48 hours to 9 months	
Qty Score 1	1 to 10 Connections	5 - 50 kW	\$50 - 500
Qty Score 2	10 to 100 Connections	50 - 500 kW	\$500 - 5,000
Qty Score 3	100 - 1,000 Connections	500 - 5,000 kW	\$5,000 - 50,000
Qty Score 4	1,000 - 5,000 Connections	5,000 - 25,000 kW	\$50,000 - 250,000
Qty Score 5	>5,000 Connections	>25,000 kW	>\$250,000
Risk Score 1	Not Prone or Not Likely		
Risk Score 2	Slightly prone or Slightly Likely		
Risk Score 3	Prone or Likely		
Risk Score 4	Quite Prone or Quite Likely		
Risk Score 5	Very Prone or Very Likely		

Quantity vs Time graph showing two shaded areas: a purple area with height n1 and width t1, and a green area with height n2 and width t2.

Record: 19 of 222 | Unfiltered | Search

Summary of highest risk for major assets			
Site	Building & Contents	Power Transformers	Switchyard Equipment
Ashburton 33/11	Low - Seismic	Low - Equipment	Medium - Lightning
Ashburton 66/11	Low - Seismic	Low - Equipment	Low - Lightning
Carew 66/22	Low - Seismic	Low - Equipment	Low - Lightning
Coldstream 66/22	Low - Seismic	Low - Equipment	Low - Lightning
Dorie 66/22	Low - Seismic	Low - Equipment	Low - Lightning
Eiffelton 66/11	Low - Seismic	Low - Equipment	Low - Lightning
Elgin 66/33	Low - Seismic	Low - Seismic	Low - Lightning
Fairton 33/11	Medium - Seismic	Low - Equipment	Medium - Seismic
Hackthorne 66/22	Low - Seismic	Low - Equipment	Low - Lightning
Lagmhor 66/22	Low - Seismic	Medium - Equipment	Low - Lightning
Lauriston 66/22	Low - Seismic	Medium - Equipment	Low - Lightning
Methven 33/11	Low - Seismic	Low - Equipment	Low - Seismic
Mt Hutt 33/11	Low - Seismic	Low - Equipment	Low - Seismic
Mt Somers 33/11	Low - Seismic	Medium - Equipment	Medium - Seismic
Methven 66/11	Low - Seismic	Low - Equipment	Low - Lightning
Methven 66/33	Low - Seismic	Low - Equipment	Low - Lightning
Montalto 33/11	N/A	Low - Equipment	Medium - Seismic
Northtown 66/11	Low - Seismic	Low - Equipment	Low - Lightning
Overdale 66/22	Medium - Seismic	Medium - Equipment	Low - Lightning
Pendarves 66/22	Low - Seismic	Low - Equipment	Low - Lightning
Seafield 33/11	Low - Seismic	Medium – Equipment	Low - Lightning
Seafield 66/11	Low - Seismic	Medium – Equipment	Low - Lightning
Wakanui 66/22	Low - Seismic	Low - Equipment	Low - Lightning

"Equipment" refers to the risks involved in equipment failure.

### Equipment Risks

The risk assessment has identified a number of pieces of equipment that have a sufficiently critical place in the EA Networks network that the consequences of failure is seen as worthy of further investigation. In most cases, the risk had been informally identified prior to the risk assessment exercise and consideration was already being given to appropriate mitigation. The preceding table gives a summary of the highest scoring risks for critical pieces of major equipment which would have implicitly high consequences if they were unavailable.

### External Risks

Seismic events, flooding, snowfalls, high wind and wildlife are the key natural risks faced by the road-side electricity network. A consequence of typically being by the road-side means that vehicles, vandalism and fire are the significant man-made risks to the electricity network.

Different items of plant will respond in different ways to the same risk. A flood is unlikely to cause major problems for a pole-mounted transformer but a kiosk-mounted unit will undoubtedly have a higher risk of failure during a flood.

The following table identifies the risks facing different parts of the network and the consequences of being exposed to that risk.



<b>Summary of risks for asset categories</b>			
<b>Category</b>	<b>Highest Risk</b>	<b>Consequences</b>	<b>Treatment</b>
UG 66kV & 33kV Cable	Seismic	High	Emergency Spares
UG 11kV Cable	Seismic	Medium	Emergency Spares
UG LV Cable	Seismic	Medium	Accept
OH 66kV Line	Wind/Snow	Medium	Emergency Spares & Design
OH 33kV Line	Wind/Snow	Medium	Emergency Spares & C.Plan
OH 22kV Line	Wind/Snow	Medium	Normal Spares & Design
OH 11kV Line	Wind/Snow	Medium	Normal Spares & Design
OH LV Line	Snow	Low	Normal Spares & Design
Circuit-Breakers	Seismic	Medium	Emergency Spares
Ring Main Units	Seismic/Flood	Low	Normal Spares & C.Plan
Disconnectors	Seismic	Low	Normal Spares & C.Plan
HV Fuses	Lightning/Seismic	Low	Normal Spares
Pole Mount Transformer	Wind/Snow Lightning/Seismic	Medium	Normal Spares & Revise Design
Kiosk Transformer	Seismic/Flood	Medium	Normal Spares & Revise Design
LV Boxes	Vehicle/Flood	Low	Accept

C.Plan = Contingency Plan

Design = Ensure Adequate Design

Accept = Accept the risk and repair any damage in a routine fashion

Emergency Spares = Spares set aside for emergency use only

External consultants have reviewed the seismic risk and a number of recommendations resulted from this review that have been adopted - in particular for distribution transformer seismic restraint.

The flood risk is highest in Ashburton township and a major stop-bank work to prevent inundation by a 100-year return flood has recently been completed. It is accepted that this effectively reduces the risk of major flooding from Ashburton township during the design life of the equipment to a very low percentage.

## 7.5 Risk Mitigation Proposals

### Procedural Responses

EA Networks can control some aspects of risk. Gathering information about potential risks and proactively planning responses to it can alleviate the likelihood of an event occurring in some cases or, alternatively, lower the consequences to EA Networks if the event does occur.

The following procedures will be adopted to assist in managing risk:

- Minimise critical equipment failure risks by early identification of issues and subsequent prudent management and maintenance to ensure equipment availability.
- Liaise closely with regulatory agencies and neighbouring electricity companies to compare preparedness and co-operate with technical information
- Ensure design standards are compatible with a risk profile deemed acceptable by the community

- Safety aspects of risk have been addressed in [section 7.2](#) and [section 2.7](#).
- Risk to the environment has been addressed in [section 7.3](#) and [section 2.8](#).
- Development of a range of emergency response plans and systems to deal with generic risks such as snowfalls and storms as well as contingency plans for specific equipment failure if that is the chosen risk treatment. These plans are still being prepared as resources allow.

### Engineering Responses

A certain amount of physical work can be undertaken that helps mitigate the risk faced by EA Networks if that is an element of the chosen treatment for those risks. The following items are engineering responses to distributed risks that are significantly mitigated by this treatment.

- **Emergency stocks:** Specific items have been reserved in the stores system for use in emergencies. These items are typically items that are long delivery or potentially difficult to transport in the aftermath of a natural disaster
- **Emergency spare distribution transformer :** A universal emergency distribution transformer has been established. It is 1,000kVA and can be connected to 22kV or 11kV, overhead line or underground cable. This is useful for covering critical individual transformers for failure (hospital, water supply, etc).
- **Distribution transformer restraint:** Revision of the mounting arrangements for all distribution transformer mechanical restraint has ensured lower risks for people as well as lower risk of interruption during an earthquake.
- **All new transformers larger than 100kVA** are now ground mounted on seismically secure precast foundations. A standard holding down arrangement has been established that offers high seismic security.
- **Staff awareness:** Education of staff has heightened awareness of risk and solutions are now becoming part of the way of working.
- **Network renewal:** By renewing the network (for other reasons) a lot of the riskiest network components are being removed or replaced.
- **Containerised autotransformers:** The 5 MVA autotransformers that are required at the junction of 11kV and 22kV distribution are housed in lined shipping containers to ensure no oil spill risk.

### Specific Solutions

Some of the risks that scored the highest in the risk register have been specifically treated by engineering a solution to minimise the likelihood and/or consequences. The following items are the most relevant responses.

- **Northtown:** In response to the risk of a transformer or switchboard failure leaving parts of Ashburton township without supply for many days it was decided to reinforce Ashburton township's supply from a separate site at the northern end of Ashburton. This solution has provided a large boost in security as well as solving some other risks identified in the 11kV underground cable network of Ashburton. The security of Northtown substation will be further enhanced by the addition of the EGN-FTN 66kV circuit in 2019. In conjunction with FTN 66kV substation commissioning [10059], this will provide two full capacity in-feed 66kV lines ([10058] in [section 5.4.2](#)).
- **Closed Subtransmission Rings:** The risk of spur lines failing in adverse weather and then not being accessible for repair has caused the fundamental design requirement of virtually all zone substations to be on a closed subtransmission ring. Those sites that are not on a ring must have alternative HV distribution voltage alternatives available that do not share the same pole line as the subtransmission supply. [Sections 5.4.2](#) and [5.4.3](#) outline a variety of projects that advance this objective.
- **Ripple plant configuration:** The possibility of ripple plant failure allowing an uncontrolled system peak has significant risks for EA Networks both - economically and electrically. The configuration of the three ripple plants has been engineered to allow any GXP to be covered by another plant in the event of a failure. This was relatively inexpensive to achieve and has reused 33kV ripple plants when the 66kV GXP was introduced. The commissioning of a new 220/66kV transformer (T9) has reduced the ability to cover for ripple plant failure. Future projects will ensure the security of ripple

plant configuration (see [section 5.4.11](#) projects [11067] and [00493]).

- Loss of 220/66kV transformer: The loss of a single 220/66kV transformer (T10) at ASB220 during summer would have left number of the irrigation pumps unable to be continuously supplied. To satisfy stakeholders, T9 has been added giving additional firm capacity to the growing load.
- SF<sub>6</sub> gas management. The release of SF<sub>6</sub> gas to the environment results in a global warming potential of 22,200 times that of CO<sub>2</sub>. The prudent approach is to acknowledge the risk to the environment and manage the gas according to industry best practices.

### **Emergency Response Plans and Contingency Plans**

Where it has been indicated as the proposed risk treatment, EA Networks have not yet completed specific emergency response or contingency plans for the electrical network. As such, there are no details of them to disclose in this plan.

The recent addition of more internal engineering resources will hopefully allow progress in this area.



# FINANCIAL PLANS

## Table of Contents

## Page

8.1	Capital Expenditure	263
8.2	Maintenance Expenditure	266



## 8 FINANCIAL PLANS


### 8.1 Capital Expenditure

Costing has been prepared for all projects and programmes identified in this plan. Detailed project costs are shown in [Appendix B](#).

Overall Network Capital	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
Subtransmission	416	4,441	3,049	-	933	1,678	2,278	1,309	-	-
Zone Substations	6,588	2,197	2,763	586	163	2,273	432	163	428	1,904
OH Distribution	2,473	1,916	2,933	1,477	1,917	2,625	1,985	1,878	1,545	1,545
UG Distribution	6,481	5,397	5,487	4,890	5,266	5,266	4,681	4,146	1,605	958
Dist'n Substations & Transformers	4,495	4,156	3,559	3,954	4,535	4,215	3,753	3,888	5,493	5,493
Distribution Switchgear	898	882	890	924	996	519	414	478	383	383
Other	225	18	565	20	0	41	4	0	663	674
Non-Network	1,838	970	840	840	870	840	840	840	870	840
<b>TOTAL (\$k)</b>	<b>23,414</b>	<b>19,977</b>	<b>20,086</b>	<b>12,691</b>	<b>14,680</b>	<b>17,457</b>	<b>14,387</b>	<b>12,702</b>	<b>10,987</b>	<b>11,797</b>

It should be noted that the estimates for the first half of the planning period are based on known drivers and hence are more accurate than those for the second half which are more in the nature of trend analysis due to a large number of unpredictable factors.

The general trend is for a decreasing expenditure after an initial peak. A significant amount of development causes a large amount of expenditure (above \$11.5M baseline) through the first half of the planning period (2016-19). It must be remembered that there is more uncertainty towards the end of the plan.

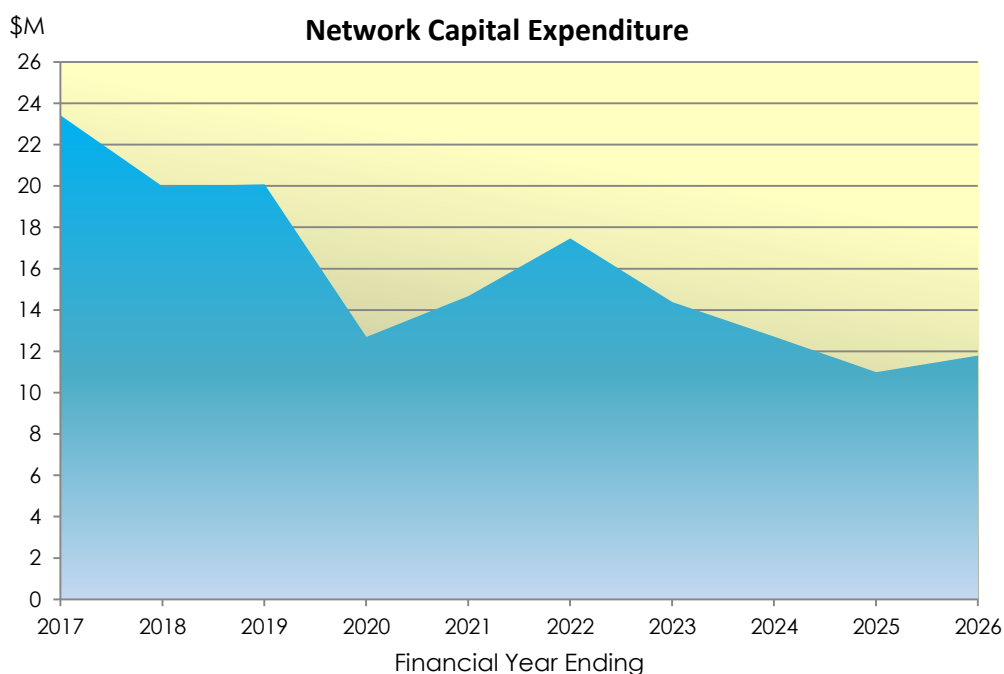

The peak levels of development are due to projects such as 66kV subtransmission development, zone substation reinforcement, 22kV conversion and network security improvements. The on-going development costs also reflect a continued emphasis on urban underground conversion and distribution automation as reclosers and gas switches are progressively automated and rural ring main units are installed. By doing this, EA Networks is planning to reduce outage quantities, durations and switching times, resulting in improved reliability statistics.

As would be expected, the bulk of the expenditure involves developing EA Networks' major assets – lines and substations. Closely following this is expenditure on switchgear which is required in substations and to interconnect lines. By 2022, almost all subtransmission line and zone substation development work has been completed and capital expenditure then drops significantly to a 'baseline' level. The next rise in expenditure could occur when the decision is made to contract Transpower for another 66kV GXP (although this is likely to be largely operational expenditure).

The 'Other' category is mostly unpopulated. This is largely due to difficulty in project disaggregation to the 'Other' category and identifying assets that fall into that category during budget preparation.

<b>Consumer Connections</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	-	-	-	-	-	-	-	-	-	-
<b>Zone Substations</b>	-	-	-	-	-	-	-	-	-	-
<b>OH Distribution</b>	421	418	409	402	394	405	394	394	394	394
<b>UG Distribution</b>	593	558	546	537	526	526	526	526	526	526
<b>Dist'n Substations &amp; Transformers</b>	1,976	1,896	1,855	1,823	1,787	2,041	1,787	1,787	1,787	1,787
<b>Distribution Switchgear</b>	99	77	75	74	72	72	72	72	72	72
<b>Other</b>	-	-	-	-	-	-	-	-	-	-
<b>Non-Network</b>	-	-	-	-	-	-	-	-	-	-
<b>TOTAL (\$k)</b>	<b>3,089</b>	<b>2,949</b>	<b>2,885</b>	<b>2,836</b>	<b>2,779</b>	<b>3,044</b>	<b>2,779</b>	<b>2,779</b>	<b>2,779</b>	<b>2,779</b>

Consumer connections are completely demand driven i.e. they occur when the consumer requires a new or enhanced connection rather than in any reliably predictable manner. Statistically, there have been a certain number of new connections and this has been used to project the future requirements.

<b>System Growth</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	0	1,568	3,049	0	0	803	0	0	0	0
<b>Zone Substations</b>	4,049	1,825	2,391	212	163	2,110	0	163	265	1,533
<b>OH Distribution</b>	229	614	816	14	413	985	152	288	152	288
<b>UG Distribution</b>	582	504	836	558	939	762	713	939	713	292
<b>Dist'n Substations &amp; Transformers</b>	1,136	1,546	1,105	17	1,989	1,129	1,243	1,488	2,966	3,210
<b>Distribution Switchgear</b>	87	28	98	4	167	29	18	154	18	154
<b>Other</b>	177	4	552	0	0	41	0	0	663	674
<b>Non-Network</b>	-	-	-	-	-	-	-	-	-	-
<b>TOTAL (\$k)</b>	<b>6,260</b>	<b>6,089</b>	<b>8,847</b>	<b>805</b>	<b>3,671</b>	<b>5,859</b>	<b>2,126</b>	<b>3,032</b>	<b>4,777</b>	<b>6,151</b>



System growth assumes the peak demand growth estimated in [section 5.2](#) occurs. If the load growth does not occur or is significantly delayed then this expenditure will drift later in the planning period or not occur at all. The baseline increase in underground distribution is caused by a planned programme to reinforce the urban Ashburton network from 2017 onwards (the "core" 11kV network). The zone substation developments cause large peaks in this expenditure which typically correspond to significant increases in distribution capacity available from that site.

<b>Asset Replacement &amp; Renewal</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	264	2,873	-	-	933	875	968	-	-	-
<b>Zone Substations</b>	79	-	-	-	-	-	-	-	-	-
<b>OH Distribution</b>	1,321	842	1,676	836	1,078	1,067	1,080	837	832	832
<b>UG Distribution</b>	4,663	3,919	3,813	3,510	3,567	3,686	3,378	2,617	76	76
<b>Dist'n Substations &amp; Transformers</b>	660	639	549	643	708	784	707	598	480	480
<b>Distribution Switchgear</b>	83	228	221	349	279	277	318	247	151	151
<b>Other</b>	-	-	-	-	-	-	-	-	-	-
<b>Non-Network</b>	-	-	-	-	-	-	-	-	-	-
<b>TOTAL (\$k)</b>	<b>7,070</b>	<b>8,501</b>	<b>6,259</b>	<b>5,338</b>	<b>6,565</b>	<b>6,689</b>	<b>6,451</b>	<b>4,299</b>	<b>1539</b>	<b>1539</b>

Asset replacements are at a significant level. This can be explained by the amount of development that has occurred and is still planned. All of the condition-based underground conversion (urban and rural) is included here and the remainder is rural overhead distribution line rebuilding. Once the underground conversion programmes begin to wind back (2024 onwards) the level of replacement activity drops sharply to largely rural overhead line rebuilding activities.

<b>Asset Relocations</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	-	-	-	-	-	-	-	-	-	-
<b>Zone Substations</b>	-	-	-	-	-	-	-	-	-	-
<b>OH Distribution</b>	-	-	-	-	-	-	-	-	-	-
<b>UG Distribution</b>	-	-	37	-	-	-	-	-	-	-
<b>Dist'n Substations &amp; Transformers</b>	-	-	16	-	-	-	-	-	-	-
<b>Distribution Switchgear</b>	-	-	-	-	-	-	-	-	-	-
<b>Other</b>	-	-	-	-	-	-	-	-	-	-
<b>Non-Network</b>	-	-	-	-	-	-	-	-	-	-
<b>TOTAL (\$k)</b>	<b>0</b>	<b>0</b>	<b>53</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Asset relocations are relatively rare events in the predominantly rural Mid Canterbury district. When they do occur they are on-demand at relatively short notice so cannot be reliably predicted. EA Networks have not allowed for any unknown asset relocations.

<b>Reliability, Safety &amp; Environment</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	152	-	-	-	-	-	1,309	1,309	-	-
<b>Zone Substations</b>	2,461	372	372	374	-	163	433	-	163	371
<b>OH Distribution</b>	503	41	32	225	32	168	359	359	168	32
<b>UG Distribution</b>	643	379	292	285	233	291	64	64	291	64
<b>Dist'n Substations &amp; Transformers</b>	722	59	51	1,470	50	261	16	16	261	16
<b>Distribution Switchgear</b>	629	550	496	497	478	141	5	5	141	5
<b>Other</b>	49	13	13	20	-	-	4	-	-	-
<b>Non-Network</b>	-	-	-	-	-	-	-	-	-	-
<b>TOTAL (\$k)</b>	<b>5,159</b>	<b>1,414</b>	<b>1,256</b>	<b>2,871</b>	<b>793</b>	<b>1,024</b>	<b>2,190</b>	<b>1,753</b>	<b>1,024</b>	<b>488</b>

The reliability, safety and environment category contains a number of the significant development programmes that EA Networks runs. These include the rural ring main unit programme, 22kV switchboard zone substation projects, several protection projects, and a number of subtransmission and distribution projects that have generally been triggered by a desire to improve reliability and/or safety.

## 8.2 Maintenance Expenditure

In future plans the maintenance programmes will be assessed individually and trended and the impact of both more modern and increased quantities of equipment will be factored into the cash-flows. Currently the maintenance planning costing is relatively short-term and this has been extrapolated forward as the best information currently available.

As information systems and condition data improve it will be used to refine the future maintenance expenditure forecasts.

<b>Overall Maintenance</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	94	95	95	96	90	91	92	92	93	93
<b>Zone Substations</b>	348	207	214	219	224	228	231	235	238	243
<b>OH Distribution</b>	1,579	1,510	1,518	1,527	1,460	1,468	1,477	1,485	1,494	1,502
<b>UG Distribution</b>	301	312	317	322	327	332	337	342	346	351
<b>Dist'n Substations &amp; Transformers</b>	334	574	592	606	623	632	641	651	660	674
<b>Distribution Switchgear</b>	204	193	191	192	187	180	182	183	185	187
<b>Other</b>	17	16	16	16	17	17	17	18	18	18
<b>TOTAL (\$k)</b>	<b>2,877</b>	<b>2,907</b>	<b>2,943</b>	<b>2,978</b>	<b>2,928</b>	<b>2,948</b>	<b>2,977</b>	<b>3,006</b>	<b>3,034</b>	<b>3,068</b>

The EA Networks network is relatively young overall. The significant levels of recent development have replaced much of the subtransmission network and coincidentally the distribution network on the same route. The 11-22kV conversion programme has 'refreshed' much of the distribution network although it has not necessarily extended the life of individual overhead structures. All of the 22kV transformers are in very good condition. Underground conversion continues to remove the oldest urban overhead lines from the asset pool and consequently there is no 'maintenance mountain' within the planning period.

<b>Service Interruptions &amp; Emergencies</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	45	45	45	45	45	45	45	45	45	45
<b>Zone Substations</b>	27	27	27	27	27	27	27	27	27	27
<b>OH Distribution</b>	771	771	771	771	771	771	771	771	771	771
<b>UG Distribution</b>	53	53	53	53	53	53	53	53	53	53
<b>Dist'n Substations &amp; Transformers</b>	80	80	80	80	80	80	80	80	80	80
<b>Distribution Switchgear</b>	91	91	91	91	91	91	91	91	91	91
<b>Other</b>	-	-	-	-	-	-	-	-	-	-
<b>TOTAL (\$k)</b>	<b>1,067</b>	<b>1,067</b>	<b>1,067</b>	<b>1,067</b>	<b>1,067</b>	<b>1,067</b>	<b>1,067</b>	<b>1,067</b>	<b>1,067</b>	<b>1,067</b>

The levels of expenditure for faults are forward extrapolations of a typical year. Future plans will continue to refine the impact that intensive development and maintenance have on the fault rate/cost.

<b>Vegetation Management</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	26	26	26	26	20	20	20	20	20	20
<b>Zone Substations</b>	-	-	-	-	-	-	-	-	-	-
<b>OH Distribution</b>	299	299	299	299	224	224	224	224	224	224
<b>UG Distribution</b>	-	-	-	-	-	-	-	-	-	-
<b>Dist'n Substations &amp; Transformers</b>	-	-	-	-	-	-	-	-	-	-
<b>Distribution Switchgear</b>	-	-	-	-	-	-	-	-	-	-
<b>Other</b>	-	-	-	-	-	-	-	-	-	-
<b>TOTAL (\$k)</b>	<b>325</b>	<b>325</b>	<b>325</b>	<b>325</b>	<b>244</b>	<b>244</b>	<b>244</b>	<b>244</b>	<b>244</b>	<b>244</b>

Trees are the bane of network operators. The control and management of trees appears to be an on-going and unavoidable cost. It is possible these costs may be changed in the future if vegetation control policies are revised in an attempt to reduce tree-related faults. The impact of such a policy is shown as a step change down in 2021.

<b>Routine and Corrective Maintenance and Inspection</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	23	23	24	25	25	26	27	27	28	29
<b>Zone Substations</b>	239	78	80	82	84	85	87	89	91	92
<b>OH Distribution</b>	104	106	109	112	115	118	121	124	127	130
<b>UG Distribution</b>	98	106	109	112	115	118	121	124	127	130
<b>Dist'n Substations &amp; Transformers</b>	34	188	192	197	201	205	209	213	218	222

<b>Distribution Switchgear</b>	48	45	47	48	49	50	51	52	53	54
<b>Other</b>	4	16	16	16	17	17	17	18	18	18
<b>TOTAL (\$k)</b>	<b>550</b>	<b>562</b>	<b>577</b>	<b>592</b>	<b>606</b>	<b>619</b>	<b>633</b>	<b>647</b>	<b>662</b>	<b>675</b>

The inspection, servicing, testing and fault-reactive expenditure has been kept to the same level through the plan to continue monitoring the condition of older components such as hardwood poles so that future maintenance may be targeted toward life extension of ageing assets. Newer assets are also monitored and tested to ensure they are maintained to an adequate level to preserve capability and guarantee a full expected lifetime of operation.

<b>Asset Replacement and Renewal</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Subtransmission</b>	0	0	0	0	0	0	0	0	0	0
<b>Zone Substations</b>	82	102	107	110	114	116	117	119	121	124
<b>OH Distribution</b>	405	334	339	344	350	355	361	366	371	377
<b>UG Distribution</b>	150	152	154	156	158	160	162	164	166	168
<b>Dist'n Substations &amp; Transformers</b>	220	306	320	330	342	347	352	358	363	372
<b>Distribution Switchgear</b>	66	57	54	53	48	39	40	41	41	42
<b>Other</b>	12	0	0	0	0	0	0	0	0	0
<b>TOTAL (\$k)</b>	<b>935</b>	<b>951</b>	<b>974</b>	<b>993</b>	<b>1,012</b>	<b>1,017</b>	<b>1,032</b>	<b>1,048</b>	<b>1,062</b>	<b>1,083</b>

There are relatively low levels of like-for-like component replacements in the EA Networks asset pool. The majority of asset replacement/renewal involves an intentional increase in capacity or functionality to offer additional system capacity, system security or reliability. The two areas of note where some like-for-like replacements occur are overhead distribution lines (e.g. 11kV or 22kV refurbishment) and distribution transformers and substations where physical deterioration can cause a component of an asset to be replaced.

<b>Non-Asset Specific</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>	<b>2022</b>	<b>2023</b>	<b>2024</b>	<b>2025</b>	<b>2026</b>
<b>Business Support</b>	3,775	3,875	3,975	4,075	4,175	4,175	4,175	4,175	4,175	4,175
<b>Operations &amp; Network Support</b>	3,660	3,760	3,860	4,323	4,312	4,153	4,327	4,423	4,521	4,474
<b>TOTAL (\$k)</b>	<b>7,435</b>	<b>7,635</b>	<b>7,835</b>	<b>8,398</b>	<b>8,487</b>	<b>8,328</b>	<b>8,502</b>	<b>8,598</b>	<b>8,696</b>	<b>8,649</b>

The non-asset specific expenditure covers the running costs of the business – both technical and back-office. These costs are reasonably well known and do not vary year-to-year by a significant amount. In recent years, staffing levels have increased to rebalance the technical side of the business which has been diluted by the demands of the more rigorous regulated business environment EA Networks operate in.

Staff numbers are anticipated to continue growing while significant development occurs. When development rolls back, staff will be redeployed to develop the systems and processes that can justify investment. The Operations and Network Support cost begins to increase towards the end of the planning period as staff are reassigned to non-capital work.

# EVALUATION OF PERFORMANCE

<b>Table of Contents</b>	<b>Page</b>
9.1 Progress Against Plan	271
9.1.1 Physical	271
9.1.2 Financial	276
9.2 Service Level	279
9.2.1 Actual Levels of Service	279
9.2.2 Overall Reliability	284
9.3 Service Improvement Initiatives	285
9.3.1 Transpower Network	285
9.3.2 Subtransmission System	286
9.3.3 Zone Substations	286
9.3.4 22kV and 11kV Distribution System	286
9.3.5 LV Distribution System	289
9.3.6 SCADA, Communications and Control	290
9.3.7 Protection Systems	290
9.4 Asset Management Maturity Evaluation	291
9.5 Gap Analysis	291
9.6 Asset Management Improvement Initiatives	291
9.7 Capability to Deliver	292



## 9 EVALUATION of PERFORMANCE

### 9.1 Progress Against Plan

It has become evident to EA Networks that during times of rapid load growth, significant demands are placed on the company and its resources – both financial and human. This extra pressure means that work is prioritised and despite the fact that every best endeavour is made to complete work in the timescale originally proposed, occasionally it is not. This can be for any number of reasons but primarily it is that there were more important things that had to be done and any work that could be deferred was. If the task involves supplying new load or a safety requirement, it will inevitably be done. Where the task involves improvements to security or reliability it will be done with the next highest priority. Where the task is largely documentary and pre-emptive (e.g. contingency plans), it has been known to slip down the list of priorities. This is basically where we find ourselves at this juncture in the progression of Asset Management Plans.

#### 9.1.1 Physical

Physical progress is essentially measured against the items in the financial plan for any given financial year. This can give a slightly distorted view in that a delay of weeks or a few months causes some projects to slip from one financial year to another which, for equipment with life expectancies of 40 to 50 years, is negligible. If replacement works or new project planning is timed that critically (other than for specific new loads) that it cannot wait for a few months, then it has been left too late.

##### Targets

The basic target for physical progress is to ensure that network performance is not sacrificed as a result of planned work not proceeding on the proposed timescale.

##### Outcome

Capital projects critical for supplying new load and dealing with immediate security concerns were generally attended to. A number of less immediate and more strategic projects have been deferred, some by only months.

The 2014-24 Asset Management Plan identified a number of projects that were planned for completion during the 2014-15 financial year. The following table identifies the incomplete projects listed in the 2014-24 Asset Management Plan and each major project (>\$100k) from the Asset Management Plan, its status as at 31 March 2015, and a commentary on the project.

The 2015-25 Asset Management Plan included a schedule of projects that were planned for completion during the 2015-16 financial year. The following table identifies each major project (>\$100k), its status as at 1 February 2016 and a commentary on the project.

#### 2014-24 & 2015-25 Asset Management Plan Project Progress/Forecast as at February 2016

Planned F.Year	Project ID	Description	Status % Physically Complete		Commentary
			Mar 2015	Feb 2016	
2014/2015	10485	11-22kV Conversion Ruapuna	100%	100%	Complete.
2014/2015	10311	Zone Substation SFD New 66kV	95%	100%	Complete.
2014/2015	10310	Zone Substation Ashburton 66kV Conversion (Stage 1)	95%	100%	Complete.

Planned F.Year	Project ID	Description	Mar 2015	Feb 2016	Commentary
2015	10056	Zone Substation NTN 66kV Conversion	95%	100%	Complete.
2015	10075	Zone Substation Elgin Completion and NTN Bay	95%	100%	Complete.
2015	10079	Zone Substation Methven 22kV Switchboard and Protection	25%	100%	Complete.
2015	10080	Zone Substation Methven 10MVA 11/22kV Transformer	75%	100%	Complete.
2015	10092	Seismic and Geotech Remediation	70%	100%	Complete.
2015	10343	66kV Christys Road to Seafield 66-22kV (1.2km)	100%	100%	Complete.
2015	10697	66kV Methven-Mt Somers 66-22kV Stage A (8.2km)	35%	70%	Outage limitations have prevented a small part of the job from being completed. Until the entire line is rebuilt this is not limiting functionality.
2015	10699	66kV Methven-Mt Somers 66-22kV Stage B (9km)	0%	100%	Delays caused by irrigation load constraints and site access issues (crops). Complete.
2015	10462	Additional RMUs	75%	100%	Complete.
2015	10483	11-22kV Conversion Cairnbrae-Highbank	25%	100%	A delay in 22kV work at Methven 66kV substation meant that 22kV could not be sourced from there. Lauriston substation was fully loaded. Load must stay at 11kV until MTV is progressed and LSN transformer upgraded. Complete.
2015	10434	Pudding Hill Road 11kV (4km)	100%	100%	Complete.
2015	10679	Rawles Crossing Road 22kV (4km)	100%	100%	Complete.
2015	10137	UG Hoods Road/Pattons Rd/Ashburton Gorge Rd, Mt Somers	90%	100%	Digging conditions in Mt Somers caused delays in progress. Complete.
2015	10038	UG Methven Highway – Myklejohn	95%	95%	Installation complete but not commissioned due to delays in [10697].
2015	10051	UG Dobson Street, Chalmers Ave to Willow Street	100%	100%	Complete.
2015	10466	UG Dolma Street, Methven	100%	100%	Complete.
2015	10052	UG Carters Terrace, Grove Street	100%	100%	Complete.
2015	10051	UG 64 Middle Road to Belt Road	100%	100%	Complete.
2015	10051	UG Albert Street - Adam Street	75%	100%	Completion delayed due to access problems to change over house services. Complete.
2015	10051	UG Chalmers Ave/Nelson Street, Havelock Street to Eaton Street	75%	100%	Completion delayed due to access problems to change over house services. Complete.
2015/ 2016	10682	Zone Substation PDS - Building Replacement	0%	100%	Narrow construction opportunity missed in winter 2014. Complete.
2015/ 2016	10914	11-22kV Conversion Dromore	50%	100%	Complete.
2015/ 2016	10702	11kV OH Line, Peters Road, Rebuild	0%	100%	Complete.
2015/ 2016	10707	11kV OH Line, Rangitata Gorge, Rebuild, Stage 1	0%	100%	Complete.



Planned F.Year	Project ID	Description	Mar 2015	Feb 2016	Commentary
2015/2016	10473	UG Methven Highway	0%	0%	Black Grass risk continues to prevent progress. Scheduled for 2017 with construction management strategy to deal with Black Grass issues.
2015/2016	10937	UG Conversion SH77 Hwy. Arundel Rakaia Gorge Rd	0%	0%	Delayed by decision to change from OH rebuild to underground conversion.
2015/2016	10936	UG Conversion SH77 Hwy. Waimarama Rd	0%	10%	Initially delayed by decision to change from OH rebuild to underground conversion. Will be completed in Q1 2016.
2015/2016	10040	UG Burnett Street CBD	50%	100%	Progress is determined by building removal and rebuilds. Complete.
2015/2016	10732	UG Rakaia 22kV security. Railway Tce East to Mackie St.	0%	55%	Delayed as other condition based work seen as more essential.
2015/2016	10690	UG Conversion Maldon St Chertsey.	0%	100%	Complete.
2016	10994	66kV, MSM to MON, 66/22kV OH Line - Stage 2, Section 1, Rebuild	N/A	10%	Delays caused by irrigation load constraints. (25% end March)
2016	10995	66kV, MSM to MON, 66/22kV OH Line - Stage 2, Section 2, Rebuild	N/A	0%	Delays caused by irrigation load constraints.
2016	10141	66kV, MTV to MSM, 33-66kV OH Line, Rebuild, Stage 3	75%	90%	Delays caused by irrigation load constraints and site access issues (crops).
2016	11090	Zone Substation CRW - 2nd Transformer Deposit	N/A	100%	Complete.
2016	10956	Zone Substation FTN New 66kV - Civil Works	N/A	10%	Delays by contractor will mean this project spills into 2016-17.
2016	10989	Zone Substation Protection Relay Upgrade - Feeder & Transformer	0%	90%	Almost complete. Commissioning still to take place.
2016	10974+ 10496	Zone Substation MTV - Protection, Cabling & Switchgear	0%	95%	Scope of project changed initially and outage opportunities were challenging.
2016	10957	Zone Substation TIN New 66kV - Structural/Electrical	N/A	15%	Delays by contractor delayed EA access to site. (25% end March)
2016	10955	Zone Substation TIN New 66kV - Civil Works	N/A	90%	Delays by contractor.
2016	10737	RMU Control Cubicles Order	N/A	20%	Other work has taken priority.
2016	10751-7	RMUs for Existing Overhead Network - Not installation	N/A	100%	Complete.
2016	10912	11-22kV Conversion Greenstreet	N/A	50%	Commissioning delayed until Rawles Crossing line completed to retain security while commissioning progresses.
2016	10911	11-22kV Conversion Thompsons Track	N/A	100%	Complete.
2016	10817	Transformers for SH1, Works Rd to Dromore Corner	0%	100%	Complete.
2016	10817	Transformers for Thompsons Track-Methven Highway 22kV Conversion	0%	100%	Complete.
2016	10817	Transformers for Timaru Track/Ashburton Stavely Rd 22kV Conversion	0%	100%	Complete.

Planned F.Year	Project ID	Description	Mar 2015	Feb 2016	Commentary
2016	10943	33-22kV OH Line, Arundel Rakaia Gorge Road, Rebuild	N/A	0%	Constrained by load and back-feed capacity in Montalto area. Should progress in autumn 2016.
2016	10945	22kV OH Line, Griggs Road, Rebuild	N/A	100%	Complete.
2016	10939	22kV OH Line, Lambies Road, Rebuild	N/A	100%	Complete.
2016	10915	Methven (MVN) Control Room	0%	20%	Delays in MTV 66kV projects caused retention of MVN33 as an operational site. MVN will be decommissioned in mid-2016.
2016	11043	22kV OH Line, Rawles Crossing Rd - Timaru Track, New Section 3	N/A	75%	Delayed due to pile driving contractor.
2016	10940	11kV OH Line, Springfield Road West, Rebuild	N/A	25%	Complete.
2016	00065	UG New Subdivision. Geoff Gearing Drive - Stage 2 (34 lots)	N/A	0%	Awaiting developer.
2016	10777	UG New Subdivision. Malcolm Tarbotton - Stage 1 (26 lots)	N/A	100%	Complete.
2016	00066	UG New Subdivision. Oaklea - Stage 3 (28 lots)	N/A	75%	Delayed by developer.
2016	11050	UG New Subdivision. Oaklea Stage 5 (18 lots)	N/A	0%	Complete.
2016	10693	UG Conversion Cambridge St. Wellington St to Beach Rd.	N/A	90%	House service OH-UG change-over delayed due to absbestos issues.
2016	10919	UG Conversion Carters Rd.	N/A	75%	Slight delay, will complete in April 2016.
2016	10895	UG Conversion Chertsey Kyle Rd Chertsey.	N/A	100%	Complete.
2016	10916	UG Conversion Davis Cres.	N/A	90%	House service OH-UG change-over delayed due to absbestos issues.
2016	10918	UG Conversion Galbraith St.	N/A	40%	Scheduled late in 2015-16. Delayed by a few months. Will be completed in Q1 2016.
2016	10694	UG Conversion Hinds Hwy. Lynford Rd to Hinds township.	0%	100%	Complete.
2016	10917	UG Conversion McDonald St Ash.	N/A	40%	Scheduled late in 2015-16. Delayed by a few months. Will be completed in Q1 2016.
2016	10820	UG Conversion Middle Rd. Belt Rd to Creek Rd.	N/A	100%	Complete.
2016	10935	UG Conversion Rakaia Hwy. Chertsey north to rail crossing	0%	0%	Scheduled for late 2015-16. Limited availability of contractors has caused this to be delayed into Q1 2016.
2016	10872	UG Conversion Rakaia Hwy. Overdale to Rakaia	0%	100%	Complete.
2016	10733	UG Conversion Rakaia Hwy. Works Rd to Dromore Cnr.	0%	100%	Complete.
2016	00214	Business Intelligence System	N/A	100%	Complete.
2016	10990	Electrical GIS Implementation	0%	90%	Likely to be complete in April 2016.
2016	10723	Electricity Billing Engine & CRM System	0%	10%	Will continue in 2016-17.
2016	00216	Enterprise Resource Planning System	0%	0%	Reliant on other system developments that are still incomplete.
2016	10692	UG Conversion. Burnett St CBD	50%	100%	Progressed as building demolished post-earthquakes. Complete.

## Reasons for Variance

Over the last 15 years EA Networks has experienced load growth well in excess of the national average. In general, new connections (and work further into the network) that is required to support new connections is given priority over other capital or maintenance with the exception of work required to mitigate safety issues.

Delays in projected work have many underlying reasons ranging from the need to level human resource demands, to legal proceedings or on occasion access difficulties. The window of opportunity for much of the work on the EA Networks' network is narrow as irrigation demand removes the summer months from the rural work schedule. This leaves the less settled autumnal, winter and early spring months as the rural work window. With the advent of dairy herds across the entire EA Networks region, it has further narrowed this window as milking also occurs outside the irrigation season. To further compound this, dairy supplies often limit planned outages to between 9am and as early as 3pm. When a significant winter storm occurs it can take resources away from planned work and create a backlog of project work that must be either completed or deferred until next autumn at the earliest. Thankfully, During 2015-16 the weather caused few significant issues.

The continuing increase in peak load altered the priorities of the forecast work. Now that there is additional capacity, it is possible to shift additional load from the 33kV network on to the 66kV network. A 5-10 year individual project schedule has now been incorporated for underground conversion work and rural ring main work which were previously large unscheduled amounts. This has caused changes to the forecast cash-flows.

### Engineering Resources

During the last two years EA Networks has employed a number of engineering staff to assist in the workload that a considerable number of project have placed upon the existing resources. It takes time for new engineers to become familiar with the business and adapt to a workplace after leaving university. In order to become productive the new engineers are mentored by existing staff and this does take time away from 'production' tasks such as design and planning. The loss of two of these staff during this period set the engineering team back for a period as well as illness amongst other engineering staff. The new group of 3 engineering graduates have arrived in early 2015 and they show much promise to fill the gaps that have caused many delays in the past (although one of these graduates is about to leave EA Networks – they will be replaced).

### Volume of Externally Driven Work

The volume of work that has been driven by external agencies and organisations has been considerable. The rate of residential subdivision has been dramatic in recent years and it is only in the last year it has shown signs of slowing down. The raft of state highway projects that have changed from overhead rebuilds to underground conversion has again increased dramatically. All of this work increases demands on engineering and construction staff. Needless to say, the staff do their best to meet these challenges but there are times when they cannot meet all expectations and this period has been one of those times.

Managing expectations of external organisations is an important aspect of dealing professionally with them. Realistic timeframes need to be given when it is known that the staff involved are already very busy. This has not always been handled well.

### Contractor Availability

The availability of contractors and the progress they make compared to that anticipated can both have a significant impact on project progress. There are a limited number of contractors active in the mid-Canterbury area. There are times when EA Networks is using most of them in some capacity. If other important clients call upon the contractor's services EA Networks' projects can slip.

## Plans to Address Variance

To date, the variation in planned work completion dates has not had a material effect on network performance. Essential work is always completed and any work that is targeted for deferral is evaluated for its criticality. If it is seen that a particular project must proceed external assistance is sought to ensure its completion in the required timeframe.

Load continues to grow at a significant rate which has placed stress on available resources. EA Networks is reluctant to increase internal contracting resources significantly as there is an emerging trend of converting

some irrigations systems from deep well or on farm pond storage to pressurised pipe systems that could significantly reduce electrical loads.

Against that trend, our overhead network continues to age. The requirement of all new connections to the network at 22kV or below to be by underground cable has placed additional workloads on cable laying resources. As a result of this, EA Networks is considering increasing its resources in this area.

On a more general note, EA Networks has invested in additional resources, both human and non-human, to address some of the project management issues that have hindered completion of some jobs. The recent addition of three graduate engineers has also bolstered the technical staff significantly (4 electrical engineers previously) and over the next few years it is hoped that they can make a marked difference in the performance of the network.

## 9.1.2 Financial

For a decade the EA Networks Asset Management Plan has formed the core of future financial planning for the Board and management of EA Networks. Corporate 10-year cash-flows are based on the data contained in the schedules prepared for the annual Asset Management Plan.

The reader is also referred to <http://www.eanetworks.co.nz/disclosures/default.asp> for additional detailed information about the financial performance of the company and its assets.

### Budget


Each year the AMP is prepared in tandem with the annual budget and the major projects are extracted from the AMP to form the core of the budget. Smaller, previously unscheduled, works are identified in the budget and used to 'flesh out' the AMP to include the details of work that comes to light at relatively short notice or is based upon newly gathered information.

This approach to budgeting/AMP preparation tends to cause an influx of small projects into the AMP project schedules that were previously unidentified. These numerous small projects although not identified are allowed for in the AMP forecast as 'unscheduled' items that are grouped together in an estimate of the total likely cost of such activities (based upon historical statistics).

As budgeting techniques and tools are refined and more staff resources can be made available for data analysis showing trends and previously hidden statistics, it is possible that some of the unscheduled work will be placed in to scheduled projects and programmes to target specific aspects of networks performance.

The following analysis focuses on network expenditure rather than non-network expenditure. The AMP's focus is on managing the assets in the network so this approach is considered valid. A summary of non-network expenditure is provided but no details are covered or explanations provided.

The 2014-24 Asset Management Plan contained the following financial plan for the 2015 financial year (actual results are shown alongside):

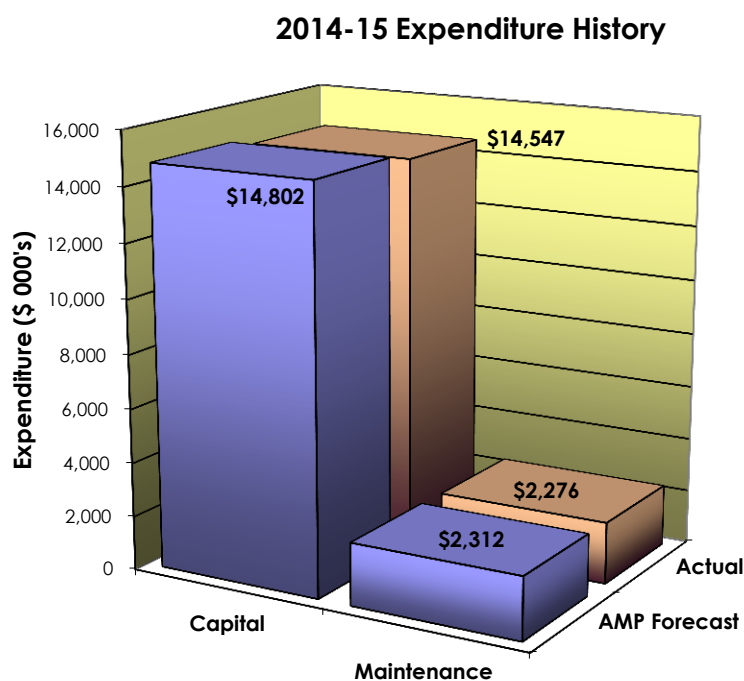

Category	Capital Expenses		Operational Expenses		Delta	
	Forecast	Actual	Forecast	Actual		
2014-15 AMP Forecast - 2015	Customer Connection	3,763	3,738	-	-	-25
	System Growth	3,423	3,608	-	-	185
	Reliability, Safety and Environment	2,302	3,578	-	-	1,276
	Asset Replacement & Renewal	4,883	3,258	-	-	-1,625
	Asset Relocations	431	365	-	-	-66
	Routine & Preventative	-	-	604	409	-195
	Refurbishment & Renewal	-	-	721	984	263
	Fault & Emergency	-	-	722	580	-142
	Vegetation Management	-	-	265	303	38
	<b>TOTAL (\$,000)</b>	<b>14,802</b>	<b>14,547</b>	<b>2,312</b>	<b>2,276</b>	<b>-291</b>
	Non-Network System Operations & Network Support	-	-	2,538	3,336	798
	Non-Network Business Support	-	-	4,224	3,509	-715

## Outcome

The chart on the previous page shows the disclosed 2014-15 actual performance compared to the forecast amount in the 2014-24 plan.

The actual values have been extracted from 2014-15 disclosure data.

As can be seen from the chart, the operational (maintenance) expenditure was 98% of that forecast (-\$36k). The capital expenditure was also 98% of the forecast (-\$255k).

Overall Capital expenditure and overall Operational expenditure was very close to the values predicted.

## Reasons for Variance

Explanation of variance more than 10% and others for interest:

### Capital Expenditure. Customer Connection (-\$25k ~ -0%)

There are some variances with the consumer connection categories that EA Networks chose for disclosure. This is the first disclosure with a revised (more representative) set of consumer connection categories. These revised categories align with the charging mechanism for new connections rather than the previous combination of electrical and usage types.

The actual investment in consumer connection has historically and continues to be affected by a large number of external macro events. EA Networks has little control over those macro events, such as dairy pricing which drives irrigation connection demand and earthquakes and the associated population movement from Christchurch. While EA Networks incorporate all known factors into its connection AMP forecast a large amount of data remains hidden from EA. As a result there will always be some variance from forecast to actual.

### Capital Expenditure. System Growth (+\$185k ~ +5%)

Zone Substations: Mainly reflects Ashburton substation upgrade which was allowed for in the 2014 year, but not completed until this year.

Distribution LV Lines: Mainly reflect 22kV conversion budget to be completed in the 2015 year, which has started but is not yet completed. These projects will be completed in 2016:

[10018] 11-22kV Conversion Dromore,

[10019] 11-22kV Conversion Ruapuna.

Distribution and LV cables, Distribution substations and transformers and Distribution Switchgear:

Overall 3 categories capital investment was in line with the AMP.

Other network asset:

Reflects an additional RMU Control box being installed, carried over from the prior year.

Capital Expenditure. Reliability, Safety and Environment (+\$1,276k ~ +55%)

The variance mainly reflects a catch-up in projects which were delayed from the 2014 year and a reorganisation of the work programme to match the availability of external resources.

Capital Expenditure. Asset Renewal and Replacement (-\$1,625k ~ -33%)

The main reason for the variance is projects which were delayed due to resourcing issues.

14003	Arundel Rakaia Gorge Road North	\$117
14004	Peters Road	\$83
14006	Waimarama Road	\$108
14009	Rangitata Gorge Road (PC Sum)	\$349
14017	Maldon Street Chertsey	\$289
140170	Maldon Street Chertsey - Services	\$8
15015	Pendarves Building and Protection	\$441
14050	66kV River Piles Ashburton River (Methven-Mt Somers Project)	\$71
	TOTAL	\$1,466

Operating Expenditure

Please refer to [EA Networks annual regulatory disclosure](#) for further details.

## Plans to Address Variance

While distributed load continues to grow in somewhat unpredictable locations and scale, the rescheduling of capital projects and expenditure during the forecast year cannot be precluded. Any capital expenditure is spent completing projects for legitimate reasons, there are no plans to address the variance with any specific actions (other than completing delayed projects as soon as it is pragmatic).

The increase in engineering resource and the appointment of dedicated project managers for substations and overhead and underground works will help provide better coordination of works as well as focusing personnel on the critical path for all projects. The lack of overall coordination has been disadvantageous in previous years.

A forecast is simply that, a forecast and not a fact. There are times when the prevailing conditions make it difficult to provide a long range forecast and aberrant localised conditions can mean forecasts are dramatically wrong.

Efforts are being made to provide a progressive planning mechanism that will review the planned projects every three months and develop a moving 18-36 month active projects database. The projects at the 18 month horizon are candidates for inclusion in the coming year's works programme. The 36 month horizon projects are more conceptual and will only become realistic proposals once thorough investigation has taken place. The projects in the database will be refined as time goes by to ensure their viability and scope. By the time they come to be designed in detail there should be a large amount of knowledge built up about how the project will be designed, built, commissioned and operated. All of the project knowledge will be held in the database so any interested personnel have the opportunity to contribute ideas and critique the technical, timing and cost aspects of the proposal.

## Forecast for 2016 Financial Year

As at 1 February 2016, the forecast end of year expenditure versus the 2015-25 AMP forecast for the 2016 financial year was as follows:

Category	Capital		Maintenance		Delta	
	AMP Forecast	EOY Forecast	AMP Forecast	EOY Forecast		
2015 AMP Update Forecast - 2016	Customer Connection	4,268	3,303	-	-	965
	System Growth	3,245	3,100	-	-	145
	Reliability, Safety and Environment	2,669	2,945	-	-	-276
	Asset Replacement & Renewal	8,150	9,024	-	-	-874
	Asset Relocations	54	-	-	-	54
	Routine & Preventative	-	-	600	535	65
	Refurbishment & Renewal	-	-	772	911	-139
	Fault & Emergency	-	-	845	989	-144
	Vegetation Management	-	-	448	319	129
	<b>TOTAL (\$,000)</b>	<b>18,386</b>	<b>18,372</b>	<b>2,665</b>	<b>2,754</b>	<b>-75</b>
	Non-Network System Operations & Network Support	-	-	3,550	3,471	79
Non-Network Business Support	-	-	4,005	3,351	654	

## 9.2 Service Level

### 9.2.1 Actual Levels of Service

#### Network Performance

EA Networks have historically set high expectations for its network performance. This is driven by the rising dairy industry profile - where even momentary interruptions caused by a circuit breaker reclosing causes significant disruption to a dairy shed's operation. There is also a rising expectation from customers that the power will "always be on".

While setting high expectations is a worthy exercise, it can be a difficult target to reach. The method used to set the individual performance targets is to take the average of the last four years (excluding aberrant years) planned performance and add this to the average unplanned performance. This technique attempts to provide a target that is achievable at least some of the time. Previous methods of calculating targets gave unrealistically low values that were very rarely achieved.

The targets are now located in amongst the peer companies that have similar styles of networks. For example, the average SAIDI forecast for peer companies for 2015-19 is 199 minutes. The current target for EA Networks 66kV SAIDI is 208 minutes. Previous EA Networks targets have been as low as 149 minutes – 25% below the peer average. The lower 25<sup>th</sup> percentile SAIDI was 160 minutes for those companies. EA Networks' SAIFI performance is better than average in comparison with both peer companies and about average for lines companies generally. The 14 peer group lines companies have a median/average SAIFI of about 2.6.

SAIDI	Total	Unplanned	Planned
Targets	208	120	88
Actual / EOY Forecast	241	166	75

The internationally recognised CAIDI, SAIDI and SAIFI indices are useful barometers of how a network has

performed over a given interval. These indices can be plotted over time to establish any trends. The tables above and below represent EA Networks' performance during 2015-16 to 28 February 2016 (March estimated).

While it is an improvement over the 2014-15 year's performance, the SAIDI target looks likely to be exceeded by about 16%.

The planned SAIDI is under the target and very close to the forecast 72.5 minutes in the previous plan. Some work has not been done because of the impact planned outages would have. Alternative techniques and system configuration is being worked on to allow completion. If the work is irrigation sensitive and irrigation starts in early September there is no opportunity to complete the work until the following financial year (the next winter). Fault SAIDI is appreciably above the target and the main culprit was the June snow 2015 event. Excluding that event brings the SAIDI value within the target.

<b>SAIFI</b>	<b>Total</b>	<b>Unplanned</b>	<b>Planned</b>
Targets	1.76	1.44	0.32
Actual / EOY Forecast	1.19	0.98	0.27

The overall SAIFI performance looks to be well within target 32% below the target level (a significant improvement from the previous year). Unplanned interruptions closely matched the forecast value (0.26) of the previous plan.

The June 2015 snow event had a largely impact with low consumer density. A number of consumers were off for a reasonably long time but they represented a small proportion of the total consumer numbers.

It should be noted that, in the interests of safety, EA Networks has strict criteria for reliving rural circuits after a fault event. Because of the possibility of irrigators becoming entangled in HV lines, significant line lengths in and around farm yards and the possibility of car vs pole events to name a few, in almost all cases EA Networks' standard requires a full line patrol (including on-property lines) after the occurrence of an earth fault. This significantly increases fault restoration times however public safety, in EA Networks' opinion, requires this.

<b>Interruptions</b>	<b>Total</b>	<b>Unplanned</b>	<b>Planned</b>
Targets	450	150	300
Actual / EOY Forecast	430	257	173

The total interruptions index is really only useful to compare to previous network performance as intercompany performance is skewed by the length of network each company operate. Up until 2010, the total interruptions were trending upwards (averaging more than 300 from 2001-2010). This trend was tracking the planned interruptions rather than reflecting any definitive increase in fault numbers. The last four years have shown a marked decrease in planned outages averaging around 250 per annum. Fault interruptions have fallen slightly and while the reduction is favourable it is not statistically significant.

The faults per 100km (by voltage) parameter is the most useful index to the asset manager.

The performance of the network at subtransmission voltages is encouraging despite exceeding the target values. The voltages which require improvement are the 11kV and 22kV networks. For 2016 the overall rate of faults per 100km seems to have deteriorated to approximately 200% of the 2015 target value.

The table shows the voltage at which the network faults are occurring and the chart in [section 2.4.1](#) illustrates the trend of these faults.



Faults/ 100km	Total	11kV-22kV	33kV-66kV
Targets	5	6	2.5
Estimate / EOY Forecast	9.40	10.50	1.80

EA Networks have revised its vegetation management and line inspection procedures to better predict and prevent future network failures.

## Discussion

A considerable quantity of 22kV conversion is undertaken each year. Every effort was made to minimise interruptions by employing additional contractors to complete as much work as possible in every planned interruption. As mentioned previously, the influx of dairy farming severely impacts on the available number of shutdowns and the duration of each shutdown has an effect. The option of live-line techniques for projects of this size would have been prohibitively expensive and slow.


The contribution of planned work to lost customer minutes is significant and this can only be reduced by doing less construction work. This will only occur if the load stops growing at relatively high rates.

Over recent years, EA Networks has invested heavily in remote controllable devices in the field. This involves installation of modern reclosers, gas switches and, in situations where 3 or 4 lines meet, ground mounted ring main units. At the same time, almost all zone substations have been linked with fibre optic cable. The advent of the fibre optic cable is allowing differential line protection to be fitted to virtually all sub-transmission circuits. Along the fibre route RMUs, reclosers and gas switches are now being connected to the communications infrastructure. This will facilitate quicker fault location identification and restoration on sections not directly affected by the fault. Outside the fibre route, remote controlled devices will be connected via a radio network. Mid-Canterbury's flat terrain makes reliable radio communication difficult (hence the deployment of a fibre network for protection purposes) however EA Networks are working with a radio manufacturer to develop a data network using much of EA Networks radio voice network core infrastructure.

Installation of remote controllable devices has generally occurred when other works are occurring. As a result it takes some time to get sufficient concentration of these devices in any one area to make a noticeable difference to overall performance. There is now a concerted effort to roll out remote control to as many devices as is practical to achieve noticeable improvements in SAIDI.

Several years ago EA Networks introduced a policy requiring all new connections to the network at 22kV or below had to be via underground cable. The policy was to reduce the large number of faults that occurred on private property but resulted in a network outage. Since implementing this policy we have had very few incidents on property involving underground cable, much less than we would have expected from an overhead service. In addition safety has been improved through less chance of strikes by irrigators, grain augers etc.


66kV and 22kV conversion work will continue to influence the indices for several more years. If increases in load continue to occur as predicted, networks at both voltages will need to be extended and the best cost/reliability trade-off occurs by having relatively few, reasonably long, but very productive planned interruptions.

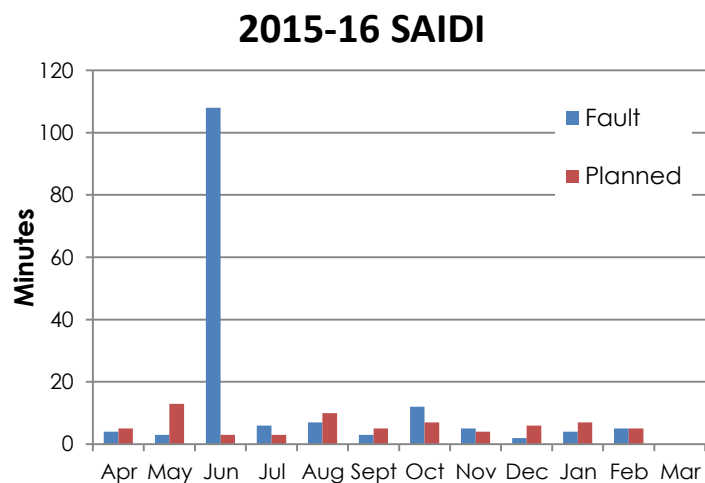

EA Networks, initial 22kV conversions were driven directly by the inability of the existing 11kV network to maintain acceptable voltages under increasing loads. On a voltage-constrained network, doubling the voltage allows four times the load to be delivered with regulatory voltage tolerances. This is achieved for a modest increase in cost and with little change to operating and construction procedures. As the 22kV network has expanded, it has introduced several areas where network security has been compromised owing to the need to supply additional load. EA Networks are now in a catch up situation where there is a need to convert additional sections of network to restore the previous security levels. This expenditure is a legacy of responding to rapidly increasing loadings and will prevent future deterioration in reliability performance rather than necessarily improving future performance.

The rates of faults per 100 km of distribution lines is still disturbing. Since 2010 the 11kV-22kV fault rate has climbed only declining slightly this year. Both were above the target rates.

A variation in 11kV vs 22kV performance (not shown in tables or diagrams) can be partly explained by the location of 22kV and 11kV across the district. Looking at the diagram showing the location of the 11kV and 22kV distribution lines in [Section 5.4.4](#) it is clear that events can affect one voltage more than the other as a consequence of their geographic location. When strong wind, lightning or other environmental events occur the network impact is not always uniform. For example, strong winds are channelled or dispersed by geographic features and if the voltage of the network in near proximity is 22kV, then the faults are attributed to the 22kV network even though an 11kV network would also have failed had it been similarly exposed.

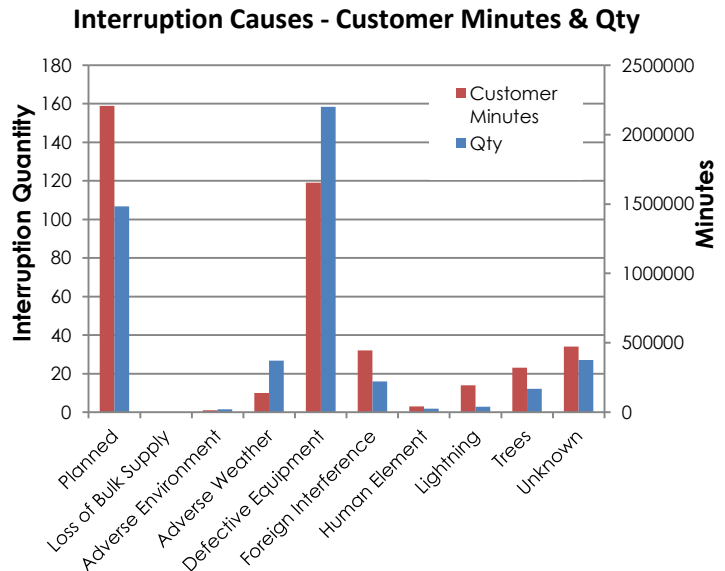

The contributions of the various categories of fault cause have shown that although planned faults are the highest individual category in terms of total quantity and duration, it is the next two highest categories of unplanned fault that are concerning. Defective Equipment and Foreign Interference suggest that there components in the network that are deficient. Examination of the individual faults in 2015-16 shows that some of the categorisation choices are struggling to separate cause and effect. For example, a transformer that fails during a lightning storm is not defective equipment – that is the result of it being struck by lightning.

During June 2015, Mid-Canterbury was subjected to a reasonable snow storm. Generally the network held up well, better than it has in the past and power was restored more quickly than would previously have been expected. There were however a large number of faults that originated on property that affected the network. Typically these are earth faults where the network protection is faster or more sensitive than the fuse supplying the customer. Investigation has revealed a large quantity of old, poor condition conductor on property, much of it #8 galvanised steel (fencing wire). In the coming financial year all customers with poor condition lines, especially #8 galvanised steel will be contacted with a view to getting these lines bought up to standard. Unfortunately, the current rural economic climate will not help this situation.

EA Networks has performed relatively poorly in CAIDI (restoration time - heavily influenced by planned outages) and SAIDI (directly related to CAIDI). Another factor that undoubtedly influences the relativity of EA Networks' restoration times is the strict adherence to the EEA publication "Guide for Reclosing of Feeder Circuit Breakers Following a Fault (October 2001)". This guideline has been updated to "Manual Re-Closing of High Voltage Circuits following a Fault (Guide) (2014)". EA Networks will examine this document closely and decide if, in balance, the new guide provides a more suitable approach to post-lockout circuit breaker closing. EA Networks are not in a position to comment on other companies' practices, but anecdotal observations would suggest that not all companies are quite as rigorous in their application of what EA Networks considers to be industry best practice (patrolling of lines following a recloser lockout).

Faults per 100km is better than average for subtransmission lines. Faults per 100km is too high for 11-22kV

lines. It is above the median for all companies and is trending up rather than down. The targets are approximately 50% of the values being achieved and it will take considerable effort to bring the actual performance down to the desired values.

## Service Levels

This is the area of performance measurement that directly affects the quality of service that consumers experience. [Section 2](#) of this plan "Levels of Service" addresses most aspects of performance and performance improvement as it relates to service levels.

### Targets

The service level targets have been detailed in [section 2.4](#).

### Outcome

See [section 2.4.1](#).

### Reasons for Variance

There are a range of reasons whereby performance may not be as per target. The significant ones are:

- On the 18th June 2015, Mid-Canterbury was subjected to a reasonable snow storm. While very little network equipment failed during the event, a significant number of network outages were caused by faults originating on privately owned lines. Typically these are earth faults where the network protection is faster or more sensitive than the fuse supplying the customer. Investigation has revealed a large quantity of old, poor condition conductor on property, much of it #8 galvanised steel (fencing wire).
- Adherence to "Patrol after auto-reclose lockout" philosophy. This can delay restoration considerably but ensures a much lower risk of liveness onto vehicle or other situation where it could place the public at risk.
- The reduced, but still high, levels of planned outages.
- A number of lightning, vehicle and perennial 'unknown' faults has contributed to the observed network performance.

There are the other perennial reasons such as trees and wildlife that always cause issues but they tend to be low frequency and sporadic.

### Plans to Address Variance

Addressing service level performance issues is an on-going process. There is no magic answer to solve all of the issues at once. EA Networks are concentrating on solving the obvious issues as they become apparent.

The replacement of faulty equipment prior to failure is a simple action to increase performance if the imminently faulty equipment can be reliably detected. More effort with diagnostic equipment is being made and this will continue for the foreseeable future.

More research is being done on the causes of faults. Distribution areas each have their own character whether it be trees, wildlife, mechanical interference, vehicle crashes etc.

The recent policy to encourage on-property underground distribution will, over time, lower the frequency and impact of on-property faults which are commonly cleared by a network circuit-breaker. The operation of a circuit-breaker affects large feeder segments or entire feeders instead of just the consumer causing the fault. A fault in an underground cable is rare and when it does happen will commonly be caused by mechanical interference which is generally reported by the person excavating allowing faster isolation and restoration of supply.

In the coming financial year all customers with poor condition lines, especially #8 galvanised steel, will be contacted with a view to getting these lines brought up to standard. Unfortunately, the current rural economic climate will not help this situation.

There are no plans to change the line patrol after auto-reclose lockout policy until the new EEA guide on

manual reclosing has been thoroughly examined.

The level of planned work is a fact of life. While new load appears it will require servicing. Live line techniques are not suitable for the scale of work required for large line rebuilds. In fact, with the drive from WorkSafe to stop live line working, the number of planned outages (mainly to connect new customers) will increase significantly.

Advances in SCADA operation and distribution automation will reduce the time taken to restore consumers after a fault. This will greatly assist in reducing SAIDI and CAIDI. EA Networks is currently in the design phase for a distribution automation pilot. It is planned to deploy this in the upcoming financial year.

It is apparent that relatively few faults can have a dramatic effect on EA Networks performance. For a smaller company (<20,000 ICPs) the relatively rare event of a typical urban feeder tripping once can have a dramatic effect on system SAIDI as the affected ICP count is a significant proportion of the total. Compare this with a large urban company (100,000+ ICPs) where a single urban feeder tripping is unlikely to impact on system SAIDI by a detectable amount. The only way to address this is by reducing the proportion of ICPs per protective zone so that a single fault affects fewer than say 2-3% of the total ICP count (in EA Networks case this would be 400-500 ICPs). For a large utility this could be 2,000 to 3,000 ICPs. EA Networks are planning to proceed down this path with more urban circuit breakers and feeders with fewer than 250 ICPs on each. In rural situations, the customer count is rarely high enough to affect SAIFI on a single fault but SAIDI can be adversely affected when faults take a long time to diagnose. The installation of many rural RMUs with fault detecting and interrupting capability will begin to address some of these issues as well.

## 9.2.2 Overall Reliability

The overall reliability for the 2025-16 year has shown a significant improvement with the only notable event to date being the June snow storm. At time of writing, the forecast default price path SAIDI and SAIFI are significantly better than target at 130/151 and 1.22/1.61 respectively.

A new tree control policy has been formulated and will be administered with rigour. The tree control policy is based upon the Electricity (Hazards from Trees) Regulations 2003 but has additional opportunities for the tree owner to allow EA Networks tree control standards to apply. If the tree owner chooses to allow EA Networks to apply their own tree proximity and trim standards (more rigorous than those in the 'Tree Regulations') then there is the possibility of significantly reduced cost of tree control to the tree owner. Together, it is hoped that these measures will reduce the impact of any future weather events and thereby prevent any future breach of the price-quality path thresholds.

The disturbing element of the statistics is the rate of fault occurrence on the 22kV distribution network. The trend is upwards and this needs to be reversed.

EA Networks' HV distribution network (particularly 22kV) has not performed as well as had been hoped during 2012-16. Targets have been exceeded. The performance of this particular voltage (22kV) appeared to be trending down to a satisfactory fault rate several years ago, however, since 2010-11 the fault rate has increased and is now over twice the target value. Many of these faults still appear to be equipment and tree related. The total faults/100km is above target by 100%. The target appears to be very ambitious. The per company industry average (not truly the industry average) is 9.58 faults per 100km for distribution lines and 4.76 faults per 100km for distribution cables. It is possible that the EA Networks target is unachievable in all but the most environmentally benign of years. The planned interruption rate is reducing as development work tails off. 22kV conversion work continues to have some planned outage impact and several of the coming years will feel the impact of 66kV line construction projects.

When planned outage frequency begins to drop, the system interruption duration will drop with it. As the 66kV subtransmission network is developed, some of the high impact faults seen historically will be reduced as circuit redundancy eliminates outages. As always, tree control is an ever-present problem that specific regulations and EA Networks own tree control policy now cover. It is anticipated that attending to tree control will continue to reduce fault frequency to some degree. Of more concern than fault frequency are duration measures such as restoration time. Full line patrolling after an auto-reclose lockout is something that EA Networks always undertakes. It is unknown whether this is the norm for all other similar companies. This has a significant impact on restoration time if no cause is found and the line is successfully restored, but it is industry best practice to do this.

A major boost to performance is expected with the SCADA system now fully operational and expanding

(but still with some devices needing connection). Comprehensive SCADA provides significant information and faster responses to interruptions, reducing the duration aspects of faults but probably not the frequency (although monitoring of protection relay reclosures and pickups may allow preventative maintenance actions).

The planned interruption rate is completely under EA Networks' control and it forms a large portion of the frequency and duration indices. It is unlikely that these will fall dramatically until the major line construction and voltage conversion projects are complete.

In summary, the overall performance of the network shows it is relatively fault resistant when compared with similar companies but fault response needs to be improved. There remains however, significant room available for improvement.

## 9.3 Service Improvement Initiatives

Having identified the level of performance that EA Networks are achieving and the level of performance and standards that stakeholders, consumers and EA Networks wish to achieve, this section details proposals that, where necessary, will drive improvements to the services EA Networks delivers to consumers. The solutions relate to different voltage levels and components within the EA Networks network. See [section 4.1](#) for a chart showing the different voltage levels and the interconnections between them.

As EA Networks move from a period of extremely high growth to one of modest growth, the maintenance regime at EA Networks will become much more focused on preventing failures rather than reacting to them or maintaining equipment at set time-based intervals. EA Networks look at any new diagnostic tests that become available and assess their usefulness for preventative maintenance. When it can be shown that the tests can reliably predict the condition of equipment and any incipient fault, it is used in a targeted fashion on the equipment that is most critical for security or other performance criteria such as safety.

All of the initiatives that have been identified for implementation are subject to economic analysis to ensure EA Networks are offering value for the increase in performance. The value can sometimes be difficult to quantify and if a business case cannot be made, the costs, pros and cons will all be presented to the Board to provide the sometimes intangible influence of consumers/shareholders wishes on the proposal.

### 9.3.1 Transpower Network

Transpower has identified that it has a need to increase the capacity of the national transmission network in order to maintain the level of security required of a national grid. Proposals have included a new 400kV line that takes electricity from the hydro schemes in the south of the South Island to the greater Christchurch area. Other, interim, less expensive steps have now been suggested and they appear to be the preferred option. All of these approaches will offer increased security to Transpower's Ashburton substation (Ashburton220) thereby improving both the security and quality of supply to EA Networks' consumers. Transpower have recently altered Ashburton220 to interconnect both circuits of the Twizel-Bromley-Islington double circuit 220kV line (previously only one of the circuits was deviated into Ashburton220). As well as assisting in relieving Transpower's grid constraints, this project has increased the security of Ashburton220's 220kV bus from n-1 to at least n-2 in relation to 220kV circuits.

The addition of a third 220/66kV transformer (T9) has permitted a reconfiguration of the Elgin 66kV bus which connects to Ashburton220. Protection system alterations have also been implemented that improve the performance of the EA Networks subtransmission network protection and allows more reliable and selective detection of faults. This assists in reducing the extent of future outages when particular types of fault occur.

The third 220/66kV transformer has provided a level of firm capacity that exceeds the present 66kV peak load. There are no projects planned to further increase the 66kV capacity at Ashburton220. In future, should load begin to exceed the level deemed suitable for supply from Ashburton220, a new geographically separate GXP will be developed to both increase GXP security and reduce the loading on the EA Networks 66kV network. A project has been included in 2025 to accommodate such a development [80004].

### 9.3.2 Subtransmission System

At least one part of the subtransmission network carries electricity to every consumer supplied by EA Networks. A consequence of this is that loss of any part of the subtransmission network is felt far more widely than the loss of an equivalent portion of the distribution voltage networks.

There are a range of initiatives that have been undertaken to improve the service levels obtained from the subtransmission network:

- new 66kV line design has been externally reviewed to ensure reliable conductor displacements under both normal and extreme conditions
- vibrations dampers have been fitted to subtransmission circuits - this lowers vibration related faults on the subtransmission network
- older lines have been inspected with a corona camera and have had subsequent inspections using ultrasonic equipment that detects cracked or faulty insulators as well as defective insulation on most equipment
- Infra-red cameras that detect thermal discrepancies are used on an annual basis to examine important lines for overloaded or potentially faulty joints and connections
- high performance protection equipment has been installed on the newer subtransmission circuits resulting in lower fault clearance times, increasing safety and decreasing the duration of voltage depressions

### 9.3.3 Zone Substations

A failure in a zone substation can be particularly difficult to deal with. A combination of sensible overall design and relatively modern asset specification can reduce the risk of failure considerably and therefore increase the level of service it provides. Specific initiatives undertaken in zone substations include:

- very careful monitoring of critical equipment using partial discharge tests, infra-red cameras , ultrasonic equipment and sophisticated oil analysis to provide details of internal transformer condition
- selection of equipment for new substations that is more immune to factors that have been the cause of historical failures
- configuration of new substations that makes them more tolerant of equipment failure - supply is not completely lost during or after a critical equipment failure.
- 66kV bus zone protection that reduces fault clearance times to a few cycles, dramatically reducing fault damage (although not preventing the fault) and localising the outage to the faulted equipment only.

There are a raft of other changes that have been implemented as a consequence of the major zone substation construction programme of the last 10 years. Suffice to say that they all assist in providing a higher level of service from the zone substation to the consumer.

It is noticeable that there are an increasing number of devices being connected to the network that are creating harmonic distortion of the supply. EA Networks have engaged in a more proactive stance on this and have installed real-time monitoring equipment at most zone substations.

### 9.3.4 22kV and 11kV Distribution System

The high voltage (HV) distribution network (22kV and 11kV) has the most geographically widespread lines in the entire EA Networks network. HV distribution also forms the highest percentage of total lines and switchgear. As a consequence, it features in the majority of faults affecting consumers.

#### Underground

The underground HV distribution network is generally meeting expected performance. Some condition monitoring is done on cables although it has not proven to be particularly good value because the low fault frequency requires monitoring a large proportion of the network to provide a proactive response. Generally, the few faults that do occur in the underground HV network are caused by either external

influences such as mechanical excavators (this is only preventable by extensive education), or faulty joints and terminations which are always being re-evaluated based upon performance.

Future developments are planned to include a new core 11kV cable network programme for Ashburton township. This will decrease the average number of ICPs per feeder to lower levels. This will mean a lower impact for any given cable fault since fewer consumers will be affected. The same network will also allow much more substantial and faster load transfer between Ashburton and Northtown substations during both planned and unplanned outages. This should make planned outages of urban Ashburton ICPs very rare and unplanned outages very short. The first project in this programme is for two Tinwald network centres [11076].

## Overhead

The overhead HV distribution network is much more prone to external influences and the majority of overhead line faults affecting consumers occur on the overhead HV distribution network. There are a number of improvement initiatives that have already been undertaken:

- urban underground conversion programme
- rural underground conversion where it is deemed to be prudent and sufficiently advantageous
- thermal imaging analysis of major distribution feeders to detect faulty connections or overloaded components
- an on-going tree control programme that is now backed up by additional measures for tree owners who wish to take advantage of them
- replacement of parallel groove connectors with higher reliability wedge connectors
- repositioning displaced line reclosers to increase network segregation
- the routine use of more reliable and remote controllable gas switches instead of air-break switches
- the installation of rural ring-main units to increase switching reliability and safety while providing the opportunity for ring-main unit circuit-breaker fault clearance and single-shot auto-reclose as well as remote control.
- vibration dampers are being fitted to underbuilt HV distribution on long spans to decrease vibration damage
- additional surge arrestors have been fitted at locations where existing equipment provides the relatively high cost of an earthing system (e.g. SF<sub>6</sub> load-break switches)
- universal application of possum guards to poles with high voltage attached to them
- 11kV glass tube fuses are progressively being replaced with expulsion drop-out types
- additional interconnections between feeders to provide alternative supplies
- 11kV to 22kV conversion increases capacity significantly and permits back-feeding which lowers both planned outages and unplanned outage length
- progressive conversion of the urban overhead HV distribution lines to underground cable causes dramatic reductions in fault frequency
- neutral earthing resistors reduce the thermal stress on wires and connectors during earth faults as well as dramatically reducing the fault voltage depression seen by consumers
- more rigorous actions in relation to non-compliant privately owned HV lines
- elimination of unfused overhead extensions onto private property
- thermal infrared camera inspection of lines and accessories to detect abnormal heating
- the requirement that all new network connections (both LV and HV) shall be via underground cable and encouragement to have all on-property reticulation underground

There is still the need to further improve the performance of the overhead HV distribution network and there are three main possibilities for achieving this.

(1) Reduce Fault Frequency (SAIFI reduction)

This is possibly the most difficult of the three methods to increase performance. There will always be people driving cars that crash into poles, irrigators that either push wires together or directly hit the wires, birds that perch on insulators, etc. Fault immunity can be increased by these initiatives that EA Networks are initiating or contemplating:

- use of covered conductor in specific areas prone to conductor contact by trees or machinery (not being actively pursued);
- use of insulator shrouds and conductor insulation in areas prone to wildlife interference (being used for specific equipment);
- use of pole-mounted fully-enclosed load-break switchgear in place of air insulated disconnectors - reducing the frequency of equipment malfunction;
- possible provision of an on-property service line maintenance service contract that would ensure lines that are presently privately owned and are on private property do not cause preventable outages on the EA Networks network;
- review of recent severe weather events has identified certain types of conductor, poles and fittings that feature in a high proportion of faults. These assets are targeted for replacement as the opportunity arises;
- even stricter enforcement of tree control to prevent (a) earth faults caused by trees touching the line, (b) bark and branches blowing onto the line, and (c) trees falling and mechanically damaging the line. This has been implemented.

(2) Reduce Extent of Fault Impact (CAIDI/SAIDI reduction)

Another possible performance improvement is to reduce the number of consumers affected by a fault. This can be either fewer consumers with the power off, or fewer consumers seeing the consequences of the fault. A number of initiatives are under consideration or have been implemented:

- application of neutral earthing resistors in an urban cable network to reduce the thermal stress on wires and connectors during earth faults as well as dramatically reducing the fault voltage depression seen by consumers (widespread implementation);
- increase the total number of HV distribution feeders thereby reducing the number of consumers served by each feeder (planned for urban Ashburton);
- continue to install additional line reclosers increasing the network segmentation (rural RMUs are displacing/supplementing reclosers);
- implement a degree of distribution automation that would rearrange the network, automatically restoring supply to some consumers within 60 seconds (trial scheme initiated in 2015-16).

(3) Reduce Duration of Fault Impact (CAIDI reduction)

If the fault is inevitable (some are) and the number of consumers affected cannot be economically reduced, the last option is to restore supply to as many consumers as possible, as quickly as possible. This is one area where modern technology can have a considerable impact. The initiatives under action or consideration are:

- more remote control of line reclosers, disconnectors, gas switches and ring-main units (actively being implemented);
- increase the sophistication of protection systems to limit the duration of fault voltage depressions (actively implemented at 66kV, less so at distribution level);
- permanently install distributed power quality monitoring equipment at consumers' properties to report not only fault information but also other power quality statistics (some aspects of this have arisen through the fibre optic network which also supplies on/off information via the consumer connected modem);



- equip field staff with devices that assist in locating faults and provide real-time operational information to allow fully informed decisions (project planned for 2017-18 [99030]);
- possible use of a large (300kVA) generator and step-up transformer to provide an alternative supply during all types of interruption (still being considered).

## Switchgear

The majority of switchgear has proven to be trouble-free provided the manufacturer's recommended maintenance is performed. There are however some particular items of plant that are sub-standard and the only remedy short of major modification is to replace the item. Things that have been done to improve performance or are proposed to be done include:

- replace switchgear where there is a known risk to safety and/or equipment integrity;
- use of equipment with better cable termination integrity, lowering the burden on jointers to use materials that are prone to environmental influences;
- regular inspection of ground-mounted switchgear using partial discharge detection equipment;
- use of equipment that is designed to be fundamentally safer, more durable and more reliable;
- increased use of remote control to minimise exposure of personnel to switching equipment;
- fault indicators are being applied in more locations to reduce restoration times;
- adopting the routine and extensive use of fully-enclosed SF<sub>6</sub> gas load-break switches which are both more reliable, more capable (400 amp load breaking) and safer than open contact style switches for both new and many existing sites.

## Transformers

Distribution transformers have proven to be a very reliable asset category. Failures are typically caused by wildlife, lightning or overloading, with equipment failure coming much further down the list. Since distribution transformers are very reliable, little additional effort can be justified in further increasing performance. The main initiative that has been implemented is a universal system spare 1,000kVA distribution transformer. This unit is self-contained with HV and LV cables and can operate at either 22kV or 11kV. It has been put to good use on a number of occasions already during transformer faults that would have been difficult to deal with otherwise.

Although not particularly increasing the reliability of the transformer, EA Networks has adopted the use of in-tank high voltage fuses for all new transformers intended for ground mounting (this typically encompasses all transformers larger than 100 kVA and 'microsub' style units used when the choice is made to mount smaller units on the ground. These fuses are intended solely as fault protection for the transformer internals and equipment directly connected to the low voltage bushings. By putting these fuses in the transformer now it prepares them for inclusion in any future underground reticulation network that may not allow for costly ring main units at each transformer site. It also overcomes the problem of adequately protecting a large and small transformer (such as occurs on many farms) on the same piece of underground cable. Previously, the fusing for a large and a small transformer was done collectively at the start of the underground cable and this was not entirely satisfactory.

One of the intentions of the policy of ground-mounting any new transformer above 100 kVA is to promote a more reliable mounting arrangement for each transformer. During extreme events such as snow storms, wind storms and major earthquakes a ground-mounted transformer is much more secure than the equivalent pole mounted unit.

### 9.3.5 LV Distribution System

The low voltage (LV) distribution network (400 volts) is typically quite reliable and any faults that occur affect relatively few consumers (security standards dictate no more than 25 initially and no more than 15 during the repair). There have been several improvement initiatives that have provided worthwhile increases in performance:

- conversion of overhead LV lines to underground cable has provided increased reliability, capacity and quality (better voltage regulation and fewer fault voltage depressions)

- replacement of old open contact LV fuses and links with modern high capacity switchgear has improved the reliability, configurability and safety of kiosk substations, roadside switching boxes and consumer service fuses
- when overhead lines are installed or replaced, pvc covered LV wires are now universally used and prevent problems with wires clashing and reduce safety concerns

### 9.3.6 SCADA, Communications and Control

The SCADA system at EA Networks has been evolving for some time. It is now in a position to provide a significant improvement in network performance with the widespread ability to control switchgear and other power system devices as well as retrieve information that assists in diagnosing both faults and power quality issues.

Now that the system is almost fully functional and expanding, the opportunity exists to have the SCADA system extend into automation of some network activities. This will permit faster restoration and allow staff to concentrate on repair of the fault rather than switching of the network.

Having stated in older plans that the ripple control system had proven to have high availability, the electronic portion of one of these plants failed during 2005 and then another failed during 2011. Certain electronic components are no longer available and in some cases the service contractor cannot repair failed equipment. Unfortunately, this was the case with both plants that failed. A decision was made to repair one of the failed plants using parts of the standby plant. The 2005 failed equipment has been replaced with a brand new item sized to suit future application at 66kV. This has returned the injection plant count to three and will ensure no on-going loss of load control for a fault in one plant.

The issue of high harmonic distortion and the potential for the required mitigation measures to degrade the signal of the ripple system are being researched. It is possible that the outcome may require a significant rethink of the load control signalling system to ensure it remains reliable.

There are two projects in the plan to replace the present ripple system [1 1067] and [00493]. The first one is a commitment to introduce a new 66kV ripple injector in 2017.

### 9.3.7 Protection Systems

Any electrical protection component is by design a high reliability item. The configuration of individual components of protective plant can have a considerable influence on the performance of the protection system as a whole. Protection maloperation is rare but it does happen and, depending on the back-up component available, can lead to a more widespread outage.

Protection relays ("relay" is a term for the control box that senses faults and switches the circuit-breaker off) are becoming much more sophisticated than they have been. Most modern protection relays are based on microprocessor technology which permits not only advanced decision making but also direct digital communication with other devices such as PC's and of course SCADA systems.

EA Networks have utilised many of these modern protection relays, and while there have been some teething issues created by the installation methods, they have proven valuable in providing all manner of loading information as well as post-fault analysis. There is a lot of scope in the application of advanced protection relays for improved network performance. This is not only in the way the relay controls the circuit-breakers but also the information they provide to staff for future engineering decisions.

Live-line work is now a routine part of network construction and maintenance techniques. Modern protection relays have the capability of being programmed to disable automatic reclosing either locally or remotely (via SCADA) and, if so desired, change the protection settings for live-line working so that a trip operation is extremely fast compared to normal operation. This does not lower the risk of an incident occurring, but it can make the consequences much more tolerable.

The main initiative will be to keep abreast of developments in the protection field so that maximum benefit can be obtained from worthwhile technology.

Some of the early electronic relays are now beginning to show sign of age-related degradation. The oldest relays are being progressively replaced either as issues become apparent during testing or simply based on the age of the unit, its criticality, the spares held and its repairability. Project [10961] is an example of this approach. Fortunately, the conversion of the subtransmission network to 66kV has made

the vast majority of aged protection relays redundant.

## 9.4 Asset Management Maturity Evaluation

There has been insufficient time and resource available to attend to a rigorous and formal evaluation of asset management processes and systems at EA Networks.

Appendix G contains EA Networks disclosed AMMAT response.

## 9.5 Gap Analysis

The service level performance gap analysis has been partly addressed in [section 9.3](#) with a range of initiatives targeting systemic baseline performance characteristics.

EA Networks have not been able to complete a comprehensive AMMAT gap analysis. Rather than present a hastily prepared commentary on the range of issues requiring attention it has been decided to leave this section without substantive content. Suffice to say that there are a range of AMMAT topics that will require attention and as internal resources permit they will be developed, documented and addressed. Some of the latent issues that have existed for some time are documented in [section 9.6](#) below.

Future plans will contain a more rigorous AMMAT discussion and analysis of gaps that exist and the areas that EA Networks consider worthy of on-going attention – offering value for money.

## 9.6 Asset Management Improvement Initiatives

There are a raft of processes and systems that need significant improvement to become equivalent to the level of excellence that are considered industry's best practice. To attempt to improve all of these elements in the short term would be folly. There are some key processes and systems that need immediate attention, while others represent a high benefit/cost ratio and should be advanced on simple economic grounds.

The following items represent elements of EA Networks' Asset Management that are to be targeted as essential for improvement during the short term (3 years).

### SCADA – Control and Data Gathering

The SCADA system is fully functional at almost all of the newer zone substation sites. Distribution system sites are being connected as communications paths become available. The DMR system will be able to boost the numbers of distribution sites dramatically with the addition of a small radio/RTU device that can be used wherever voice coverage is available.

A big part of a successful SCADA implementation is obtaining reliable data communication to all zone substations. A separate fibre-optic communications infrastructure has been developed as a potentially commercial enterprise and all 66kV zone substations are connected plus other field equipment is being progressively connected. This platform provides a very secure and reliable network.

Once fully operational at all controllable sites, the SCADA system will provide: full remote control (a means to reduce restoration times), remote fault diagnosis, gathering of equipment loading in real time, gathering of condition-related data in real time, gathering of power quality data in real time, and temporal trending of a range of power system parameters.

### Risk Management

Although a considerable amount of time and effort has gone into the risk assessment process there are still very few contingency plans to assist staff in the event of that risk affecting particular items of equipment or classes of equipment. Some risks may be treated by engineering responses to reduce exposure to the risk instead of attempting to reduce its consequences after the event through contingency planning.

The target of EA Networks' risk management is to follow through on high risk items already identified and

create documentation to manage the outcome of that risk. This work should have been completed by now but continuing pressure on resources has seen this delayed. At the earliest opportunity and when resources permit this work will be progressed.

### **Spatial Information and Network Modelling**

The spatial data storage application EA Networks are presently using (Power-View) is no longer supported by the vendor. The same application maintains the electrical model of the network which facilitates intelligent tracing of faults and analysis of the network. It is imperative that EA Networks do not fall behind in this arena as the company relies on spatial information in many critical processes. There is no suggestion that Power-View is incapable of accurately maintaining the data currently being stored, but with no development occurring there are opportunities for utilising the data that EA Networks cannot take advantage of.

EA Networks have purchased the Hexagon G/Technology GIS system to capture and model the EA Networks fibre-optic network. This modelling work is nearly complete, conversion of Power-View electrical network data into the Intergraph system has been trialled. The work is almost complete and it is anticipated that the electrical system will go live in April 2016.

The Hexagon G/Technology system will offer a stable and robust platform from which integration with other asset-related systems would increase and much more creative use could be made of the electrical model and other valuable stored data.

### **Levels of Service**

Having set in place a number of security standards that are supposed to target improvements in the levels of service, additional effort is required to determine the degree of compliance with these standards. All new projects are designed to offer the prospect of improved compliance with the standards but may require an evolution to achieve 100% conformity.

The ability to efficiently analyse compliance with the security standards has been hindered by the lack of data available from several systems (SCADA, consumer loading data, GIS tracing ease/performance). These will largely be resolved within 12-18 months.

The target for this aspect of asset management is to identify the non-compliant sections of the EA Networks network and rank them according to priority. Previous targets were not met. With the assistance of new engineering staff members and new software tools, it is intended to complete this task in 2016.

## **9.7 Capability to Deliver**

This plan has been published annually for more than 15 years and has been instrumental in guiding the development and lifecycle management of the EA Networks electricity assets. There have been a number of years when the annual goals have not been met but, overall, the strategies outlined around the year 2000 have succeeded or are steadily progressing towards the desired level of performance. The plan performance targets have been in many cases based upon the best aspects of historical performance. This ensures they are achievable, but ambitious.

The ability of EA Networks to achieve the plan objectives is tested annually, not only by the Board, but also the Shareholders' Committee who provide a commentary on the performance of the company in the Annual Report.

At the management level, the expectation is that any planned project is identified as early as possible and included in the Asset Management Plan project database to give an estimate of the project duration and timing, financial resources, design resources and construction resources required to achieve the goal. Three monthly, this database is interrogated to ensure that the cost and design/construction resourcing are within the means of EA Networks and its contractors for any given period. Additionally, analysis of the long-term benefits of the individual projects and programmes must be sufficient (either individually or collectively) to justify their inclusion in any future plan.

In recent years, EA Networks has grown and additional staff have been employed to bolster the technical and business capabilities. This growth has increased the rigour of a number of the internal processes including those on investment and project commercial viability.

Although some projects are still ultimately considered at Board level using the ethos of a cooperative company structure, the knowledge of underlying commercial considerations will always be relevant.

The EA Networks business structure has shown itself to be remarkably stable over time. This stability existed during a period in its history which will be remembered as when asset development was at the highest ever level. The fact that significant network level decisions made more than 15 years ago have been successfully implemented demonstrate that the business structure and processes are sufficient to support the continued implementation of the plan. During this period all consumers irrespective of size were connected without unreasonable delay.

As the development workload decreases, it will permit more time to be spent refining the lifecycle management structures and systems as well as developing the formal documentation of many processes and systems that are currently understood and adhered to while not being contained within a 'controlled document'.



# APPENDICES

<b>Table of Contents</b>	<b>Page</b>
10.1 Appendix A - Definitions	297
10.2 Appendix B - Asset Management Plan Cash-flow Schedule	305
10.3 Appendix C - Forecast Load Growth	310
10.4 Appendix D - Disclosure Cross-References	317
10.5 Appendix E – Large Consumer Dialogue Questionnaire	322
10.6 Appendix F – Customer Engagement Statement	327
10.7 Appendix G – Disclosure Schedules	330





## 10 APPENDICES

### 10.1 Appendix A - Definitions

The Electricity Distribution Information Disclosure Determination 2012 contains an extensive range of definitions covering a range of activities, assets, and associated terms. In future plans it is intended to make every effort to synchronise the terms in use in the plan (and here in the definitions) with those used by the Disclosure Determination. Unfortunately, there has been insufficient time available to change the structure of this plan to reflect the Disclosure Determination preferred terms.

EA Networks do have philosophical issues with some of the Disclosure Determination asset definitions, seemingly having more to do with financial asset definition than physical populations of like assets which are managed in common using the same methodology.

#### **Maintenance Activity Definitions**

##### ***Inspection, Service and Testing***

###### Routine

This is expenditure on patrols, inspections, servicing and testing of assets on a routine basis. Typically, these activities are conducted at periodic intervals defined for each asset or type of asset. This work does not involve any repairs other than some minor component replacements in the course of servicing.

###### Special Inspection, Service and Testing

Expenditure on patrols, inspections, servicing and testing which are based on a specific need, as opposed to being time based as with periodic inspections and servicing.

###### Faults

Repairs undertaken during fault conditions to restore supply. This does not include the eventual repair of a faulted asset, where it is taken out of service in the course of repairing the fault; only the expenditure required restoring supply is included.

##### ***Planned repairs and refurbishment***

Repairs to and refurbishment of an asset which may involve component replacement but not the complete replacement of the asset. This includes corrective repairs of defects identified within a year, "special" repairs (e.g. based on an identified type failure or type weakness) and planned refurbishment's that may involve a significant proportion of component replacement. However to identify refurbishment's as distinct from general repairs would require identification of all specific refurbishment projects over the planning period and this has not proved feasible for this plan.

##### ***Planned replacement***

Replacement of an existing asset with a modern equivalent asset providing similar capacity or other aspect of service provided. Note that the asset need not be identical in capacity etc, but should be materially similar.

##### ***Maintenance contingency***

An explicit planning contingency, where it is not feasible to identify all minor work, or where it is expected that work will arise but its classification cannot be easily predicted. All contingencies are specifically identified and no implicit contingencies are included in the detailed expenditure projections for other activity classifications.

This contingency is converted into one of the above activity classifications once committed. Therefore "Maintenance Contingency" is not a real activity for reporting purposes.

## **Enhancement and Development Activity Definitions**

### ***Enhancement***

This is the replacement of an existing asset with a modern equivalent asset, which is materially improved on the original asset, or modifications to an existing asset, which have this effect. Specifically, this will include improvements to the existing asset configuration, which are undertaken with the purpose of:

- Further improving the inherent safety of the system (e.g. installing smoke/heat detectors and entry alarms in substations)
- Improving the level of consumer service (e.g. increasing capacity by replacing a transformer with a larger unit, or adding an extra circuit to it to increase security)
- Improving economic efficiency or investing to improve the asset by reducing operating or maintenance costs (e.g. fitting vibration dampers to specific lines to reduce the rate of component deterioration)
- Improving environmental risk management (e.g. fitting oil containment facilities at substations)
- Improvement to corporate profile (e.g. landscaping station grounds, although this is also fully justifiable on the basis of reduced grounds maintenance)

Note that each aspect of improvement is related to a specific asset management performance driver.

### ***Development***

This is work, which involves installation of new assets in sites or configurations where none previously existed. This may also include substantial upgrade work (e.g. re-building a substation at a higher voltage) in which the original configuration is significantly altered or extended.

### ***Development contingency***

An explicit planning contingency, where it is not feasible to identify all minor work, or where it is expected that work will arise but its classification cannot be easily predicted. No implicit contingencies are included in the detailed enhancement and development expenditure projections. For the same reasons as those discussed under "Maintenance Contingency", this activity is not included in financial reports.

## **Other Activity Definitions**

### ***Operating***

Any disconnection of consumer's services for any reason except non-payment of electricity accounts. This includes activities such as house painting, transportation of high loads and low voltage switching. It also includes operation of the high voltage network where this is not directly associated with maintenance or enhancement work.

### ***Trees***

This activity covers all tree cutting and trimming to maintain safe working clearances from power lines and any costs incurred during negotiations with consumers regarding tree trimming.

## **Planning Period Definitions**

### ***Plan(ning) Period***

In this plan the term is used to describe the interval that the plan is attempting to predict with a tolerable degree of certainty. Beyond the end of this interval there are too many unknown factors that will influence contemporary engineering decisions to allow reasoned assessment. The solutions that are proposed in this plan will have lifetimes considerably in excess of the planning period but may not provide the specified level of service beyond the planning horizon without enhancement.

During periods of high load growth, such as being experienced by EA Networks, the accuracy (and therefore risk) of looking too far ahead can be unacceptably poor. EA Networks have chosen to keep the load forecasting horizon coincident with the end of the planning period for the moment. Projects that are initiated during the planning period are designed with future expansion capability in mind in an attempt to provide options for accommodating unknown future load/security requirements.

### ***Plan(ning) Horizon***

The end of the planning period.

## **Asset Type Definitions**

### ***High Voltage Lines and Cables (Subtransmission and Distribution)***

Includes all power distribution and subtransmission lines with a rated voltage of 11kV or higher. Within the plan, lines may be further disaggregated into major components, being:

- Poles
- Conductors and accessories
- Insulators and hardware
- Down and aerial guys
- Underground cables
- Terminations
- Joints
- Ducting
- Land or easements

### ***Low Voltage Lines and Cables***

Includes all low voltage lines with a rated voltage of 400V or lower up to the consumer's service fuse. As for high voltage lines, lines may be further disaggregated into major components, being:

- Poles
- Conductors and accessories
- Insulators and hardware
- Underground cables
- Distribution, link or pillar boxes
- Terminations
- Joints
- Ducting
- Land or easements

### ***Service Lines (High Voltage and Low Voltage)***

Includes all service lines on road reserve from the consumer's service fuse to the point at which it crosses the consumer's boundary. This includes:

- Lines and cables
- Fuse arms

- Service fuses
- Service lines on road reserve

### **Zone Substations**

This includes substation facilities such as land and buildings and the power transformers within them that are connected to the subtransmission network. Individual items of equipment such as disconnectors, circuit-breakers and bus-work are covered in other asset type definitions, which are generic for the whole network. For example, no distinction is made between a disconnector in a substation and one on a distribution line.

- Power transformers
- Foundations
- Oil interception equipment
- Land or easements
- Buildings and fencing
- Other station equipment such as batteries, chargers, NER's etc

### **Distribution Substations**

All distribution and regulator substation equipment including:

- Kiosk covers
- Foundations
- Connection cables LV and HV
- Land or easements
- Accessories - heaters, instruments, CT's etc

High voltage and low voltage switchgear located in distribution substations are covered in separate asset definitions.

### **Distribution Transformers**

All distribution transformers from 5kVA to 1,000kVA 11kV and 22kV primary voltage, including regulators or autotransformers up to 5,000kVA:

- Ground-mounted transformers
- Pole-mounted transformers
- 11kV or 22kV Regulators and Autotransformers

### **High Voltage Switchgear**

All high voltage switchgear, busbars and other items of equipment, both on lines and within substations, including:

- Circuit-breakers
- Reclosers
- Sectionalisers
- Disconnectors
- Ring-main units

- Expulsion drop-out fuses
- Structures and bus-work
- Instrument transformers
- HV Capacitors

### **Low Voltage Switchgear**

All low voltage switchgear and busbars installed in distribution substations, distribution boxes, link boxes or pillar boxes, including:

- Load-break switches
- Fuse Switches
- Fuses
- Support frames
- Busbars
- LV Capacitors

### **Protection Systems**

There are two main protective systems applied to the electrical network. These are:

**(a)** the systems that detect when a piece of electrical equipment has become faulty or has been damaged so as to make it unsafe or at risk of further damage.

The electrical fault protection system is comprised of many components that include:

- Electromechanical "disk" protection relays.
- Electronic relays.
- Metering/Datalogging devices.
- Interconnecting cables.
- Panels for mounting.
- Control switches and control devices.

**(b)** the systems that prevent excessive voltages from damaging network equipment.

The over-voltage protection that is applied to protect the EA Networks network is limited to the following components:

- Metal Oxide Varistor (MOV) surge arrestors
- Spark-gap devices mounted on some transformers

### **Earthing Systems**

All earthing systems connected to EA Networks equipment. The componentry required to construct earthing systems is relatively simple and includes:

- Driven earth rods from 10 mm diameter to 40 mm diameter, copper and steel.
- Buried copper conductor
- Insulated copper conductor
- Crimped, welded and clamped joints

### **SCADA, Communications and Control**

Includes SCADA Master Station(s) and Remote Terminal Units at individual sites. Communication equipment comprises specific communications sites, associated equipment and facilities and radio communications equipment installed in vehicles, at substations and other bases. Radio aerial support structures are included in this category.

#### **Ripple Control**

Ripple Injection Plants installed at Zone Substations or Grid Exit Points. This definition also includes the load control software included in the SCADA Master Station. The physical injection plant consists of solid-state components. These complex plants comprise capacitors, inductors, transformers, generators and controllers.

### **Performance Indicator Definitions**

There are a range of parameters that can be derived from raw reliability statistics to indicate the level of performance of a particular network or portion of network. In order to reliably compare these "performance indicators" between networks, the specific method of calculation needs to be defined. The majority of these parameters are as defined in the "Electricity Information Disclosure Requirements 2004" but they are reproduced here for completeness.

#### **Consumer Service Indicators**

Interruption:	in relation to the supply of electricity to an electricity consumer by means of a prescribed voltage electric line, means the cessation of supply of electricity to that electricity consumer for a period of 1 minute or longer, other than by reason of disconnection of that electricity consumer for breach of the contract under which the electricity is supplied. For the purposes of this plan "interruption" does not include events originating in the Transpower network.
Planned Interruption:	means any interruption in respect of which not less than 24 hours' notice was given, either to the public or to all electricity consumers affected by the interruption.
Unplanned Interruption:	means any interruption in respect of which less than 24 hours' notice, or no notice, was given, either to the public or to all electricity consumers affected by the interruption.
Interruption Duration:	means the time from the cessation of supply of electricity until the supply of electricity is restored.
Interruption Duration Factor:	in relation to an interruption, means the sum obtained by calculating, for each electricity consumer that is affected by that interruption, the duration (in minutes) of that interruption and adding together the results of each calculation.
SAIDI:	means the system average interruption duration index.  The sum obtained by adding together the Interruption Duration Factor for the interruption(s) of interest, divided by the total number of consumers served by EA Networks.  For the purposes of this plan, faults originating on the Transpower network are not included in this index.

SAIFI:	<p>means the system average interruption frequency index.</p> <p>The sum obtained by adding together the number of electricity consumers affected by the interruption(s) of interest, divided by the total number of consumers served by EA Networks.</p> <p>For the purposes of this plan, faults originating on the Transpower network are not included in this index.</p>
CAIDI:	<p>means the electricity consumer average interruption duration index.</p> <p>Is the sum obtained by adding together the interruption duration factors for the interruptions of interest, divided by the sum obtained by adding together the number of electricity consumers affected by each of those interruptions.</p> <p>For the purposes of this plan, faults originating on the Transpower network are not included in this index.</p>
Consumer:	<p>an individual or organisation beyond a network connection point, to which electricity is conveyed by means of works owned, provided, maintained and/or operated by EA Networks.</p>
Network Connection Point:	<p>means a point where a supply of electricity may flow between EA Networks' electric lines and the electrical installation of a consumer or consumers, as the case may be, but excluding points where there is no meter at that point or downstream from that point.</p>
Urban:	<p>means a zone or geographic area that is predominantly used for relatively high density housing and business use.</p>
Rural:	<p>means a zone or geographic area that is predominantly used for farming, forestry, recreation and cannot be construed as a city or township, but is accessible by more than one major arterial road.</p>
Remote:	<p>means a zone or geographic area that is distant from the general location of the rural population. Typically served by only one minor road and subject to disruption of vehicular access during adverse weather.</p>
Prescribed Voltage Electric Line:	<p>means an electric line that is capable of conveying electricity at a voltage equal to or greater than 3.3 kilovolts.</p>

### **Asset Performance Indicators**

Fault:	<p>means any unplanned event that causes any prescribed voltage electric line to cease to convey electricity for a period of more than 1 minute, regardless of whether or not an interruption occurs; but does not include any event that originates in a transformer or a capacitor.</p>
Faults	<p>means the number of faults per 100 circuit kilometres of prescribed</p>

- per 100km: voltage electric line (can be broken down into per nominal line voltages).
- System Length: means the total circuit length (in kilometres) of the electric lines that form part of the EA Networks system.
- System: means all works owned, provided, maintained, or operated by EA Networks that are used or intended to be used for the conveyance or supply of electricity.



## **10.2 Appendix B - Asset Management Plan Cash-flow Schedule**

This appendix contains the network capital cash-flow schedule which includes all capital items from the electricity network portion of the current EA Networks 2016-17 budget, the capital projects and programmes and baseline unscheduled capital expenditure currently identified as being necessary in the financial years 2018-26.

For legibility it is recommended that the following three pages are printed at A3.

CAPITAL CASHFLOW		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
11172	Consumer Connection - Other (inc Large Subdivisions)	163	161	158	155	152	152	152	152	152	152
11136	Consumer Connection - Rural Capacity Alteration	280	276	270	266	260	260	260	260	260	260
11136	Consumer Connection - Rural LV	85	84	82	81	79	79	79	79	79	79
11136	Consumer Connection - Rural Safety Alteration	195	192	188	185	181	181	181	181	181	181
11136	Consumer Connection - Rural Transformer	1,044	1,033	1,009	991	972	972	972	972	972	972
11058	Consumer Connection - Urban Capacity Alteration	10	10	10	9	9	9	9	9	9	9
11058	Consumer Connection - Urban LV	91	89	88	86	84	84	84	84	84	84
11058	Consumer Connection - Urban Safety Alteration	7	6	6	6	6	6	6	6	6	6
11058	Consumer Connection - Urban Transformer	79	78	76	75	73	73	73	73	73	73
11069	DTX - System Growth	976	1,326	864	11	1,502	906	1,113	1,113	1,113	1,113
11097	DTX - Reliability, Safety & Environment	431	11	11	1,042	11	11	11	11	11	11
11135	DTX - Renewal & Replacement	108	26	26	27	26	27	26	27	27	26
11140	DTX - Consumer Connection (Other)	137	135	132	130	127	127	127	127	127	127
11138	DTX - Consumer Connection (Rural Capacity)	54	53	52	51	50	50	50	50	50	50
11138	DTX - Consumer Connection (Rural LV)	16	16	15	15	15	15	15	15	15	15
11138	DTX - Consumer Connection (Rural Safety)	67	66	65	63	62	62	62	62	62	62
11138	DTX - Consumer Connection (Rural TX)	625	616	603	593	581	581	581	581	581	581
11137	DTX - Consumer Connection (Urban Capacity)	8	8	8	8	8	8	8	8	8	8
11137	DTX - Consumer Connection (Urban LV)	14	14	14	14	13	13	13	13	13	13
11137	DTX - Consumer Connection (Urban Safety)										
11137	DTX - Consumer Connection (Urban TX)	114	112	110	108	106	106	106	106	106	106
01030	Non-Network - Routine Vehicles	120	180	180	180	180	180	180	180	180	180
01031	Non-Network - Routine Building Work		50	50	50	50	50	50	50	50	50
01031	Non-Network - Routine Plant	10	10	10	10	10	10	10	10	10	10
01032	Non-Network - Routine Info Tech	10	100	100	100	100	100	100	100	100	100
01033	Non-Network - Atypical Info Tech		500	500	500	500	500	500	500	500	500
11059	Unscheduled System Growth		55	55	55	55	55	55	55	55	55
11078	Unscheduled Quality of Supply		53	53	53	53	53	53	53	53	53
11079	Unscheduled Other Reliability, Safety and Environment		54	54	54	54	54	54	54	54	54
11105	Unscheduled Asset Replacement and Renewal		1,509	1,508	1,512	1,512	1,512	1,512	1,512	1,512	1,512
	<b>SUBTOTAL ANNUAL</b>	<b>4,644</b>	<b>6,823</b>	<b>6,297</b>	<b>6,430</b>	<b>6,831</b>	<b>6,236</b>	<b>6,442</b>	<b>6,443</b>	<b>6,443</b>	<b>6,442</b>
11076	11kV Network Centres - Tinwald	418									
10940	11kV OH Rebuild - Springfield Road West	100									
11081	11kV UG New - Mt Somers Back-feed	132									
11061	11kV UG New - Tarbottons Rd 300mm <sup>2</sup> Cable Alterations	121									
11073	22kV Conversion - Hollands Rd, Tinwald Westerfield Mayfield Rd	66									
11104	22kV Conversion - Lake Hood	61									
11072	22kV Conversion - Maronan Rd, Tinwald to 66kV crossing	108									
11071	22kV Conversion - Mitcham Rd, Hepburns Rd	168									
10912	22kV Conversion - Greenstreet Completion	27									
11064	22kV OH New - Fairfield Rd underbuild	49									
11085	22kV OH New - Gibsons & Smalls Rd - Underbuild	99									
11084	22kV OH New - Hepburns Rd	62									
11087	22kV OH New - Maronan Road Fill-in	54									
10679	22kV OH New - Rawles Crossing Road - Timaru Track, Section 3	42									
11088	22kV OH New - Winslow Westerfield Rd O/H Fill-in	187									
11131	22kV OH Rebuild - Arundel Rakaia Gorge Road	90									
11125	22kV OH Rebuild - Ashburton Staveley Road Section 2	142									
11129	22kV OH Rebuild - Ashburton Staveley Road Section 1	38									
11122	22kV OH Rebuild - Barnswood Rd to Boltons Rd	33									
11126	22kV OH Rebuild - Chertsey Road	63									
11123	22kV OH Rebuild - Dobsons Ferry Road	95									
11130	22kV OH Rebuild - Gardiners Road	61									
11124	22kV OH Rebuild - Maronan Rd Rebuild (Lills Rd West)	77									
11121	22kV OH Rebuild - Mitcham Rd	196									
11120	22kV OH Rebuild - New Park Road	41									
11132	22kV OH Rebuild - Old Main South Road	180									
11133	22kV OH Rebuild - Rangitata Gorge - Stage B	210									
11128	22kV OH Rebuild - Tinwald Westerfield Mayfield Road	36									
11127	22kV OH Rebuild - Winters Road	27									
11083	22kV UG New - New Carew ZSS Feeders	27									
11060	22kV UG New - New Fairton ZSS Feeders	353									
11082	22kV UG New - New Hackthorne ZSS Feeders	27									
11065	22kV UG New - New Tinwald ZSS Feeders	84									
10943	33-22kV OH Rebuild - Arundel Rakaia Gorge Road	111									
11089	33-66kV OH Conversion - Holmes Rd	24									
11086	66kV OH New - Company Rd from FTN66 to Pole 84423 Company Rd	181									
10697	66kV OH Rebuild - Methven to Mt Somers, Stage 3, Section 1	62									
10994	66kV OH Rebuild - Mt Somers to Montalto, Stage 2, Section 1	125									
10995	66kV OH Rebuild - Mt Somers to Montalto, Stage 2, Section 2	123									
11057	DSS New - EV Charging Solution Sites	101									
11049	DSS Rebuild - Kermodie S1 71 (750kVA)	35									
11134	DSS Rebuild - South S1 22	34									
11056	Non-Network - Device Licences for Protection Events Management	18									
11077	Non-Network - EV Charging Solution	158									
11075	Non-Network - EV Charging Station Number 2	5									
00545	Non-Network - Asset Management System	100									
00546	Non-Network - Board Reporting Software	15									
00548	Non-Network - Contracting Access Switch	20									
00547	Non-Network - Core and Storage Switches	200									
00540	Non-Network - Corporate Vehicle	60									

CAPITAL CASHFLOW		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
00543	Non-Network - Data Warehouse	100									
10982	Non-Network - Document Management System	75									
00541	Non-Network - ICP Management	400									
00552	Non-Network - Legal Compliance Software	25									
00551	Non-Network - Payroll System	65									
00550	Non-Network - Small IT Items	46									
00549	Non-Network - Video Conferencing Facilities	20									
00542	Non-Network - Website Development	50									
11074	Non-Network - Outage Manager - Control Centre	210									
11055	Non-Network - Urban Orthophoto Update	25									
11100	RMU (3 x CB) - cnr Ashburton Staveley Rd and Allan Smiths Rd	106									
11062	RMU (3 x CB) - cnr Mitcham & Hepburns Rds	84									
11101	RMU (4 x CB) - cnr Hackthorne Rd and Ealing Montalto Rd	134									
11098	RMU (4 x CB) - cnr Hackthorne Rd and Valetta Westerfield Rd	134									
11102	RMU (4 x CB) - cnr Seafield Rd and Christys Rd.	134									
11099	RMU (4 x CB) - cnr Timaru Track Rd and Tinwald Westerfield Rd	134									
11103	RMU (4 x CB) - cnr Tinwald Westerfield Mayfield Rd and Mayfield Valetta Rd	134									
11070	SCADA - Tap Changer Comms	12									
11111	UG Conversion - Aitken St (William - Cass)	217									
11110	UG Conversion - Albert St (McDonald - Bridge)	331									
10937	UG Conversion - Arundel Rakaia Gorge Rd, Hwy 77	32									
10991	UG Conversion - Barrhill Village	47									
11108	UG Conversion - Beach Rd	840									
11115	UG Conversion - Bowen St East (Bridge - Railway Tce East)	324									
11114	UG Conversion - Elizabeth Ave East (Bridge - Tancred)	89									
11116	UG Conversion - Eton St (Albert - Nelson)	323									
11080	UG Conversion - Eton St (Beach - Tancred)	131									
11106	UG Conversion - Fairton Township	646									
10918	UG Conversion - Galbraith St	60									
11109	UG Conversion - George St	326									
11117	UG Conversion - Harrison St (Oak Grove - Cross)	80									
11118	UG Conversion - Hinds Hwy (Longbeach Rd - Tinwald)	304									
10473	UG Conversion - Methven Hwy (Farm Rd - Digbys Bridge)	433									
11119	UG Conversion - Methven Hwy (Winchmore - Rooneys Rd)	241									
11107	UG Conversion - Nixon St	137									
11053	UG Conversion - Pitt St, Rakaia	8									
11113	UG Conversion - Railway Tce West (Shopping Centre)	117									
10732	UG Conversion - Rakaia 22kV security, Railway Tce East to Mackie St	78									
10936	UG Conversion - Waimarama Rd, Hwy 77	38									
11112	UG Conversion - Walnut Ave (Chalmers Ave - Intermediate School)	420									
11090	ZSS CRW - 2nd 66/22kV Transformer	1,180									
11093	ZSS CRW - Substation Gate	9									
11067	ZSS EGN - 66kV Ripple Plant	711									
11095	ZSS EGN - Seal road frontage	13									
11066	ZSS FTN - Substation Completion (Structural/Electrical works)	3,338									
11091	ZSS HTH - 22kV Switchboard Extension	179									
11094	ZSS HTH - Substation Gate	9									
10961	ZSS MHT - Protection Upgrade	79									
11068	ZSS MHT - ZSS Comms and Scada	165									
10915	ZSS MVN - Backup Control Room	106									
11092	ZSS TIN - 22/11 Transformer and Switchboards	998									
10955	ZSS TIN - New 66kV Switching Station - Civil Works	32									
00566	11kV Core Network Cables - Ashburton		453								
00556	11kV Network Centres - Ashburton		437								
10685	11kV UG New - SH1 & Walnut Ave intersection re-design		53								
00141	22kV Conversion - Methven Hwy Digbys Bridge to Wmr Hall & Racecourse Rd.		97								
00087	22kV Conversion - Methven Hwy Winchmore Hall to Springfield Rd + side roads.		235								
00083	22kV Conversion - Springfield Rd West		59								
00143	22kV Conversion - Winchmore Lauriston Rd, Methven Hwy to end of line		28								
00142	22kV Conversion - Winchmore School Rd		49								
00518	66kV OH New - HTH-LSN - Stage 1		1,959								
00510	66kV UG New - EGN-ASH Cable		2,873								
00450	Non-Network - Distance Protection Modelling Software		25								
00132	Non-Network - IEC61850 Trial		30								
99030	Non-Network - IT Field Mobility		50								
00452	Non-Network - Software for central storage of protection related information		25								
00247	RMU (3 x CB) - cnr Bonningtons Rd & Seaside Rd		98								
00244	RMU (3 x CB) - cnr of Dromore Methven Rd and Winchmore School Rd		98								
00245	RMU (3 x CB) - cnr of Lyndhurst Rd & Back Track		98								
00248	RMU (3 x CB) - cnr of Wakanui School Rd & Wilsons Rd		98								
00446	RMU (4 x CB) - cnr McDougalls Rd & Fountains Rd		126								
00243	RMU (4 x CB) - cnr Valetta Westerfield Rd & Mayfield Valetta Rd		126								
00246	RMU (4 X CB) - River Rd 1196, Hakatere		126								
00278	UG Conversion - Bell Road (Racecourse Rd - Hanrahan St)		473								
00392	UG Conversion - Bowen St East (Bridge St - Burrows Rd)		328								
00277	UG Conversion - Chalmers Ave (Wakanui Rd - Wellington St)		233								
00292	UG Conversion - Chapman Street (STB - Bowen St)		185								
00281	UG Conversion - Church Street (Beach Rd - Wellington St)		298								
00216	UG Conversion - Convert State Hwy OH crossings to UG		87								
00283	UG Conversion - Leeston Street (Beach Rd - River)		390								
00394	UG Conversion - Rakaia Hwy (Coplands Rd - Dromore)		222								
00393	UG Conversion - Rakaia Hwy (Overdale - Chertsey Rail Crossing)		412								


CAPITAL CASHFLOW		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
00288	UG Conversion - Reid Cres (Elizabeth St - Cross St)		368								
00280	UG Conversion - Tancred Street (William St - Cambridge St)		458								
00287	UG Conversion - Victoria Street (Wills St - William St)		140								
00285	UG Conversion - William Street (Dobson St - Princes St)		587								
00505	ZSS ASH - 66kV Conversion - Stage 2		1,355								
00509	ZSS EGN - New 66kV Line Protection for ASH Cct		37								
00517	ZSS HTH & LSN - New HTH-LSN 66kV Line Bays		437								
00557	11kV Core Network Cables - Ashburton			453							
00559	11kV Network Centres - Ashburton			437							
00089	22kV Conversion - Staveley Area			332							
00088	22kV Conversion - Tramway Rd			189							
00576	22kV Rebuild - Upper Rakaia River Crossing			847							
00499	66kV OH Convert - HTH-MSM 22kV Line			131							
00511	66kV OH New - EGN-FTN			1,669							
00519	66kV OH New - HTH-LSN - Stage 2			1,958							
00249	RMU (3 x CB) - cnr of Longbeach Rd & Dawsons Rd			98							
00258	RMU (3 x CB) - cnr of Poplar Rd & Davisons Rd			98							
00260	RMU (4 x CB) - cnr Anama School Rd & Peters Rd			126							
00259	RMU (4 x CB) - cnr Coldstream Rd & Boundary Rd			126							
00257	RMU (4 x CB) - cnr Coldstream Rd & Emersons Rd			126							
00420	RMU (4 x CB) - cnr Emersons Rd & Brogdens Rd			126							
00575	SCADA - Replacement System			528							
00293	UG Conversion - Cox St (Cass St - Chalmers Ave)			360							
00303	UG Conversion - Dunford Street (Bridge St - Tancred St)			78							
00301	UG Conversion - Grey St (William St - Eton St)			235							
00297	UG Conversion - Grove St (Catherine St - Wilkin St)			1,312							
00300	UG Conversion - Harland St (Johnstone St - Manchester St)			256							
00295	UG Conversion - Harrison St (Bathurst St - Lane St)			265							
00299	UG Conversion - James St (Alford Forest Rd - Harrison St)			210							
00302	UG Conversion - Millichamp St			128							
00304	UG Conversion - Normanby Street (West Town Belt - Cridland St)			107							
00305	UG Conversion - Porter St (Bridge St - McDonald St)			262							
00294	UG Conversion - Sudbury St			187							
00402	UG Conversion - Waimarama Rd, Hwy 77 (Drayton - ARG Rd)			391							
00298	UG Conversion - Wilkin St (Millbrook Pl - Grove St)			85							
00497	ZSS EGN - New 66kV Line Protection for FIN Cct			37							
00496	ZSS EGN - Reconfigure Site (T1) as 66/22kV.			356							
00498	ZSS HTH - New HTH-MSM 66kV Line Bay			269							
00516	ZSS MSM - Upgrade to 66kV			1,788							
00555	ZSS MTV - MTV-MSM 66kV Line Bay & Protection			218							
00560	11kV Core Network Cables - Tinwald				454						
00567	11kV Network Centre - Ashburton				431						
00558	11kV Network Centre - Tinwald				219						
00090	22kV Conversion - Methven Hwy Springfield Rd to Mthvn, Afd Frst to Nwtns Cnr				386						
00453	Power Quality - Meters in zone subs				11						
00261	RMU (3 x CB) - cnr of Corbetts Rd & Acton Rd				98						
00433	RMU (3 x CB) - cnr of Longbeach Rd & Surveyors Rd				98						
00266	RMU (3 x CB) - cnr of Mainwarings Rd & McLachlans Rd				98						
00264	RMU (4 x CB) - cnr Arundel Rakaia Gorge & McLennans Rd				127						
00262	RMU (4 x CB) - cnr Dobsons Ferry Rd & Mainwarings Rd				127						
00263	RMU (4 x CB) - cnr Methven Hwy & Reynold Rd				127						
00312	UG Conversion - Anne St				363						
00316	UG Conversion - Cambridge St (Nelson St - Wakanui Rd)				271						
00317	UG Conversion - Cameron St (William St - Chalmers Ave)				204						
00306	UG Conversion - Cridland Street (Elizabeth Ave - Michael St)				473						
00310	UG Conversion - Elizabeth Ave West (North Side, West Town Belt - Cridland St)				174						
00395	UG Conversion - Hinds Hwy (Chatmos - Windermere Rd)				201						
00313	UG Conversion - Lauriston Township				326						
00311	UG Conversion - McMurdo St (Hassel St - Wilkins St)				1,437						
00314	UG Conversion - Peter Street (William St - Cass St)				79						
00307	UG Conversion - Robinson Street, Rakaia (West Town Belt - Cridland St)				166						
00315	UG Conversion - Wills St (Victoria St - William St)				103						
00495	ZSS MTV - Reconfigure T1 as 66/22kV.				80						
00514	ZSS MTV - T4 & T5, 22/11/33kV Step-up				205						
00562	11kV Core Network Cables - Ashburton					682					
00271	22kV Conversion - Flemington, Huntingdon & Windermere Area.					526					
00570	66kV OH Rebuild - WNU-SFD					1,166					
00500	Contingency Project					906					
90022	Non-Network - Aerial Photography					30					
00268	RMU (3 x CB) - cnr Ashburton Staveley Rd & Walkhams Rd					98					
00270	RMU (3 x CB) - cnr of Fords Rd & Wheatstone Rd					98					
00267	RMU (3 x CB) - cnr of Mayfield Klondyke Rd & Hinds Gorge Rd					98					
00269	RMU (4 x CB) - cnr Ealing Montalto Rd & Trevors Rd					127					
00412	RMU (4 x CB) - cnr Ledgerwood Rd & Dip Rd					127					
00265	RMU (4 x CB) - cnr Pendarves Rakaia Rd & Rules Rd.					127					
00326	UG Conversion - Cracroft St, Hinds (Peters St - Nugent St)					197					
00328	UG Conversion - Cridland Street (West Town Belt - Elizabeth Ave)					235					
00329	UG Conversion - Elizabeth Ave West (Sth Side, Wst Town Belt - Railway Tce Wst)					289					
00324	UG Conversion - Gray St, Hinds (Cracroft St - Isleworth Rd)					305					
00319	UG Conversion - Isleworth Rd, Hinds (Peters St - Nugent St)					272					
00321	UG Conversion - Johnstone St, Hinds (Peters St - Nugent St)					81					
00333	UG Conversion - Mackie Street HV Only (Rolleston St - Michael St)					73					

CAPITAL CASHFLOW		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
00331	UG Conversion - Melcombe St (Anne St - Maronan Rd)					169					
00400	UG Conversion - Methven Hwy (Pole Rd - Methven)					265					
00396	UG Conversion - Methven Hwy (Rooneys - Shearers)					276					
00325	UG Conversion - Michael St (East Side, Bridge St - Burrowes Rd)					259					
00318	UG Conversion - Michael Street (West Side, West Town Belt - Railway Tce West)					441					
00330	UG Conversion - Moore St (William St - Chalmers Ave)					197					
00320	UG Conversion - Peters St, Hinds (Cracraft St - Isleworth Rd)					366					
00323	UG Conversion - Rakaia Terrace					45					
00332	UG Conversion - Rolleston Street West HV Only (Cridland St - Mackie St)					85					
00322	UG Conversion - West Town Belt (Elizabeth Ave - Rakaia Tce)					306					
00561	11kV Core Network Cables - Tinwald						682				
00375	22kV Conversion - Eiffelton						483				
00512	22kV OH New - MON Feeder Integration						709				
00520	66kV OH New - MON-MSM - Stage 3						873				
00571	66kV OH Rebuild - SFD-PDS						1,094				
00501	Contingency Project						906				
00343	UG Conversion - Bowen St West (Cridland St - Rakaia Terrace West)						145				
00344	UG Conversion - Burrowes Road (STB to Elizabeth Ave)						111				
00340	UG Conversion - Carters Tce						192				
00341	UG Conversion - Fergusson Street (Rakaia Terrace East - Burrowes Rd)						463				
00334	UG Conversion - Harland St (Catherine St - Graham St)						306				
00338	UG Conversion - Johnstone St (McMurdo St - Grove St)						366				
00346	UG Conversion - Mackie Street (Elizabeth Ave - Dunford St)						165				
00336	UG Conversion - Manchester St (McMurdo St - Harland St)						218				
00399	UG Conversion - Methven Hwy (Thompsons Track - Pole Rd)						848				
00339	UG Conversion - Oxford St (Beach Rd - Wellington St)						309				
00348	UG Conversion - South Town Belt East (Bridge St - Burrowes Rd)						137				
00347	UG Conversion - Tancred Street, Rakaia (South Town Belt - Dunford St)						417				
00335	UG Conversion - Thomson St (Carter Tce - Wilkin St)						179				
00337	UG Conversion - Wilkin St (McMurdo St - Millbrook Pt)						199				
00513	ZSS MON - New 66/22kV ZSS						1,932				
00554	ZSS Montalto Hydro - Inject at 22kV						265				
00573	ZSS MSM - New MSM-MON 66kV Line Bay						219				
00563	11kV Core Network Cables - Ashburton							682			
00376	22kV Conversion - 2023 Assessment							276			
00507	66kV OH New - CRW-MON - Stage 1							1,637			
00572	66kV OH Rebuild - PDS-DOR							1,210			
00356	UG Conversion - Agnes St (McMurdo St - Grove St)							306			
00369	UG Conversion - Allens Road (Harrison St-Alford Forest Rd)							281			
00368	UG Conversion - Allens Road (Racecourse Rd-Carters Rd)							166			
00350	UG Conversion - Farm Rd (Middle Rd - Racecourse Rd)							282			
00355	UG Conversion - Grahams Street (McMurdo St - Grove St)							343			
00353	UG Conversion - McNally St (Range St - McGregor Ln)							81			
00398	UG Conversion - Methven Hwy (Blands Cnr - Thompsons Track)							286			
00349	UG Conversion - Racecourse Rd (Farm Rd - Russell Ave)							790			
00352	UG Conversion - Robinson St (McNill St - Smlbn Dr) & Wfnsn St (Rnge St - Rbnsn St)							241			
00354	UG Conversion - Thomson St (Wilkin St - Grove St)							927			
00506	ZSS CRW & MON - New 66kV Line Bays							437			
00564	11kV Core Network Cables - Ashburton								682		
00377	22kV Conversion - 2024 Assessment								276		
00508	66kV OH New - CRW-MON - Stage 2								1,637		
00502	Contingency Project								906		
00360	UG Conversion - Burrowes Road (Elizabeth Ave - Michael St)								89		
00366	UG Conversion - Catherine St (McMurdo St - Grove St)								299		
00365	UG Conversion - Jane St (McMurdo St - Grove St)								312		
00357	UG Conversion - Melcombe St (Anne St - Lagmhor Rd)								211		
00397	UG Conversion - Methven Hwy (Shearers - Blands Cnr)								276		
00401	UG Conversion - Mt Hutt Stn Rd (Methven - Holmes Rd)								53		
00361	UG Conversion - Rolleston Street (Tancred St - Burrowes Rd)								215		
00363	UG Conversion - Rolleston Street West (Mackie St - Cridland St)								152		
00359	UG Conversion - Shearman St								76		
00362	UG Conversion - South Town Belt - West (West Town Belt - SH1)								431		
00364	UG Conversion - Thomson St (Grahams St - Hassel St)								646		
00565	11kV Core Network Cables - Ashburton									682	
00378	22kV Conversion - 2025 Assessment									276	
00503	Contingency Project									906	
00580	Electric Vehicle/Batteries/Solar Impact									2,650	
80004	GXP - New 66kV GXP (+\$1.5M T.Charge p.a.)									-	-
90023	Non-Network - Aerial Photography									30	
00379	22kV Conversion - 2026 Assessment										276
00554	Contingency Project										906
00580	Electric Vehicle/Batteries/Solar Impact										2,650
00493	ZSS EGN - 33kV Ripple Plant Replacement										371
00504	ZSS TIN - New 66/11kV Transformer										1,151
	<b>SUBTOTAL PROJECTS AND PROGRAMMES</b>	<b>18,775</b>	<b>13,153</b>	<b>13,788</b>	<b>6,258</b>	<b>7,846</b>	<b>11,218</b>	<b>7,945</b>	<b>6,261</b>	<b>4,544</b>	<b>5,354</b>
	<b>GRAND TOTAL</b>	<b>23,419</b>	<b>19,976</b>	<b>20,085</b>	<b>12,688</b>	<b>14,677</b>	<b>17,454</b>	<b>14,387</b>	<b>12,704</b>	<b>10,987</b>	<b>11,796</b>

## 10.3 Appendix C - Forecast Load Growth

Future load estimation is as much art as it is science. There are two main techniques one can use to try and predict future load, one is to look at historical trends and extrapolate these into the future (referred to in this plan as projection), the other is to model the loads and estimate the impact of various factors such as the economy, commodity prices, resource availability, legislative changes, weather, etc on the future loads placed on the network (referred to in this plan as estimation). Provided sufficient information is at hand, it is worth looking at both approaches and that is what has been done at EA Networks.

The projection approach examines the previous peak loads on the network and trends this out in to the future. The risk with this technique is that it assumes no major changes in environmental factors in the extrapolated period. The projection approach does have an advantage as, on average, it can take into account the completely unknown factors in load growth. Any unknown factors that have occurred in the past will influence the projected future load. Using this technique, the average load growth over a moving four-year interval has been examined, a linear extrapolation applied for ten years, and three growth projections have been applied to the extrapolated line -3% (low growth), 0% (medium growth), and +3% (high growth). A chart of the load growth can be seen below "Percentage Growth for EA Networks' Summer Maximum Demand". These growth rates have then been applied to the Transpower GXP maximum demand of the last financial year (all time maximum demand for winter) and plotted to give a ten-year projection and these can be seen in the chart "Actual and Projected EA Networks Summer/Winter Maximum Demand" (see [section 5.2.4](#)). Historically, predictions using this technique have been reasonably accurate to the "average growth" line. With the knowledge that Environment Canterbury has started to restrict access to underground water resources, the projected growth is very optimistic and now hopelessly unrealistic. Even the minimum curve results in 53% load growth over the next ten years. This is the last time this model will appear in the Asset Management Plan.

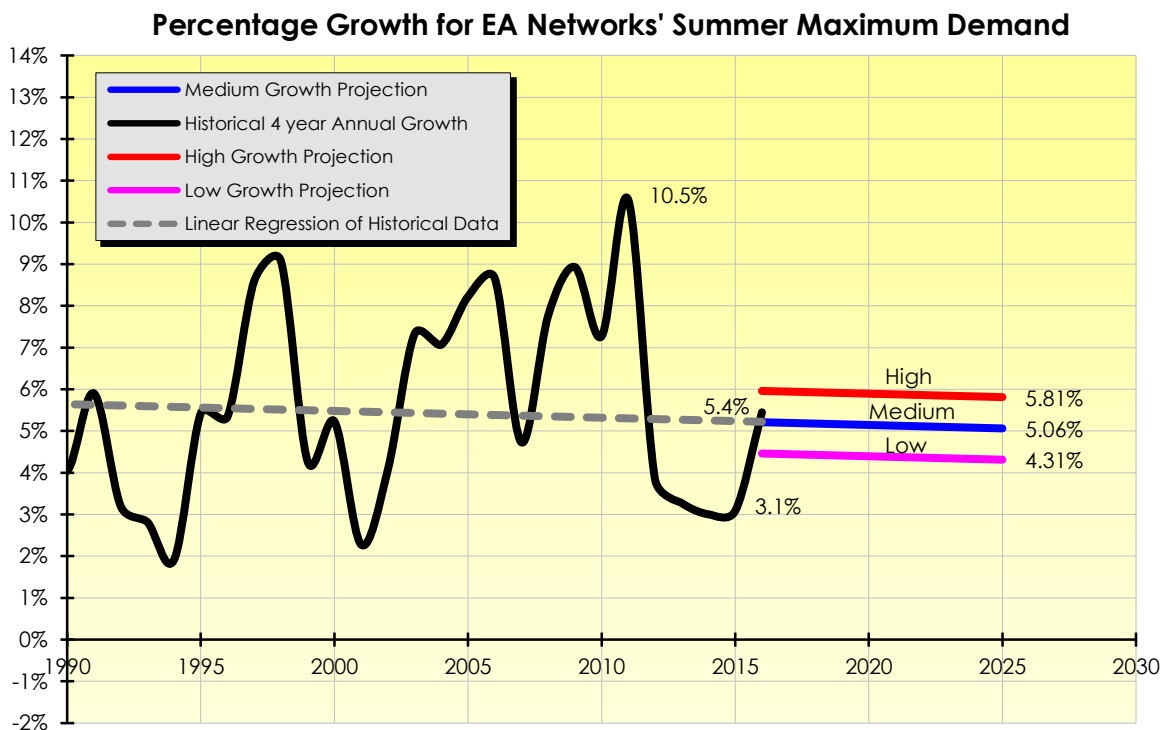

The estimation approach is more time consuming and detailed but it does offer the advantage of estimating zone substation maximum demands individually. The model EA Networks has chosen takes each substation and assumes a base load for winter and a base load for summer. The winter base load is assumed to be approximately the winter maximum demand. An irrigation load is available for summer maximum demand calculation. The summer base load and the irrigation load are added together with a diversity factor applied and this gives a summer zone substation maximum demand. Individual subtransmission lines and ultimately Transpower GXP maximum demands can also be calculated. Growth

at each substation is estimated from, among other things, localised trends in irrigation pump size and resource consent density. These trends are subjective and are influenced by the opinions of many people involved in the irrigation industry - from well drillers to end use farmers. The chart "Actual and Estimated EA Networks Summer/Winter Maximum Demands" (see [section 5.2.4](#)) and the table "Base and Irrigation Loads for Zone Substation Load Predictions" (see below) show the results of this modelling. The estimation technique has been pessimistic in previous plans (since it cannot accommodate unknown load growth). It will be used as a realistic/minimum growth curve for the 2016-26 plan.

<b>BASE AND IRRIGATION LOADS FOR ZONE SUBSTATION LOAD PREDICTIONS</b>													
		Financial Year	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
<b>SUBSTATION</b>		<b>Year</b>	<b>2015/16</b>	<b>2016/17</b>	<b>2017/18</b>	<b>2018/19</b>	<b>2019/20</b>	<b>2020/21</b>	<b>2021/22</b>	<b>2022/23</b>	<b>2023/24</b>	<b>2024/25</b>	<b>2025/26</b>
	GXP		33	33	66	66	66	66	66	66	66	66	66
<b>Ashburton</b>	<b>Total Summer</b>		<b>15.89</b>	<b>14.66</b>	<b>14.81</b>	<b>14.97</b>	<b>15.13</b>	<b>15.29</b>	<b>15.55</b>	<b>15.71</b>	<b>15.88</b>	<b>16.05</b>	<b>16.22</b>
<b>2 x 10/20 MVA</b>	<b>Total Winter</b>		<b>26.18</b>	<b>18.75</b>	<b>19.17</b>	<b>19.59</b>	<b>20.02</b>	<b>20.46</b>	<b>20.91</b>	<b>21.37</b>	<b>21.84</b>	<b>22.32</b>	<b>22.81</b>
<b>22.0 Firm</b>	<b>Winter Base</b>	<b>2.2% Growth</b>	26.18	18.75	19.17	19.59	20.02	20.46	20.91	21.37	21.84	22.32	22.81
<b>ASH</b>	<b>Summer Base</b>	<b>1.5% Growth</b>	11.49	10.16	10.31	10.47	10.63	10.79	10.95	11.11	11.28	11.45	11.62
	<b>Irrigation Base</b>	<b>100% Diversity</b>	4.40	4.50	4.50	4.50	4.50	4.50	4.60	4.60	4.60	4.60	4.60
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Northtown</b>	<b>Total Summer</b>		<b>10.17</b>	<b>11.79</b>	<b>11.94</b>	<b>12.09</b>	<b>12.35</b>	<b>12.50</b>	<b>12.66</b>	<b>12.82</b>	<b>13.08</b>	<b>13.25</b>	<b>13.41</b>
<b>2 x 10/20 MVA</b>	<b>Total Winter</b>		<b>9.52</b>	<b>17.73</b>	<b>18.12</b>	<b>18.52</b>	<b>18.93</b>	<b>19.34</b>	<b>19.77</b>	<b>20.20</b>	<b>20.65</b>	<b>21.10</b>	<b>21.57</b>
<b>22.0 Firm</b>	<b>Winter Base</b>	<b>2.2% Growth</b>	9.52	17.73	18.12	18.52	18.93	19.34	19.77	20.20	20.65	21.10	21.57
<b>NTN</b>	<b>Summer Base</b>	<b>1.5% Growth</b>	8.27	9.89	10.04	10.19	10.35	10.50	10.66	10.82	10.98	11.15	11.31
	<b>Irrigation Base</b>	<b>100% Diversity</b>	1.90	1.90	1.90	1.90	2.00	2.00	2.00	2.00	2.10	2.10	2.10
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Carew</b>	<b>Total Summer</b>		<b>15.43</b>	<b>15.56</b>	<b>15.58</b>	<b>15.60</b>	<b>15.62</b>	<b>15.65</b>	<b>15.67</b>	<b>15.69</b>	<b>15.72</b>	<b>15.84</b>	<b>15.87</b>
<b>1 x 10/15 MVA</b>	<b>Total Winter</b>		<b>1.17</b>	<b>1.18</b>	<b>1.19</b>	<b>1.20</b>	<b>1.22</b>	<b>1.23</b>	<b>1.24</b>	<b>1.25</b>	<b>1.27</b>	<b>1.28</b>	<b>1.29</b>
<b>9.0 Firm</b>	<b>Winter Base</b>	<b>1.0% Growth</b>	1.17	1.18	1.19	1.20	1.22	1.23	1.24	1.25	1.27	1.28	1.29
<b>CRW</b>	<b>Summer Base</b>	<b>1.0% Growth</b>	2.23	2.26	2.28	2.30	2.32	2.35	2.37	2.39	2.42	2.44	2.47
	<b>Irrigation Base</b>	<b>100% Diversity</b>	13.20	13.30	13.30	13.30	13.30	13.30	13.30	13.30	13.30	13.40	13.40
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Coldstream</b>	<b>Total Summer</b>		<b>15.31</b>	<b>15.32</b>	<b>15.44</b>	<b>15.46</b>	<b>15.47</b>	<b>15.59</b>	<b>15.61</b>	<b>15.62</b>	<b>15.74</b>	<b>15.76</b>	<b>15.78</b>
<b>1 x 10/15 MVA</b>	<b>Total Winter</b>		<b>0.72</b>	<b>0.73</b>	<b>0.74</b>	<b>0.75</b>	<b>0.75</b>	<b>0.76</b>	<b>0.77</b>	<b>0.78</b>	<b>0.78</b>	<b>0.79</b>	<b>0.80</b>
<b>9.0 Firm</b>	<b>Winter Base</b>	<b>1.0% Growth</b>	0.72	0.73	0.74	0.75	0.75	0.76	0.77	0.78	0.78	0.79	0.80
<b>CSM</b>	<b>Summer Base</b>	<b>1.0% Growth</b>	1.61	1.62	1.64	1.66	1.67	1.69	1.71	1.72	1.74	1.76	1.78
	<b>Irrigation Base</b>	<b>100% Diversity</b>	13.70	13.70	13.80	13.80	13.80	13.90	13.90	13.90	14.00	14.00	14.00
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Dorie</b>	<b>Total Summer</b>		<b>11.33</b>	<b>11.44</b>	<b>11.46</b>	<b>11.47</b>	<b>11.49</b>	<b>11.50</b>	<b>11.52</b>	<b>11.53</b>	<b>11.55</b>	<b>11.56</b>	<b>11.58</b>
<b>1 x 10/15 MVA</b>	<b>Total Winter</b>		<b>0.91</b>	<b>0.92</b>	<b>0.93</b>	<b>0.94</b>	<b>0.95</b>	<b>0.96</b>	<b>0.97</b>	<b>0.98</b>	<b>0.99</b>	<b>1.00</b>	<b>1.01</b>
<b>9.0 Firm</b>	<b>Winter Base</b>	<b>1.0% Growth</b>	0.91	0.92	0.93	0.94	0.95	0.96	0.97	0.98	0.99	1.00	1.01
<b>DOR</b>	<b>Summer Base</b>	<b>1.0% Growth</b>	1.43	1.44	1.46	1.47	1.49	1.50	1.52	1.53	1.55	1.56	1.58
	<b>Irrigation Base</b>	<b>100% Diversity</b>	9.90	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Eiffelton</b>	<b>Total Summer</b>		<b>8.84</b>	<b>8.95</b>	<b>9.07</b>	<b>9.19</b>	<b>9.30</b>	<b>9.42</b>	<b>9.54</b>	<b>9.66</b>	<b>9.77</b>	<b>9.89</b>	<b>9.91</b>
<b>1 x 10/20 MVA</b>	<b>Total Winter</b>		<b>1.68</b>	<b>1.70</b>	<b>1.71</b>	<b>1.73</b>	<b>1.75</b>	<b>1.77</b>	<b>1.78</b>	<b>1.80</b>	<b>1.82</b>	<b>1.84</b>	<b>1.86</b>
<b>4.0 Firm</b>	<b>Winter Base</b>	<b>1.0% Growth</b>	1.68	1.70	1.71	1.73	1.75	1.77	1.78	1.80	1.82	1.84	1.86
<b>EFN</b>	<b>Summer Base</b>	<b>1.0% Growth</b>	1.64	1.65	1.67	1.69	1.70	1.72	1.74	1.76	1.77	1.79	1.81
	<b>Irrigation Base</b>	<b>100% Diversity</b>	7.20	7.30	7.40	7.50	7.60	7.70	7.80	7.90	8.00	8.10	8.10

		Year	2015/16	2016/17	2017/18	2018/19	2019/20	2020/21	2021/22	2022/23	2023/24	2024/25	2025/26
	GXP		33	66	66	66	66	66	66	66	66	66	66
<b>Fairton</b>	<b>Total Summer</b>		<b>6.24</b>	<b>6.30</b>	<b>6.46</b>	<b>6.52</b>	<b>6.59</b>	<b>6.65</b>	<b>6.72</b>	<b>6.78</b>	<b>6.85</b>	<b>6.91</b>	<b>6.98</b>
<b>2 x 5/10 MVA</b>	<b>Total Winter</b>		<b>8.30</b>	<b>8.47</b>	<b>8.64</b>	<b>8.81</b>	<b>8.99</b>	<b>9.17</b>	<b>9.35</b>	<b>9.54</b>	<b>9.73</b>	<b>9.92</b>	<b>10.12</b>
<b>10.0 Firm</b>	<b>Winter Base</b>	<b>2.0% Growth</b>	8.30	8.47	8.64	8.81	8.99	9.17	9.35	9.54	9.73	9.92	10.12
<b>FTN</b>	<b>Summer Base</b>	<b>1.0% Growth</b>	6.14	6.20	6.26	6.32	6.39	6.45	6.52	6.58	6.65	6.71	6.78
	<b>Irrigation Base</b>	<b>100% Diversity</b>	0.10	0.10	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Highbank</b>	<b>Summer Load</b>		<b>9.00</b>	<b>9.00</b>	<b>12.00</b>	<b>12.00</b>	<b>12.00</b>	<b>12.00</b>	<b>12.00</b>	<b>12.00</b>	<b>12.00</b>	<b>12.00</b>	<b>12.00</b>
	<b>Summer Gen</b>		<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>
<b>HBK</b>	<b>Winter Gen</b>		<b>-27</b>	<b>-27</b>	<b>-27</b>	<b>-27</b>	<b>-27</b>	<b>-27</b>	<b>-27</b>	<b>-27</b>	<b>-27</b>	<b>-27</b>	<b>-27</b>
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Hackthorne</b>	<b>Total Summer</b>		<b>17.58</b>	<b>17.60</b>	<b>17.63</b>	<b>17.66</b>	<b>17.68</b>	<b>17.71</b>	<b>17.74</b>	<b>17.76</b>	<b>17.79</b>	<b>17.82</b>	<b>17.85</b>
<b>1 x 10/20 MVA</b>	<b>Total Winter</b>		<b>1.85</b>	<b>1.89</b>	<b>1.92</b>	<b>1.96</b>	<b>2.00</b>	<b>2.04</b>	<b>2.08</b>	<b>2.13</b>	<b>2.17</b>	<b>2.21</b>	<b>2.26</b>
<b>9.0 Firm</b>	<b>Winter Base</b>	<b>2.0% Growth</b>	1.85	1.89	1.92	1.96	2.00	2.04	2.08	2.13	2.17	2.21	2.26
<b>HTH</b>	<b>Summer Base</b>	<b>1.0% Growth</b>	2.58	2.60	2.63	2.66	2.68	2.71	2.74	2.76	2.79	2.82	2.85
	<b>Irrigation Base</b>	<b>100% Diversity</b>	15.00	15.00	15.00	15.00	15.00	15.00	15.00	15.00	15.00	15.00	15.00
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Lagmhor</b>	<b>Total Summer</b>		<b>7.38</b>	<b>7.38</b>	<b>7.39</b>	<b>7.39</b>	<b>7.39</b>	<b>7.40</b>	<b>7.50</b>	<b>7.51</b>	<b>7.51</b>	<b>7.51</b>	<b>7.52</b>
<b>1 x 10/20 MVA</b>	<b>Total Winter</b>		<b>1.15</b>	<b>1.18</b>	<b>1.20</b>	<b>1.22</b>	<b>1.25</b>	<b>1.27</b>	<b>1.30</b>	<b>1.33</b>	<b>1.35</b>	<b>1.38</b>	<b>1.41</b>
<b>5.0 Firm</b>	<b>Winter Base</b>	<b>2.0% Growth</b>	1.15	1.18	1.20	1.22	1.25	1.27	1.30	1.33	1.35	1.38	1.41
<b>LGM</b>	<b>Summer Base</b>	<b>1.0% Growth</b>	0.38	0.38	0.39	0.39	0.39	0.40	0.40	0.41	0.41	0.41	0.42
	<b>Irrigation Base</b>	<b>100% Diversity</b>	7.00	7.00	7.00	7.00	7.00	7.00	7.10	7.10	7.10	7.10	7.10
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Lauriston</b>	<b>Total Summer</b>		<b>16.71</b>	<b>16.93</b>	<b>16.94</b>	<b>17.00</b>	<b>17.11</b>	<b>17.12</b>	<b>17.13</b>	<b>17.14</b>	<b>17.16</b>	<b>17.17</b>	<b>17.18</b>
<b>1 x 10/15 MVA</b>	<b>Total Winter</b>		<b>1.60</b>	<b>1.63</b>	<b>1.67</b>	<b>1.70</b>	<b>1.73</b>	<b>1.77</b>	<b>1.80</b>	<b>1.84</b>	<b>1.88</b>	<b>1.91</b>	<b>1.95</b>
<b>7.0 Firm</b>	<b>Winter Base</b>	<b>2.0% Growth</b>	1.60	1.63	1.67	1.70	1.73	1.77	1.80	1.84	1.88	1.91	1.95
<b>LSN</b>	<b>Summer Base</b>	<b>1.0% Growth</b>	1.11	1.13	1.14	1.15	1.16	1.17	1.18	1.19	1.21	1.22	1.23
	<b>Irrigation Base</b>	<b>100% Diversity</b>	15.60	15.80	15.80	15.85	15.95	15.95	15.95	15.95	15.95	15.95	15.95
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Methven 33</b>	<b>Total Summer</b>		<b>1.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>
<b>1 x 5/10 MVA</b>	<b>Total Winter</b>		<b>1.88</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>
<b>4.0 Firm</b>	<b>Winter Base</b>	<b>2.0% Growth</b>	1.88	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
<b>MVN</b>	<b>Summer Base</b>	<b>1.5% Growth</b>	0.90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	<b>Irrigation Base</b>	<b>100% Diversity</b>	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Methven 66</b>	<b>Total Summer</b>		<b>3.67</b>	<b>4.74</b>	<b>4.85</b>	<b>4.90</b>	<b>4.95</b>	<b>5.06</b>	<b>5.11</b>	<b>5.22</b>	<b>5.28</b>	<b>5.33</b>	<b>5.39</b>
<b>1 x 10/15 MVA</b>	<b>Total Winter</b>		<b>4.44</b>	<b>6.48</b>	<b>6.60</b>	<b>6.74</b>	<b>6.87</b>	<b>7.01</b>	<b>7.15</b>	<b>7.29</b>	<b>7.44</b>	<b>7.59</b>	<b>7.74</b>
<b>4.0 Firm</b>	<b>Winter Base</b>	<b>2.0% Growth</b>	4.44	6.48	6.60	6.74	6.87	7.01	7.15	7.29	7.44	7.59	7.74
<b>MTV</b>	<b>Summer Base</b>	<b>1.5% Growth</b>	2.27	3.24	3.29	3.34	3.39	3.44	3.49	3.54	3.60	3.65	3.71
	<b>Irrigation Base</b>	<b>100% Diversity</b>	1.40	1.50	1.56	1.56	1.56	1.62	1.62	1.68	1.68	1.68	1.68
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Montalto</b>	<b>Summer</b>		<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>	<b>-1.00</b>
<b>Generation</b>	<b>Winter</b>		<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>	<b>-1.50</b>
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Montalto</b>	<b>Total Summer</b>		<b>1.86</b>	<b>1.87</b>	<b>1.88</b>	<b>1.89</b>	<b>1.89</b>	<b>1.90</b>	<b>1.91</b>	<b>1.92</b>	<b>1.93</b>	<b>1.94</b>	<b>1.95</b>
<b>1 x 2.5 MVA</b>	<b>Total Winter</b>		<b>0.43</b>	<b>0.44</b>	<b>0.44</b>	<b>0.44</b>	<b>0.45</b>	<b>0.45</b>	<b>0.46</b>	<b>0.46</b>	<b>0.47</b>	<b>0.47</b>	<b>0.48</b>
<b>1.0 Firm</b>	<b>Winter Base</b>	<b>1.0% Growth</b>	0.43	0.44	0.44	0.44	0.45	0.45	0.46	0.46	0.47	0.47	0.48
<b>MON</b>	<b>Summer Base</b>	<b>1.5% Growth</b>	0.56	0.57	0.58	0.59	0.59	0.60	0.61	0.62	0.63	0.64	0.65
	<b>Irrigation Base</b>	<b>100% Diversity</b>	1.30	1.30	1.30	1.30	1.30	1.30	1.30	1.30	1.30	1.30	1.30



		Year	2015/16	2016/17	2017/18	2018/19	2019/20	2020/21	2021/22	2022/23	2023/24	2024/25	2025/26
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Mt Hutt</b>	<b>Total Summer</b>		<b>0.56</b>	<b>0.56</b>	<b>0.56</b>	<b>0.56</b>	<b>0.56</b>	<b>0.56</b>	<b>0.56</b>	<b>0.56</b>	<b>0.56</b>	<b>0.56</b>	<b>0.56</b>
1 x 5 MVA	<b>Total Winter</b>		<b>2.30</b>	<b>2.30</b>	<b>2.30</b>	<b>2.30</b>	<b>2.30</b>	<b>2.30</b>	<b>2.30</b>	<b>2.30</b>	<b>2.30</b>	<b>2.30</b>	<b>2.30</b>
2.0 Firm	<b>Winter Base</b>		2.30	2.30	2.30	2.30	2.30	2.30	2.30	2.30	2.30	2.30	2.30
<b>MHT</b>	<b>Summer Base</b>		0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50
	<b>Irrigation Base</b>		0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Mt Somers</b>	<b>Total Summer</b>		<b>3.36</b>	<b>3.38</b>	<b>3.40</b>	<b>3.42</b>	<b>3.43</b>	<b>3.51</b>	<b>3.53</b>	<b>3.55</b>	<b>3.56</b>	<b>3.58</b>	<b>3.60</b>
1 x 2.5 MVA	<b>Total Winter</b>		<b>2.24</b>	<b>2.26</b>	<b>2.28</b>	<b>2.31</b>	<b>2.33</b>	<b>2.35</b>	<b>2.38</b>	<b>2.40</b>	<b>2.42</b>	<b>2.45</b>	<b>2.47</b>
3.0 Firm	<b>Winter Base</b>	1.0% Growth	2.24	2.26	2.28	2.31	2.33	2.35	2.38	2.40	2.42	2.45	2.47
<b>MSM</b>	<b>Summer Base</b>	1.0% Growth	1.66	1.68	1.70	1.72	1.73	1.75	1.77	1.79	1.80	1.82	1.84
	<b>Irrigation Base</b>	100% Diversity	1.70	1.70	1.70	1.70	1.70	1.76	1.76	1.76	1.76	1.76	1.76
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Overdale</b>	<b>Total Summer</b>		<b>15.91</b>	<b>16.03</b>	<b>16.04</b>	<b>16.05</b>	<b>16.06</b>	<b>16.07</b>	<b>16.18</b>	<b>16.19</b>	<b>16.21</b>	<b>16.22</b>	<b>16.23</b>
1 x 10/20 MVA	<b>Total Winter</b>		<b>2.82</b>	<b>2.87</b>	<b>2.93</b>	<b>2.99</b>	<b>3.05</b>	<b>3.11</b>	<b>3.17</b>	<b>3.23</b>	<b>3.30</b>	<b>3.36</b>	<b>3.43</b>
10.0 Firm	<b>Winter Base</b>	2.0% Growth	2.82	2.87	2.93	2.99	3.05	3.11	3.17	3.23	3.30	3.36	3.43
<b>OVD</b>	<b>Summer Base</b>	1.0% Growth	1.11	1.13	1.14	1.15	1.16	1.17	1.18	1.19	1.21	1.22	1.23
	<b>Irrigation Base</b>	100% Diversity	14.80	14.90	14.90	14.90	14.90	14.90	15.00	15.00	15.00	15.00	15.00
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Pendarves</b>	<b>Total Summer</b>		<b>19.10</b>	<b>19.12</b>	<b>19.14</b>	<b>19.15</b>	<b>19.17</b>	<b>19.19</b>	<b>19.21</b>	<b>19.33</b>	<b>19.34</b>	<b>19.36</b>	<b>19.38</b>
2 x 10/20 MVA	<b>Total Winter</b>		<b>3.17</b>	<b>3.23</b>	<b>3.30</b>	<b>3.36</b>	<b>3.43</b>	<b>3.50</b>	<b>3.57</b>	<b>3.64</b>	<b>3.71</b>	<b>3.79</b>	<b>3.86</b>
25.0 Firm	<b>Winter Base</b>	2.0% Growth	3.17	3.23	3.30	3.36	3.43	3.50	3.57	3.64	3.71	3.79	3.86
<b>PDS</b>	<b>Summer Base</b>	1.0% Growth	1.70	1.72	1.74	1.75	1.77	1.79	1.81	1.83	1.84	1.86	1.88
	<b>Irrigation Base</b>	100% Diversity	17.40	17.40	17.40	17.40	17.40	17.40	17.40	17.50	17.50	17.50	17.50
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Seafield</b>	<b>Total Summer</b>		<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>
1 x 5/10 MVA	<b>Total Winter</b>		<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>	<b>8.90</b>
5.0 Firm	<b>Winter Base</b>		8.90	8.90	8.90	8.90	8.90	8.90	8.90	8.90	8.90	8.90	8.90
<b>SFD</b>	<b>Summer Base</b>		8.90	8.90	8.90	8.90	8.90	8.90	8.90	8.90	8.90	8.90	8.90
	<b>Irrigation Base</b>		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	GXP		66	66	66	66	66	66	66	66	66	66	66
<b>Wakanui</b>	<b>Total Summer</b>		<b>11.46</b>	<b>11.58</b>	<b>11.59</b>	<b>11.61</b>	<b>11.62</b>	<b>11.64</b>	<b>11.65</b>	<b>11.67</b>	<b>11.68</b>	<b>11.70</b>	<b>11.71</b>
1 x 10/15 MVA	<b>Total Winter</b>		<b>1.73</b>	<b>1.75</b>	<b>1.77</b>	<b>1.79</b>	<b>1.80</b>	<b>1.82</b>	<b>1.84</b>	<b>1.86</b>	<b>1.88</b>	<b>1.90</b>	<b>1.92</b>
10.0 Firm	<b>Winter Base</b>	1.0% Growth	1.73	1.75	1.77	1.79	1.80	1.82	1.84	1.86	1.88	1.90	1.92
<b>WNU</b>	<b>Summer Base</b>	1.0% Growth	1.46	1.48	1.49	1.51	1.52	1.54	1.55	1.57	1.58	1.60	1.61
	<b>Irrigation Base</b>	100% Diversity	10.00	10.10	10.10	10.10	10.10	10.10	10.10	10.10	10.10	10.10	10.10
	<b>Peak Loss</b>	<b>Summer 33</b>	2.71	0.94	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
(Estimated)	<b>Summer 66</b>	5.0% Growth	2.81	3.40	4.04	4.24	4.45	4.68	4.91	5.15	5.41	5.68	5.97
	<b>Total Summer</b>		5.52	4.34	4.04	4.24	4.45	4.68	4.91	5.15	5.41	5.68	5.97
	<b>Winter 33</b>	3.0% Growth	2.41	0.80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	<b>Winter 66</b>	0.1% Growth	1.92	2.32	2.72	2.72	2.72	2.73	2.73	2.73	2.74	2.74	2.74
	<b>Total Winter</b>		4.32	3.12	2.72	2.72	2.72	2.73	2.73	2.73	2.74	2.74	2.74

<b>OVERALL</b>	<b>Summer Load</b>	<b>excl Gen</b>	<b>176.9</b>	<b>177.1</b>	<b>179.8</b>	<b>180.6</b>	<b>181.6</b>	<b>182.6</b>	<b>183.7</b>	<b>184.7</b>	<b>185.7</b>	<b>186.7</b>	<b>187.5</b>
<b>TOTALS</b>	<b>220.0 Firm</b>	Diversity	86%	86%	86%	86%	86%	86%	86%	86%	86%	86%	86%
		<b>excl Gen (Low)</b>	<b>176.9</b>	<b>177.1</b>	<b>179.8</b>	<b>180.6</b>	<b>181.6</b>	<b>182.6</b>	<b>183.7</b>	<b>184.7</b>	<b>185.7</b>	<b>186.7</b>	<b>187.5</b>
		Diversity	86%	86%	86%	86%	86%	86%	86%	86%	86%	86%	86%
	Ashburton 33		24.3	15.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	<b>60.0 Firm</b>	<b>excl Gen</b>	24.3	15.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		Diversity	98%	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%
	Ashburton 66		152.3	160.4	177.8	178.6	179.6	180.5	181.6	182.6	183.6	185.7	186.5
	<b>220.0 Firm</b>	<b>excl Gen</b>	153.3	161.4	176.2	177.0	180.6	181.5	182.6	183.6	184.6	186.7	187.5
		Diversity	85%	85%	86%	86%	86%	86%	86%	86%	86%	86%	86%
	Irrigation	<b>High</b>	143.0	143.8	147.2	147.3	147.6	147.9	148.3	148.6	148.9	149.1	149.9
		Diversity	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%
		<b>Low</b>	143.0	143.1	145.0	143.6	142.4	141.3	140.1	138.9	137.7	136.4	134.9
		Diversity	100%	99%	98%	97%	96%	95%	94%	93%	92%	91%	90%
	Generation (S)		-1.0	-1.0	-1.0	-1.0	-1.0	-1.0	-1.0	-1.0	-1.0	-1.0	-1.0
	<b>Winter Load</b>	<b>81% of Subs</b>	<b>68.7</b>	<b>68.8</b>	<b>69.7</b>	<b>70.8</b>	<b>72.0</b>	<b>73.2</b>	<b>74.4</b>	<b>75.7</b>	<b>77.0</b>	<b>78.3</b>	<b>79.6</b>
	<b>220.0 Firm</b>	Diversity	77%	77%	77%	77%	77%	77%	77%	77%	77%	77%	77%
	Ashburton 33	<b>83% of Subs</b>	30.4	16.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	<b>60.0 Firm</b>	<b>excl Gen</b>	30.4	16.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		Diversity	83%	83%	83%	83%	83%	83%	83%	83%	83%	83%	83%
	Ashburton 66	<b>85% of Subs</b>	12.7	27.6	45.1	46.3	47.5	48.8	50.1	51.4	52.8	54.2	55.6
	<b>220.0 Firm</b>	<b>excl Gen</b>	41.2	56.1	71.3	72.5	73.7	75.0	76.2	77.5	78.8	80.2	81.6
		Diversity	85%	85%	85%	85%	85%	85%	85%	85%	85%	85%	85%
	Generation (W)		-28.5	-28.5	-28.5	-28.5	-28.5	-28.5	-28.5	-28.5	-28.5	-28.5	-28.5
		- Load exceeds the current firm capacity of the substation (if a transformer fails).											
	This is only one of many possible future scenarios. It is possible the load transfer between 33kV and 66kV will not occur as shown.												



It should be noted that the firm capacity referred to in the table above is the present firm capacity (steady state and switched) and this will change with development in the network (both subtransmission and distribution development). The pink highlight is used to show the point at which load will exceed firm capacity if nothing is done. Many of the firm capacity constraints are addressed by network development projects during the plan period.

The load forecasts assume a dry year (low diversity) as that is the demand the network must cope with and when the irrigation capacity is most needed. The risk of irrigation load either remaining static or falling because of surface irrigation scheme piping has resulted in a change of approach for load estimation. The normal and dry year estimates are average and this is used as the realistic load estimate for subtransmission planning. Future individual zone substation loads are assessed using non-diverse load estimates.

The two charts shown below represent load duration data for the 2015-16 year so far. The charts show the seasonal sensitivity of the 66kV GXP when compared to the 33kV GXP. A marked transition occurs from summer high loads to base winter loads where Highbank generation (20-26 MW) is running. The loads below 40 MW have both voltages at a similar load gradient. The second (frequency distribution) chart has two distinct 'humps' that show the winter load (29-62 MW) and summer load (70-177 MW). A considerable amount of productive 'growing' time is spent beyond 150 MW and the irrigation consumers causing this peak have indicated they are prepared to pay for the assets (both EA Networks and Transpower) necessary to avoid load control of the absolute peak load. The summer of 2015-16 was dry and this caused a very low diversity compared to the past few years. The actual summer peak (177MW) was very similar to that predicted for a dry year and was not unexpected. Had 2015-16 been a normal/wet summer, EA Networks would have predicted a peak load of about 160 MW.

190 hours were spent above 160 MW during 2015-16 (26 hours 2014-15).

33 hours were spent above 170 MW during 2015-16 (none 2014-15).

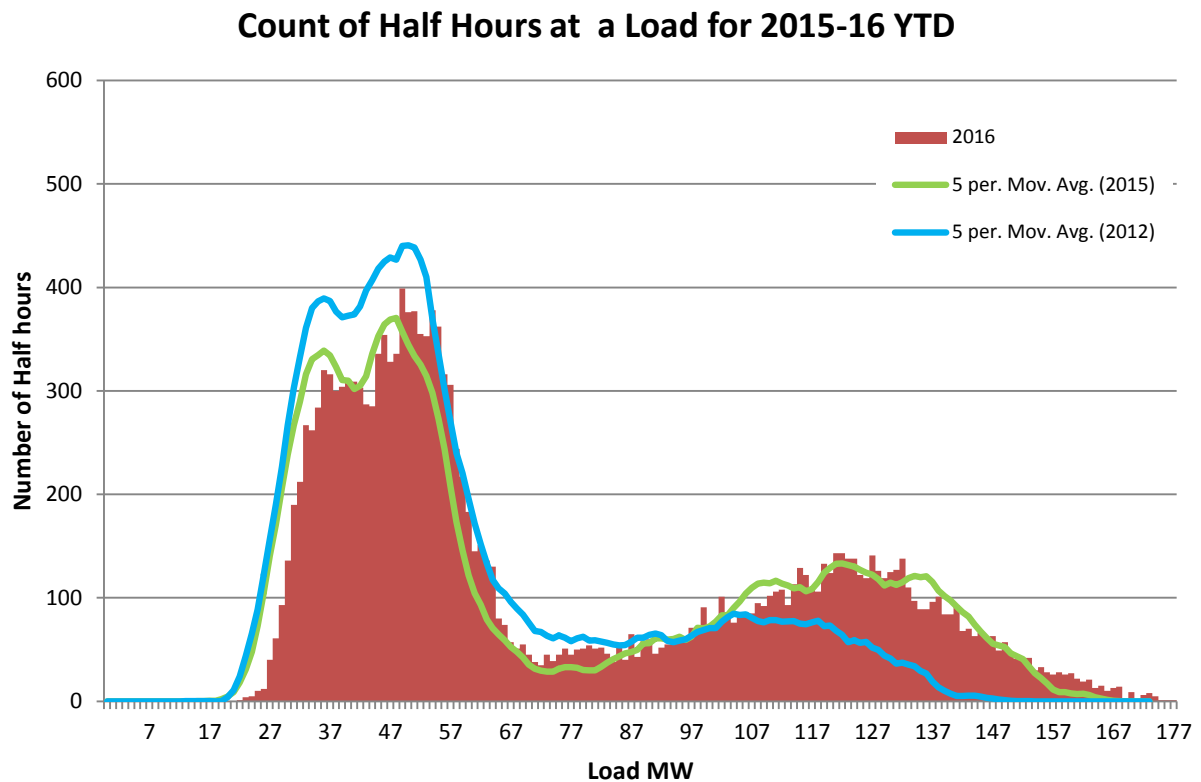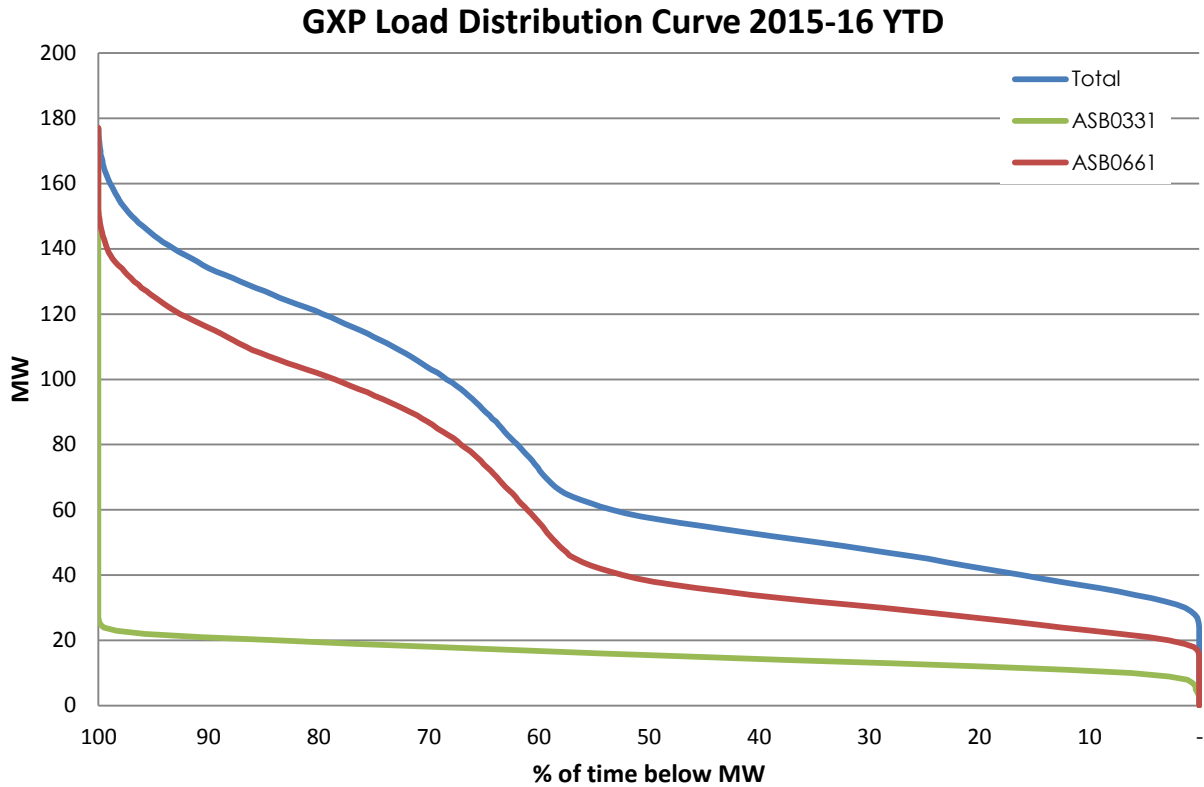

EA Networks have reached a point in time where some of the underlying assumptions about summer load growth have changed. The total amount of water that can be abstracted from underground aquifers in much of Mid Canterbury has reached the limit stipulated by ECAN. This forces other sources of water to be sought. These other sources are typically obtained from storage regimes and water conservation from existing river abstraction schemes. The piping of existing open race schemes can have a twofold effect:

- (1) The losses from open race systems are eliminated and that water is now available to the scheme as 'new' water.
- (2) The pipe system is gravity pressurised for most of its length and this allows existing electrical surface pumps to be relinquished or saved only for a dry year. It also can permit some small hydro generation options.

Some of the farms that have 'new' surface water available are existing deep well irrigators with a water abstraction consent and a large electrical pump. This deep well water consent is to some degree portable in that the water is no longer taken from the aquifer so another farmer can apply for the consent to take water from the same aquifer. Initially it is likely that the original consent holder will retain the consent and deep well pump to guarantee reliability of water supply during drought conditions (river based schemes may be restricted). If the piped gravity scheme proves to be reliable, the electrical demand from the deep well pump may shift to a less traditional irrigation area that is less well serviced for this type of demand by EA Networks. Overall the demand for water will remain high and it is very unlikely the total electrical pumping demand will remain fall in the medium term although the growth rate in irrigation demand will be significantly lower than in recent years.

The other environmental issue that constrains rural intensification is that of nutrient run-off. At the time of writing, ECAN have released a decision on a variation to the Regional Water Plan that:

- precludes almost all additional water abstraction south of the Ashburton River,
- places strict limits on groundwater nitrate levels, and
- places strict limits on the quantity of nitrogen run-off from farming operations.

These additional restrictions have resulted in EA Networks revising down the irrigation load growth potential in all areas of the Ashburton District. The area north of the Ashburton River may have some additional irrigation development but it is likely to be delivered via a gravity pressurised scheme and not electric pumping.

EA Networks are planning on the basis that all available deep well consents will be used and some existing surface electrical pumps will be substituted by gravity pressurised pipe schemes. The level of generation provided by piped schemes is likely to be low (of the order of a few MW) and will not materially affect the GXP load. It may however affect particular zone substation loads and delay the need for transformer upgrades and similar demand-driven asset intensive solutions.

## 10.4 Appendix D - Disclosure Cross-References

To assist people reading this plan in relation to the Electricity Information Disclosure Requirements, a cross-reference list of mandatory items is shown here. This allows the reader to find all items listed in "Attachment A" of the Electricity Information Disclosure Determination 2012 without searching the entire plan.

### 3. The AMP must include the following-

3.1 A summary	<a href="#">Exec. Summary</a>
<b>Background and Objectives</b>	
3.2 Details of the background and objectives of the EDB's asset management and planning processes	<a href="#">s1</a>
3.3 A purpose statement which-	
3.3.1 makes clear the purpose and status of the AMP in the EDB's asset management practices.	<a href="#">s1.3, s1.5</a>
3.3.2 states the corporate mission or vision as it relates to asset management	<a href="#">s1.3, s1.7</a>
3.3.3 identifies the documented plans produced by the annual business planning process	<a href="#">s1.6</a>
3.3.4 how do the different documented plans relate to one another, particularly asset management	<a href="#">s1.6</a>
3.3.5 the interaction of the objectives of the AMP and other corporate goals, business processes, and plans	<a href="#">s1.7</a>
3.4 Details of the AMP planning period	<a href="#">s1.5</a>
3.5 The date that it was approved by the directors	<a href="#">I.F.C.</a>
3.6 A description of stakeholder interests identifying important stakeholders and indicates -	<a href="#">s1.4</a>
3.6.1 how the interests of stakeholders are identified	<a href="#">s1.4</a>
3.6.2 what these interests are	<a href="#">s1.4</a>
3.6.3 how these interests are accommodated in asset management practices	<a href="#">s1.4</a>
3.6.4 how conflicting interests are managed	<a href="#">s2.2</a>
3.7 A description of the accountabilities and responsibilities for asset management on at least 3 levels, including-	
3.7.1 governance	<a href="#">s1.2, s1.6</a>
3.7.2 executive	<a href="#">s1.2</a>
3.7.3 field operations	<a href="#">s1.9</a>
3.8 All significant assumptions	<a href="#">s1.10</a>
3.8.1 quantified where possible	<a href="#">s1.10</a>
3.8.2 clearly identified in an understandable manner to interested persons, including	<a href="#">s1.10</a>
3.8.3 a description of changes proposed where the information is not based on the EDB's existing business	<a href="#">s1.10.3</a>
3.8.4 the sources of uncertainty and the potential effect of the uncertainty on the prospective information	<a href="#">s1.10</a>
3.8.5 the price inflator assumptions used to prepare nominal New Zealand dollar costs	<a href="#">s1.10.6</a>
3.9 Factors that may lead to a material difference (disclosed vs future actual)	<a href="#">s1.10, s9.1</a>

3.10 An overview of asset management strategy and delivery	<a href="#">s1.7</a>
3.11 An overview of systems and information management data	<a href="#">s1.8</a>
3.12 Any limitations in the asset management data and any data improvement initiatives	<a href="#">s1.8</a>
3.13 A description of the processes used within the EDB for-	
3.13.1 managing routine asset inspections and network maintenance	<a href="#">s4.2.5</a> , <a href="#">s4</a>
3.13.2 planning and implementing network development projects	<a href="#">s5.1.6</a> – <a href="#">s5.1.7</a>
3.13.3 measuring network performance.	<a href="#">s9</a>
3.14 An overview of asset management documentation, controls and review processes	Not Available
3.15 An overview of communication and participation processes	Not Available
3.16 AMP must present all financial values in constant price NZD except where specified otherwise;	Compliant
3.17 The AMP must be structured and presented to support the purposes of AMP disclosure (clause 2.6.2)	Compliant

#### Assets covered

#### 4. The AMP must provide details of the assets covered, including-

4.1 a high-level description of the service areas covered, including-	
4.1.1 the region(s) covered	<a href="#">s3.1</a>
4.1.2 identification of large consumers that have a significant impact on the network	<a href="#">s3.1</a>
4.1.3 description of the load characteristics for different parts of the network	<a href="#">s3.1</a>
4.1.4 peak demand and total energy delivered in the previous year	<a href="#">s3.1</a> , <a href="#">s1.1</a>
4.2 a description of the network configuration, including-	<a href="#">s3.2</a>
4.2.1 GXPs and any DG greater than 1 MW inc. firm supply capacity and current peak load;	<a href="#">s3.2.1</a>
4.2.2 subtransmission system off each GXP, and security/capacity of zone substations.	<a href="#">s3.2.2</a> , <a href="#">s3.2.3</a>
4.2.3 a description of the distribution system, including the extent to which it is underground;	<a href="#">s3.2.4</a>
4.2.4 a brief description of the network's distribution substation arrangements;	<a href="#">s3.2.4</a>
4.2.5 a description of the low voltage network including the extent to which it is underground; and	<a href="#">s3.2.4</a>
4.2.6 assets such as protection relays, ripple injection systems, SCADA and telecommunications systems.	<a href="#">s3.2.5</a>
4.3 sub-networks as per subclause 4.2.	

#### Network assets by category

4.4 The AMP must describe the network assets by providing the following information for each asset category-	
4.4.1 voltage levels;	<a href="#">s4.3</a> – <a href="#">s4.15</a>
4.4.2 description and quantity of assets;	<a href="#">s4.3</a> – <a href="#">s4.15</a>
4.4.3 age profiles; and	<a href="#">s4.3</a> – <a href="#">s4.15</a>
4.4.4 condition of the assets	<a href="#">s4.3</a> – <a href="#">s4.15</a>
4.5 The asset categories discussed in subclause 4.4 above should include at least the	

following-	
4.5.1 Sub transmission	<a href="#">s4.3</a>
4.5.2 Zone substations	<a href="#">s4.7</a>
4.5.3 Distribution and LV lines	<a href="#">s4.4.1</a> , <a href="#">s4.5.1</a>
4.5.4 Distribution and LV cables	<a href="#">s4.4.2</a> , <a href="#">s4.5.3</a>
4.5.5 Distribution substations and transformers	<a href="#">s4.8</a> , <a href="#">s4.9</a>
4.5.6 Distribution switchgear	<a href="#">s4.10</a> , <a href="#">s4.11</a>
4.5.7 Other system fixed assets	<a href="#">s4.12</a> , <a href="#">s4.13</a> , <a href="#">s4.14</a> , <a href="#">s4.15</a>
4.5.8 Other assets;	<a href="#">s6.1</a>
4.5.9 Assets owned by the EDB but installed at bulk electricity supply points owned by others;	<a href="#">s4.15</a>
4.5.10 Reliability and security mobile substations and generators; and	Not Applicable
4.5.11 Other generation plant owned by the EDB.	Not Applicable

### Service Levels

<b>5. A set of performance indicators.</b>	<a href="#">s2.4</a>
<b>6. Performance indicators SAIDI and SAIFI values for the next 5 disclosure years.</b>	<a href="#">s2.4.1</a> , <a href="#">s2.4.2</a>
<b>7. Performance indicators for which targets have been defined in clause 5 above should also include-</b>	
7.1 Consumer oriented indicators that preferably differentiate between different consumer types;	<a href="#">s2.4</a>
7.2 Indicators of asset performance, asset efficiency and effectiveness, and service efficiency.	<a href="#">s2.4</a>
<b>8. Basis on which the target level for each performance indicator was determined.</b>	<a href="#">s2.2</a> , <a href="#">s2.3</a>
<b>9. Targets should be compared to historic values where available to provide context and scale to the reader.</b>	<a href="#">s2.4.1</a>
<b>10. Forecast expenditure materially affecting performance vs target - expected change.</b>	<a href="#">s2.4.2</a>

### Network Development Planning

<b>11. AMPs must provide a detailed description of network development plans, including-</b>	
11.1 A description of the planning criteria and assumptions for network development;	<a href="#">s5.1</a> , <a href="#">s5.2</a>
11.2 Planning criteria for network developments should be described logically and succinctly;	Compliant
11.3 Strategies or processes promoting cost efficiency;	<a href="#">s5</a> By Asset Category
11.4 The use of standardised designs may lead to improved cost efficiencies.	<a href="#">s5.1.4</a>
11.4.1 the categories of assets and designs that are standardised;	<a href="#">s5.1.4</a>
11.4.2 the approach used to identify standard designs.	<a href="#">s5.1.4</a>
11.5 Energy efficiency strategies or processes.	<a href="#">s5.3</a>
11.6 Equipment capacity for different types of assets or different parts of the network.	<a href="#">s5</a> By Asset Category
11.7 Prioritising network development projects.	<a href="#">s5.1.9</a>
11.8 Demand forecasts - basis, constraint locations;	<a href="#">s5.2</a> , <a href="#">Appendix C</a>
11.8.1 load forecasting methodology and factors;	<a href="#">s5.2</a> , <a href="#">Appendix C</a>

11.8.2 forecasts to zone substation. Uncertain but substantial load accounted in forecasts;	<a href="#">s5.2</a> , <a href="#">Appendix C</a>
11.8.3 network or equipment constraints; and	<a href="#">s5</a> By Asset Category
11.8.4 DG and demand management impact on the load forecasts.	<a href="#">s5.2</a> , <a href="#">s5.4.12</a> <a href="#">Appendix C</a> ,
11.9 Significant network level development options identified satisfying target levels of service, including-	<a href="#">s5.3</a>
11.9.1 the reasons for choosing a selected option for projects where decisions have been made;	<a href="#">s5.3</a>
11.9.2 alternative options for projects planned within five years and any non-network solutions;	<a href="#">s5</a> By Project and <a href="#">s5.1.8</a>
11.9.3 planned innovations that improve efficiencies, utilisation, asset lives, and defer investment.	Various locations
11.10 Network development programme inc. DG and non-network with expenditure. Must include-	<a href="#">s5.3</a> , <a href="#">s5.4</a> , <a href="#">Appendix B</a>
11.10.1 detailed description of projects underway or planned to start within the next 12 months;	<a href="#">s5.4</a> by Project
11.10.2 summary description of programmes/projects for the following four years; and	<a href="#">s5.4</a> by Project
11.10.3 overview of the big projects being considered for the remainder of the AMP planning period.	<a href="#">s5.4</a> by Project
11.11 EDB's policies on distributed generation.	<a href="#">s5.4.12</a>
11.12 A description of the EDB's policies on non-network solutions, including-	<a href="#">s5.1.8</a>
11.12.1 economically feasible and practical alternatives to conventional network augmentation; and	<a href="#">s5.1.8</a>
11.12.2 the potential for non-network solutions to address network problems or constraints.	<a href="#">s5.1.8</a> , <a href="#">s5.2.3</a> , <a href="#">s5.4.1</a> , <a href="#">s5.4.3</a> by Project

### Lifecycle Asset Management Planning (Maintenance and Renewal)

#### 12. The AMP must provide a detailed description of the lifecycle asset management processes, including-

12.1 The key drivers for maintenance planning and assumptions;	<a href="#">s4.2</a>
12.2 Routine and corrective maintenance and inspection policies/programmes/actions per asset category, must include-	<a href="#">s4</a>
12.2.1 approach to inspecting/maintaining each asset category - inspection types/tests/monitoring/intervals;	<a href="#">s4.3</a> – <a href="#">s4.15</a>
12.2.2 systemic problems identified per asset types and proposed actions to address these problems; and	<a href="#">s4.3</a> – <a href="#">s4.15</a>
12.2.3 budgets for maintenance activities broken down by asset category for the AMP planning period.	<a href="#">s8.2</a>
12.3 Asset replacement and renewal policies/programmes/actions per asset category, inc. expenditure. Must include-	<a href="#">s4</a>
12.3.1 processes used to decide when and whether an asset is replaced or refurbished;	<a href="#">s4.2</a> , <a href="#">s4.3</a> – <a href="#">s4.15</a>
12.3.2 a description of innovations made that have deferred asset replacement;	<a href="#">s4.2</a> , <a href="#">s4.3</a> – <a href="#">s4.15</a>
12.3.3 a description of the projects currently underway or planned for the next 12 months;	<a href="#">s4.3</a> – <a href="#">s4.15</a>



12.3.4 a summary of the projects planned for the following four years (where known); and	<a href="#">s4.3</a> – <a href="#">s4.15</a>
12.3.5 an overview of other work being considered for the remainder of the AMP planning period.	<a href="#">s4.3</a> – <a href="#">s4.15</a>
12.4 Asset categories in subclauses 12.2 and 12.3 should include at least the categories in subclause 4.5 above.	Compliant
<b>Non-Network Development, Maintenance and Renewal</b>	
<b>13. Description of material non-network development, maintenance and renewal plans, including-</b>	<a href="#">s6</a>
13.1 a description of non-network assets;	<a href="#">s6.1</a>
13.2 development, maintenance and renewal policies that cover them;	<a href="#">s6.2</a>
13.3 a description of material capital expenditure projects (where known) planned for the next five years;	<a href="#">s6.3</a> , <a href="#">Appendix G</a>
13.4 a description of material maintenance and renewal projects (where known) planned for the next five years.	<a href="#">s6.3</a> , <a href="#">Appendix G</a>
<b>Risk Management</b>	
<b>14. AMPs must provide details of risk policies, assessment, and mitigation, including-</b>	<a href="#">s7</a>
14.1 Methods, details and conclusions of risk analysis;	<a href="#">s7.4</a>
14.2 Strategies to identify areas vulnerable to high impact low probability events;	<a href="#">s7.4</a>
14.3 A description of the policies to mitigate or manage the risks of events identified in subclause 16.2;	<a href="#">s7.5</a>
14.4 Details of emergency response and contingency plans.	<a href="#">s7.5</a>
<b>Evaluation of performance</b>	
<b>15. AMPs must provide details of performance measurement, evaluation, and improvement, including-</b>	
15.1 A review of progress against plan, both physical and financial;	<a href="#">s9.1</a>
15.2 An evaluation and comparison of actual service level performance against targeted performance;	<a href="#">s9.2</a>
15.3 AMMAT evaluation and comparison vs objectives of the EDB's asset management and planning processes.	<a href="#">s9.4</a>
15.4 Gap analysis from AMMAT and performance. Planned initiatives to address the situation.	<a href="#">s9.3</a> , <a href="#">s9.4</a> , <a href="#">s9.5</a> , <a href="#">s9.6</a>
<b>Capability to deliver</b>	
<b>16. AMPs must describe the processes used by the EDB to ensure that-</b>	
16.1 The AMP is realistic and the objectives set out in the plan can be achieved;	<a href="#">s9.7</a>
16.2 Organisation structure and processes for authorisation/business capabilities to support AMP implementation.	<a href="#">s9.7</a>

Please note that this list does not include explicit references to every passage in the plan that has some relevance to each mandatory item. For readability, EA Networks have chosen to discuss different aspects of some mandatory items in discrete places - where they are relevant. Complete understanding of the plan's concepts and direction requires digestion of the plan as a whole.

## 10.5 Appendix E – Large Consumer Dialogue Questionnaire

This following questionnaire is used by an external agency engaged by EA Networks to assess the satisfaction that large consumers have with EA Networks. The most recent use of this was February 2009. Another Large Consumer survey will be performed in 2015.

---



---

### EA NETWORKS CONSUMER ENGAGEMENT INTERVIEW GUIDE

Interview No. \_\_\_\_\_

Name \_\_\_\_\_

Date \_\_\_\_\_

Survey conducted on behalf of EA Networks with a sample of major users. EA Networks directors have commissioned this project as part of their on-going commitment to satisfying their consumers' needs. EA Networks is basically looking for an independent assessment of consumer opinions regarding its performance with regard to all aspects of its relationships as well as opportunities for improvement.

Results of this survey are confidential to the Directors of EA Networks as well as senior executive staff. You are free to choose whether or not your individual comments are quoted in our report. This interview is expected to take about 20-30 minutes.

#### (A) Initial impressions

1. What image does EA Networks project in its dealings with your organisation?

\_\_\_\_\_

2. Do you think that EA Networks has the needs and best interests of its consumers at heart?

\_\_\_\_\_

#### (B) Ranking of service expectations and (C) EA Networks performance ratings

3. What are your expectations of service from EA Networks? What do you really need from them? (Probe/rank in order of importance)
4. How well has EA Networks performed in terms of your expectations? (1-10 rating scale where 1 = Poor, 5 = OK and 10 = Excellent)

(1) \_\_\_\_\_

(2) \_\_\_\_\_

(3) \_\_\_\_\_

(4) \_\_\_\_\_

(5) \_\_\_\_\_

\_\_\_\_\_

#### (D) Overall performance rating

5. Using the same rating scale can you give an overall performance rating for service received from EA Networks?




---

**(E) Planned supply interruption**

6. EA Networks allows for a maximum of three planned outages (supply interruptions) each year in order to conduct maintenance or upgrade work on its network.

Is this number reasonable? \_\_\_\_\_

What would be more reasonable? \_\_\_\_\_

7. EA Networks expects planned outages will on average last for around five hours each time.

Is this amount of time reasonable? \_\_\_\_\_

What amount of time would be more reasonable? \_\_\_\_\_

8. Have you received advice of a planned electricity outage during the past six months?

Yes

No

**If Yes:**

Were you satisfied with the amount of information given?

Yes

No

Did you feel you were given enough notice of this planned outage?

Yes

No

**If Yes/No:**

How much notice of planned outages would you prefer to be given?

Yes

No

**(F) Unexpected supply interruptions**

9. Have you had an unexpected interruption to your power supply during the last six months?

Yes

No

How long did it take for your power to be restored after your most recent experience?

\_\_\_\_\_

\_\_\_\_\_

What amount of time is reasonable? \_\_\_\_\_

10. Who would you contact in the event of power supply to your business being unexpectedly interrupted?

EA Networks

Retailer

Have you made such a call within the last 6 months?

Yes

No

**If Yes:**

Were you satisfied that the system worked in getting you through to the right person?

What could be done to improve this system?

Were you satisfied with the information that you received?

What could be done to improve this information or the way it was delivered?

**(G) Supply upgrades**

11. How satisfied are you with the process used by EA Networks for dealing with supply upgrades?

1 = Very Poor, 5 = OK, 10 = Very Satisfied

What specifically could be improved?

12. How satisfied are you with the options offered to you by EA Networks regarding supply upgrades?

1 = Very Poor, 5 = OK, 10 = Very Satisfied

What specifically could be improved?

**(H) Price/Quality trade offs**

13. Has your electricity supplier offered you either:

(A) Alternative supply configurations

Yes

No

or (B) Alternative pricing options for controllable load

Yes No 

**If Yes:** Obtain details of offers an indication as to whether or not they were taken up.

---

**(I) Line charges/reliability**

14. Would you consider paying a higher line charge for a more reliable power supply (or vice versa)?

Imagine, if you were to receive half the number of interruptions than you do now,

would you be prepared to pay

10%	20%	50%	100%
-----	-----	-----	------

more than you pay now?

---

**(J) Strengths/Weaknesses**

15. What do you consider that EA Networks does really well?

---

16. What can be improved? How can the service provided by EA Networks be made better?

---

**(K) Wrap up**

17. Are there any other issues relating to your relationship with EA Networks which you wish to raise?

---

**That concludes our interview. Thank you very much for your time.**

In addition to the external survey, meetings are held between EA Networks personnel and major consumers on an as-required basis. The minutes for such a meeting are recorded and form the action plan for both parties. A sample of the minutes of such a meeting are as follows. The details of the specific consumer have been excluded. In future, these meetings are likely to be facilitated by the Commercial Division of EA Networks with technical assistance from the Network Division as required.



## NETWORK ENGAGEMENT WITH CONSUMER

**Meeting Date:** 28/2/06      **Time:** 09:00      **ICP No:**#####

**Consumer:** Large Consumer #1

**Persons Present:** Consumer Representative, B Quinn, R Rapley, K Stirling.

### Discussion Topics

<b>Quality of supply:</b>	<b>Action</b>	<b>Date</b>
No issues, electronic systems have UPS.		

**Reliability of Supply:**  
Very few outages experienced and happy with response.

**Security of Supply:**  
Appears to be adequate as is.

**Price/Quality Trade off:**  
On the basis of current reliability the consumer considers it unnecessary to upgrade or extend the existing supply configuration.

**Future Growth and Requirements:**  
The consumer is currently upgrading its heating systems and replacing the older large hot water storage system with individual heat pump systems. Energy consumption is expected to fall.

**General Business**  
The substation site was inspected and the area is to be cleared with new work soon to be started. This should provide clear access to the substation. The site of a new switching station was looked at and agreed that the planned location was acceptable.

**Next Meeting:** Date March 2007.

## 10.6 Appendix F – Customer Engagement Statement

The following is an extract from the EA Networks 'Customer Engagement Statement' of 2006. It has been approved by the Board as an accurate description of the processes used in customer consultation.

Compliance requirement	Large customer activities	Mass-market activities
<p>6(1)(c)(i) properly advise (or ensure that another person properly advises on its behalf) its customers (or another person that accurately reflects the interests of those customers) about the price and quality trade-offs available to them in relation to the goods and services provided by the distribution business.</p>	<ul style="list-style-type: none"> <li>• EAL meets with customers (or their representative) seeking a new or significantly altered physical connection to discuss options for precise location, asset configuration, connection rating and pricing options.</li> <li>• EAL regularly meets with large customers to discuss price and quality issues.</li> <li>• Key reliability measures are defined in Page 11 of the 2005 AMP available from the EAL website.</li> <li>• The quality service targets that each class of consumer might reasonably expect are discussed in section 2.4.1 of the 2005 AMP on the EAL website.</li> <li>• Detailed comparisons of actual and target quality service performance over the last 8 years along with explanations are included in section 2.4.2 of the 2005 AMP on EAL's website.</li> <li>• Service levels are broadly discussed in EAL's Annual Report and at the company's Annual General Meeting.</li> </ul>	<ul style="list-style-type: none"> <li>• EAL meets with customers (or their representative) seeking a new or significantly altered physical connection to discuss options for precise location, asset configuration, connection rating and pricing options.</li> <li>• EAL offers a number of controlled pricing options that provide customers with a choice of quality (controlled interruption) and price.</li> <li>• Key reliability measures are defined on Page 11 of the 2005 AMP available from the EAL website.</li> <li>• The quality service targets that each class of consumer might reasonably expect are discussed in section 2.4.1 of the 2005 AMP on the EAL website.</li> <li>• Detailed comparisons of actual and target quality service performance over the last 8 years along with explanations are included in section 2.4.2 of the 2005 AMP on EAL's website.</li> <li>• Service levels are broadly discussed in EAL's Annual Report and at the company's Annual General Meeting.</li> </ul>
Compliance requirement	Large customer activities	Mass-market activities
<p>6(1)(c)(ii) consult (or ensure that another person consults on its behalf) with those customers (or another person that accurately reflects the interests of those customers) about the quality of goods and services that they require, with reference to the price of those goods and services.</p>	<ul style="list-style-type: none"> <li>• EAL regularly meets with large customers to discuss price and quality issues.</li> </ul>	<ul style="list-style-type: none"> <li>• Through a survey of mass-market consumers.</li> <li>• EAL has sought the views of electricity retailers operating on EAL's network.</li> <li>• EAL has sought the views of the local economic development agency Enterprise Ashburton as to whether EAL is providing reliable and appropriately priced community infrastructure to the general business community, including commercial customers that are not large enough to fall within the definition of "large".</li> <li>• EAL sought the views of Federated Farmers on whether EAL was providing a reliable and reasonably priced rural</li> </ul>

		<p>electricity supply, but no response was ever received.</p> <ul style="list-style-type: none"> <li>EAL sought the views of GreyPower on whether EAL is providing a reliable service at an affordable price as might be evidenced by complaints from members, general grumblings amongst members or being raised as a formal agenda item.</li> <li>The Use of System Agreement with each energy retailer defines the price &amp; quality of supply available to consumers.</li> <li>EAL's Statement Of Corporate Intent contains details of expected service levels and expected revenue (as a reflection of prices) and is presented annually to the Shareholder Committee (representing customer interests).</li> </ul>
<b>Compliance requirement</b>	<b>Large customer activities</b>	<b>Mass-market activities</b>
<p>6(1)(c)(iii) properly consider the views expressed by customers during and after that consultation.</p>	<ul style="list-style-type: none"> <li>Range of quality/price options provided for customers to select the service package most suitable to their individual business operation.</li> </ul>	<ul style="list-style-type: none"> <li>Shareholders Committee meets at least two times during the year to consider price and quality expectancy, targets and performance.</li> <li>Review process within the company's Use of System Agreement provides energy retailers the opportunity to make representation on variations to the published quality service standards and penalty payment regime.</li> <li>Energy retailers provide monthly reports on quality service performance and benchmark against other line companies.</li> <li>Technical staff receives reports from controllers on interruption causes and customer comments.</li> </ul>
<b>Compliance requirement</b>	<b>Large customer activities</b>	<b>Mass-market activities</b>
<p>6(1)(c)(iv) adequately take these views into account when making asset management decisions.</p>	<ul style="list-style-type: none"> <li>Agreed projects included in AMP.</li> </ul>	<ul style="list-style-type: none"> <li>Customer views from above are compared against actual performance and service quality targets.</li> <li>Quality performance is benchmarked against other line companies and industry norms.</li> <li>Network management team meet regularly to discuss and evaluate the cost implications of quality service variations.</li> <li>Target quality service standards are the</li> </ul>



		key driver for determining maintenance schedules and capital development expenditure within the AMP.
--	--	--

### **New Physical Connection Consultation**

When an intending consumer seeks a new physical connection or if an existing consumer seeks a significant alteration to an existing connection, EAL meets with either the consumer or their representative on site to present a range of alternatives on matters that include the following...

- The location of the physical connection.
- The rating of the supply sought.
- The configuration of assets required.
- Pricing options available for the chosen supply configuration.

### **New Physical Connection Consultation – Large Consumers**

EAL meets regularly with its large consumers to discuss a range of issues including price and quality.

Generally consumers report they have no problems with the quality of their supply with some minor incidences of transients. There have been few supply interruptions and consumers are satisfied with the response when they occur. Where possible consumers are offered various price/quality options. In the last two-year period no new alternatives have been taken up although an alternative backup supply option is being evaluated for one consumer.

Consumers have reported some potential for capacity growth and are looking at options such as energy management, standby generation and business continuity planning.

### **Annual General Meeting**

EAL's Annual Report and Annual General Meeting provides a forum to inform interested stakeholders about financial and quality service performance and to receive any concerns about service levels and pricing.

### **Statement of Corporate Intent**

Electricity Ashburton is a co-operative company where all consumers (end users) are also shareholders of the company. A Shareholders Committee is publicly elected to represent shareholders' interests. The role of the Shareholders Committee is to; appoint directors of the company, to receive the annual Statement of Corporate Intent (SCI) and to discuss performance of the company with directors, and to report to shareholders an assessment of performance of the company on a comparative basis against other similar companies. The SCI is the key governance mechanism providing an interface between the shareholders (consumers) and the board.

The election of the Shareholder Committee provides a strong accountability of the Committee members back to the community, hence this is a further process of engaging with a proxy for mass market customers.

When consumer views are required the Shareholders Committee provides the effective voice for consumer/shareholders. Regular consultation occurs between the Board and the Shareholders Committee where any issues of concern are discussed.

The Shareholders Committee receives annually the SCI and associated trend statement that covers both financial (price) and quality performance targets.

## 10.7 Appendix G – Disclosure Schedules

This appendix contains the schedules that are required to be disclosed to the Commerce Commission and the plan **must** “Include, in the AMP or AMP update as applicable, the information contained in each of the reports”. To ensure **all** of the information contained in the schedules is in the plan they have been included here. They are also disclosed in the original formats on the [EA Networks website](#).

Schedule	Description
11a	Report on Forecast Capital Expenditure
11b	Report on Forecast Operational Expenditure
12a	Report on Asset Condition
12b	Report on Forecast Capacity
12c	Report on Forecast Demand
12d	Report on Forecast Interruptions and Duration
13	Report on Asset Management Maturity
14a	Mandatory Explanatory Notes on Forecast Information
17	Certification of Year-beginning Disclosures

### Notes on the schedules:

<b>11a</b>	<ul style="list-style-type: none"> <li>The 12 month forecast values for the current year have been derived by escalating the 10 months of available YTD values by a factor of 1.2.</li> <li>The pages are laid out for A3 portrait printing. The text is small at this scale.</li> </ul>
<b>12a</b>	<ul style="list-style-type: none"> <li>The data in this schedule represents the best assessment of EA Networks' understanding of the requirements, unique asset categorisation and known condition. The “% of asset to be replaced in next 5 years” is a formulaic assessment based on known age which will be refined over time to reflect actual condition if it is obtained.</li> </ul>
<b>12b</b>	<ul style="list-style-type: none"> <li>There is a significant increase in switched transfer capacity in +5yrs at many sites, however there is no way of showing this in the schedule.</li> <li>Several sites have changed feeder open points recently and this may lead to variations in quoted “Current Peak Load” values in different parts of the plan for the same site.</li> </ul>
<b>13</b>	<ul style="list-style-type: none"> <li>The AMMAT report has been presented in a compact manner. If readers wish to see the full template with associated commentary and scoring notes please go to: <a href="http://www.comcom.govt.nz/current-electricity-information-disclosure-requirements/">http://www.comcom.govt.nz/current-electricity-information-disclosure-requirements/</a> and download the “EDB ID Determination AMP Templates” in Excel format.</li> <li>Warning: the default print layout of Schedule 13 requires 24 pages of A3.</li> </ul>



SCHEDULE 11a: REPORT ON FORECAST CAPITAL EXPENDITURE

This schedule requires a breakdown of forecast expenditure on assets for the current disclosure year and a 10 year planning period. The forecasts should be consistent with the supporting information set out in the AMP. The forecast is to be expressed in both constant price and nominal dollar terms. Also required is a forecast of the value of commissioned assets (i.e., the value of RAB additions)
EDBs must provide explanatory comment on the difference between constant price and nominal dollar forecasts of expenditure on assets in Schedule 14a (Mandatory Explanatory Notes). This information is not part of audited disclosure information.

Table with columns for years (31 Mar 16 to 31 Mar 26) and rows for expenditure categories: 11a(i) Expenditure on Assets Forecast (nominal and constant prices), Difference between nominal and constant price forecasts, 11a(ii) Consumer Connection, and 11a(iii) System Growth. Subsections include Consumer connection, System growth, Asset replacement and renewal, Reliability, safety and environment, and Subcomponents of expenditure on assets.

**SCHEDULE 11a: REPORT ON FORECAST CAPITAL EXPENDITURE**

This schedule requires a breakdown of forecast expenditure on assets for the current disclosure year and a 10 year planning period. The forecasts should be consistent with the supporting information set out in the AMP. The forecast is to be expressed in both constant price and nominal dollar terms. Also required is a forecast of the value of commissioned assets (i.e., the value of RAB additions)

EDBs must provide explanatory comment on the difference between constant price and nominal dollar forecasts of expenditure on assets in Schedule 14a (Mandatory Explanatory Notes). This information is not part of audited disclosure information.

sch ref		Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
	for year ended	<b>31 Mar 16</b>	<b>31 Mar 17</b>	<b>31 Mar 18</b>	<b>31 Mar 19</b>	<b>31 Mar 20</b>	<b>31 Mar 21</b>

**11a(v): Asset Relocations**

Project or programme*		\$000 (in constant prices)					
	11kV UG New - 5H1 & Walnut Ave Intersection Re-design	-	-	53	-	-	-
*Include additional rows if needed							
	All other project or programmes - asset relocations	-	-	-	-	-	-
	<b>Asset relocations expenditure</b>	-	-	53	-	-	-
less	Capital contributions funding asset relocations	-	-	53	-	-	-
	<b>Asset relocations less capital contributions</b>	-	-	-	-	-	-

**11a(vi): Quality of Supply**

Project or programme*		\$000 (in constant prices)					
	11-22kV Conversion Programme	-	61	-	-	386	-
	Urban Underground Conversion Programme	60	218	-	-	-	-
	Ashburton 11kV Core Network Programme	-	418	437	437	650	-
	Rural Ring Main Unit Programme	502	776	771	701	675	675
	[11097] Distribution Transformers - Reliability, Safety, Enviro	-	431	11	11	1,042	11
	[10080] [2014] Methven 10MVA 11/22kV Transformer	903	-	-	-	-	-
	TIN New 66kV ZSS - Structural/Electrical	300	-	-	-	-	-
	PDS ZSS - T1/T2 Firewall	-	-	-	-	-	-
	[10955] ZSS TIN - New 66kV Switching Station - Civil Works	559	32	-	-	-	-
	[342] ZSS CRW - 2nd 66/22kV Transformer	-	1,180	-	-	-	-
	[351] ZSS HTH - 22kV Switchboard Extension	-	179	-	-	-	-
	[358] ZSS TIN - 22/11 Transformer and Switchboards	-	998	-	-	-	-
	Protection Relay Upgrade - Stage 1 (Feeder)	70	-	-	-	-	-
	Protection Relay Upgrade - Stage 2 (Transformer)	61	-	-	-	-	-
	[207] 22kV OH New - Gibsons & Smalls Rd - Underbuild	-	99	-	-	-	-
	[206] 22kV OH New - Hepburns Rd	-	62	-	-	-	-
	[233] 22kV OH New - Maronan Road Fill-in	-	54	-	-	-	-
	[234] 22kV OH New - Winslow Westerfield Rd O/H Fill-in	-	187	-	-	-	-
	[10679] 22kV OH New - Rawles Crossing Road - Timaru Track, s3	170	42	-	-	-	-
	[209] 66kV OH New - From FTN66 to Pole 84423 along Cpnry Rd	-	181	-	-	-	-
	[391] 11kV UG New - Mt Somers Back-feed	-	132	-	-	-	-
	[537] 22kV UG New - New Carew ZSS Feeders	-	27	-	-	-	-
	[536] 22kV UG New - New Hackthorne ZSS Feeders	-	27	-	-	-	-
*Include additional rows if needed							
	All other projects or programmes - quality of supply	222	-	53	53	64	53
	<b>Quality of supply expenditure</b>	2,847	5,104	1,272	1,202	2,817	739
less	Capital contributions funding quality of supply	-	-	-	-	-	-
	<b>Quality of supply less capital contributions</b>	2,847	5,104	1,272	1,202	2,817	739

**11a(vii): Legislative and Regulatory**

Project or programme*		\$000 (in constant prices)					
	[521] 33-66kV OH Conversion - Holmes Rd	-	24	-	-	-	-
	[531] ZSS EGN - Seal road frontage	-	13	-	-	-	-
*Include additional rows if needed							
	All other projects or programmes - legislative and regulatory	-	-	-	-	-	-
	<b>Legislative and regulatory expenditure</b>	-	37	-	-	-	-
less	Capital contributions funding legislative and regulatory	-	-	-	-	-	-
	<b>Legislative and regulatory less capital contributions</b>	-	37	-	-	-	-

**11a(viii): Other Reliability, Safety and Environment**

Project or programme*		\$000 (in constant prices)					
	Zone Substation Security and Surveillance	80	-	-	-	-	-
	[380] ZSS CRW - Substation Gate	-	9	-	-	-	-
	[381] ZSS HTH - Substation Gate	-	9	-	-	-	-
	[00216] Convert State Hwy Crossings to UG	-	-	87	-	-	-
*Include additional rows if needed							
	All other projects or programmes - other reliability, safety and environment	18	-	54	54	54	54
	<b>Other reliability, safety and environment expenditure</b>	98	18	141	54	54	54
less	Capital contributions funding other reliability, safety and environment	-	-	-	-	-	-
	<b>Other reliability, safety and environment less capital contributions</b>	98	18	141	54	54	54

**11a(ix): Non-Network Assets**

**Routine expenditure**

Project or programme*		\$000 (in constant prices)					
	[1030] Routine Vehicles	124	120	180	180	180	180
	[1031] Routine Plant	8	10	10	10	10	10
	[1032] Routine Info Tech	197	10	100	100	100	100
	[540] Routine Building Work	-	-	50	50	50	50
	[540] Corporate Vehicle	-	60	-	-	-	-
	[550] Small IT Items	-	46	-	-	-	-
	[542] Website Development	-	50	-	-	-	-
	[214] Urban Orthophoto Update	-	25	-	-	-	30
*Include additional rows if needed							
	All other projects or programmes - routine expenditure	-	-	-	-	-	-
	<b>Routine expenditure</b>	329	321	340	340	340	370

**Atypical expenditure**

Project or programme*		\$000 (in constant prices)					
	Office Building Alterations/Improvements	-	-	-	-	-	-
	Primary Test System for MV and HV Equipment	74	-	-	-	-	-
	Mobility/LTE Trial	1	-	-	-	-	-
	[10915] ZSS MVN - Backup Control Room	-	106	-	-	-	-
	Infrared Thermal Camera	45	-	-	-	-	-
	Survey GPS Unit	-	-	-	-	-	-
	Electrical GIS Implementation	-	-	-	-	-	-
	[541] JCP Management	1	400	-	-	-	-
	Business Intelligence System	100	-	-	-	-	-
	[10982] Document Management System	-	75	-	-	-	-
	Enterprise Resource Planning System	-	-	-	-	-	-
	[448] EV Charging Solution	-	158	-	-	-	-
	[545] Asset Management System	-	100	-	-	-	-
	[547] Core and Storage Switches	-	200	-	-	-	-
	[543] Data Warehouse	-	100	-	-	-	-
	[552] Legal Compliance Software	25	25	-	-	-	-
	[551] Payroll System	-	65	-	-	-	-
	[212] Outage Manager - Control Centre	-	210	-	-	-	-
	[01033] Atypical Information Technology	-	-	500	500	500	500
*Include additional rows if needed							
	All other projects or programmes - atypical expenditure	46	78	130	-	-	-
	<b>Atypical expenditure</b>	292	1,517	630	500	500	500
	<b>Expenditure on non-network assets</b>	621	1,838	970	840	840	870

Company Name **Electricity Ashburton Limited**  
 AMP Planning Period **1 April 2016 – 31 March 2026**

**SCHEDULE 11b: REPORT ON FORECAST OPERATIONAL EXPENDITURE**

This schedule requires a breakdown of forecast operational expenditure for the disclosure year and a 10 year planning period. The forecasts should be consistent with the supporting information set out in the AMP. The forecast is to be expressed in both constant price and nominal dollar terms. EDBs must provide explanatory comment on the difference between constant price and nominal dollar operational expenditure forecasts in Schedule 14a (Mandatory Explanatory Notes). This information is not part of audited disclosure information.

sch ref

		Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5	CY+6	CY+7	CY+8	CY+9	CY+10
	for year ended	31 Mar 16	31 Mar 17	31 Mar 18	31 Mar 19	31 Mar 20	31 Mar 21	31 Mar 22	31 Mar 23	31 Mar 24	31 Mar 25	31 Mar 26
<b>Operational Expenditure Forecast</b>												
<b>\$000 (in nominal dollars)</b>												
7												
8												
9												
10	Service interruptions and emergencies	989	1,067	1,110	1,133	1,158	1,184	1,210	1,236	1,264	1,292	1,320
11	Vegetation management	319	325	338	346	353	271	277	283	289	295	302
12	Routine and corrective maintenance and inspection	535	549	586	613	642	672	702	734	767	801	835
13	Asset replacement and renewal	911	936	989	1,034	1,079	1,122	1,154	1,197	1,241	1,286	1,339
14	<b>Network Opex</b>	<b>2,753</b>	<b>2,877</b>	<b>3,024</b>	<b>3,126</b>	<b>3,232</b>	<b>3,249</b>	<b>3,343</b>	<b>3,450</b>	<b>3,560</b>	<b>3,673</b>	<b>3,796</b>
15	System operations and network support	3,471	3,660	3,912	4,101	4,693	4,785	4,710	5,015	5,238	5,473	5,534
16	Business support	3,351	3,775	4,031	4,222	4,424	4,632	4,734	4,838	4,944	5,053	5,164
17	<b>Non-network opex</b>	<b>6,822</b>	<b>7,435</b>	<b>7,944</b>	<b>8,323</b>	<b>9,117</b>	<b>9,416</b>	<b>9,443</b>	<b>9,852</b>	<b>10,182</b>	<b>10,526</b>	<b>10,698</b>
18	<b>Operational expenditure</b>	<b>9,575</b>	<b>10,312</b>	<b>10,967</b>	<b>11,449</b>	<b>12,349</b>	<b>12,665</b>	<b>12,786</b>	<b>13,302</b>	<b>13,742</b>	<b>14,199</b>	<b>14,495</b>
19												
20												
21												
<b>\$000 (in constant prices)</b>												
22	Service interruptions and emergencies	989	1,067	1,067	1,067	1,067	1,067	1,067	1,067	1,067	1,067	1,067
23	Vegetation management	319	325	325	325	325	244	244	244	244	244	244
24	Routine and corrective maintenance and inspection	535	549	563	577	591	605	619	633	647	661	675
25	Asset replacement and renewal	911	936	951	974	994	1,012	1,018	1,033	1,048	1,063	1,083
26	<b>Network Opex</b>	<b>2,753</b>	<b>2,877</b>	<b>2,906</b>	<b>2,943</b>	<b>2,977</b>	<b>2,928</b>	<b>2,948</b>	<b>2,977</b>	<b>3,006</b>	<b>3,035</b>	<b>3,069</b>
27	System operations and network support	3,471	3,660	3,760	3,860	4,323	4,312	4,154	4,327	4,423	4,521	4,474
28	Business support	3,351	3,775	3,875	3,975	4,075	4,175	4,175	4,175	4,175	4,175	4,175
29	<b>Non-network opex</b>	<b>6,822</b>	<b>7,435</b>	<b>7,635</b>	<b>7,835</b>	<b>8,398</b>	<b>8,487</b>	<b>8,328</b>	<b>8,502</b>	<b>8,597</b>	<b>8,696</b>	<b>8,649</b>
30	<b>Operational expenditure</b>	<b>9,575</b>	<b>10,312</b>	<b>10,541</b>	<b>10,778</b>	<b>11,375</b>	<b>11,415</b>	<b>11,276</b>	<b>11,479</b>	<b>11,603</b>	<b>11,731</b>	<b>11,717</b>
31	<b>Subcomponents of operational expenditure (where known)</b>											
32	Energy efficiency and demand side management, reduction of energy losses	-	-	-	-	-	-	-	-	-	-	-
33	Direct billing*	-	-	-	-	-	-	-	-	-	-	-
34	Research and Development	-	-	-	-	-	-	-	-	-	-	-
35	Insurance	21	21	21	21	21	21	21	21	21	21	21
36												
37	* Direct billing expenditure by suppliers that direct bill the majority of their consumers											
38												
39												
40												
41												
<b>Difference between nominal and real forecasts</b>												
<b>\$000</b>												
42	Service interruptions and emergencies	-	-	43	66	91	117	143	169	197	225	253
43	Vegetation management	-	-	13	20	28	27	33	39	45	51	58
44	Routine and corrective maintenance and inspection	-	-	23	36	51	66	83	101	119	139	160
45	Asset replacement and renewal	-	-	38	61	85	111	136	164	193	224	257
46	<b>Network Opex</b>	<b>-</b>	<b>-</b>	<b>117</b>	<b>183</b>	<b>255</b>	<b>321</b>	<b>395</b>	<b>473</b>	<b>554</b>	<b>639</b>	<b>727</b>
47	System operations and network support	-	-	152	240	370	472	556	687	815	951	1,060
48	Business support	-	-	157	247	349	457	559	663	770	878	990
49	<b>Non-network opex</b>	<b>-</b>	<b>-</b>	<b>308</b>	<b>488</b>	<b>719</b>	<b>929</b>	<b>1,115</b>	<b>1,351</b>	<b>1,585</b>	<b>1,830</b>	<b>2,050</b>
50	<b>Operational expenditure</b>	<b>-</b>	<b>-</b>	<b>426</b>	<b>671</b>	<b>974</b>	<b>1,250</b>	<b>1,510</b>	<b>1,823</b>	<b>2,139</b>	<b>2,468</b>	<b>2,777</b>

**SCHEDULE 12a: REPORT ON ASSET CONDITION**

This schedule requires a breakdown of asset condition by asset class as at the start of the forecast year. The data accuracy assessment relates to the percentage values disclosed in the asset condition columns. Also required is a forecast of the percentage of units to be replaced in the next 5 years. All information should be consistent with the information provided in the AMP and the expenditure on assets forecast in Schedule 11a. All units relating to cable and line assets, that are expressed in km, refer to circuit lengths.

sch ref

Asset condition at start of planning period (percentage of units by grade)											
	Voltage	Asset category	Asset class	Units	Grade 1	Grade 2	Grade 3	Grade 4	Grade unknown	Data accuracy (1-4)	% of asset forecast to be replaced in next 5 years
7											
8											
9											
10	All	Overhead Line	Concrete poles / steel structure	No.	2.58%	3.42%	80.93%	13.07%	-	2	4.29%
11	All	Overhead Line	Wood poles	No.	6.86%	4.41%	35.04%	53.69%	-	2	9.06%
12	All	Overhead Line	Other pole types	No.	20.00%	-	15.00%	65.00%	-	2	20.00%
13	HV	Subtransmission Line	Subtransmission OH up to 66kV conductor	km	0.65%	3.25%	20.02%	76.07%	-	3	2.28%
14	HV	Subtransmission Line	Subtransmission OH 110kV+ conductor	km	-	-	-	-	-	N/A	-
15	HV	Subtransmission Cable	Subtransmission UG up to 66kV (XLPE)	km	-	-	66.22%	33.78%	-	3	-
16	HV	Subtransmission Cable	Subtransmission UG up to 66kV (Oil pressurised)	km	-	-	-	-	-	N/A	-
17	HV	Subtransmission Cable	Subtransmission UG up to 66kV (Gas pressurised)	km	-	-	-	-	-	N/A	-
18	HV	Subtransmission Cable	Subtransmission UG up to 66kV (PILC)	km	-	-	-	-	-	N/A	-
19	HV	Subtransmission Cable	Subtransmission UG 110kV+ (XLPE)	km	-	-	-	-	-	N/A	-
20	HV	Subtransmission Cable	Subtransmission UG 110kV+ (Oil pressurised)	km	-	-	-	-	-	N/A	-
21	HV	Subtransmission Cable	Subtransmission UG 110kV+ (Gas Pressurised)	km	-	-	-	-	-	N/A	-
22	HV	Subtransmission Cable	Subtransmission UG 110kV+ (PILC)	km	-	-	-	-	-	N/A	-
23	HV	Subtransmission Cable	Subtransmission submarine cable	km	-	-	-	-	-	N/A	-
24	HV	Zone substation Buildings	Zone substations up to 66kV	No.	-	-	5.00%	95.00%	-	2	-
25	HV	Zone substation Buildings	Zone substations 110kV+	No.	-	-	-	-	-	N/A	-
26	HV	Zone substation switchgear	22/33kV CB (Indoor)	No.	-	-	-	-	-	N/A	-
27	HV	Zone substation switchgear	22/33kV CB (Outdoor)	No.	5.00%	65.00%	30.00%	-	-	2	37.50%
28	HV	Zone substation switchgear	33kV Switch (Ground Mounted)	No.	-	-	-	-	-	N/A	-
29	HV	Zone substation switchgear	33kV Switch (Pole Mounted)	No.	1.05%	12.63%	80.00%	6.32%	-	3	7.37%
30	HV	Zone substation switchgear	33kV RMU	No.	-	-	-	-	-	N/A	-
31	HV	Zone substation switchgear	50/66/110kV CB (Indoor)	No.	-	-	-	-	-	N/A	-
32	HV	Zone substation switchgear	50/66/110kV CB (Outdoor)	No.	-	-	-	100.00%	-	2	-
33	HV	Zone substation switchgear	3.3/6.6/11/22kV CB (ground mounted)	No.	0.71%	5.71%	17.86%	75.71%	-	2	3.57%
34	HV	Zone substation switchgear	3.3/6.6/11/22kV CB (pole mounted)	No.	9.09%	18.18%	30.30%	42.42%	-	2	18.18%

Asset condition at start of planning period (percentage of units by grade)											
	Voltage	Asset category	Asset class	Units	Grade 1	Grade 2	Grade 3	Grade 4	Grade unknown	Data accuracy (1-4)	% of asset forecast to be replaced in next 5 years
35											
36											
37											
38											
39	HV	Zone Substation Transformer	Zone Substation Transformers	No.	3.57%	10.71%	14.29%	71.43%	-	3	8.93%
40	HV	Distribution Line	Distribution OH Open Wire Conductor	km	4.54%	3.42%	38.65%	53.39%	-	3	6.24%
41	HV	Distribution Line	Distribution OH Aerial Cable Conductor	km	-	-	-	-	-	N/A	-
42	HV	Distribution Line	SWER conductor	km	-	-	-	-	-	N/A	-
43	HV	Distribution Cable	Distribution UG XLPE or PVC	km	0.24%	0.48%	23.32%	75.96%	-	3	0.48%
44	HV	Distribution Cable	Distribution UG PILC	km	4.57%	49.78%	43.27%	2.39%	-	1	29.46%
45	HV	Distribution Cable	Distribution Submarine Cable	km	-	-	-	-	-	N/A	-
46	HV	Distribution switchgear	3.3/6.6/11/22kV CB (pole mounted) - reclosers and sectionalisers	No.	-	-	100.00%	-	-	2	-
47	HV	Distribution switchgear	3.3/6.6/11/22kV CB (Indoor)	No.	-	-	-	-	-	N/A	-
48	HV	Distribution switchgear	3.3/6.6/11/22kV Switches and fuses (pole mounted)	No.	2.24%	1.50%	11.62%	84.64%	-	2	2.99%
49	HV	Distribution switchgear	3.3/6.6/11/22kV Switch (ground mounted) - except RMU	No.	-	-	-	-	-	N/A	-
50	HV	Distribution switchgear	3.3/6.6/11/22kV RMU	No.	0.45%	3.84%	30.02%	65.69%	-	3	2.37%
51	HV	Distribution Transformer	Pole Mounted Transformer	No.	9.50%	11.68%	22.16%	56.66%	-	3	15.35%
52	HV	Distribution Transformer	Ground Mounted Transformer	No.	4.86%	6.48%	16.36%	72.31%	-	3	8.10%
53	HV	Distribution Transformer	Voltage regulators	No.	-	100.00%	-	-	-	3	50.00%
54	HV	Distribution Substations	Ground Mounted Substation Housing	No.	0.45%	3.84%	30.02%	65.69%	-	2	2.37%
55	LV	LV Line	LV OH Conductor	km	29.21%	11.34%	40.58%	18.88%	-	3	34.88%
56	LV	LV Cable	LV UG Cable	km	1.57%	3.84%	35.75%	58.84%	-	3	3.49%
57	LV	LV Streetlighting	LV OH/UG Streetlight circuit	km	7.03%	5.19%	38.15%	49.63%	-	2	9.62%
58	LV	Connections	OH/UG consumer service connections	No.	-	33.33%	33.33%	33.34%	-	3	16.67%
59	All	Protection	Protection relays (electromechanical, solid state and numeric)	No.	-	6.67%	13.33%	80.00%	-	2	3.33%
60	All	SCADA and communications	SCADA and communications equipment operating as a single system	Lot	-	-	-	100.00%	-	3	-
61	All	Capacitor Banks	Capacitors including controls	No.	-	-	-	-	-	N/A	-
62	All	Load Control	Centralised plant	Lot	66.67%	33.33%	-	-	-	3	83.33%
63	All	Load Control	Relays	No.	-	-	-	-	-	N/A	-
64	All	Civils	Cable Tunnels	km	-	-	-	-	-	N/A	-

Company Name

Electricity Ashburton Limited

AMP Planning Period

1 April 2016 – 31 March 2026

**SCHEDULE 12b: REPORT ON FORECAST CAPACITY**

This schedule requires a breakdown of current and forecast capacity and utilisation for each zone substation and current distribution transformer capacity. The data provided should be consistent with the information provided in the AMP. Information provided in this table should relate to the operation of the network in its normal steady state configuration.

sch ref

7	12b(i): System Growth - Zone Substations									
8	Existing Zone Substations	Current Peak Load (MVA)	Installed Firm Capacity (MVA)	Security of Supply Classification (type)	Transfer Capacity (MVA)	Utilisation of Installed Firm Capacity %	Installed Firm Capacity +5 years (MVA)	Utilisation of Installed Firm Capacity + 5yrs %	Installed Firm Capacity Constraint +5 years (cause)	Explanation
9	Ashburton 33/11kV [ASH]	25	20	N-1 Switched	28	125%	-	-	No constraint within +5 years	Firm capacity limit is N-1 transformer capacity limit. 20 MVA hot stand-by available from ASH 66/11kV substation. Additional 11kV cables in Ashburton will increase fast transfer capacity from NTN.
10	Ashburton 66/11kV [ASH]	-	-	N-1 Switched	28	-	20	94%	No constraint within +5 years	Does not normally serve load. Within 3 years the ASH 33/11kV substation will be the ASH 66/11 kV substation. All load will be served from the 66kV network. A combination of a second 66/11kV transformer, steady state load transfer to NTN, and additional fast transfer switched capacity will ensure acceptable security.
11	Carew 66/22kV [CRW]	15	-	N	9	-	20	64%	No constraint within +5 years	Second transformer is one of two system spares and provides 100% firm capacity. Transfer capacity increases with additional 22kV conversion.
12	Coldstream 66/22kV [CSM]	13	-	N	9	-	-	-	Transformer	Second Carew transformer (2016) along with additional 22kV lines provides an increase in transfer capacity.
13	Dorie 66/22kV [DOR]	11	-	N	9	-	-	-	Transformer	Full capacity at Pendarves and a larger Overdale transformer offers close to 100% of firm capacity via transfer on 22kV distribution network.
14	Eiffelton 66/11kV [EFN]	9	-	N	4	-	-	-	Transformer	Transfer capacity increases significantly with additional 22kV conversion. When operating at 66/22kV all load should be able to be backfed.
15	Fairton 33/11kV [FTN]	8	10	N-1 Switched	6	78%	10	100%	No constraint within +5 years	Substation provides 100% firm capacity. 33/11kV substation to be decommissioned within 2 years. New 66/11-22kV substation replacing 33/11kV site. Significant switched transfer capacity from adjacent sites at 11kV and 22kV. 10 MVA of N-1 capacity limited by 22/11kV transformer.
16	Hackthorne 66/22kV [HTH]	15	-	N	9	-	-	-	Transformer	Second Carew transformer along with additional 22kV conversion provides extra transfer capacity. Future 66kV MSM and MON also increases transfer capacity.
17	Highbank 66/11kV [HBK]	8	-	N	-	-	-	-	Subtransmission circuit	Owned by Trustpower. Winter:generation. Summer:pump load. By agreement, EA Networks provide n 66kV security.
18	Lagmhor 66/22kV [LGM]	7	-	N	6	-	-	-	Transformer	22kV transfer capacity increases with additional 22kV conversion, new 22kV lines, and Tinwald 11/22kV, 8MVA transformer.
19	Lauriston 66/22kV [LSN]	15	-	N	7	-	-	-	Transformer	Transfer capacity increases with additional 22kV conversion, larger OVD transformer, FTN commissioning, and MTV 22kV supply capability (2016).
20	Methven 33/11kV [MVN]	2	-	N	4	-	-	-	No constraint within +5 years	Decommissioned and load merged with Methven 66/11kV substation in 2016.
21	Methven 66/11kV [MTV]	4	-	N	4	-	-	-	Transformer	22/11kV transformer will provide significant backfeed from LSN (2016). 66/22kV, 66/11kV & 22/11kV transformers will provide 100% transfer capacity in 2020.
22	Methven 66/33kV [MTV]	5	-	N	5	-	-	-	No constraint within +5 years	Existing 33 load is converted to 66/11-22kV alleviating constraint.
23	Mt Somers 33/11kV [MSM]	3	-	N	3	-	-	-	Transformer	Additional conversion of surrounding distribution network to 22kV permits adequate switched transfer capacity. After conversion to 66/22kV (2019) two 66kV circuits provide N-1 subtransmission security (currently N subtransmission security).
24	Mt Hutt 33/11kV [MHT]	2	-	N	2	-	-	-	Transformer	Considered adequate. Possible 22kV conversion would increase switched transfer capacity.
	Montalto 33/11kV [MON]	2	-	N	1	-	-	-	Transformer	Conversion to 66/22kV and surrounding distribution network 22kV conversion increases transfer capacity in 2022. May be N subtransmission security for some time.
	Northtown 66/11kV [NTN]	9	20	N-1	8	-	20	93%	No constraint within +5 years	Currently seasonally constrained by subtransmission network. Fully resolved in 2019 with additional 66kV circuit. Additional 11kV cables in Ashburton increase fast transfer capacity from ASH.
	Overdale 66/22kV [OVD]	14	-	N	10	-	-	-	Transformer	Transfer capacity has increased with larger 66/22kV transformers at adjacent substations ([PDS] & [LSN]) and increases further with additional 22kV conversion and Fairton 66/22kV construction (2016).
25	Pendarves 66/22kV [PDS]	16	20	N-1	30	80%	20	80%	No constraint within +5 years	Firm capacity limit is N-1 transformer capacity limit. Second transformer is one of two system spares.
26	Seafeld 33/11kV [SFD33]	8	-	N-1 Switched	10	-	-	-	Transformer	A second transformer would provide 100% firm capacity. Negotiated security with sole industrial customer. In 2019 this substation will be decommissioned.
27	Seafeld 66/11kV [SFD66]	8	-	N-1 Switched	10	-	-	-	Transformer	A second transformer would provide 100% firm capacity. Negotiated security with sole industrial customer. Remote-controlled change-over between 33/11kV and 66/11kV substations.
28	Wakanui 66/22kV [WNU]	13	-	N	10	-	-	-	Transformer	Elgin's 66/33kV transformer conversion to 66/22kV (2019) increases 22kV transfer capacity significantly.
29	* Extend forecast capacity table as necessary to disclose all capacity by each zone substation									



Company Name **Electricity Ashburton Limited**  
 AMP Planning Period **1 April 2016 – 31 March 2026**

**SCHEDULE 12C: REPORT ON FORECAST NETWORK DEMAND**

This schedule requires a forecast of new connections (by consumer type), peak demand and energy volumes for the disclosure year and a 5 year planning period. The forecasts should be consistent with the supporting information set out in the AMP as well as the assumptions used in developing the expenditure forecasts in Schedule 11a and Schedule 11b and the capacity and utilisation forecasts in Schedule 12b.

sch ref

12c(i): Consumer Connections		Number of connections					
		Current Year CY for year ended 31 Mar 16	CY+1 31 Mar 17	CY+2 31 Mar 18	CY+3 31 Mar 19	CY+4 31 Mar 20	CY+5 31 Mar 21
Number of ICPs connected in year by consumer type							
Consumer types defined by EDB*							
Urban LV		104	103	101	99	97	95
Urban Transformer		-	5	5	5	5	5
Urban Alteration for Safety		-	3	3	3	3	3
Urban Capacity Alteration		-	6	6	6	6	5
Rural LV		145	108	106	104	101	99
Rural Transformer		55	54	53	52	51	50
Rural Alteration for Safety		-	15	14	14	14	14
Rural Capacity Alteration		-	34	34	33	32	32
Other		-	5	5	5	5	5
<b>Connections total</b>		<b>304</b>	<b>333</b>	<b>327</b>	<b>321</b>	<b>314</b>	<b>308</b>
*include additional rows if needed							
<b>Distributed generation</b>							
Number of connections		38	30	27	25	25	25
Capacity of distributed generation installed in year (MVA)		1	-	-	-	-	-
<b>12c(ii) System Demand</b>							
<b>Maximum coincident system demand (MW)</b>							
GXP demand		176	178	181	184	187	189
plus Distributed generation output at HV and above		1	1	1	1	1	1
<b>Maximum coincident system demand</b>		<b>177</b>	<b>179</b>	<b>182</b>	<b>185</b>	<b>188</b>	<b>190</b>
less Net transfers to (from) other EDBs at HV and above		-	-	-	-	-	-
<b>Demand on system for supply to consumers' connection points</b>		<b>177</b>	<b>179</b>	<b>182</b>	<b>185</b>	<b>188</b>	<b>190</b>
<b>Electricity volumes carried (GWh)</b>							
Electricity supplied from GXPs		604	615	625	636	647	658
less Electricity exports to GXPs		1	1	1	1	1	1
plus Electricity supplied from distributed generation		95	97	97	97	97	97
less Net electricity supplied to (from) other EDBs		-	-	-	-	-	-
<b>Electricity entering system for supply to ICPs</b>		<b>698</b>	<b>711</b>	<b>721</b>	<b>732</b>	<b>743</b>	<b>754</b>
less Total energy delivered to ICPs		644	654	664	674	684	694
<b>Losses</b>		<b>54</b>	<b>57</b>	<b>58</b>	<b>58</b>	<b>59</b>	<b>60</b>
<b>Load factor</b>		<b>45%</b>	<b>45%</b>	<b>45%</b>	<b>45%</b>	<b>45%</b>	<b>45%</b>
<b>Loss ratio</b>		<b>7.7%</b>	<b>8.0%</b>	<b>8.0%</b>	<b>8.0%</b>	<b>8.0%</b>	<b>8.0%</b>

Company Name	Electricity Ashburton Limited
AMP Planning Period	1 April 2016 – 31 March 2026
Network / Sub-network Name	Electricity Ashburton Limited

**SCHEDULE 12d: REPORT FORECAST INTERRUPTIONS AND DURATION**

This schedule requires a forecast of SAIFI and SAIDI for disclosure and a 5 year planning period. The forecasts should be consistent with the supporting information set out in the AMP as well as the assumed impact of planned and unplanned SAIFI and SAIDI on the expenditures forecast provided in Schedule 11a and Schedule 11b.

<i>sch ref</i>		Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
	for year ended	31 Mar 16	31 Mar 17	31 Mar 18	31 Mar 19	31 Mar 20	31 Mar 21
8							
9							
10	<b>SAIDI</b>						
11	Class B (planned interruptions on the network)	74.0	71.2	77.3	85.1	64.2	72.1
12	Class C (unplanned interruptions on the network)	174.0	118.7	117.5	116.3	115.2	112.9
13	<b>SAIFI</b>						
14	Class B (planned interruptions on the network)	0.26	0.26	0.28	0.31	0.23	0.26
15	Class C (unplanned interruptions on the network)	1.09	1.44	1.43	1.41	1.40	1.38

**SCHEDULE 13: REPORT ON ASSET MANAGEMENT MATURITY**

This schedule requires information on the EDB's self-assessment of the maturity of its asset management practices.

Question No.	Function	Question	Score	Evidence—Summary	Why	Who	Record/document information	Evaluated Maturity Level
3	Asset management policy	To what extent has an asset management policy been documented, authorised and communicated?	2	EAN's asset management policy is an inherent part of the AMP. EAN develops policies as the need arises. For example, the rural network harmonic policy is used to address the issues arising out of the irrigation connections. Various operating policies are used to manage the day to day network operational issues. PSMS is used to manage assets to avoid any inadvertent risks. There is also a wider interaction among the management and the board on a regular basis.	Widely used AM practice standards require an organisation to document, authorise and communicate its asset management policy (eg, as required in PAS 55 para 4.2 i). A key pre-requisite of any robust policy is that the organisation's top management must be seen to endorse and fully support it. Also vital to the effective implementation of the policy, is to tell the appropriate people of its content and their obligations under it. Where an organisation outsources some of its asset-related activities, then these people and their organisations must equally be made aware of the policy's content. Also, there may be other stakeholders, such as regulatory authorities and shareholders who should be made aware of it.	Top management. The management team that has overall responsibility for asset management.	The organisation's asset management policy, its organisational strategic plan, documents indicating how the asset management policy was based upon the needs of the organisation and evidence of communication.	The organisation has an asset management policy, which has been authorised by top management, but it has had limited circulation. It may be in use to influence development of strategy and planning but its effect is limited.
10	Asset management strategy	What has the organisation done to ensure that its asset management strategy is consistent with other appropriate organisational policies and strategies, and the needs of stakeholders?	1	EAN's asset management strategies are in line with its asset management policies. Health and safety meetings are regularly held and minutes are circulated to all staff. There is also a regular auditing and interviewing process to identify and resolve any health and safety issues. Annually, an external consultant is engaged to do a survey of all customers which provides an input into the asset management strategies of the company. A regular benchmarking of processes and systems is carried out to compare the performance of the company to other companies.	In setting an organisation's asset management strategy, it is important that it is consistent with any other policies and strategies that the organisation has and has taken into account the requirements of relevant stakeholders. This question examines to what extent the asset management strategy is consistent with other organisational policies and strategies (eg, as required by PAS 55 para 4.3.1 b) and has taken account of stakeholder requirements as required by PAS 55 para 4.3.1 c). Generally, this will take into account the same policies, strategies and stakeholder requirements as covered in drafting the asset management policy but at a greater level of detail.	Top management. The organisation's strategic planning team. The management team that has overall responsibility for asset management.	The organisation's asset management strategy document and other related organisational policies and strategies. Other than the organisation's strategic plan, these could include those relating to health and safety, environmental, etc. Results of stakeholder consultation.	The need to align the asset management strategy with other organisational policies and strategies as well as stakeholder requirements is understood and work has started to identify the linkages or to incorporate them in the drafting of asset management strategy.
11	Asset management strategy	In what way does the organisation's asset management strategy take account of the lifecycle of the assets, asset types and asset systems over which the organisation has stewardship?	2	Life cycle of the assets are regularly checked and reported to the management. There is an effective maintenance regime to address the life cycle related issues. The age profiles are analysed and conditions of assets are monitored regularly to replace aging equipment. GIS and other databases are frequently used to maintain an up-to-date knowledge of the assets installation date, categories etc.	Good asset stewardship is the hallmark of an organisation compliant with widely used AM standards. A key component of this is the need to take account of the lifecycle of the assets, asset types and asset systems. (For example, this requirement is recognised in 4.3.1 d) of PAS 55). This question explores what an organisation has done to take lifecycle into account in its asset management strategy.	Top management. People in the organisation with expert knowledge of the assets, asset types, asset systems and their associated life-cycles. The management team that has overall responsibility for asset management. Those responsible for developing and adopting methods and processes used in asset management	The organisation's documented asset management strategy and supporting working documents.	The long-term asset management strategy takes account of the lifecycle of some, but not all, of its assets, asset types and asset systems.
26	Asset management plan(s)	How does the organisation establish and document its asset management plan(s) across the life cycle activities of its assets and asset systems?	3	EAN's AMP has been in place for over 15 years and has a 10 year outlook to maintain and develop assets. Major tasks and activities are identified, developed and implemented to optimize the network.	The asset management strategy need to be translated into practical plan(s) so that all parties know how the objectives will be achieved. The development of plan(s) will need to identify the specific tasks and activities required to optimize costs, risks and performance of the assets and/or asset system(s), when they are to be carried out and the resources required.	The management team with overall responsibility for the asset management system. Operations, maintenance and engineering managers.	The organisation's asset management plan(s).	Asset management plan(s) are established, documented, implemented and maintained for asset systems and critical assets to achieve the asset management strategy and asset management objectives across all life cycle phases.
27	Asset management plan(s)	How has the organisation communicated its plan(s) to all relevant parties to a level of detail appropriate to the receiver's role in their delivery?	3	Asset management plans are communicated to all those parties involved in implementing the plan. Those involved in implementing the plan are also involved in creating it. Evidence includes an email sent out to all relevant parties when the AMP is finally published.	Plans will be ineffective unless they are communicated to all those, including contracted suppliers and those who undertake enabling function(s). The plan(s) need to be communicated in a way that is relevant to those who need to use them.	The management team with overall responsibility for the asset management system. Delivery functions and suppliers.	Distribution lists for plan(s). Documents derived from plan(s) which detail the receivers role in plan delivery. Evidence of communication.	The plan(s) are communicated to all relevant employees, stakeholders and contracted service providers to a level of detail appropriate to their participation or business interests in the delivery of the plan(s) and there is confirmation that they are being used effectively.
29	Asset management plan(s)	How are designated responsibilities for delivery of asset plan actions documented?	3	AMP responsibilities are defined to appropriate people in the organisation.	The implementation of asset management plan(s) relies on (1) actions being clearly identified, (2) an owner allocated and (3) that owner having sufficient delegated responsibility and authority to carry out the work required. It also requires alignment of actions across the organisation. This question explores how well the plan(s) set out responsibility for delivery of asset plan actions.	The management team with overall responsibility for the asset management system. Operations, maintenance and engineering managers. If appropriate, the performance management team.	The organisation's asset management plan(s). Documentation defining roles and responsibilities of individuals and organisational departments.	Asset management plan(s) consistently document responsibilities for the delivery actions and there is adequate detail to enable delivery of actions. Designated responsibility and authority for achievement of asset plan actions is appropriate.
31	Asset management plan(s)	What has the organisation done to ensure that appropriate arrangements are made available for the efficient and cost effective implementation of the plan(s)?  (Note this is about resources and enabling support)	3	The company does its best to make appropriate arrangements once a project is finally approved. It goes through the normal planning, design, drawing and commissioning phases. However, on-going large growth makes it difficult to achieve all the tasks identified in the plan.	It is essential that the plan(s) are realistic and can be implemented, which requires appropriate resources to be available and enabling mechanisms in place. This question explores how well this is achieved. The plan(s) not only need to consider the resources directly required and timescales, but also the enabling activities, including for example, training requirements, supply chain capability and procurement timescales.	The management team with overall responsibility for the asset management system. Operations, maintenance and engineering managers. If appropriate, the performance management team. Where appropriate the procurement team and service providers working on the organisation's asset-related activities.	The organisation's asset management plan(s). Documented processes and procedures for the delivery of the asset management plan.	The organisation's arrangements fully cover all the requirements for the efficient and cost effective implementation of asset management plan(s) and realistically address the resources and timescales required, and any changes needed to functional policies, standards, processes and the asset management information system.
33	Contingency planning	What plan(s) and procedure(s) does the organisation have for identifying and responding to incidents and emergency situations and ensuring continuity of critical asset management activities?	3	Responding to "emergencies" is a common activity within the company. For example, any unplanned outages during an extreme weather condition requires controllers to immediately prepare operating instructions and dispatch fault men to the affected areas. An appropriate risk register is maintained for an on-going health and safety analysis. While not fully documented, plans/resources are in place to respond to an event.	Widely used AM practice standards require that an organisation has plan(s) to identify and respond to emergency situations. Emergency plan(s) should outline the actions to be taken to respond to specified emergency situations and ensure continuity of critical asset management activities including the communication to, and involvement of, external agencies. This question assesses if, and how well, these plan(s) triggered, implemented and resolved in the event of an incident. The plan(s) should be appropriate to the level of risk as determined by the organisation's risk assessment methodology. It is also a requirement that relevant personnel are competent and trained.	The manager with responsibility for developing emergency plan(s). The organisation's risk assessment team. People with designated duties within the plan(s) and procedure(s) for dealing with incidents and emergency situations.	The organisation's plan(s) and procedure(s) for dealing with emergencies. The organisation's risk assessments and risk registers.	Appropriate emergency plan(s) and procedure(s) are in place to respond to credible incidents and manage continuity of critical asset management activities consistent with policies and asset management objectives. Training and external agency alignment is in place.
37	Structure, authority and responsibilities	What has the organisation done to appoint member(s) of its management team to be responsible for ensuring that the organisation's assets deliver the requirements of the asset management strategy, objectives and plan(s)?	3	There is an on-going process to identify the gaps and delegate tasks to appropriate people. The network manager has overall responsibility to undertake these functions. Appropriate structures, authorities and responsibilities are in place to a certain extent. Current structure is more reliant on matrix management for the best possible outcome.	In order to ensure that the organisation's assets and asset systems deliver the requirements of the asset management policy, strategy and objectives responsibilities need to be allocated to appropriate people who have the necessary authority to fulfil their responsibilities. (This question, relates to the organisation's assets eg, para b), s 4.4.1 of PAS 55, making it therefore distinct from the requirement contained in para a), s 4.4.1 of PAS 55).	Top management. People with management responsibility for the delivery of asset management policy, strategy, objectives and plan(s). People working on asset-related activities.	Evidence that managers with responsibility for the delivery of asset management policy, strategy, objectives and plan(s) have been appointed and have assumed their responsibilities. Evidence may include the organisation's documents relating to its asset management system, organisational charts, job descriptions of post-holders, annual targets/objectives and personal development plan(s) of post-holders as appropriate.	The appointed person or persons have full responsibility for ensuring that the organisation's assets deliver the requirements of the asset management strategy, objectives and plan(s). They have been given the necessary authority to achieve this.
40	Structure, authority and responsibilities	What evidence can the organisation's top management provide to demonstrate that sufficient resources are available for asset management?	2	Resources are allocated based on the needs of the organisation. Generally, issues are identified and resources are evaluated/allocated after discussions with the relevant parties. Items identified in the plan are completed in the plan time. Three additional engineers have been appointed to improve the AM processes.	Optimal asset management requires top management to ensure sufficient resources are available. In this context the term 'resources' includes manpower, materials, funding and service provider support.	Top management. The management team that has overall responsibility for asset management. Risk management team. The organisation's managers involved in day-to-day supervision of asset-related activities, such as frontline managers, engineers, foremen and chargehands as appropriate.	Evidence demonstrating that asset management plan(s) and/or the process(es) for asset management plan implementation consider the provision of adequate resources in both the short and long term. Resources include funding, materials, equipment, services provided by third parties and personnel (internal and service providers) with appropriate skills competencies and knowledge.	A process exists for determining what resources are required for its asset management activities and in most cases these are available but in some instances resources remain insufficient.
42	Structure, authority and responsibilities	To what degree does the organisation's top management communicate the importance of meeting its asset management requirements?	3	Asset management requirements are regularly communicated to people as per their responsibilities. For example, 6 monthly safety sessions are held and all staff are updated on the current asset management projects, practices and requirements.	Widely used AM practice standards require an organisation to communicate the importance of meeting its asset management requirements such that personnel fully understand, take ownership of, and are fully engaged in the delivery of the asset management requirements (eg, PAS 55 s 4.4.1 g).	Top management. The management team that has overall responsibility for asset management. People involved in the delivery of the asset management requirements.	Evidence of such activities as road shows, written bulletins, workshops, team talks and management walk-about would assist an organisation to demonstrate it is meeting this requirement of PAS 55.	Top management communicates the importance of meeting its asset management requirements to all relevant parts of the organisation.

SCHEDULE 13: REPORT ON ASSET MANAGEMENT MATURITY (cont)				Company Name AMP Planning Period Asset Management Standard Applied		Electricity Ashburton Limited 1 April 2015 – 31 March 2025 No formal asset management standard has been used for this evaluation.		
Question No.	Function	Question	Score	Evidence—Summary	Why	Who	Record/document information	Evaluated Maturity Level
45	Outsourcing of asset management activities	Where the organisation has outsourced some of its asset management activities, how has it ensured that appropriate controls are in place to ensure the compliant delivery of its organisational strategic plan, and its asset management policy and strategy?	2	Very little work is outsourced so this is not as relevant. However, this could change in the future due to either load growth or other initiatives. Most projects are contracted out to an "in house" contracting department. Additional resources have been applied to the process of contracting work which will be managed directly by the asset managers rather than via the in house contractor.	Where an organisation chooses to outsource some of its asset management activities, the organisation must ensure that these outsourced process(es) are under appropriate control to ensure that all the requirements of widely used AM standards (eg, PAS 55) are in place, and the asset management policy, strategy objectives and plan(s) are delivered. This includes ensuring capabilities and resources across a time span aligned to life cycle management. The organisation must put arrangements in place to control the outsourced activities, whether it be to external providers or to other in-house departments. This question explores what the organisation does in this regard.	Top management. The management team that has overall responsibility for asset management. The manager(s) responsible for the monitoring and management of the outsourced activities. People involved with the procurement of outsourced activities. The people within the organisations that are performing the outsourced activities. The people impacted by the outsourced activity.	The organisation's arrangements that detail the compliance required of the outsourced activities. For example, this could form part of a contract or service level agreement between the organisation and the suppliers of its outsourced activities. Evidence that the organisation has demonstrated to itself that it has assurance of compliance of outsourced activities.	Controls systematically considered but currently only provide for the compliant delivery of some, but not all, aspects of the organisational strategic plan and/or its asset management policy and strategy. Gaps exist.
48	Training, awareness and competence	How does the organisation develop plan(s) for the human resources required to undertake asset management activities - including the development and delivery of asset management strategy, process(es), objectives and plan(s)?	2	Training plans are identified on an individual basis. There is no specific training application as such. Regular meetings are held with staff to discuss training and personal development opportunities. Staff and various departments are encouraged to come up with their own training, awareness and competence requirements. A staff member has been tasked to develop competencies directly relating to job positions	There is a need for an organisation to demonstrate that it has considered what resources are required to develop and implement its asset management system. There is also a need for the organisation to demonstrate that it has assessed what development plan(s) are required to provide its human resources with the skills and competencies to develop and implement its asset management systems. The timescales over which the plan(s) are relevant should be commensurate with the planning horizons within the asset management strategy considers e.g. if the asset management strategy considers 5, 10 and 15 year time scales then the human resources development plan(s) should align with these. Resources include both 'in house' and external resources who undertake asset management activities.	Senior management responsible for agreement of plan(s). Managers responsible for developing asset management strategy and plan(s). Managers with responsibility for development and recruitment of staff (including HR functions). Staff responsible for training. Procurement officers. Contracted service providers.	Evidence of analysis of future work load plan(s) in terms of human resources. Document(s) containing analysis of the organisation's own direct resources and contractors resource capability over suitable timescales. Evidence, such as minutes of meetings, that suitable management forums are monitoring human resource development plan(s). Training plan(s), personal development plan(s), contract and service level agreements.	The organisation has developed a strategic approach to aligning competencies and human resources to the asset management system including the asset management plan but the work is incomplete or has not been consistently implemented.
49	Training, awareness and competence	How does the organisation identify competency requirements and then plan, provide and record the training necessary to achieve the competencies?	2	There is a competency register to capture competency levels of all staff and contractors. It is kept up to date where possible. But it is aimed more at operational competencies. Refer Q 48.	Widely used AM standards require that organisations to undertake a systematic identification of the asset management awareness and competencies required at each level and function within the organisation. Once identified the training required to provide the necessary competencies should be planned for delivery in a timely and systematic way. Any training provided must be recorded and maintained in a suitable format. Where an organisation has contracted service providers in place then it should have a means to demonstrate that this requirement is being met for their employees. (eg, PAS 55 refers to frameworks suitable for identifying competency requirements).	Senior management responsible for agreement of plan(s). Managers responsible for developing asset management strategy and plan(s). Managers with responsibility for development and recruitment of staff (including HR functions). Staff responsible for training. Procurement officers. Contracted service providers.	Evidence of an established and applied competency requirements assessment process and plan(s) in place to deliver the required training. Evidence that the training programme is part of a wider, co-ordinated asset management activities training and competency programme. Evidence that training activities are recorded and that records are readily available (for both direct and contracted service provider staff) e.g. via organisation wide information system or local records database.	The organisation is in the process of identifying competency requirements aligned to the asset management plan(s) and then plan, provide and record appropriate training. It is incomplete or inconsistently applied.
50	Training, awareness and competence	How does the organization ensure that persons under its direct control undertaking asset management related activities have an appropriate level of competence in terms of education, training or experience?	2	Competency register exists as mentioned above but to-date review and assessment has concentrated on operational staff. Refer Q 48	A critical success factor for the effective development and implementation of an asset management system is the competence of persons undertaking these activities. Organisations should have effective means in place for ensuring the competence of employees to carry out their designated asset management function(s). Where an organisation has contracted service providers undertaking elements of its asset management system then the organisation shall assure itself that the outsourced service provider also has suitable arrangements in place to manage the competencies of its employees. The organisation should ensure that the individual and corporate competencies it requires are in place and actively monitor, develop and maintain an appropriate balance of these competencies.	Managers, supervisors, persons responsible for developing training programmes. Staff responsible for procurement and service agreements. HR staff and those responsible for recruitment.	Evidence of a competency assessment framework that aligns with established frameworks such as the asset management Competencies Requirements Framework (Version 2.0); National Occupational Standards for Management and Leadership; UK Standard for Professional Engineering Competence, Engineering Council, 2005.	The organization is in the process of putting in place a means for assessing the competence of person(s) involved in asset management activities including contractors. There are gaps and inconsistencies.
53	Communication, participation and consultation	How does the organisation ensure that pertinent asset management information is effectively communicated to and from employees and other stakeholders, including contracted service providers?	3	Majority of work is done by the "in house" contractor. Regular staff meetings are held where AMP projects are discussed. Asset management plans and policies are published on internet and intranet. Formal after board meeting brief is held on a monthly basis to inform the key staff about the asset management expectations and requirements. Customers are also engaged on a regular basis to refine the company's asset management strategies.	Widely used AM practice standards require that pertinent asset management information is effectively communicated to and from employees and other stakeholders including contracted service providers. Pertinent information refers to information required in order to effectively and efficiently comply with and deliver asset management strategy, plan(s) and objectives. This will include for example the communication of the asset management policy, asset performance information, and planning information as appropriate to contractors.	Top management and senior management representative(s), employee's representative(s), employee's trade union representative(s), contracted service provider management and employee representative(s); representative(s) from the organisation's Health, Safety and Environmental team. Key stakeholder representative(s).	Asset management policy statement prominently displayed on notice boards, intranet and internet; use of organisation's website for displaying asset performance data; evidence of formal briefings to employees, stakeholders and contracted service providers; evidence of inclusion of asset management issues in team meetings and contracted service provider contract meetings; newsletters, etc.	Two way communication is in place between all relevant parties, ensuring that information is effectively communicated to match the requirements of asset management strategy, plan(s) and process(es). Pertinent asset information requirements are regularly reviewed.
59	Asset Management System documentation	What documentation has the organisation established to describe the main elements of its asset management system and interactions between them?	2	Currently, PSMS is being developed to include these functions. There are various other databases and systems such as GIS, DigSILENT, assets database etc. to capture relevant information relating to the main elements of its asset management system.	Widely used AM practice standards require an organisation maintain up to date documentation that ensures that its asset management systems (ie, the systems the organisation has in place to meet the standards) can be understood, communicated and operated. (eg, s 4.5 of PAS 55 requires the maintenance of up to date documentation of the asset management system requirements specified throughout s 4 of PAS 55).	The management team that has overall responsibility for asset management. Managers engaged in asset management activities.	The documented information describing the main elements of the asset management system (process(es)) and their interaction.	The organisation in the process of documenting its asset management system and has documentation in place that describes some, but not all, of the main elements of its asset management system and their interaction.
62	Information management	What has the organisation done to determine what its asset management information system(s) should contain in order to support its asset management system?	1	Information is regularly captured to support the AMP processes. For example, the assets database captures asset condition information relating to assets such as CBS, and transformers. GIS captures location, types and other technical information relating to many other assets within the network. The company has purchased an asset management system and is in the process of implementing it.	Effective asset management requires appropriate information to be available. Widely used AM standards therefore require the organisation to identify the asset management information it requires in order to support its asset management system. Some of the information required may be held by suppliers.  The maintenance and development of asset management information systems is a poorly understood specialist activity that is akin to IT management but different from IT management. This group of questions provides some indications as to whether the capability is available and applied. Note: To be effective, an asset information management system requires the mobilisation of technology, people and process(es) that create, secure, make available and destroy the information required to support the asset management system.	The organisation's strategic planning team. The management team that has overall responsibility for asset management. Information management team. Operations, maintenance and engineering managers	Details of the process the organisation has employed to determine what its asset information system should contain in order to support its asset management system. Evidence that this has been effectively implemented.	The organisation is aware of the need to determine in a structured manner what its asset information system should contain in order to support its asset management system and is in the process of deciding how to do this.
63	Information management	How does the organisation maintain its asset management information system(s) and ensure that the data held within it (them) is of the requisite quality and accuracy and is consistent?	2	Data quality is being continually improved by regularly carrying out data audits and via feedback mechanisms. Engineering meetings are held to discuss and address any relevant issues. They will be further reviewed and strengthened with the introduction of the new asset management system.	The response to the questions is progressive. A higher scale cannot be awarded without achieving the requirements of the lower scale.  This question explores how the organisation ensures that information management meets widely used AM practice requirements (eg, s 4.4.6 (a), (c) and (d) of PAS 55).	The management team that has overall responsibility for asset management. Users of the organisational information systems.	The asset management information system, together with the policies, procedure(s), improvement initiatives and audits regarding information controls.	The organisation has developed a controls that will ensure the data held is of the requisite quality and accuracy and is consistent and is in the process of implementing them.
64	Information management	How has the organisation's ensured its asset management information system is relevant to its needs?	2	A lot of information is already available via GIS, assets database and other applications. Some improvements have been identified. For example, the ability to link financial information with the engineering information that is already available. Refer Q 63	Widely used AM standards need not be prescriptive about the form of the asset management information system, but simply require that the asset management information system is appropriate to the organisations needs, can be effectively used and can supply information which is consistent and of the requisite quality and accuracy.	The organisation's strategic planning team. The management team that has overall responsibility for asset management. Information management team. Users of the organisational information systems.	The documented process the organisation employs to ensure its asset management information system aligns with its asset management requirements. Minutes of information systems review meetings involving users.	The organisation has developed and is implementing a process to ensure its asset management information system is relevant to its needs. Gaps between what the information system provides and the organisations needs have been identified and action is being taken to close them.
69	Risk management process(es)	How has the organisation documented process(es) and/or procedure(s) for the identification and assessment of asset and asset management related risks throughout the asset life cycle?	2	Many risks have been identified and are being dealt with through wider discussions and operational feedback sessions. Continual improvement process also identifies and deals with the assets at risk. Identified risks are regularly investigated and resolved as soon as practicable. External consultants are also engaged to provide their opinion on some specific risks. Staff have been trained on risk management procedures and are about to implement the process.	Risk management is an important foundation for proactive asset management. Its overall purpose is to understand the cause, effect and likelihood of adverse events occurring, to optimally manage such risks to an acceptable level, and to provide an audit trail for the management of risks. Widely used standards require the organisation to have process(es) and/or procedure(s) in place that set out how the organisation identifies and assesses asset and asset management related risks. The risks have to be considered across the four phases of the asset lifecycle (eg, para 4.3.3 of PAS 55).	The top management team in conjunction with the organisation's senior risk management representatives. There may also be input from the organisation's Safety, Health and Environment team. Staff who carry out risk identification and assessment.	The organisation's risk management framework and/or evidence of specific process(es) and/or procedure(s) that deal with risk control mechanisms. Evidence that the process(es) and/or procedure(s) are implemented across the business and maintained. Evidence of agendas and minutes from risk management meetings. Evidence of feedback in to process(es) and/or procedure(s) as a result of incident investigation(s). Risk registers and assessments.	The organisation is in the process of documenting the identification and assessment of asset related risk across the asset lifecycle but it is incomplete or there are inconsistencies between approaches and a lack of integration.
79	Use and maintenance of asset risk information	How does the organisation ensure that the results of risk assessments provide input into the identification of adequate resources and training and competency needs?	1	Risks and dangers are considered continually through the existing asset management processes. Continuous improvement forms are also used for this purpose. Health and safety, and public safety risks are continuously monitored and updated to reflect the correct risk matrix.	Widely used AM standards require that the output from risk assessments are considered and that adequate resource (including staff) and training is identified to match the requirements. It is a further requirement that the effects of the control measures are considered, as there may be implications in resources and training required to achieve other objectives.	Staff responsible for risk assessment and those responsible for developing and approving resource and training plan(s). There may also be input from the organisation's Safety, Health and Environment team.	The organisations risk management framework. The organisation's resourcing plan(s) and training and competency plan(s). The organisation should be able to demonstrate appropriate linkages between the content of resource plan(s) and training and competency plan(s) to the risk assessments and risk control measures that have been developed.	The organisation is aware of the need to consider the results of risk assessments and effects of risk control measures to provide input into reviews of resources, training and competency needs. Current input is typically ad-hoc and reactive.

Company Name	Electricity Ashburton Limited
AMP Planning Period	1 April 2015 – 31 March 2025
Asset Management Standard Applied	No formal asset management standard has been used for this evaluation.

**SCHEDULE 13: REPORT ON ASSET MANAGEMENT MATURITY (cont)**

Question No.	Function	Question	Score	Evidence—Summary	Why	Who	Record/document information	Evaluated Maturity Level
82	Legal and other requirements	What procedure does the organisation have to identify and provide access to its legal, regulatory, statutory and other asset management requirements, and how is requirements incorporated into the asset management system?	3	Compliance issues are regularly considered and applied in the day to day operation of the network. Organisational, legal, regulatory, statutory and other asset management requirements are discussed on the weekly engineering meetings as well. Responsible people are encouraged to participate in industry events which also helps to keep up to date knowledge of the legal and other requirements.	In order for an organisation to comply with its legal, regulatory, statutory and other asset management requirements, the organisation first needs to ensure that it knows what they are (eg, PAS 55 specifies this in s 4.4.8). It is necessary to have systematic and auditable mechanisms in place to identify new and changing requirements. Widely used AM standards also require that requirements are incorporated into the asset management system (e.g. procedure(s) and process(es))	Top management. The organisations regulatory team. The organisation's legal team or advisors. The management team with overall responsibility for the asset management system. The organisation's health and safety team or advisors. The organisation's policy making team.	The organisational processes and procedures for ensuring information of this type is identified, made accessible to those requiring the information and is incorporated into asset management strategy and objectives	Evidence exists to demonstrate that the organisation's legal, regulatory, statutory and other asset management requirements are identified and kept up to date. Systematic mechanisms for identifying relevant legal and statutory requirements.
88	Life Cycle Activities	How does the organisation establish implement and maintain process(es) for the implementation of its asset management plan(s) and control of activities across the creation, acquisition or enhancement of assets. This includes design, modification, procurement, construction and commissioning activities?	3	AMP has been developed for 15 years with good feedback from reviewers. Various life cycle plans have been implemented with no major issues.	Life cycle activities are about the implementation of asset management plan(s) i.e. they are the "doing" phase. They need to be done effectively and well in order for asset management to have any practical meaning. As a consequence, widely used standards (eg, PAS 55 s 4.5.1) require organisations to have in place appropriate process(es) and procedure(s) for the implementation of asset management plan(s) and control of lifecycle activities. This question explores those aspects relevant to asset creation.	Asset managers, design staff, construction staff and project managers from other impacted areas of the business, e.g. Procurement	Documented process(es) and procedure(s) which are relevant to demonstrating the effective management and control of life cycle activities during asset creation, acquisition, enhancement including design, modification, procurement, construction and commissioning.	Effective process(es) and procedure(s) are in place to manage and control the implementation of asset management plan(s) during activities related to asset creation including design, modification, procurement, construction and commissioning.
91	Life Cycle Activities	How does the organisation ensure that process(es) and/or procedure(s) for the implementation of asset management plan(s) and control of activities during maintenance (and inspection) of assets are sufficient to ensure activities are carried out under specified conditions, are consistent with asset management strategy and control cost, risk and performance?	3	AMP has been developed for over 15 years with good feedback from reviewers. Various life cycle plans have been implemented with no major issues.	Having documented process(es) which ensure the asset management plan(s) are implemented in accordance with any specified conditions, in a manner consistent with the asset management policy, strategy and objectives and in such a way that cost, risk and asset system performance are appropriately controlled is critical. They are an essential part of turning intention into action (eg, as required by PAS 55 s 4.5.1).	Asset managers, operations managers, maintenance managers and project managers from other impacted areas of the business	Documented procedure for review. Documented procedure for audit of process delivery. Records of previous audits, improvement actions and documented confirmation that actions have been carried out.	The organisation has in place process(es) and procedure(s) to manage and control the implementation of asset management plan(s) during this life cycle phase. They include a process, which is itself regularly reviewed to ensure it is effective, for confirming the process(es)/ procedure(s) are effective and if necessary carrying out modifications.
95	Performance and condition monitoring	How does the organisation measure the performance and condition of its assets?	2	Same as above.	Widely used AM standards require that organisations establish implement and maintain procedure(s) to monitor and measure the performance and/or condition of assets and asset systems. They further set out requirements in some detail for reactive and proactive monitoring, and leading/lagging performance indicators together with the monitoring or results to provide input to corrective actions and continual improvement. There is an expectation that performance and condition monitoring will provide input to improving asset management strategy, objectives and plan(s).	A broad cross-section of the people involved in the organisation's asset-related activities from data input to decision-makers, i.e. an end-to-end assessment. This should include contactors and other relevant third parties as appropriate.	Functional policy and/or strategy documents for performance or condition monitoring and measurement. The organisation's performance monitoring frameworks, balanced scorecards etc. Evidence of the reviews of any appropriate performance indicators and the action lists resulting from these reviews. Reports and trend analysis using performance and condition information. Evidence of the use of performance and condition information shaping improvements and supporting asset management strategy, objectives and plan(s).	The organisation is developing coherent asset performance monitoring linked to asset management objectives. Reactive and proactive measures are in place. Use is being made of leading indicators and analysis. Gaps and inconsistencies remain.
99	Investigation of asset-related failures, incidents and nonconformities	How does the organisation ensure responsibility and the authority for the handling, investigation and mitigation of asset-related failures, incidents and emergency situations and non conformances is clear, unambiguous, understood and communicated?	2	Regular inspections, feedback from reliability reports and other measures such as survey and real time SCADA information. They will be part of the new AM system.	Widely used AM standards require that the organisation establishes implements and maintains process(es) for the handling and investigation of failures incidents and non-conformities for assets and sets down a number of expectations. Specifically this question examines the requirement to define clearly responsibilities and authorities for these activities, and communicate these unambiguously to relevant people including external stakeholders if appropriate.	The organisation's safety and environment management team. The team with overall responsibility for the management of the assets. People who have appointed roles within the asset-related investigation procedure, from those who carry out the investigations to senior management who review the recommendations. Operational controllers responsible for managing the asset base under fault conditions and maintaining services to consumers. Contractors and other third parties as appropriate.	Process(es) and procedure(s) for the handling, investigation and mitigation of asset-related failures, incidents and emergency situations and non conformances. Documentation of assigned responsibilities and authority to employees. Job Descriptions, Audit reports. Common communication systems i.e. all Job Descriptions on Internet etc.	The organisation are in the process of defining the responsibilities and authorities with evidence. Alternatively there are some gaps or inconsistencies in the identified responsibilities/authorities.
105	Audit	What has the organisation done to establish procedure(s) for the audit of its asset management system (process(es))?	1	PWC is engaged to audit reliability stastics. Other consultants are involved on an as and when required basis to audit various internal asset management systems.	This question seeks to explore what the organisation has done to comply with the standard practice AM audit requirements (eg, the associated requirements of PAS 55 s 4.6.4 and its linkages to s 4.7).	The management team responsible for its asset management procedure(s). The team with overall responsibility for the management of the assets. Audit teams, together with key staff responsible for asset management. For example, Asset Management Director, Engineering Director. People with responsibility for carrying out risk assessments	The organisation's asset-related audit procedure(s). The organisation's methodology(s) by which it determined the scope and frequency of the audits and the criteria by which it identified the appropriate audit personnel. Audit schedules, reports etc. Evidence of the procedure(s) by which the audit results are presented, together with any subsequent communications. The risk assessment schedule or risk registers.	The organisation understands the need for audit procedure(s) and is determining the appropriate scope, frequency and methodology(s).
109	Corrective & Preventative action	How does the organisation instigate appropriate corrective and/or preventive actions to eliminate or prevent the causes of identified poor performance and non conformance?	3	The organisation has a strong record of investigation and applying change as a result of our continuous improvement programs.	Having investigated asset related failures, incidents and non-conformances, and taken action to mitigate their consequences, an organisation is required to implement preventative and corrective actions to address root causes. Incident and failure investigations are only useful if appropriate actions are taken as a result to assess changes to a businesses risk profile and ensure that appropriate arrangements are in place should a recurrence of the incident happen. Widely used AM standards also require that necessary changes arising from preventive or corrective action are made to the asset management system.	The management team responsible for its asset management procedure(s). The team with overall responsibility for the management of the assets. Audit and incident investigation teams. Staff responsible for planning and managing corrective and preventive actions.	Analysis records, meeting notes and minutes, modification records. Asset management plan(s), investigation reports, audit reports, improvement programmes and projects. Recorded changes to asset management procedure(s) and process(es). Condition and performance reviews. Maintenance reviews	Mechanisms are consistently in place and effective for the systematic instigation of preventive and corrective actions to address root causes of non compliance or incidents identified by investigations, compliance evaluation or audit.
113	Continual Improvement	How does the organisation achieve continual improvement in the optimal combination of costs, asset related risks and the performance and condition of assets and asset systems across the whole life cycle?	2	Currently, the system focusses on public and employee safety but it is intended to be applied across all aspects of the company.	Widely used AM standards have requirements to establish, implement and maintain process(es)/procedure(s) for identifying, assessing, prioritising and implementing actions to achieve continual improvement. Specifically there is a requirement to demonstrate continual improvement in optimisation of cost risk and performance/condition of assets across the life cycle. This question explores an organisation's capabilities in this area—looking for systematic improvement mechanisms rather than reviews and audit (which are separately examined).	The top management of the organisation. The manager/team responsible for managing the organisation's asset management system, including its continual improvement. Managers responsible for policy development and implementation.	Records showing systematic exploration of improvement. Evidence of new techniques being explored and implemented. Changes in procedure(s) and process(es) reflecting improved use of optimisation tools/techniques and available information. Evidence of working parties and research.	Continual improvement process(es) are set out and include consideration of cost risk, performance and condition for assets managed across the whole life cycle but it is not yet being systematically applied.
115	Continual Improvement	How does the organisation seek and acquire knowledge about new asset management related technology and practices, and evaluate their potential benefit to the organisation?	3	The company has commitment to encourage staff to explore new ideas via conferences, seminars and workshops. EA Networks also encourages staff to bench mark their work to other companies. Regular supplier visits are organised to learn about the new technologies and advances.	One important aspect of continual improvement is where an organisation looks beyond its existing boundaries and knowledge base to look at what 'new things are on the market'. These new things can include equipment, process(es), tools, etc. An organisation which does this (eg, by the PAS 55 s 4.6 standards) will be able to demonstrate that it continually seeks to expand its knowledge of all things affecting its asset management approach and capabilities. The organisation will be able to demonstrate that it identifies any such opportunities to improve, evaluates them for suitability to its own organisation and implements them as appropriate. This question explores an organisation's approach to this activity.	The top management of the organisation. The manager/team responsible for managing the organisation's asset management system, including its continual improvement. People who monitor the various items that require monitoring for 'change'. People that implement changes to the organisation's policy, strategy, etc. People within an organisation with responsibility for investigating, evaluating, recommending and implementing new tools and techniques, etc.	Research and development projects and records, benchmarking and participation knowledge exchange professional forums. Evidence of correspondence relating to knowledge acquisition. Examples of change implementation and evaluation of new tools, and techniques linked to asset management strategy and objectives.	The organisation actively engages internally and externally with other asset management practitioners, professional bodies and relevant conferences. Actively investigates and evaluates new practices and evolves its asset management activities using appropriate developments.

## Schedule 14a Mandatory Explanatory Notes on Forecast Information

1. This Schedule provides for EDBs to provide explanatory notes to reports prepared in accordance with clause 2.6.5.
2. This Schedule is mandatory—EDBs must provide the explanatory comment specified below, in accordance with clause 2.7.1. This information is not part of the audited disclosure information, and so is not subject to the assurance requirements specified in section 2.8.

### *Commentary on difference between nominal and constant price capital expenditure forecasts (Schedule 11a)*

3. In the box below, comment on the difference between nominal and constant price capital expenditure for the disclosure year, as disclosed in Schedule 11a.

The difference is 0.0%. Costs have been prepared using 2016-17 values for labour, plant and materials. Years after 2016-17 have been escalated by the 2017 CPI Forecast by the New Zealand Government Treasury published on 16th December 2015. ( <http://www.treasury.govt.nz/budget/forecasts/hyefu2015> )

### *Commentary on difference between nominal and constant price operational expenditure forecasts (Schedule 11b)*

4. In the box below, comment on the difference between nominal and constant price operational expenditure for the disclosure year, as disclosed in Schedule 11b.

The difference is 0.0%. Costs have been prepared using 2016-17 values for labour, plant and materials. Years after 2016-17 have been escalated by the 2017 CPI Forecast by the New Zealand Government Treasury published on 16th December 2015. ( <http://www.treasury.govt.nz/budget/forecasts/hyefu2015> )

EA Networks considers the answers given for 3. and 4. represent the most prudent source of information available to EA Networks for the purpose of estimating future costs.

A vast range of alternative algorithms can be proposed and defended but there is no authoritative judgement upon which is the most accurate and reliable.

EA Networks do not have sufficient internal expertise to promote any particular theory or speculate on how future costs will trend.

It is the opinion of EA Networks that the Treasury's CPI forecast is a reasonable indicator of future cost as it incorporates a range of factors that could influence the future cost of expenditure on the electricity network.

Even with additional cost escalation data, EA Networks current future cost modelling is not sufficiently granular to take full advantage of the additional detail.

The Treasury forecast extends to 2020. Beyond 2020, EA Networks have used the 2020 CPI value (2.2%) until 2026.

Schedule 17 Certification for Year-beginning Disclosures

**Office** 22 JB Cullen Drive  
Ashburton Business Estate  
Ashburton 7772  
New Zealand

**Postal** Private Bag 802  
Ashburton 7740  
New Zealand

**Telephone** 03 307 9800  
**Facsimile** 03 307 9801  
**Email** enquiries@eanetworks.co.nz  
**Web** www.eanetworks.co.nz

Clause 2.9.1

We, Gary Richard Leech and Bruce Robert McPherson being directors of Electricity Ashburton Limited trading as EA Networks certify that, having made all reasonable enquiry, to the best of our knowledge:

- a) the following attached information of EA Networks prepared for the purposes of clauses 2.4.1, 2.6.1, 2.6.3, 2.6.6 and 2.7.2 of the Electricity Distribution Information Disclosure Determination 2012 in all material respects complies with that determination.
- b) The prospective financial or non-financial information included in the attached information has been measured on a basis consistent with regulatory requirements or recognised industry standards.
- c) The forecasts in Schedules 11a, 11b, 12a, 12b, 12c and 12d are based on objective and reasonable assumptions which both align with EA Network's corporate vision and strategy and are documented in retained records.



Gary Richard Leech



Bruce Robert McPherson

31 March 2016

**EA** *networks*  
*connecting our community*